


# NFPA® 11

## Standard for Low-, Medium-, and High-Expansion Foam

### 2016 Edition



NFPA, 1 Batterymarch Park, Quincy, MA 02169-7471  
An International Codes and Standards Organization

## **IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS**

### **NOTICE AND DISCLAIMER OF LIABILITY CONCERNING THE USE OF NFPA STANDARDS**

NFPA® codes, standards, recommended practices, and guides (“NFPA Standards”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

### **REMINDER: UPDATING OF NFPA STANDARDS**

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that NFPA Standards may be amended from time to time through the issuance of Tentative Interim Amendments or corrected by Errata. An official NFPA Standard at any point in time consists of the current edition of the document together with any Tentative Interim Amendment and any Errata then in effect.

In order to determine whether an NFPA Standard has been amended through the issuance of Tentative Interim Amendments or corrected by Errata, visit the Document Information Pages on NFPA’s website. The Document Information Pages provide up-to-date, document specific information including any issued Tentative Interim Amendments and Errata.

To access the Document Information Page for a specific NFPA Standard, go to <http://www.nfpa.org/docinfo> to choose from the list of NFPA Standards or use the search feature on the right to select the NFPA Standard number (e.g., NFPA 101). In addition to posting all existing Tentative Interim Amendments and Errata, the Document Information Page also includes the option to sign-up for an “Alert” feature to receive an email notification when new updates and other information are posted regarding the document.

## IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

### ADDITIONAL NOTICES AND DISCLAIMERS

#### Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of new editions or may be amended from time to time through the issuance of Tentative Interim Amendments or corrected by Errata. An official NFPA Standard at any point in time consists of the current edition of the document together with any Tentative Interim Amendments and any Errata then in effect. In order to determine whether a given document is the current edition and whether it has been amended through the issuance of Tentative Interim Amendments or corrected through the issuance of Errata, consult appropriate NFPA publications such as the National Fire Codes® Subscription Service, visit the NFPA website at [www.nfpa.org](http://www.nfpa.org), or contact the NFPA at the address listed below.

#### Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

#### Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

**NOTICE:** The user’s attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

#### Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

#### Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

#### For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: [stds\\_admin@nfpa.org](mailto:stds_admin@nfpa.org)

For more information about NFPA, visit the NFPA website at [www.nfpa.org](http://www.nfpa.org). All NFPA codes and standards can be viewed at no cost at [www.nfpa.org/freeaccess](http://www.nfpa.org/freeaccess).

Copyright © 2015 National Fire Protection Association®. All Rights Reserved.

## NFPA® 11

### Standard for

## Low-, Medium-, and High-Expansion Foam

### 2016 Edition

This edition of NFPA 11, *Standard for Low-, Medium-, and High-Expansion Foam*, was prepared by the Technical Committee on Foam and acted on by NFPA at its June Association Technical Meeting held June 22–25, 2015, in Chicago, IL. It was issued by the Standards Council on August 18, 2015, with an effective date of September 7, 2015, and supersedes all previous editions.

This edition of NFPA 11 was approved as an American National Standard on September 7, 2015.

### Origin and Development of NFPA 11

NFPA committee activity in this field dates from 1921, when the Committee on Manufacturing Risks and Special Hazards prepared standards on foam as a section of the general *Standard on Protection of Fire Hazards, Incident to the Use of Volatiles in Manufacturing Processes*. Subsequently the standards were successively under the jurisdiction of the Committee on Manufacturing Hazards and the Committee on Special Extinguishing Systems, prior to the present committee organization. The present text supersedes the prior editions adopted in 1922, 1926, 1931, 1936, 1942, 1950, 1954, 1959, 1960, 1963, 1969, 1970, 1972, 1973, 1974, 1975, 1976, and 1978. It also supersedes the 1977 edition of NFPA 11B.

The 1983 edition was completely rewritten to include all the material formerly contained in NFPA 11B, *Standard on Synthetic and Combined Agent Systems*. The standard was revised in 1988 and again in 1994 to more clearly state the requirements and to separate mandatory requirements from advisory text.

The standard was revised for the 1998 edition to include requirements for foam systems for marine applications and to provide guidance relating to the environmental impact of foam system discharges.

The 2002 edition was revised to address mixing of foam concentrates and to clarify requirements related to foam concentrate pumps. Requirements for medium- and high-expansion foam systems were included.

The 2005 edition was reorganized to provide the requirements for low-, medium-, and high-expansion foam, to better incorporate the requirements of NFPA 11A.

The 2010 edition added a new chapter to address compressed air foam systems. Unenforceable terms were removed to comply with the *Manual of Style for NFPA Technical Committee Documents*.

For the 2016 edition, the committee addressed several areas of concern. The piping requirements have been reorganized and clarified, issues regarding acceptance criteria for annual foam concentrate testing have been addressed, environmentally friendly methods of testing foam proportioners are recognized, and seal-only protection is permitted for composite roofs that meet specific criteria.

## Technical Committee on Foam

**Fay Purvis, Chair**

Vector Fire Technology, Inc., PA [SE]

**Joan M. Leedy, Secretary**

Dyne Technologies, MN [IM]

**Jean-Pierre Asselin,** FireFlex Systems, Inc., Canada [M]

**V. Frank Bateman,** National Foam, CA [M]

**Gene E. Benzenberg,** Alison Control Inc., NJ [M]

**Jerald A. Borowski,** Amerex/Solberg Company, WI [M]

**Richard A. Coppola,** Oliver Fire Protection & Security, PA [M]

Rep. National Fire Sprinkler Association

**Laurence E. Fisher,** U.S. Coast Guard, DC [E]

**Steven Fox,** Sprinklerfitters U.A. Local 483, CA [L]

Rep. United Assn. of Journeymen & Apprentices of the Plumbing & Pipe Fitting Industry

**Robert A. Green,** Public Service Electric & Gas Company, NJ [U]

Rep. Edison Electric Institute

**Martin Hawkes,** Hawkes Fire Ltd, United Kingdom [IM]

**Randall Hendricksen,** Tyco/ChemGuard, Inc., TX [M]

**Edward G. Hugill,** Amerex/Janus Fire Systems, IN [IM]

Rep. Fire Suppression Systems Association

**William E. Janz,** XL Global Asset Protection Services, IL [I]

**Robert Kasiski,** FM Global, MA [I]

**Ronald J. Mahlman** JENSEN HUGHES, CA [SE]

**Edward C. Norman,** Aqueous Foam Technology, Inc., PA [SE]

**David W. Owen,** ExxonMobil Corporation, TX [U]

Rep. American Petroleum Institute

**Austin G. Prather,** Hayden and Company, TX [M]

**Niall Ramsden,** Resource Protection International, United Kingdom [SE]

**Gaston J. Santerre,** Integrated Protection Services Inc., CA [SE]

**Joseph L. Scheffey,** JENSEN HUGHES, MD [SE]

**Donald H. Seaman,** CSC Advanced Marine, DC [SE]

**Blake M. Shugarman,** UL LLC, IL [RT]

**David M. Sornsin,** Sornsin Fire Protection, ND [IM]

Rep. American Fire Sprinkler Association

**John A. Toney,** Dooley Tackaberry, Inc., TX [IM]

Rep. National Association of Fire Equipment Distributors

**Kevin D. Westwood,** BP International, United Kingdom [U]

**Martin H. Workman,** The Viking Corporation, MI [M]

**Steven E. Younis,** Steven E. Younis PE, Inc., MA [M]

Rep. Automatic Compressed Air Foam Systems

### Alternates

**Megan Anderson,** Dyne Technologies, MN [IM]

(Alt. to J. M. Leedy)

**Gerard G. Back,** JENSEN HUGHES, MD [SE]

(Alt. to J. L. Scheffey)

**Jason C. Black,** Firetrol Protection Systems, Inc., AL [IM]

(Alt. to D. M. Sornsin)

**Robert M. Cordell,** FM Approvals, MA [I]

(Alt. to R. Kasiski)

**Shawn Feenstra,** The Viking Corporation, MI [M]

(Alt. to M. H. Workman)

**John J. Foley** The RJA Group, Inc., GA [SE]

(Alt. to R. J. Mahlman)

**Scott E. Herreth,** Dooley Tackaberry, Inc., TX [IM]

(Alt. to J. A. Toney)

**Paul Hubrich,** XL Global Asset Protection Services, WI [I]

(Alt. to W. E. Janz)

(Alt. to W. E. Janz)

**Barry D. Chase,** NFPA Staff Liaison

**John L. Hulett,** Western States Fire Protection Company, CO [M]

(Alt. to R. A. Coppola)

**Eric LaVergne,** TYCO, TX [M]

(Alt. to R. Hendricksen)

**Louis Nash,** U.S. Coast Guard, DC [E]

(Alt. to L. E. Fisher)

**Joseph M. Pada,** Amerex Corporation, WI [M]

(Alt. to J. A. Borowski)

**Timothy Pope,** Amerex/Janus Fire Systems, IN [M]

(Alt. to E. G. Hugill)

**Raymond Quenneville,** FireFlex Systems, Inc., Canada [M]

(Alt. to J. Asselin)

**Clark D. Shepard,** ExxonMobil Corporation, VA [U]

(Alt. to D. W. Owen)

*This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.*

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

**Committee Scope:** This Committee shall have primary responsibility for documents on the installation, maintenance, and use of foam systems for fire protection, including foam hose streams.

## Contents

<b>Chapter 1 Administration</b> .....	11- 5	6.6 Personnel Safety .....	11-25
1.1 Scope .....	11- 5	6.7 Operation and Control of Systems .....	11-26
1.2 Purpose .....	11- 5	6.8 Foam Concentrate .....	11-27
1.3 Application .....	11- 5	6.9 Air Supply .....	11-27
1.4 Retroactivity .....	11- 5	6.10 Foam-Generating Apparatus Location .....	11-27
1.5 Equivalency .....	11- 5	6.11 Distribution Systems .....	11-27
1.6 Units and Formulas .....	11- 5	6.12 Total Flooding Systems General Information .....	11-27
<b>Chapter 2 Referenced Publications</b> .....	11- 5	6.13 Local Application Systems .....	11-29
2.1 General .....	11- 5	6.14 Foam Applications for Liquefied Natural Gas (LNG) .....	11-30
2.2 NFPA Publications .....	11- 6	6.15 Portable Foam-Generating Devices .....	11-30
2.3 Other Publications .....	11- 6	<b>Chapter 7 Compressed Air Foam Systems</b> .....	11-31
2.4 References for Extracts in Mandatory Sections .....	11- 7	7.1 General .....	11-31
<b>Chapter 3 Definitions</b> .....	11- 7	7.2 Water Supplies .....	11-31
3.1 General .....	11- 7	7.3 Foam Concentrate .....	11-31
3.2 NFPA Official Definitions .....	11- 7	7.4 Air or Nitrogen Supply .....	11-32
3.3 General Definitions .....	11- 7	7.5 Compressed Air Foam-Generating Method .....	11-32
<b>Chapter 4 System Components and System Types</b> .....	11- 9	7.6 Distribution Systems .....	11-32
4.1 General .....	11- 9	7.7 Compressed Air Foam Discharge Devices .....	11-32
4.2 Water Supplies .....	11-10	7.8 Operation and Control of Systems .....	11-32
4.3 Foam Concentrates .....	11-10	7.9 System Types .....	11-32
4.4 Concentrate Compatibility .....	11-11	7.10 Limitations .....	11-32
4.5 Foam Proportioning .....	11-11	7.11 System Design .....	11-32
4.6 Foam Concentrate Pumps .....	11-11	7.12 Installation of Piping and Fittings .....	11-32
4.7 Piping .....	11-11	7.13 Installation of Automatic Detection .....	11-32
4.8 System Types .....	11-13	7.14 CAFS Discharge Device Choice and Location .....	11-32
4.9 Operation and Control of Systems .....	11-13	7.15 Discharge Density .....	11-32
<b>Chapter 5 Low-Expansion System Design</b> .....	11-13	7.16 Discharge Duration .....	11-32
5.1 Types of Hazards .....	11-13	7.17 System Flow Calculation .....	11-32
5.2 Outdoor Fixed Roof (Cone) Tanks .....	11-13	7.18 Plans and Specifications .....	11-32
5.3 Outdoor Open-Top Floating Roof Tanks .....	11-17	7.19 Testing and Acceptance .....	11-33
5.4 Outdoor Covered (Internal) Floating Roof Tanks .....	11-19	7.20 Maintenance .....	11-33
5.5 Indoor Hazards .....	11-22	<b>Chapter 8 Specifications and Plans</b> .....	11-33
5.6 Loading Racks .....	11-23	8.1 Approval of Plans .....	11-33
5.7 Diked Areas — Outdoor .....	11-23	8.2 Specifications .....	11-33
5.8 Nondiked Spill Areas .....	11-24	8.3 Plans .....	11-33
5.9 Supplementary Protection .....	11-24	<b>Chapter 9 Installation Requirements</b> .....	11-34
<b>Chapter 6 Medium- and High-Expansion Systems</b> .....	11-25	9.1 Foam Concentrate Pumps .....	11-34
6.1 General Information and Requirements .....	11-25	9.2 Flushing .....	11-34
6.2 Use and Limitations .....	11-25	9.3 Power Supply .....	11-34
6.3 Hazards Protected .....	11-25	9.4 Low-Expansion System Piping .....	11-34
6.4 Types of Systems .....	11-25	9.5 Valves in Low-Expansion Systems .....	11-34
6.5 Systems Protecting One or More Hazards .....	11-25	9.6 Hangers, Supports, and Protection for Pipework .....	11-35
		9.7 Hose Requirements .....	11-35
		9.8 Test Connections .....	11-35

<b>Chapter 10 Low-Expansion Foam Systems for Marine Applications</b> .....	<b>11-35</b>	11.7 Approval of Low-, Medium-, and High-Expansion Foam Systems .....	<b>11-40</b>
10.1 General .....	<b>11-35</b>	11.8 System Restoration .....	<b>11-40</b>
10.2 Fixed Low-Expansion Foam Systems for Machinery Spaces .....	<b>11-35</b>	<b>Chapter 12 Maintenance</b> .....	<b>11-40</b>
10.3 Fixed Low-Expansion Foam Systems on Deck for Petroleum and Chemical Tankers .....	<b>11-35</b>	12.1 Inspection, Testing, and Maintenance .....	<b>11-40</b>
10.4 Foam Outlet Devices .....	<b>11-36</b>	12.2 Foam-Producing Equipment .....	<b>11-40</b>
10.5 Monitors .....	<b>11-36</b>	12.3 Piping .....	<b>11-40</b>
10.6 Hand Hoselines .....	<b>11-37</b>	12.4 Strainers .....	<b>11-40</b>
10.7 Hydraulic Calculations .....	<b>11-37</b>	12.5 Detection and Actuation Equipment .....	<b>11-40</b>
10.8 Isolation Valves .....	<b>11-37</b>	12.6 Foam Concentrate Inspection .....	<b>11-40</b>
10.9 Hangers, Supports, and Protection of Pipework .....	<b>11-37</b>	12.7 High-Pressure Cylinders .....	<b>11-40</b>
10.10 Testing and Inspection .....	<b>11-37</b>	12.8 Operating Instructions and Training .....	<b>11-40</b>
10.11 Foam System Concentrate Storage .....	<b>11-37</b>	<b>Annex A Explanatory Material</b> .....	<b>11-41</b>
10.12 Supply Arrangements .....	<b>11-38</b>	<b>Annex B Storage Tank Protection Summary</b> .....	<b>11-71</b>
10.13 Piping Materials .....	<b>11-38</b>	<b>Annex C Medium- and High-Expansion Foam</b> .....	<b>11-73</b>
<b>Chapter 11 Testing and Acceptance</b> .....	<b>11-38</b>	<b>Annex D Tests for Foam Systems</b> .....	<b>11-74</b>
11.1 Inspection and Visual Examination .....	<b>11-38</b>	<b>Annex E Foam Environmental Issues</b> .....	<b>11-82</b>
11.2 Flushing after Installation .....	<b>11-38</b>	<b>Annex F Test Method for Marine Fire-Fighting Foam Concentrates Protecting Hydrocarbon Hazards</b> .....	<b>11-87</b>
11.3 Acceptance Tests .....	<b>11-39</b>	<b>Annex G Foam Concentrate Quality</b> .....	<b>11-89</b>
11.4 Pressure Tests .....	<b>11-39</b>	<b>Annex H Informational References</b> .....	<b>11-92</b>
11.5 Operating Tests .....	<b>11-39</b>	<b>Index</b> .....	<b>11-94</b>
11.6 Discharge Tests .....	<b>11-39</b>		



**NFPA 11**  
**Standard for**  
**Low-, Medium-, and High-Expansion Foam**  
**2016 Edition**

**IMPORTANT NOTE:** This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading "Important Notices and Disclaimers Concerning NFPA Standards." They can also be obtained on request from NFPA or viewed at [www.nfpa.org/disclaimers](http://www.nfpa.org/disclaimers).

**UPDATES, ALERTS, AND FUTURE EDITIONS:** New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with any TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by any TIAs or Errata, please consult the National Fire Codes® Subscription Service or visit the Document Information (DocInfo) pages on the NFPA website at [www.nfpa.org/docinfo](http://www.nfpa.org/docinfo). In addition to TIAs and Errata, the DocInfo pages also include the option to sign up for Alerts for each document and to be involved in the development of the next edition.

**NOTICE:** An asterisk (\*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [ ] following a section or paragraph indicates material that has been extracted from another NFPA document. As an aid to the user, the complete title and edition of the source documents for extracts in mandatory sections of the document are given in Chapter 2 and those for extracts in informational sections are given in Annex H. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced publications can be found in Chapter 2 and Annex H.

## Chapter 1 Administration

### 1.1\* Scope.

**1.1.1** This standard covers the design, installation, operation, testing, and maintenance of low-, medium-, and high-expansion and compressed air foam systems for fire protection.

**1.1.2** It is not the intent of this standard to specify where foam protection is required.

### 1.2 Purpose.

**1.2.1** This standard is intended for the use and guidance of those responsible for designing, installing, testing, inspecting, approving, listing, operating, or maintaining fixed, semifixed, or portable low-, medium-, and high-expansion and com-

pressed air foam fire-extinguishing systems for interior or exterior hazards.

**1.2.2** Nothing in this standard is intended to restrict new technologies or alternative arrangements, provided the level of safety prescribed by the standard is not lowered.

**1.2.3** Low-, medium-, and high-expansion foam and compressed air foam systems are intended to provide property protection and not life safety.

**1.3 Application.** This standard is not applicable to the following types of systems:

- (1) Chemical foams and systems (considered obsolete)
- (2) Deluge foam-water sprinkler or spray systems (See NFPA 16.)
- (3) Foam-water closed-head sprinkler systems (See NFPA 16.)
- (4) Combined agent systems
- (5) Mobile foam apparatus (See NFPA 1901.)
- (6) Class A foam and systems (See NFPA 1150.)

**1.4 Retroactivity.** The provisions of this standard reflect a consensus of what is necessary to provide an acceptable degree of protection from the hazards addressed in this standard at the time the standard was issued.

**1.4.1** Unless otherwise specified, the provisions of this standard shall not apply to facilities, equipment, structures, or installations that existed or were approved for construction or installation prior to the effective date of the standard. Where specified, the provisions of this standard shall be retroactive.

**1.4.2** In those cases where the authority having jurisdiction determines that the existing situation presents an unacceptable degree of risk, the authority having jurisdiction shall be permitted to apply retroactively any portions of this standard deemed appropriate.

**1.4.3** The retroactive requirements of this standard shall be permitted to be modified if their application clearly would be impractical in the judgment of the authority having jurisdiction, and only where it is clearly evident that a reasonable degree of safety is provided.

**1.5 Equivalency.** Nothing in this standard is intended to prevent the use of systems, methods, or devices of equivalent or superior quality, strength, fire resistance, effectiveness, durability, and safety over those prescribed by this standard.

**1.5.1** Technical documentation shall be submitted to the authority having jurisdiction to demonstrate equivalency.

**1.5.2** The system, method, or device shall be approved for the intended purpose by the authority having jurisdiction.

**1.6 Units and Formulas.** Metric units of measurement in this standard are in accordance with the modernized metric system known as the International System of Units (SI). The liter unit, which is not part of but is recognized by SI, is commonly used in international fire protection. Conversion factors for this unit are found in Table 1.6.

## Chapter 2 Referenced Publications

**2.1 General.** The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.



**Table 1.6 Metric Units of Measure**

Name of Unit	Unit Symbol	Conversion Factor
liter	L	1 gal = 3.785 L
liter per minute per square meter	L/min·m <sup>2</sup>	1 gpm/ft <sup>2</sup> = 40.746 L/min·m <sup>2</sup>
cubic decimeter	dm <sup>3</sup>	1 gal = 3.785 dm <sup>3</sup>
pascal	Pa	1 psi = 6894.757 Pa
bar	bar	1 psi = 0.0689 bar
bar	bar	1 bar = 10 <sup>5</sup> Pa
kilopascal	kPa	1 psi = 6.895 kPa

Note: For additional conversions and information, see IEEE/ASTM SI 10.

## 2.2 NFPA Publications.

National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 2016 edition.

NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*, 2012 edition.

NFPA 16, *Standard for the Installation of Foam-Water Sprinkler and Foam-Water Spray Systems*, 2015 edition.

NFPA 20, *Standard for the Installation of Stationary Pumps for Fire Protection*, 2016 edition.

NFPA 24, *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*, 2016 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 2015 edition.

NFPA 70<sup>®</sup>, *National Electrical Code*<sup>®</sup>, 2014 edition.

NFPA 72<sup>®</sup>, *National Fire Alarm and Signaling Code*, 2016 edition.

NFPA 220, *Standard on Types of Building Construction*, 2015 edition.

NFPA 1150, *Standard on Foam Chemicals for Fires in Class A Fuels*, 2010 edition.

NFPA 1901, *Standard for Automotive Fire Apparatus*, 2016 edition.

NFPA 1961, *Standard on Fire Hose*, 2013 edition.

## 2.3 Other Publications.

### 2.3.1 ANSI Publications.

American National Standards Institute, Inc., 25 West 43rd St., 4th Floor, New York, NY 10036.

ANSI B1.20.1, *Standard for Pipe Threads, General Purpose*, 1983 (R2006).

ANSI B16.1, *Gray Iron Pipe Flanges and Flanged Fittings*, 2010.

ANSI B16.3, *Malleable Iron Threaded Fittings: Classes 150 and 300*, 2011.

ANSI B16.4, *Gray Iron Threaded Fittings, Classes 150 and 300*, 2006.

ANSI B16.5, *Pipe Flanges and Flanged Fittings: NPS 1/2 through 24 Metric/Inch Standard*, 2013.

ANSI B16.9, *Factory-Made Wrought Butt-Welding Fittings*, 2012.

ANSI B16.11, *Forged Fittings, Socket-Welding and Threaded*, 2011.

ANSI B16.15, *Cast Bronze Threaded Fittings*, 1985 (R1994).

ANSI B16.24, *Cast Copper Alloy Pipe Flanges and Flanged Fittings*, 1991 (R1998).

ANSI B16.25, *Butt-Welding Ends*, 2012.

### 2.3.2 API Publications.

American Petroleum Institute, 1220 L Street, N.W., Washington, DC 20005-4070.

API 607, *Fire Test for Quarter-turn Valves and Valves Equipped with Nonmetallic Seats*, 6th edition, 2010.

API 650, *Welded Tanks for Oil Storage*, 12th edition, 2013.

### 2.3.3 ASME Publications.

American Society of Mechanical Engineers, Two Park Avenue, New York, NY 10016-5990.

ASME *Boiler and Pressure Vessel Code*, 2013.

ASME B31.1, *Power Piping Code*, 2012.

### 2.3.4 ASTM Publications.

ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM A 53, *Standard Specification for Pipe, Steel, Black and Hot-Dipped, Zinc-Coated, Welded and Seamless*, 2012.

ASTMA 105, *Standard Specification for Carbon Steel Forgings for Piping Applications*, 2012.

ASTM A 106, *Standard Specification for Seamless Carbon Steel Pipe for High-Temperature Service*, 2011.

ASTM A 135, *Standard Specification for Electric Resistance-Welded Steel Pipe*, 2009.

ASTM A 182, *Standard Specification for Forged or Rolled Alloy- and Stainless Steel Pipe Flanges, Forged Fittings, and Valves and Parts for High-Temperature Service*, 2012.

ASTM A 216, *Standard Specification for Steel Castings, Carbon, Suitable for Fusion Welding for High-Temperature Service*, 2012.

ASTM A 234, *Standard Specification for Piping Fittings of Wrought Carbon Steel and Alloy Steel for Moderate and High-Temperature Service*, 2011.

ASTM A 312, *Standard Specification for Seamless-, Welded-, and Heavily Cold Worked Austenitic Stainless Steel Pipes*, 2012.

ASTM A 395, *Standard Specification for Ferritic Ductile Iron Pressure-Retaining Castings for Use at Elevated Temperatures*, 1999.

ASTM A 795, *Standard Specification for Black and Hot-Dipped-, Zinc-Coated-, (Galvanized) Welded and Seamless Steel Pipe for Fire Protection Use*, 2008.

ASTM B 43, *Standard Specification for Seamless Red Brass Pipe, Standard Sizes*, 2009.

ASTM B 315, *Standard Specification for Seamless Copper Alloy Pipe and Tube*, 2012.

ASTM C 582, *Standard Specification for Contact-Molded Reinforced Thermosetting Plastic (RTP) Laminates for Corrosion-Resistant Equipment*, 2009.

ASTM D 323, *Standard Test Method for Vapor Pressure of Petroleum Products (Reid Method)*, 2008.

ASTM D 1331, *Standard Test Methods for Surface and Interfacial Tension of Solutions of Surface-Active Agents*, 2011.

ASTM E 84, *Standard Test Method for Surface Burning Characteristics of Building Materials*, 2013.

IEEE/ASTM SI 10, *American National Standard for Metric Practice*, 2010.

### 2.3.5 AWS Publications.

American Welding Society, 550 NW LeJeune Road, Miami, FL 33126.

AWS B2.1, *Specification for Welding Procedure and Performance Qualification*, 2009.

**2.3.6 IEEE Publications.** IEEE, Three Park Avenue, 17th Floor, New York, NY 10016-5997.

IEEE 45, *Recommended Practice for Electric Installations on Shipboard*, 2002.

**2.3.7 IMO Publications.** International Maritime Organization, 4 Albert Embankment, London SE1 7SR.

*Safety of Life at Sea*, SOLAS Regulations II-2/4.3 and 4.3.5.

**2.3.8 ISO Publications.** International Organization for Standardization, 1, ch. de la Voie-Creuse, CP 56 – CH-1211 Geneva 20 Switzerland.

ISO 7-1, *Pipe Threads Where Pressure-Tight Joints Are Made on the Threads — Part 1: Dimensions, Tolerances and Designation*, 1994.

**2.3.9 UL Publications.** Underwriters Laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062-2096.

UL 162, *Standard for Safety Foam Equipment and Liquid Concentrates*, 1999.

**2.3.10 Other Publications.**

*Merriam-Webster's Collegiate Dictionary*, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

**2.4 References for Extracts in Mandatory Sections.**

NFPA 10, *Standard for Portable Fire Extinguishers*, 2013 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 2015 edition.

## Chapter 3 Definitions

**3.1 General.** The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster's Collegiate Dictionary*, 11th edition, shall be the source for the ordinarily accepted meaning.

**3.2 NFPA Official Definitions.**

**3.2.1\* Approved.** Acceptable to the authority having jurisdiction.

**3.2.2\* Authority Having Jurisdiction (AHJ).** An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

**3.2.3 Labeled.** Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

**3.2.4\* Listed.** Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of

production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

**3.2.5 Shall.** Indicates a mandatory requirement.

**3.2.6 Should.** Indicates a recommendation or that which is advised but not required.

**3.2.7 Standard.** An NFPA Standard, the main text of which contains only mandatory provisions using the word “shall” to indicate requirements and that is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered a part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA Manuals of Style. When used in a generic sense, such as in the phrase “standards development process” or “standards development activities,” the term “standards” includes all NFPA Standards, including Codes, Standards, Recommended Practices, and Guides.

**3.3 General Definitions.**

**3.3.1 Combustible Liquid.** Any liquid that has a closed-cup flash point at or above 37.8°C (100°F), as determined by the test procedures and apparatus set forth in Section 4.4 of NFPA 30. [30, 2015]

**3.3.1.1 Class II Liquid.** A liquid that has a closed-cup flash point at or above 37.8°C (100°F) and below 60°C (140°F). [30, 2015]

**3.3.1.2 Class IIIA Liquid.** Any Liquid that has a closed-cup flash point at or above 60°C (140°F), but below 93°C (200°F). [30, 2015]

**3.3.1.3 Class IIIB Liquid.** Any liquid that has a closed-cup flash point at or above 93°C (200°F). [30, 2015]

**3.3.2\* Concentration.** The percent of foam concentrate contained in a foam solution.

**3.3.3\* Discharge Devices.** Devices designed to discharge water or foam-water solution in a predetermined, fixed, or adjustable pattern.

**3.3.3.1 Air-Aspirating Discharge Devices.** Devices specially designed to aspirate and mix air into the foam solution to generate foam, followed by foam discharge in a specific design pattern.

**3.3.3.2 Compressed Air Foam Discharge Devices.** Devices specifically designed to discharge compressed air foam in a predetermined pattern.

**3.3.3.3\* Non-Air-Aspirating Discharge Devices.** Devices designed to provide a specific water discharge pattern.

**3.3.4 Discharge Outlet.**

**3.3.4.1 Fixed Foam Discharge Outlet.** A device permanently attached to a tank, dike, or other containment structure, designed to introduce foam.

**3.3.4.2\* Type I Discharge Outlet.** An approved discharge outlet that conducts and delivers foam gently onto the liquid surface without submergence of the foam or agitation of the surface.

**3.3.4.3 Type II Discharge Outlet.** An approved discharge outlet that does not deliver foam gently onto the liquid surface but is designed to lessen submergence of the foam and agitation of the surface.

**3.3.5\* Eductor (Inductor).** A device that uses the Venturi principle to introduce a proportionate quantity of foam concentrate into a water stream; the pressure at the throat is below atmospheric pressure and will draw in liquid from atmospheric storage.

**3.3.5.1\* In-Line Eductor.** A Venturi-type proportioning device that meters foam concentrate at a fixed or variable concentration into the water stream at a point between the water source and a nozzle or other discharge device.

**3.3.6 Expansion.** The ratio of final foam volume to original foam solution volume.

**3.3.7 Film Formation.** A property of aqueous film-forming foams and film-forming fluoroproteins characterized by a positive (>0.0 dynes/cm) spreading coefficient when measured according to ASTM D 1331 using cyclohexane as the hydrocarbon substrate and distilled water to make the foam solution.

### 3.3.8 Fire.

**3.3.8.1 Class A Fire.** A fire in ordinary combustible materials, such as wood, cloth, paper, rubber, and many plastics. [10, 2013]

**3.3.8.2 Class B Fire.** A fire in flammable liquids, combustible liquids, petroleum greases, tars, oils, oil-based paints, solvents, lacquers, alcohols, and flammable gases.

**3.3.9 Flammable (Class I) Liquid.** Any liquid that has a closed-cup flash point that is below 37.8°C (100°F), as determined by the test procedures and apparatus set forth in Section 4.4 of NFPA 30, and a Reid vapor pressure that does not exceed an absolute pressure of 276 kPa (40 psi) at 37.8°C (100°F), as determined by ASTM D 323, *Standard Test Method for Vapor Pressure of Petroleum Products (Reid Method)*. [30, 2015]

**3.3.9.1 Class IA Liquid.** Any liquid that has a closed-cup flash point below 22.8°C (73°F) and a boiling point below 37.8°C (100°F). [30, 2015]

**3.3.9.2 Class IB Liquid.** Any liquid that has a closed-cup flash point below 22.8°C (73°F) and a boiling point at or above 37.8°C (100°F). [30, 2015]

**3.3.9.3 Class IC Liquid.** Any liquid that has a closed-cup flash point at or above 22.8°C (73°F) but below 37.8°C (100°F). [30, 2015]

**3.3.10\* Foam.** A stable aggregation of bubbles of lower density than oil or water.

**3.3.10.1 Compressed Air Foam (CAF).** A homogenous foam produced by the combination of water, foam concentrate, and air or nitrogen under pressure.

**3.3.11 Foam Chamber.** See 3.3.4.1, Fixed Foam Discharge Outlet.

**3.3.12\* Foam Concentrate.** A concentrated liquid foaming agent as received from the manufacturer.

**3.3.12.1\* Alcohol-Resistant Foam Concentrate.** A concentrate used for fighting fires on water-soluble materials and other fuels destructive to regular, AFFF, or FFFP foams, as well as for fires involving hydrocarbons.

**3.3.12.2\* Aqueous Film-Forming Foam Concentrate (AFFF).** A concentrate based on fluorinated surfactants plus foam stabilizers to produce a fluid aqueous film for suppressing hydrocarbon fuel vapors and usually diluted with water to a 1 percent, 3 percent, or 6 percent solution.

**3.3.12.3\* Film-Forming Fluoroprotein Foam Concentrate (FFFP).** A protein-foam concentrate that uses fluorinated surfactants to produce a fluid aqueous film for suppressing hydrocarbon fuel vapors.

**3.3.12.4 Film-Forming Foam.** A concentrate that when mixed at its nominal use concentration will form an aqueous film on hydrocarbon fuels.

**3.3.12.5\* Fluoroprotein Foam Concentrate.** A concentrate very similar to protein-foam concentrate but with a synthetic fluorinated surfactant additive.

**3.3.12.6\* Medium- and High-Expansion Foam Concentrate.** A concentrate, usually derived from hydrocarbon surfactants, used in specially designed equipment to produce foams having foam-to-solution volume ratios of 20:1 to approximately 1000:1.

**3.3.12.7\* Protein Foam Concentrate.** Concentrate consisting primarily of products from a protein hydrolysate, plus stabilizing additives and inhibitors to protect against freezing, to prevent corrosion of equipment and containers, to resist bacterial decomposition, to control viscosity, and to otherwise ensure readiness for use under emergency conditions.

**3.3.12.8 Synthetic Foam Concentrate.** Concentrate based on foaming agents other than hydrolyzed proteins and including aqueous film-forming foam (AFFF) concentrates, medium- and high-expansion foam concentrates, and other synthetic foam concentrates.

**3.3.12.8.1\* Other Synthetic Foam Concentrate.** A concentrate based on hydrocarbon surface active agents and listed as a wetting agent, foaming agent, or both.

**3.3.13 Foam Concentrate Type.** A classification of a foam concentrate that includes the chemical composition as defined under foam concentrate (*see 3.3.12*), including the use percentage, the minimum usable temperature, and the fuels on which the concentrate is effective.

### 3.3.14 Foam Generators.

**3.3.14.1 Foam Generators — Aspirator Type.** Foam generators, fixed or portable, in which jet streams of foam solution aspirate sufficient amounts of air that is then entrained on the screens to produce foam, and which usually produce foam with expansion ratios of not more than 250:1.

**3.3.14.2\* Foam Generators — Blower Type.** Foam generators, fixed or portable, in which the foam solution is discharged as a spray onto screens through which an airstream developed by a fan or blower is passing.

### 3.3.15 Foam Injection.

**3.3.15.1 Semisubsurface Foam Injection.** Discharge of foam at the liquid surface within a storage tank from a floating hose that rises from a piped container near the tank bottom.

**3.3.15.2 Subsurface Foam Injection.** Discharge of foam into a storage tank from an outlet near the tank bottom.

**3.3.16\* Foam Solution.** A homogeneous mixture of water and foam concentrate in the correct proportions.



**3.3.16.1 Premixed Foam Solution.** Solution produced by introducing a measured amount of foam concentrate into a given amount of water in a storage tank.

### 3.3.17 Foam System Types.

**3.3.17.1\* Compressed Air Foam System (CAFS).** A system employing compressed air foam discharge devices or hoses attached to a piping system through which foam is transported from a mixing chamber.

**3.3.17.2 Fixed System.** A complete installation in which foam is piped from a central foam station, discharging through fixed delivery outlets to the hazard to be protected with permanently installed pumps where required.

**3.3.17.3\* Mobile System.** Any type of foam-producing unit that is mounted on wheels and that is self-propelled or towed by a vehicle and can be connected to a water supply or can utilize a premixed foam solution.

**3.3.17.4 Portable System.** Foam-producing equipment, materials, hose, and so forth that are transported by hand.

**3.3.17.5\* Semifixed System.** A system in which the hazard is equipped with fixed discharge outlets connected to piping that terminates at a safe distance.

**3.3.18\* Foam-Generating Methods.** Methods of generation of air foam including hose stream, foam nozzle, and medium- and high-expansion generators, foam maker, pressure foam maker (high back pressure or forcing type), or foam monitor stream.

**3.3.18.1\* Compressed Air Foam-Generating Method.** A method of generating compressed air foam recognized in this standard by using a mixing chamber to combine air or nitrogen under pressure, water, and foam concentrate in the correct proportions.

**3.3.19\* Handline.** A hose and nozzle that can be held and directed by hand.

**3.3.20 Inductor** See 3.3.5.

### 3.3.21 Monitor:

**3.3.21.1\* Fixed Monitor (Cannon).** A device that delivers a large foam stream and is mounted on a stationary support that either is elevated or is at grade.

**3.3.21.2 Portable Monitor (Cannon).** A device that delivers a foam monitor stream and is mounted on a movable support or wheels so it can be transported to the fire scene.

### 3.3.22 Nozzle.

**3.3.22.1\* Foam Nozzle or Fixed Foam Maker.** A specially designed hoseline nozzle or fixed foam maker designed to aspirate air that is connected to a supply of foam solution.

**3.3.22.2\* Self-Educting Nozzle.** A device that incorporates a venturi to draw foam concentrate through a short length of pipe and/or flexible tubing connected to the foam supply.

**3.3.23\* Pressure Foam Maker (High Back Pressure or Forcing Type).** A foam maker utilizing the Venturi principle for aspirating air into a stream of foam solution forms foam under pressure.

**3.3.24 Proportioning.** The continuous introduction of foam concentrate at the recommended ratio into the water stream to form foam solution.

**3.3.24.1\* Balanced Pressure Pump-Type Proportioning.** A foam proportioning system that utilizes a foam pump and valve(s) to balance foam and water pressures at a modified venturi-type proportioner located in the foam solution delivery piping; a foam concentrate metering orifice is fitted in the foam inlet section of the proportioner.

**3.3.24.1.1\* In-Line Balanced Pressure Proportioning.** A foam proportioning system utilizing a foam concentrate pump or a bladder tank in conjunction with a listed pressure reducing valve. At all design flow rates, the constant foam concentrate pressure is greater than the maximum water pressure at the inlet to the in-line balanced pressure proportioner. A pressure balancing valve integral to the in-line balanced pressure proportioner regulates the foam concentrate pressure to be balanced to incoming water pressure.

**3.3.24.2\* Coupled Water-Motor Driven Pump Proportioning.** A correctly designed positive displacement water motor in the water supply line coupled to a positive displacement foam concentrate pump to provide proportioning.

**3.3.24.3\* Direct Injection Variable Pump Output Proportioning.** A direct injection proportioning system that utilizes flowmeters for foam concentrate and water in conjunction with a variable output foam pump control system.

**3.3.25 Proportioning Methods for Foam Systems.** The methods of proportioning used to create the correct solution of water and foam liquid concentrate.

**3.3.26\* Pump Proportioner (Around-the-Pump Proportioner).** A system that uses a venturi eductor installed in a bypass line between the discharge and suction side of a water pump and suitable variable or fixed orifices to induct foam concentrate from a tank or container into the pump suction line.

### 3.3.27 Stream.

**3.3.27.1 Foam Hose Stream.** A foam stream from a handline.

**3.3.27.2 Foam Monitor Stream.** A large capacity foam stream from a nozzle that is supported in position and can be directed by one person.

**3.3.28\* Spreading Coefficient.** The measurement of a foam solution's potential to spread spontaneously across a hydrocarbon surface.

### 3.3.29 Tank.

**3.3.29.1 Balanced Pressure Bladder Tank.** A foam concentrate tank fitted with an internal bladder that uses waterflow through a modified venturi-type proportioner to control the foam concentrate injection rate by displacing the foam concentrate within the bladder with water outside the bladder.

**3.3.29.2\* Pressure Proportioning Tank.** A foam concentrate tank with no bladder that uses waterflow through an orifice to displace a foam concentrate, having a specific gravity of at least 1.15, in the tank with water to add foam concentrate through an orifice into a water line at a specified rate.

## Chapter 4 System Components and System Types

**4.1\* General.** This chapter shall provide requirements for the correct use of foam system components.

**4.1.1\*** All components shall be listed for their intended use.



**4.1.2** Where listings for components do not exist, components shall be approved.

## **4.2 Water Supplies.**

### **4.2.1 Water Supplies, Including Premixed Solution.**

#### **4.2.1.1 Quality.**

**4.2.1.1.1\*** The water supply to foam systems shall be permitted to be hard or soft, fresh or salt, but shall be of a quality such that adverse effects on foam formation or foam stability do not occur.

**4.2.1.1.2** No corrosion inhibitors, emulsion breaking chemicals, or any other additives shall be present without prior consultation with the foam concentrate supplier.

**4.2.1.2\* Quantity.** The water supply shall be of a quantity to supply all the devices that shall be permitted to be used simultaneously for the specified time.

**4.2.1.2.1** This quantity shall include not only the volume required for the foam apparatus but also water that shall be permitted to be used in other fire-fighting operations, in addition to the normal plant requirements.

**4.2.1.2.2** Premixed solution-type systems shall not be required to be provided with a continuous water supply.

**4.2.1.3 Pressure.** The pressure at the inlet to the foam system (e.g., foam generator, air foam maker) under required flow conditions shall be at least the minimum pressure for which the system has been designed.

**4.2.1.4\* Temperature.** Optimum foam production shall be obtained by using water at temperatures between 4°C (40°F) and 37.8°C (100°F).

**4.2.1.5 Design.** The water supply system shall be designed and installed in accordance with NFPA 24.

**4.2.1.5.1** Strainers shall be provided where solids of a size large enough to obstruct openings or damage equipment are present.

**4.2.1.5.2** Hydrants furnishing the water supply for foam equipment shall be provided in the required number.

**4.2.1.5.3** Hydrants shall be located as required by the authority having jurisdiction (AHJ).

**4.2.1.6 Storage.** Water supply or premixed solution shall be protected against freezing in climates where freezing temperatures are expected.

### **4.2.2 Water and Foam Concentrate Pumps.**

**4.2.2.1** When water or foam concentrate pumps are required for automatic foam system operation, they shall be designed and installed in accordance with NFPA 20.

**4.2.2.2** Controllers in accordance with NFPA 20 shall not be required for manual systems.

## **4.3 Foam Concentrates.**

### **4.3.1 Types of Foam Concentrate.**

**4.3.1.1** Foam concentrate shall be listed.

**4.3.1.2\*** The concentrate used in a foam system shall be listed for use on the specific flammable or combustible liquid to be protected.

**4.3.1.3** The limitations of the listing and the manufacturers' specifications shall be followed.

**4.3.1.4** Acceptable ranges for the following physiochemical properties of the foam concentrate shall be published as part of the listing to determine compliance with 12.6.2:

- (1) Density or specific gravity
- (2) pH
- (3) Refractive index
- (4)\*Viscosity

**4.3.1.5** Foam concentrates for protection of hydrocarbon fuels shall be one of the following types:

- (1) Protein
- (2) Fluoroprotein
- (3) Aqueous film-forming foam (AFFF)
- (4) Film-forming fluoroprotein (FFFP)
- (5) Alcohol-resistant
- (6) High-expansion
- (7) Medium-expansion
- (8) Others listed for this purpose

**4.3.1.6** Water-miscible and polar flammable or combustible liquids shall be protected by alcohol-resistant concentrates listed for this purpose.

### **4.3.2 Concentrate Storage.**

#### **4.3.2.1 Storage Facilities.**

**4.3.2.1.1** Foam concentrates and equipment shall be stored in a location not exposed to the hazard they protect.

**4.3.2.1.2** If housed, foam concentrates and equipment shall be in a noncombustible structure.

**4.3.2.1.3** For outdoor nonautomatic systems, the AHJ shall be permitted to approve the storage of foam concentrate in a location off premises where these supplies are available at all times.

**4.3.2.1.4** Loading and transportation facilities for foam concentrates shall be provided.

**4.3.2.1.5** Off-premises supplies shall be of the type required for use in the systems of the given installation.

**4.3.2.1.6** At the time of a fire, these off-premises supplies shall be accumulated in the required quantities, before the equipment is placed in operation, to ensure uninterrupted foam production at the design rate for the required period of time.

**4.3.2.2\* Quantity.** The amount of concentrate shall meet the discharge requirements for the largest single hazard protected or group of hazards that are to be protected simultaneously.

#### **4.3.2.3 Foam Concentrate Storage Tanks.**

**4.3.2.3.1** Bulk liquid storage tanks shall be fabricated from or be lined with materials compatible with the concentrate.

**4.3.2.3.2** The storage tank shall be designed to minimize evaporation of foam concentrate.

**4.3.2.3.3\*** Proportioning systems shall have signage to provide instruction on the proper sequence of system shutdown to prevent accidental loss of foam concentrate and/or system damage.

**4.3.2.3.4** In atmospheric storage tanks, the suction inlet shall be located a minimum of 25.4 mm (1 in.) above the bottom of the tank.

**4.3.2.3.5** Foam concentrate below the level of the suction inlet shall not be considered usable.

#### **4.3.2.4 Storage Conditions.**

**4.3.2.4.1\*** In order to ensure the correct operation of any foam-producing system, the chemical and physical characteristics of the materials comprising the system shall be taken into consideration in design.

**4.3.2.4.2\*** Foam concentrates shall be stored within the listed temperature limitations.

**4.3.2.4.3** Markings shall be provided on storage vessels to identify the type of concentrate and its intended concentration in solution.

#### **4.3.2.5 Foam Concentrate Supply.**

**4.3.2.5.1 Foam Concentrate Consumption Rates.** The consumption rates shall be based on the percentage concentrate used in the system design (e.g., 3 percent or 6 percent or other, if so listed or approved by the AHJ).

#### **4.3.2.5.2 Reserve Supply of Foam Concentrate.**

**4.3.2.5.2.1** There shall be a reserve supply of foam concentrate to meet design requirements in order to put the system back into service after operation.

**4.3.2.5.2.2** The reserve supply shall be in separate tanks or compartments, in drums or cans on the premises, or shall be able to be obtained from an approved outside source within 24 hours.

**4.3.2.6 Auxiliary Supplies.** Other equipment necessary to re-commission the system, such as bottles of nitrogen or carbon dioxide for premixed systems, also shall be able to be secured.

#### **4.4 Concentrate Compatibility.**

##### **4.4.1 Compatibility of Foam Concentrates.**

**4.4.1.1\*** Different types of foam concentrates shall not be mixed for storage.

**4.4.1.2** Different brands of the same type of concentrate shall not be mixed unless data are provided by the manufacturer and accepted by the AHJ to prove that they are compatible.

**4.4.1.3** Low-expansion foams generated separately from protein, fluoroprotein, FFFP, AFFF, and alcohol-resistant concentrates shall be permitted to be applied to a fire in sequence or simultaneously.

##### **4.4.2\* Foam Compatibility with Dry Chemical Agents.**

**4.4.2.1** The manufacturers of the dry chemical and foam concentrate to be used in the system shall confirm that their products are mutually compatible.

**4.4.2.2** Where used, limitations imposed on either of the agents alone shall be applied.

**4.5 Foam Proportioning.** The method of foam proportioning shall conform to one of the following:

- (1) Self-educing nozzle
- (2) In-line eductor
- (3) Pressure proportioners (with or without bladder)
- (4) Around-the-pump proportioners
- (5) Direct injection variable output foam pump system
- (6) Coupled water-motor driven pump proportioner
- (7) Balanced pressure pump-type proportioners

**4.5.1\*** The proportioning system shall meet the listed minimum flow rate based on the minimum and maximum system discharge flow rate.

#### **4.6\* Foam Concentrate Pumps.**

**4.6.1** The design and materials of construction for foam concentrate pumps shall be in accordance with NFPA 20.

**4.6.2** Special attention shall be paid to the type of seal or packing used. Seals or packing used shall be compatible with the foam concentrate.

**4.6.3** A foam concentrate pump shall have the capacity to meet the maximum system demand.

**4.6.4** To ensure positive injection of concentrates, the discharge pressure ratings of pumps at the design discharge capacity shall be in excess of the maximum water pressure under any condition at the point of concentration injection.

#### **4.7 Piping.**

##### **4.7.1\* Foam Concentrate Pipe Materials.**

**4.7.1.1\*** Foam concentrate pipe and valves shall be made of one of the following materials:

- (1) Brass (red or naval)
- (2) Bronze
- (3) Stainless steel (304 or 316)
- (4) Other material, in accordance with the foam concentrate manufacturer's certification of compatibility with the foam concentrate and as approved by the AHJ

**4.7.1.2\*** Carbon steel pipe shall not be used.

**4.7.1.3** Pipe carrying foam concentrate shall not be galvanized.

**4.7.1.4** Foam concentrate pipe shall conform to one of the following standards:

- (1) ASTM A312
- (2) ASTM B43
- (3) ASTM B315
- (4) Other standards as allowed by 4.7.1.1(4), 4.7.1.2, and 4.7.1.3

**4.7.1.5** In piping with dissimilar metals, dielectric components shall be used to insulate and reduce the possibility of galvanic corrosion.

**4.7.1.6** Selection of pipe wall thickness shall conform to one of the following:

- (1) Schedule 40
- (2) ASME B31.1

**4.7.1.7\*** For the purpose of computing friction loss in the foam concentrate piping, the following shall be used:

- (1) Darcy-Weisbach formula for (Newtonian) foam concentrates
- (2) Manufacturers' friction loss data for alcohol-resistant (non-Newtonian) foam concentrates

**4.7.1.8** Flushing and drainage valves/connections for dry foam concentrate piping shall be installed in the standby condition.

**4.7.1.9** Dry foam concentrate piping shall be pitched a minimum of 4 mm/m ( $\frac{1}{2}$  in. over 10 ft) to allow for drainage.

##### **4.7.2\* Foam Solution Pipe Materials.**

**4.7.2.1\*** Foam solution pipe shall be made of one of the following materials:

- (1) Galvanized steel
- (2) Stainless steel

- (3) Internal/external corrosion-resistant pipe in accordance with the foam manufacturer's specification for compatibility and acceptable to the authority having jurisdiction
- (4) Unprotected carbon steel pipe, when the discharge devices are closed to the atmosphere

**4.7.2.2** Where exposed to corrosive influences, the piping shall be corrosion resistant or protected against corrosion.

**4.7.2.3** Pipe within the hazard area shall be rated for the pressure and temperature involved.

**4.7.2.4** Pipe within the hazard area shall be able to withstand the anticipated exposure to fire.

**4.7.2.5** Nonmetallic foam solution piping shall be listed for the intended application.

**4.7.2.6** Metallic foam solution pipe shall not be less than standard weight.

**4.7.2.7** Foam solution pipe shall conform to one of the following standards:

- (1) ASTM A53
- (2) ASTM A135
- (3) ASTM A795
- (4) Other standards as allowed in 4.7.2.1 (3)

**4.7.2.8** Underground foam solution pipe shall be in accordance with NFPA 24.

**4.7.2.9** For the purpose of computing friction loss in foam solution piping, the following C-values shall be used for the Hazen-Williams formula:

- (1) Galvanized steel pipe — 120
- (2) Other C-values for corrosion-resistant piping materials in accordance with NFPA 13

### 4.7.3 Fittings.

#### 4.7.3.1\* Foam Concentrate Fittings.

**4.7.3.1.1** Foam concentrate piping shall use fittings made of the following materials, as appropriate to the foam concentrate pipe material:

- (1) Brass (red or naval)
- (2) Bronze
- (3) Stainless steel (304 or 316)
- (4) Other material, in accordance with the foam concentrate manufacturer's certification of compatibility, with approval from the AHJ, and as permitted by 4.7.3.1.2

**4.7.3.1.2** Foam concentrate fittings shall not be carbon steel or galvanized.

**4.7.3.1.3** Foam concentrate fittings shall not be less than standard class weight.

**4.7.3.1.4** Foam concentrate fitting shall be in accordance with one of the following or as permitted by the AHJ:

- (1) ANSI B16.5
- (2) ANSI B16.11
- (3) ANSI B16.15
- (4) ANSI B16.24

#### 4.7.3.2 Foam Solution Fittings.

**4.7.3.2.1** Foam solution fittings shall be one of the following:

- (1) Galvanized steel
- (2) Stainless steel

- (3) Other material, in accordance with the manufacturer's certification of compatibility and with approval of the AHJ
- (4) Unprotected carbon steel pipe, when discharge devices are closed to the atmosphere
- (5) Internally/externally coated materials that are listed for the application

**4.7.3.2.2** Foam solution fittings shall not be less than standard class weight.

**4.7.3.2.3** Foam solution fittings shall be in accordance with one of the following or as permitted by the AHJ:

- (1) ANSI B16.1
- (2) ANSI B16.3
- (3) ANSI B16.4
- (4) ANSI B16.5
- (5) ANSI B16.9
- (6) ANSI B16.11
- (7) ANSI B16.25
- (8) ASTM A 234

**4.7.3.2.4** Cast-iron fittings shall not be used where dry sections of piping are exposed to possible fire or where fittings are subject to stress in self-supporting systems.

**4.7.3.2.5** Listed rubber or other elastomeric-gasketed fittings shall be permitted to be used in fire-exposed areas if the foam system is actuated automatically.

**4.7.3.2.6** Listed rubber or other elastomeric-gasketed fittings shall be permitted to be used in fire-exposed areas if the foam system is actuated manually and high-temperature-rated extra-heavy-duty grooved fittings and gaskets have been tested in accordance with API 607 and meet these criteria within industry standards.

### 4.7.4 Joining of Pipes and Fittings.

#### 4.7.4.1 Threaded Pipe.

**4.7.4.1.1** Pipe threading shall be in conformance with ANSI B1.20.1 or ISO 7-1.

**4.7.4.1.2** PTFE tape or the foam concentrate manufacturer's compatible thread-locking compounds shall be used at pipe joints in the foam concentrate supply line.

**4.7.4.2** Dimensions of cut- and roll-grooves and outside diameters of piping materials shall conform to the manufacturers' recommendations and the listing laboratories' certifications.

#### 4.7.4.3\* Welded Pipe

**4.7.4.3.1** Field welding shall conform to the requirements of AWS B2.1 or equivalent.

**4.7.4.3.2** Shop welding shall conform to the requirements of Section 6.5 in NFPA 13.

**4.7.4.3.3** Precautions shall be taken to ensure that the openings are fully cut out and that no obstructions remain in the waterway.

**4.7.4.3.4** Precautions shall be taken to ensure that no galvanic corrosion occurs between piping and fittings.

### 4.7.5 Strainers.

**4.7.5.1** Strainers shall be provided where solids of a size large enough to obstruct openings or damage equipment are present.

**4.7.5.2** The ratio of the strainer's open basket area to its inlet pipe area shall be at least 10:1.



**4.7.5.2.1** The net open area of the strainer shall be at least four times the area of the suction piping.

**4.7.5.2.2** Strainer mesh size shall be in accordance with the pump manufacturer's recommendations.

**4.7.6\* Valves.**

**4.7.6.1** All valves for water and foam solution lines shall be of the indicator type, such as OS&Y or post indicator.

**4.7.6.2** Automatic valves for foam concentrate lines shall be listed for this service.

**4.7.6.3** Valve specifications for water use shall be permitted outside the hazard or diked area.

**4.7.6.4** Inside the hazard or diked area, automatic control valves and shutoff valves shall be of steel or other alloy capable of withstanding exposure to fire temperatures.

**4.7.6.5** All valves required for automatic foam systems shall be supervised in their operating position by one of the following methods:

- (1) Electrical, in accordance with *NFPA 72*
- (2) Locked
- (3) Sealed

**4.8 System Types.** The following four types of systems shall be permitted:

- (1) Fixed
- (2) Semifixed
- (3) Mobile
- (4) Portable

**4.9 Operation and Control of Systems.**

**4.9.1 Methods of Actuation.**

**4.9.1.1** Systems shall be permitted to be actuated automatically or manually.

**4.9.1.2** All systems shall have provisions for manual actuation.

**4.9.2 Automatically Actuated Systems.**

**4.9.2.1** An automatic system shall be activated by automatic detection equipment.

**4.9.2.2** Operation shall be controlled by listed or approved mechanical, electrical, hydraulic, or pneumatic means.

**4.9.2.3** Where operation is automatic, a reliable source of energy shall be used.

**4.9.2.4** The need for an alternate power supply shall be determined by the AHJ.

**4.9.2.5\* Automatic Detection Equipment.**

**4.9.2.5.1** Automatic detection equipment — whether pneumatic, hydraulic, or electric — shall be provided with supervision arranged so that failure of equipment or loss of supervising air pressure or loss of electric energy results in positive notification of the abnormal condition.

**4.9.2.5.2** Where approved by the AHJ, small systems for localized hazards shall be permitted to be unsupervised.

**4.9.2.6\*** Electric automatic detection equipment and any auxiliary electric equipment, if in hazardous areas, shall be designed expressly for use in such areas.

**4.9.2.7** The system shall be permitted to be arranged to shut off automatically after a predetermined operating time.

**4.9.2.7.1** Automatic shutdown and the predetermined operating time shall be approved by the AHJ.

**4.9.2.7.2** Where automatic shutdown is required, an alarm condition shall remain until manually reset.

**4.9.2.8 Detection System.**

**4.9.2.8.1** The detection system shall activate a local alarm as well as an alarm at a constantly attended location.

**4.9.2.8.2** The detection system's alarms also shall be actuated when the system is operated manually.

**4.9.3 Manually Actuated Systems.**

**4.9.3.1** Controls for manually actuated systems shall be located in a place removed from the hazard zone to permit them to be operated in an emergency, yet close enough to ensure operator knowledge of fire conditions.

**4.9.3.2** The location and purposes of the controls shall be indicated and shall be related to the operating instructions.

**4.9.4 Equipment.**

**4.9.4.1** All operating devices shall be designed for the service conditions they encounter.

**4.9.4.2** Operating devices shall not be rendered inoperative, or be susceptible to inadvertent operation, by environmental factors such as high or low temperature, atmospheric humidity or pollution, or marine conditions.

**4.9.4.3** Operating device systems shall have means for manual actuation.

## Chapter 5 Low-Expansion System Design

**5.1\* Types of Hazards.** This chapter shall cover design information for the use of low-expansion foam to protect outdoor storage tanks, interior flammable liquid hazards, loading racks, diked areas, and nondiked spill areas.

**5.2 Outdoor Fixed Roof (Cone) Tanks.** The following methods for protecting exterior fixed-roof tanks shall be included within this section and shall not be considered to be in any order of preference:

- (1) Foam monitors and handlines
- (2) Surface application with fixed foam discharge outlets
- (3) Subsurface application
- (4) Semisubsurface injection methods

**5.2.1 Supplementary Protection.** In addition to the primary means of protection, supplementary protection shall be provided in accordance with the requirements found in Section 5.9.

**5.2.2 Basis of Design.** System design shall be based on protecting the tank requiring the largest foam solution flow, including supplementary hose streams.

**5.2.3\* Limitations.** Fixed outlets shall not be used to protect horizontal or pressure tanks.

**5.2.4 Design Criteria for Foam Monitors and Handlines.**

**5.2.4.1 Limitations.**

**5.2.4.1.1** Monitor nozzles shall not be used as the primary means of protection for fixed-roof tanks over 18 m (60 ft) in diameter.

**5.2.4.1.2** Foam handlines shall not be permitted to be used as the primary means of protection for fixed-roof tanks over 9 m (30 ft) in diameter or those over 6 m (20 ft) in height.

**5.2.4.2 Foam Application Rates.**

**5.2.4.2.1\*** To determine actual solution flow requirements, consideration shall be given to potential foam losses from wind, and other factors shall be included in the calculations.

**5.2.4.2.2\*** The design parameters for the use of monitors and handline nozzles to protect tanks containing hydrocarbons shall be in accordance with Table 5.2.4.2.2.

**5.2.4.3\* Tanks Containing Flammable and Combustible Liquids Requiring Alcohol-Resistant Foams.**

**5.2.4.3.1\*** Water-soluble and certain flammable and combustible liquids and polar solvents that are destructive to regular (nonalcohol-resistant) foams shall use alcohol-resistant foams.

**5.2.4.3.2\*** For liquids of a depth greater than 25.4 mm (1 in.), monitor and foam hose streams shall be limited for use with special alcohol-resistant foams listed and/or approved for the purpose.

**5.2.4.3.3** In all cases, the manufacturer of the foam concentrate and the foam-making equipment shall be consulted as to limitations and for recommendations based on listings or specific fire tests.

**5.2.4.4 Design Parameters.** Where monitors and handline nozzles are used to protect tanks containing flammable and combustible liquids requiring alcohol-resistant foams, the operation time shall be 65 minutes at listed application rates, unless the foam manufacturer has established, by fire test, that a shorter time shall be permitted.

**5.2.5 Design Criteria for Surface Application with Fixed Foam Discharge Outlets.**

**5.2.5.1\* Fixed Foam Discharge Outlets.**

**5.2.5.1.1** For the protection of a flammable liquid contained in a vertical fixed-roof (cone) atmospheric storage tank, discharge outlets shall be attached to the tank.

**5.2.5.1.2** Where two or more discharge outlets are required, the outlets shall be spaced equally around the tank periphery.

**5.2.5.1.2.1** Such outlets shall be individually piped and separately valved for isolation outside the dike area in accordance with 9.5.1.

**5.2.5.1.2.2** Each outlet shall be sized to deliver foam at the minimum application rate or higher.

**5.2.5.1.3** Fixed foam discharge outlets shall be attached at the top of the shell and shall be located or connected to preclude the possibility of the tank contents overflowing into the foam lines.

**5.2.5.1.4** Fixed foam discharge outlets shall be attached so that displacement of the roof will not subject them to damage.

**5.2.5.1.5** Fixed foam discharge outlets shall be provided with seal, frangible under low pressure, to prevent entrance of vapors into foam outlets and pipelines.

**5.2.5.1.6** Fixed foam discharge outlets shall be provided with inspection means to allow maintenance and for inspection and replacement of vapor seals.

**5.2.5.2 Design Criteria for Tanks Containing Hydrocarbons.**

**5.2.5.2.1\*** Fixed-roof (cone) tanks shall be provided with approved fixed foam discharge outlets as indicated in Table 5.2.5.2.1.

**Table 5.2.4.2.2 Foam Handline and Monitor Protection for Fixed-Roof Storage Tanks Containing Hydrocarbons**

Hydrocarbon Type	Minimum Application Rate		Minimum Discharge Time (minutes)
	L/min · m <sup>2</sup>	gpm/ft <sup>2</sup>	
Flash point between 37.8°C and 60°C (100°F and 140°F)	6.5	0.16	50
Flash point below 37.8°C (100°F) or liquids heated above their flash points	6.5	0.16	65
Crude petroleum	6.5	0.16	65

Notes:

(1) Included in this table are gasohols and unleaded gasolines containing no more than 10 percent oxygenated additives by volume. Where oxygenated additives content exceeds 10 percent by volume, protection is normally in accordance with 5.2.4.3. Certain nonalcohol-resistant foams might be suitable for use with fuels containing oxygenated additives of more than 10 percent by volume. The manufacturer should be consulted for specific listings or approvals.

(2) Flammable liquids having a boiling point of less than 37.8°C (100°F) might require higher rates of application. Suitable rates of application should be determined by test. Flammable liquids with a wide range of boiling points might develop a heat layer after prolonged burning and then can require application rates of 8.1 L/min · m<sup>2</sup> (0.2 gpm/ft<sup>2</sup>) or more.

(3) Care should be taken in applying portable foam streams to high-viscosity materials heated above 93.3°C (200°F). Good judgment should be used in applying foam to tanks containing hot oils, burning asphalts, or burning liquids that have a boiling point above the boiling point of water. Although the comparatively low water content of foams can beneficially cool such fuels at a slow rate, it can also cause violent frothing and “slop-over” of the tank’s contents.

**Table 5.2.5.2.1 Number of Fixed Foam Discharge Outlets for Fixed-Roof Tanks Containing Hydrocarbons or Flammable and Combustible Liquids Requiring Alcohol-Resistant Foams**

Tank Diameter (or Equivalent Area)		Minimum Number of Discharge Outlets
m	ft	
Up to 24	Up to 80	1
Over 24 to 36	Over 80 to 120	2
Over 36 to 42	Over 120 to 140	3
Over 42 to 48	Over 140 to 160	4
Over 48 to 54	Over 160 to 180	5
Over 54 to 60	Over 180 to 200	6
Over 60	Over 200	6
		Plus 1 outlet for each additional 465 m <sup>2</sup> (5000 ft <sup>2</sup> )

**5.2.5.2.2\* Minimum Discharge Times and Application Rates.** Where fixed foam discharge outlets are used for fixed-roof (cone) tanks containing hydrocarbons, the minimum discharge times and application rates shall be in accordance with Table 5.2.5.2.2.

**5.2.5.2.3** If the apparatus available has a delivery rate higher than 4.1 L/min·m<sup>2</sup> (0.1 gpm/ft<sup>2</sup>), a proportionate reduction in the time figure shall be permitted to be made, provided that the time is not less than 70 percent of the minimum discharge times shown.

**Table 5.2.5.2.2 Minimum Discharge Times and Application Rates for Type II Fixed Foam Discharge Outlets on Fixed-Roof (Cone) Storage Tanks Containing Hydrocarbons**

Hydrocarbon Type	Minimum Application Rate		Minimum Discharge Time (minutes)
	L/min · m <sup>2</sup>	gpm/ft <sup>2</sup>	
Flash point between 37.8°C and 60°C (100°F and 140°F)	4.1	0.10	30
Flash point below 37.8°C (100°F) or liquids heated above their flash points	4.1	0.10	55
Crude petroleum	4.1	0.10	55

Notes:

(1) Included in this table are gasohols and unleaded gasolines containing no more than 10 percent oxygenated additives by volume. Where oxygenated additives content exceeds 10 percent by volume, protection is normally in accordance with 5.2.5.3. Certain nonalcohol-resistant foams might be suitable for use with fuels containing oxygenated additives of more than 10 percent by volume. Consult manufacturer for specific listings or approvals.

(2) Flammable liquids having a boiling point of less than 37.8°C (100°F) might require higher rates of application. Suitable rates of application should be determined by test.

(3) For high-viscosity liquids heated above 93.3°C (200°F), lower initial rates of application might be desirable to minimize frothing and expulsion of the stored liquid. Good judgment should be used in applying foams to tanks containing hot oils, burning asphalts, or burning liquids that have boiling points above the boiling point of water. Although the comparatively low water content of foams can beneficially cool such liquids at a slow rate, it can also cause violent frothing and “slop-over” of the tank’s contents.

(4) Type I discharge outlets are considered obsolete, and those currently installed become Type II outlets if damaged. Refer to A.5.2.5.2.2 for additional information and minimum discharge times for existing Type I outlets.

**5.2.5.3\* Design Criteria for Tanks Containing Flammable and Combustible Liquids Requiring Alcohol-Resistant Foams.**

**5.2.5.3.1** Water-soluble and certain flammable and combustible liquids and polar solvents that are destructive to nonalcohol-resistant foams shall require the use of alcohol-resistant foams.

**5.2.5.3.2\*** In all cases, the manufacturers of the foam concentrate and the foam-making equipment shall be consulted as to limitations and for recommendations based on listings or specific fire tests.

**5.2.5.3.3** Fixed-roof (cone) tanks shall be provided with approved fixed foam discharge outlets as indicated in Table 5.2.5.2.1.

**5.2.5.3.4 Minimum Discharge Times and Application Rates.** Minimum discharge times and application rates for fixed-roof (cone) tanks containing flammable and combustible liquids requiring alcohol-resistant foams shall be in accordance with Table 5.2.5.3.4.

**5.2.6 Design Criteria for Subsurface Application.**

**5.2.6.1\*** Subsurface foam injection systems shall be permitted for protection of liquid hydrocarbons in vertical fixed-roof atmospheric storage tanks.

**5.2.6.1.1** Subsurface injection systems shall not be used for protection of Class IA hydrocarbon liquids or for the protection of alcohols, esters, ketones, aldehydes, anhydrides, or other products requiring the use of alcohol-resistant foams.

**5.2.6.1.2** Foam concentrates and equipment for subsurface injection shall be listed for this purpose.

**5.2.6.1.3** Fluoroprotein foam, AFFF, and FFFP for subsurface injection shall have expansion ratios between 2:1 and 4:1.

**Table 5.2.5.3.4 Minimum Application Rates and Discharge Times for Fixed-Roof (Cone) Tanks Containing Flammable and Combustible Liquids Requiring Alcohol-Resistant Foams**

Application Rate for Specific Product Stored	Minimum Discharge Time (minutes)
	Type II Foam Discharge Outlet
Consult manufacturer for listings on specific products	55

## Notes:

(1) Most currently manufactured alcohol-resistant foams are suitable for use with Type II fixed foam discharge outlets. However, some older alcohol-resistant foams require gentle surface application by Type I fixed foam discharge outlets. Consult manufacturers for listings on specific products.

(2) Type I discharge outlets are considered obsolete, and those currently installed become Type II outlets if damaged. Refer to A.5.2.5.2.2 for additional information and minimum discharge times for existing Type I outlets.

**5.2.6.2\* Foam Discharge Outlets.**

**5.2.6.2.1** The discharge outlet into the tank shall be permitted to be the open end of a foam delivery line or product line.

**5.2.6.2.2** Outlets shall be sized so that foam generator discharge pressure and foam velocity limitations are not exceeded.

**5.2.6.2.3** The foam velocity at the point of discharge into the tank contents shall not exceed 3 m/sec (10 ft/sec) for Class IB liquids or 6 m/sec (20 ft/sec) for other classes of liquids unless actual tests prove that higher velocities are satisfactory.

**5.2.6.2.4** Where two or more outlets are required, they shall be located so that the foam travel on the surface cannot exceed 30 m (100 ft).

**5.2.6.2.5** Each outlet shall be sized to deliver foam at the minimum application rate or higher.

**5.2.6.2.6** For even foam distribution, outlets shall be permitted to be shell connections or shall be permitted to be fed through a pipe manifold within the tank from a single shell connection.

**5.2.6.2.7** Rather than installing additional tank nozzles, shell connections shall be permitted to be made in manway covers.

**5.2.6.2.8** Tanks shall be provided with subsurface foam discharge outlets as shown in Table 5.2.6.2.8.

**5.2.6.3\* Foam Discharge Outlet Elevation.**

**5.2.6.3.1\*** Foam discharge outlets shall be located so as not to discharge into a water bottom.

**5.2.6.3.2** The requirement of 5.2.6.3.1 shall be accomplished by having the outlets located at least 0.3 m (1 ft) above the highest water level to prevent destruction of the foam.

**5.2.6.4\* Subsurface Injection Back-Pressure Limitations.** The sizes and lengths of discharge pipe or lines used beyond the foam maker and the anticipated maximum depth of the fuel to be protected shall be such that the back pressure is within the range of pressures under which the device has been tested and listed by testing laboratories.

**5.2.6.5 Minimum Discharge Times and Application Rates.**

**5.2.6.5.1** The minimum discharge times and application rates for subsurface application on fixed-roof storage tanks shall be in accordance with Table 5.2.6.5.1.

**Table 5.2.6.2.8 Minimum Number of Subsurface Foam Discharge Outlets for Fixed-Roof Tanks Containing Hydrocarbons**

Tank Diameter		Minimum Number of Discharge Outlets	
m	ft	Flash Point Below 37.8°C (100°F)	Flash Point 37.8°C (100°F) or Higher
Up to 24	Up to 80	1	1
Over 24 to 36	Over 80 to 120	2	1
Over 36 to 42	Over 120 to 140	3	2
Over 42 to 48	Over 140 to 160	4	2
Over 48 to 54	Over 160 to 180	5	2
Over 54 to 60	Over 180 to 200	6	3
Over 60	Over 200	6	3
		Plus 1 outlet for each additional 465 m <sup>2</sup> (5000 ft <sup>2</sup> )	Plus 1 outlet for each additional 697 m <sup>2</sup> (7500 ft <sup>2</sup> )

## Notes:

(1) For Class IA liquids, see 5.2.6.1.1.

(2) Table 5.2.6.2.8 is based on extrapolation of fire test data on 7.5 m (25 ft), 27.9 m (93 ft), and 34.5 m (115 ft) diameter tanks containing gasoline, crude oil, and hexane, respectively.

(3) The most viscous fuel that has been extinguished by subsurface injection where stored at ambient conditions [15.6°C (60°F)] had a viscosity of 2000 SSU (440 centistokes) and a pour point of -9.4°C (15°F). Subsurface injection of foam generally is not recommended for fuels that have a viscosity greater than 440 centistokes (2000 SSU) at their minimum anticipated storage temperature.

(4) In addition to the control provided by the smothering effect of the foam and the cooling effect of the water in the foam that reaches the surface, fire control and extinguishment can be enhanced further by the rolling of cool product to the surface.



**Table 5.2.6.5.1 Minimum Discharge Times and Application Rates for Subsurface Application on Fixed-Roof Storage Tanks**

Hydrocarbon Type	Minimum Application Rate		Minimum Discharge Time (minutes)
	L/min · m <sup>2</sup>	gpm/ft <sup>2</sup>	
Flash point between 37.8°C and 60°C (100°F and 140°F)	4.1	0.1	30
Flash point below 37.8°C (100°F) or liquids heated above their flash points	4.1	0.1	55
Crude petroleum	4.1	0.1	55

**Notes:**

(1) The maximum application rate shall be 8.1 L/min · m<sup>2</sup> (0.20 gpm/ft<sup>2</sup>).

(2) For high-viscosity liquids heated above 93.3°C (200°F), lower initial rates of application might be desirable to minimize frothing and expulsion of the stored liquid. Good judgment should be used in applying foams to tanks containing hot oils, burning asphalts, or burning liquids that are heated above the boiling point of water. Although the comparatively low water content of foams can beneficially cool such liquids at a slow rate, it can also cause violent frothing and “slop-over” of the tank’s contents.

**5.2.6.5.2\*** In cases where liquid hydrocarbons contain foam-destructive products, the manufacturer of the foam concentrate shall be consulted for recommendations based on listings and/or approvals.

**5.2.6.5.3** If the apparatus available has a delivery rate higher than 4.1 L/min · m<sup>2</sup> (0.1 gpm/ft<sup>2</sup>), a proportionate reduction in the time figure shall be permitted to be made, provided that the time is not less than 70 percent of the minimum discharge time shown and that the maximum foam velocity is in accordance with 5.2.6.2.3.

**5.2.7\* Semisubsurface Systems.** All equipment used in semisubsurface systems shall be listed or approved for this purpose.

**5.3\* Outdoor Open-Top Floating Roof Tanks.** Outdoor open-top floating roof tanks shall be as illustrated in Figure 5.3(a) through Figure 5.3(d).

**5.3.1** Tanks equipped with the following floating roof types shall not be covered in Section 5.3:

- (1) Roofs made from floating diaphragms
- (2) Roofs made from plastic blankets
- (3) Roofs made from plastic or other flotation material, even if encapsulated in metal or fiberglass
- (4) Roofs that rely on flotation device closures that are easily submerged if damaged
- (5) Pan roofs

**5.3.2** Systems for tanks so equipped shall be designed in accordance with 5.4.2.2.

**5.3.3\* Types of Fires Anticipated.**

**5.3.3.1 Subsurface and Semisubsurface Injection.** Subsurface and semisubsurface injection shall not be used for protection of open-top or covered floating roof tanks because of the possibility of improper distribution of foam at the fuel surface.

**5.3.3.2 Seal Area Protection.** The foam protection facilities for an open-top floating roof tank seal area shall be based on 5.3.2 through 5.3.5.


**5.3.4 Methods of Seal Fire Protection.**

**5.3.4.1** The following methods for fire protection of seals in open-top floating roof tanks shall be as required in 5.3.5 through 5.3.7:

- (1) Fixed discharge outlets
- (2) Foam handlines
- (3) Foam monitors

**5.3.4.2 Supplementary Protection.** In addition to the primary means of protection, supplementary protection shall be provided in accordance with the requirements of Section 5.9.

**5.3.4.3\* Basis of Design.** System design shall be based on protecting the tank requiring the largest foam solution flow, including supplementary hose streams.

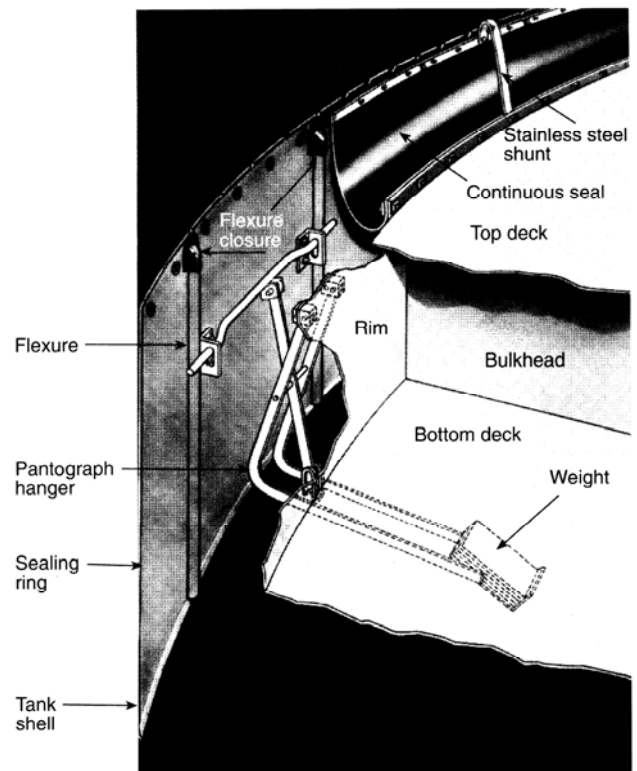**FIGURE 5.3(a) Pantograph-Type Seal Open-Top Floating Roof Tank.**



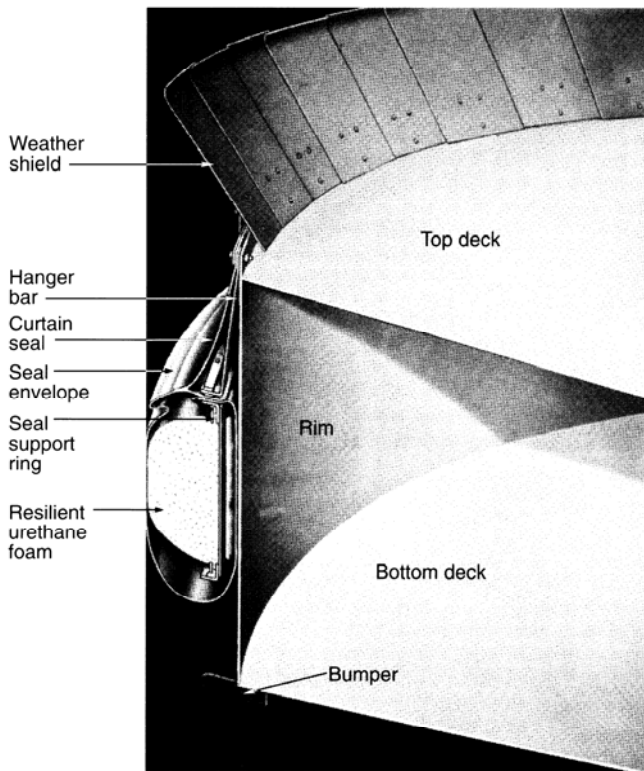


FIGURE 5.3(b) Tube Seal Open-Top Floating Roof Tank.

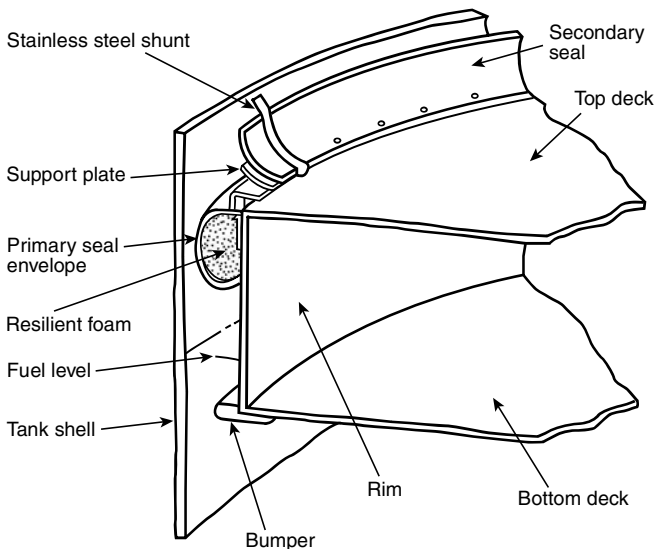


FIGURE 5.3(c) Double Seal System for Floating Roofs.

### 5.3.5 Fixed Discharge Outlets Design Criteria for Seal Area Protection.

5.3.5.1 Application of foam from fixed discharge outlets shall be permitted to be achieved by either of the following two methods:

- (1) The first method discharges foam above the mechanical shoe seal, a metal weather shield, or a secondary seal.

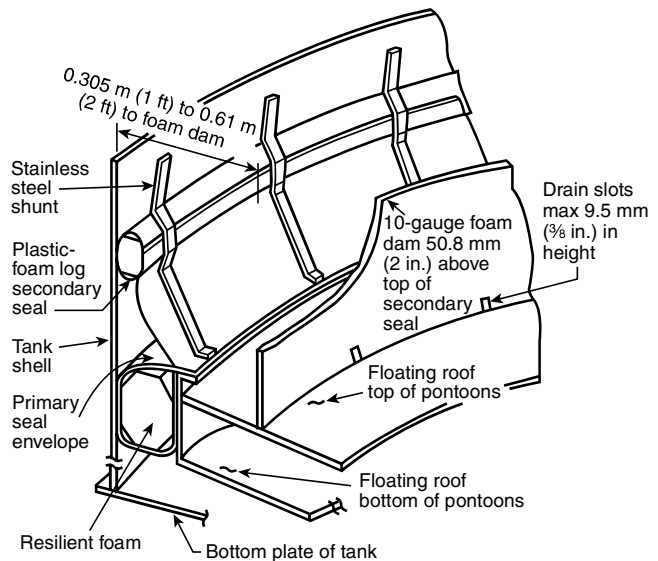


FIGURE 5.3(d) Double Seal System for Floating Roofs Using Plastic-Foam Log (Secondary Seal).

- (2) The second method discharges foam below a mechanical shoe seal directly onto the flammable liquid, behind a metal weather shield directly onto the tube seal envelope, or beneath a secondary seal onto the primary seal.

#### 5.3.5.2\* Top-of-Seal Method with Foam Dam.

5.3.5.2.1 Fixed foam discharge outlets located above a mechanical shoe seal, above a tube seal weather shield, or above a secondary seal shall be used in conjunction with a foam dam.

5.3.5.2.2 The following shall be permitted to be two methods of application of fixed foam discharge outlets:

- (1) Fixed foam discharge outlets (normally Type II) mounted above the top of the tank shell
- (2) Fixed foam discharge outlets mounted on the periphery of the floating roof

5.3.5.2.3\* For this application, the fixed foam discharge outlets shall not be fitted with a frangible vapor seal device.

#### 5.3.5.3 Top-of-Seal System Design.

5.3.5.3.1 The design parameters for the application of fixed foam discharge outlets on top of the seal to protect open-top floating roof tanks shall be in accordance with Table 5.3.5.3.1 and Figure 5.3.5.3.1.

5.3.5.3.2 The requirements specified in Table 5.3.5.3.1 apply to tanks containing hydrocarbons or flammable and combustible materials requiring alcohol-resistant foams.

5.3.5.3.3 The required minimum application rates specified in Table 5.3.5.3.1 shall apply, unless listings for specific products require higher application rates where Type II fixed foam discharge outlets are used.

5.3.5.3.4 If the application rate is higher than the minimum rate specified in Table 5.3.5.3.1, the discharge time shall be permitted to be reduced proportionately, provided that the reduced time is not less than 70 percent of the minimum discharge times specified.

**Table 5.3.5.3.1 Top-of-Seal Fixed Foam Discharge Protection for Open-Top and Internal Floating Roof Tanks**

Seal Type	Applicable Illustration Detail	Minimum Application Rate		Minimum Discharge Time (minutes)	Maximum Spacing Between Discharge Outlets with			
		L/min · m <sup>2</sup>	gpm/ft <sup>2</sup>		305 mm (12 in.) Foam Dam		610 mm (24 in.) Foam Dam	
					m	ft	m	ft
Mechanical shoe seal	A	12.2	0.3	20	12.2	40	24.4	80
Tube seal with metal weather shield	B	12.2	0.3	20	12.2	40	24.4	80
Fully or partly combustible secondary seal	C	12.2	0.3	20	12.2	40	24.4	80
All metal secondary seal	D	12.2	0.3	20	12.2	40	24.4	80

Note: Where the fixed foam discharge outlets are mounted above the top of the tank shell, a foam splashboard is necessary due to the effect of winds.

### 5.3.5.3.5 Below Primary Seal or Weather Shield Method.

**5.3.5.3.5.1** Fixed foam discharge outlets located below either a mechanical shoe seal, a metal weather shield, or a metal secondary seal shall use the designs that are illustrated in Figure 5.3.5.3.5.1.

**5.3.5.3.5.2** A foam dam shall be installed if a tube seal is used and the top of the tube seal is less than 152 mm (6 in.) below the top of the pontoon.

### 5.3.5.3.6 Below-the-Seal or Weather Shield System.

**5.3.5.3.6.1** The design parameters for the application of fixed foam discharge outlets below the seal (or weather shield) to protect open-top floating roof tanks shall be in accordance with Table 5.3.5.3.6.1.

**5.3.5.3.6.2** The requirements shown in Table 5.3.5.3.6.1 shall apply to tanks containing hydrocarbons or flammable and combustible materials requiring alcohol-resistant foams.

**5.3.5.3.6.3** The required minimum application rates shown in Table 5.3.5.3.6.1 shall apply unless listings for specific products require higher application rates when Type II fixed foam discharge outlets are used.

**5.3.5.3.6.4** Below-the-seal (or shield) application shall not be used with combustible secondary seals.

### 5.3.5.4 Foam Dam Design Criteria.

**5.3.5.4.1** The foam dam shall be circular and constructed of at least No. 10 U.S. standard gauge thickness [3.4 mm (0.134 in.)] steel plate.

**5.3.5.4.2** The foam dam shall be welded or otherwise fastened to the floating roof.

**5.3.5.4.3** The foam dam shall be designed to retain foam at the seal area, at a depth to cover the seal area while causing the foam to flow laterally to the point of seal rupture.

**5.3.5.4.3.1** Dam height shall be at least 305 mm (12 in.).

**5.3.5.4.3.2** The dam shall extend at least 51 mm (2 in.) above a metal secondary seal or a combustible secondary seal using a plastic-foam log.

**5.3.5.4.3.3** Dam height shall be at least 51 mm (2 in.) higher than any burnout panels in metal secondary seals.

**5.3.5.4.4** The foam dam shall be at least 0.3 m (1 ft), but not more than 0.6 m (2 ft), from the tank shell.

**5.3.5.4.5\*** To allow drainage of rainwater, the foam dam bottom shall be slotted on the basis of 278 mm<sup>2</sup> of slot area per m<sup>2</sup> of dammed area (0.04 in.<sup>2</sup> of slot area per ft<sup>2</sup> of dammed area), restricting drain slots to a maximum 9.5 mm (3/8 in.) in height as shown in Figure 5.3.5.4.5.

### 5.3.6\* Foam Handline Design Criteria for Seal Area Protection.

**5.3.6.1** Foam handlines shall be permitted to be used from the windgirder for extinguishment of seal fires in open-top floating roof tanks.

**5.3.6.2** Listed or approved equipment shall be used.

**5.3.7 Foam Monitor Design Criteria for Seal Area Protection.** Monitors shall not be used as the primary means of floating roof seal fire extinguishment because of the difficulty of directing foam into the annular space and the possibility of sinking the roof.

**5.4\* Outdoor Covered (Internal) Floating Roof Tanks.** See Figure 5.4.


**5.4.1** Requirements for tanks equipped with the following floating roof types shall not be covered in Section 5.4:

- (1) Roofs made from floating diaphragms
- (2) Roofs made from plastic blankets
- (3) Roofs made with plastic or other flotation material, even if encapsulated in metal or fiberglass, except as permitted in 5.4.2
- (4) Roofs that rely on flotation device closures that are easily submerged if damaged
- (5) Pan roofs


**5.4.2** Seal area protection systems shall be permitted for the following types of roof construction:

- (1) Steel double deck
- (2) Steel pontoon




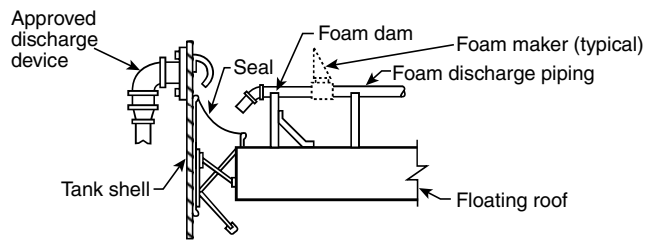


**DETAIL A — Top-of-seal application**  
Foam discharge above mechanical shoe seal

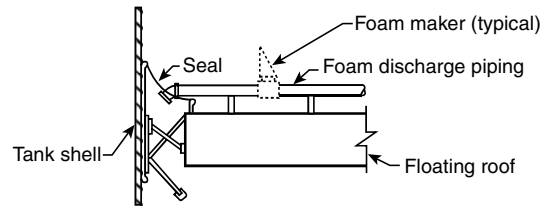


**DETAIL A — Below-the-seal application**  
Foam discharge below mechanical shoe seal — no foam dam

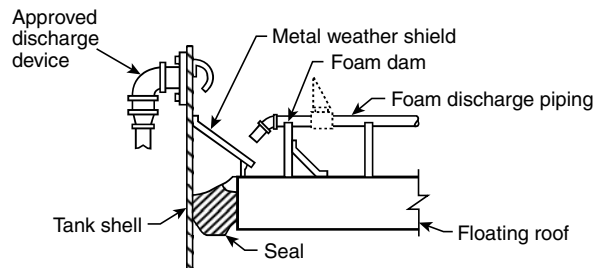


**DETAIL B — Top-of-seal application**  
Foam discharge above metal weather shield

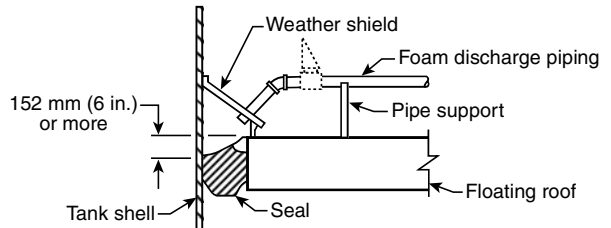


**DETAIL B — Below-the-shield application**  
Foam discharge below metal weather shield  
Top of seal 152 mm (6 in.) or more below top of floating roof

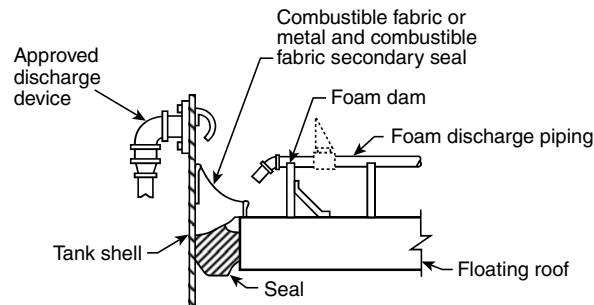


**DETAIL C — Top-of-seal application**  
Foam discharge above secondary combustible fabric seal, or metal with combustible fabric sections

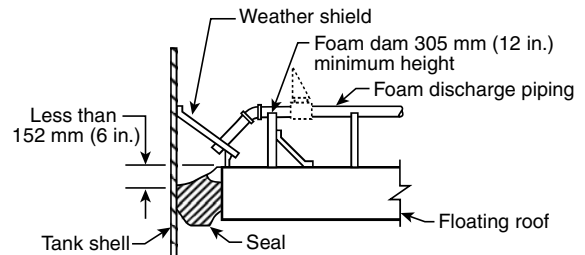

**DETAIL C — Below-the-shield application**  
Foam discharge below metal weather shield  
Top of seal less than 152 mm (6 in.) below top of floating roof

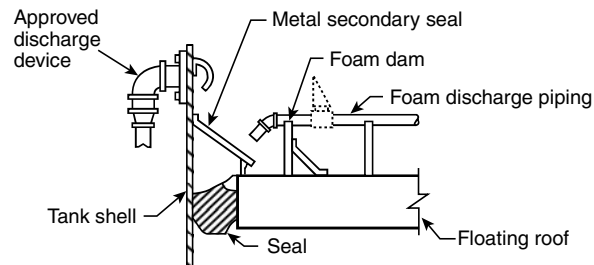

**DETAIL D — Top-of-seal application**  
Foam discharge above metal secondary seal

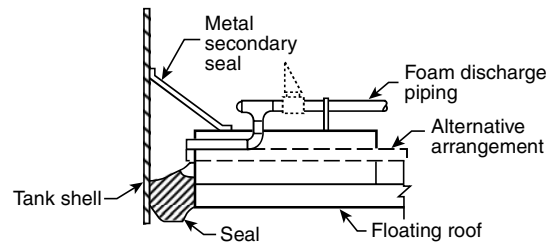

**DETAIL D — Below-the-seal application**  
Foam discharge below metal secondary seal  
This foam application method is not acceptable if secondary seal is constructed of any combustible fabric sections.  
(Refer to application above seal.)


**FIGURE 5.3.5.3.1 Typical Foam System Illustrations for Top-of-Seal Fire Protection.** Both fixed foam (wall-mounted) and roof-mounted discharge outlets are shown for illustrative purposes. Although both methods are shown, only one is needed.

**FIGURE 5.3.5.3.5.1 Typical Foam System Arrangement Illustrations for Below-the-Seal (or Shield) Application.**

**Table 5.3.5.3.6.1 Below-the-Seal Fixed Foam Discharge Protection for Open-Top Floating Roof Tanks**

Seal Type	Applicable Illustration Detail	Minimum Application Rate		Minimum Discharge Time (minutes)	Maximum Spacing Between Discharge Outlets
		L/min · m <sup>2</sup>	gpm/ft <sup>2</sup>		
Mechanical shoe seal	A	20.4	0.5	10	39 m (130 ft) — Foam dam not required
Tube seal with more than 152 mm (6 in.) between top of tube and top of pontoon	B	20.4	0.5	10	18 m (60 ft) — Foam dam not required
Tube seal with less than 152 mm (6 in.) between top of tube and top of pontoon	C	20.4	0.5	10	18 m (60 ft) — Foam dam required
Tube seal with foam discharge below metal secondary seal*	D	20.4	0.5	10	18 m (60 ft) — Foam dam not required

\*A metal secondary seal is equivalent to a foam dam.

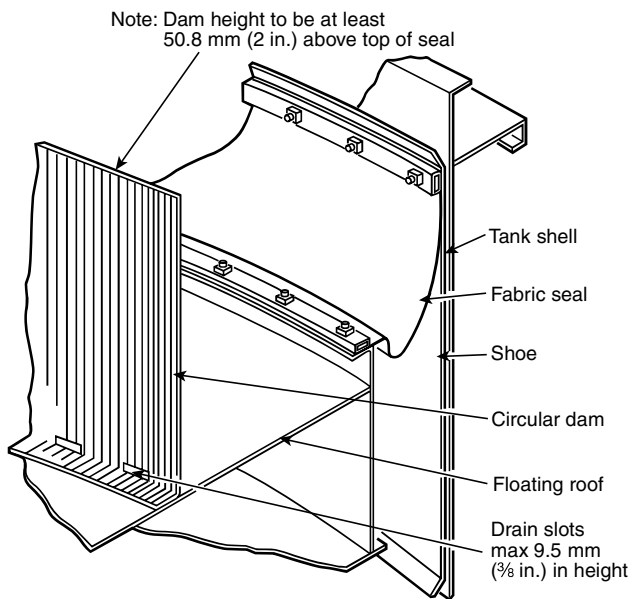

**FIGURE 5.3.5.4.5 Typical Foam Dam for Floating Roof Tank Protection.**

- (3) Full liquid surface contact, metallic sandwich panel, conforming to Appendix H, “Internal Floating Roofs,” requirements of API 650
- (4)\*Full liquid surface contact, composite sandwich roof/seal system, designed in accordance with the performance cri-

teria in Appendix H, “Internal Floating Roofs,” requirements of API 650 and the following:

- (a) Fiberglass components shall be made from high-grade vinyl ester resin with a corrosion-resistant bottom surface and be compatible with the stored product.
- (b) Top layer shall provide flame spread properties in accordance with ASTM E84 flame spread Class A rating.
- (c) The structural laminate of the composite sandwich structure shall be in accordance with ASTM C582.
- (d) Core material shall be of a closed-cell structure for inherent redundant buoyancy and shall be chemically compatible with the stored product.
- (e) The roof surfaces shall be a seamless, one-piece construction that utilizes chemical bonds to join all components.
- (f) The perimeter seal system shall be gas-tight and utilize noncombustible material to cover the rim space.

**5.4.2.1** All other types of roof construction shall require full surface protection.

**5.4.2.2 Design for Full Surface Fire.**

**5.4.2.2.1** Where the basis for design is a full surface fire, the covered (internal) floating roof tank shall be treated as equivalent to a fixed-roof (cone) tank of the same diameter for the purpose of foam system design.

**5.4.2.2.2** For a full surface fire, the foam facilities shall be designed in accordance with 5.2.5 and Section 5.9, except that separately valved laterals for each foam discharge shall not be required.

**5.4.2.2.3** For this application, fixed foam discharge outlets shall not be fitted with a frangible vapor seal device.

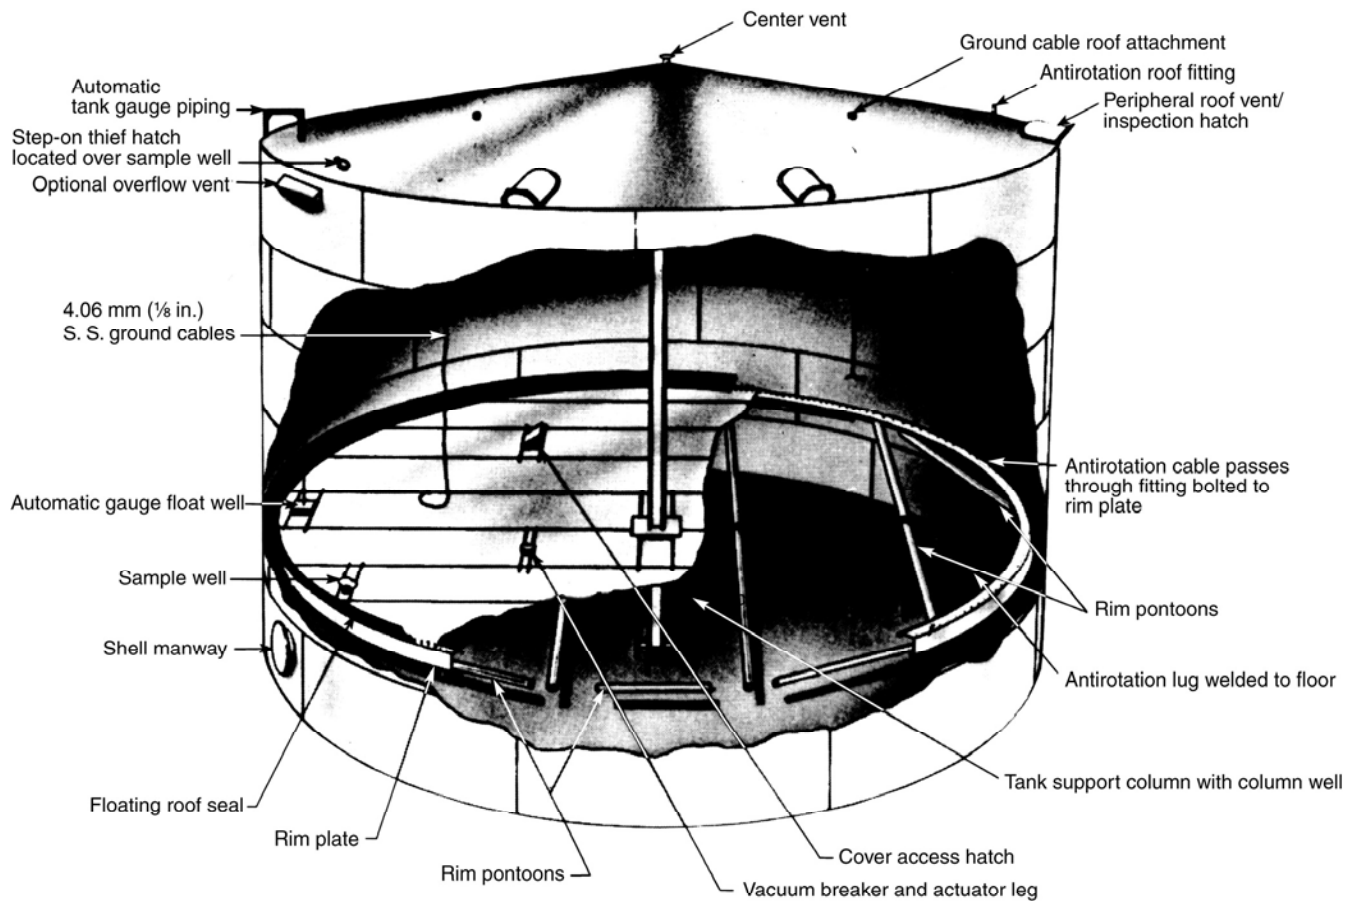


FIGURE 5.4 Typical Covered Floating Roof Tank.

5.4.2.2.4 Subsurface and semisubsurface injection shall not be used because of the possibility of improper distribution of foam.

#### 5.4.2.3 Design for Seal Area Fire.

5.4.2.3.1 Where the basis for design is a seal fire, the covered (internal) floating roof tank shall be treated as equivalent to an open-top floating roof tank of the same diameter for the purpose of foam system design.

5.4.2.3.2 For a seal fire, the foam discharge system shall be designed in accordance with the requirements specified in Table 5.3.5.3.1 utilizing fixed foam discharge outlets.

5.4.2.3.3 **Supplementary Protection.** In addition to the primary means of protection, there shall be provisions for supplementary protection in accordance with the requirements of Section 5.9.

#### 5.4.2.3.4\* Basis of Design.

5.4.2.3.4.1 System design shall be based on protecting the tank requiring the largest solution flow, including supplementary hose streams.

5.4.2.3.4.2 If the application rate is higher than the minimum rate specified in Table 5.2.6.5.1, the discharge time shall be permitted to be reduced proportionately, but shall not be less than 70 percent of the minimum discharge times specified.

### 5.5 Indoor Hazards.

5.5.1\* This section shall address foam fire-extinguishing systems, which are intended to protect indoor storage tanks that have liquid surface areas of 37.2 m<sup>2</sup> (400 ft<sup>2</sup>) or greater.

5.5.2 **Discharge Outlets.** Tanks for storing liquid hydrocarbons shall be fitted with Type II, tank-mounted fixed foam discharge outlets as specified in Table 5.2.6.2.8.

#### 5.5.3 Minimum Discharge Time and Application Rate.

5.5.3.1 The minimum application rate for indoor hydrocarbon storage tanks shall be 6.5 L/min·m<sup>2</sup> (0.16 gpm/ft<sup>2</sup>) of liquid surface area.

5.5.3.2 Minimum discharge time shall be as specified in Table 5.2.5.2.2 for Type II fixed foam discharge outlets.

5.5.3.3 If the application rate is higher than the minimum rate specified in 5.5.2, the discharge time shall be permitted to be reduced proportionately, but not to less than 70 percent of the minimum discharge times indicated.

#### 5.5.4 Design Criteria for Indoor Storage Tanks Containing Flammable or Combustible Liquids Requiring Alcohol-Resistant Foams.

5.5.4.1\* Water-soluble and certain flammable and combustible liquids and polar solvents that are destructive to nonalcohol-resistant foams shall require the use of alcohol-resistant foams.

**5.5.4.2** In all cases, the manufacturers of the foam concentrate and the foam-making equipment shall be consulted as to limitations and for recommendations based on listings or specific fire tests.

**5.6\* Loading Racks.**

**5.6.1** Within the scope of this standard, loading racks shall be defined as being either truck or rail car types for the purpose of loading or unloading product.

**5.6.2** Total rack size, flammable or combustible products involved, proximity of other hazards and exposures, drainage facilities, wind conditions, ambient temperatures, and available staff all shall be factored into the design of a loading rack foam system.

**5.6.3 Methods of Protection.** The following shall be permitted to be two methods of protecting loading racks:

- (1) Foam-water sprinkler application utilizing air-aspirating foam-water sprinklers or nozzles or non-air-aspirating standard sprinklers
- (2) Foam monitors

**5.6.4 Design Criteria for Foam-Water Sprinkler Systems.** The design criteria for sprinkler systems shall be in accordance with NFPA 16.

**5.6.5 Design Criteria for Foam Monitor Protection Systems.**

**5.6.5.1\* Areas to Be Protected by Monitor Nozzles.** Monitor nozzle system design shall be based on the total ground area.

**5.6.5.2\*** The intent of the design shall be to protect the canopy, pumps, meters, vehicles, and miscellaneous equipment associated with the loading and unloading operation in the event of a spill fire.

**5.6.5.3 Minimum Application Rates and Discharge Times.**

**5.6.5.3.1** Minimum foam application rates and discharge times for loading racks protected by monitor nozzles shall be as specified in Table 5.6.5.3.1.

**5.6.5.3.2** If a fuel depth of more than 25.4 mm (1 in.) can accumulate within the protected area, the application rate shall be increased to 6.5 L/min·m<sup>2</sup> (0.16 gpm/ft<sup>2</sup>).

**5.7\* Diked Areas — Outdoor.**

**5.7.1** For the purpose of this standard, diked areas shall be areas bounded by contours of land or physical barriers that retain a fuel to a depth greater than 25.4 mm (1 in.).

**5.7.2** Protection of these areas shall be achieved by either fixed discharge outlets, fixed or portable monitors, or foam hoses.

**5.7.3 Methods of Application.** Where foam protection is used for a diked area, it shall be permitted to be accomplished by any of the following methods:

- (1) Low-level foam discharge outlets
- (2) Foam monitors or foam hoses
- (3) Foam-water sprinklers or nozzles

**5.7.3.1** This list of methods shall not be considered as being in the order of preference.

**5.7.3.2 Minimum Application Rates and Discharge Times for Fixed Discharge Outlets on Diked Areas Involving Liquid Hydrocarbons.** The minimum application rates and discharge times for fixed foam application on diked areas shall be as specified in Table 5.7.3.2.

**5.7.3.3\* Fixed Foam Discharge Outlets.**

**5.7.3.3.1** Fixed foam discharge outlets shall be sized and located to apply foam uniformly over the dike area at the application rate specified in Table 5.7.3.2.

**5.7.3.3.2** Large dike areas shall be permitted to be subdivided to keep the total design solution within practical limits.

**5.7.3.4 Fixed Foam-Water Sprinklers or Nozzles.**

**5.7.3.4.1** Where fixed foam-water sprinklers or nozzles are used, the system design shall be in accordance with NFPA 16.

**5.7.3.4.2\*** Where foam-water sprinklers or nozzles are used as the primary protection, the design shall include the possibility that some of the foam discharge will be carried by the wind beyond the area of the fuel spill.

**5.7.3.5 Fixed Low-Level Foam Discharge Outlets.**

**5.7.3.5.1** Fixed low-level foam discharge outlets shall be permitted to be open pipe fittings or directional flow nozzles designed to discharge a compact, low-velocity foam stream onto the inner wall of the dike or, where necessary, directly onto the dike floor.

**Table 5.6.5.3.1 Minimum Application Rates and Discharge Times for Loading Racks Protected by Foam Monitor Nozzle Systems**

Foam Type	Minimum Application Rate		Minimum Discharge Time (minutes)	Product Being Loaded
	L/min · m <sup>2</sup>	gpm/ft <sup>2</sup>		
Protein and fluoroprotein	6.5	0.16	15	Hydrocarbons
AFFF, FFFP, and alcohol-resistant AFFF or FFFP	4.1	0.10	15	Hydrocarbons
Alcohol-resistant foams	Consult manufacturer for listings on specific products		15	Flammable and combustible liquids requiring alcohol-resistant foam

**Table 5.7.3.2 Minimum Application Rates and Discharge Times for Fixed Foam Application on Diked Areas Involving Hydrocarbon Liquids**

Type of Foam Discharge Outlets	Minimum Application Rate		Minimum Discharge Time (minutes)	
	L/min · m <sup>2</sup>	gpm/ft <sup>2</sup>	Class I Hydrocarbon	Class II Hydrocarbon
Low-level foam discharge outlets	4.1	0.10	30	20
Foam monitors	6.5	0.16	30	20

**5.7.3.5.2** Fixed low-level foam discharge outlets shall be located around the dike wall, and, where necessary, inside the dike area, to apply foam uniformly over the dike area.

**5.7.3.5.3\* Limitations.**

**5.7.3.5.3.1** Where fixed discharge outlets installed at a low level are used as the primary protection, they shall be located so that no point in the dike area is more than 9 m (30 ft) from a discharge outlet where the discharge per outlet is 225 L/min (60 gpm) or less.

**5.7.3.5.3.2** For outlets having discharge rates higher than 225 L/min (60 gpm), the maximum distance between discharge outlets shall be 18 m (60 ft).

**5.7.3.5.4 Foam Monitors.** Where monitors are used to discharge foam onto the dike area, they shall be located outside the dike area.

**5.7.3.5.4.1** Where foam monitors are used as the primary protection, the design shall include the possibility that some of the foam discharge will be carried by the wind beyond the area of the fuel spill.

**5.7.3.5.4.2** Where the monitor discharge is in the form of a compact, high-velocity foam stream, it shall be directed against the dike walls, tank surfaces, or other structures to prevent its plunging directly into the burning liquid surface.

**5.7.4 Diked Areas Involving Flammable or Combustible Liquids Requiring Alcohol-Resistant Foams.**

**5.7.4.1** Water-soluble and certain flammable and combustible liquids and polar solvents that are destructive to nonalcohol-resistant foams shall require the use of alcohol-resistant foams.

**5.7.4.2** Systems using these foams shall require special engineering consideration.

**5.7.4.3** The design criteria for diked areas involving flammable or combustible liquids requiring alcohol-resistant foams shall be as stated in 5.7.4.3.1 through 5.7.4.3.3.

**5.7.4.3.1** Methods of fixed protection shall be the same as those described in 5.7.3.3 for hydrocarbon hazards.

**5.7.4.3.2** Application rates shall be in accordance with manufacturer recommendations based on listings or approvals for specific products and corresponding foam-making devices.

**5.7.4.3.3** The minimum discharge time shall be 30 minutes.

**5.8\* Nondiked Spill Areas.**

**5.8.1 Design Criteria for Protection of Spill Fires Involving Hydrocarbons or Flammable and Combustible Liquids Requiring Alcohol-Resistant Foams.**

**5.8.1.1** To determine protection for spill fires, the potential spill area shall be estimated.

**5.8.1.2** Once this area has been determined, Table 5.8.1.2 shall be used to calculate requirements to be used as design criteria for portable nozzles or monitors.

**5.9\* Supplementary Protection.**

**5.9.1 Additional Protection.** In addition to the primary means of protection, some types of hazards shall require provisions for supplemental means of protection.

**5.9.2 Supplemental Foam Hose Stream Requirements.**

**5.9.2.1** Approved foam hose stream equipment shall be provided in addition to tank foam installations as supplementary protection for small spill fires.

**Table 5.8.1.2 Minimum Application Rates and Discharge Times for Nondiked Spill Fire Protection Using Portable Foam Nozzles or Monitors**

Foam Type	Minimum Application Rate		Minimum Discharge Time (minutes)	Anticipated Product Spill
	L/min · m <sup>2</sup>	gpm/ft <sup>2</sup>		
Protein and fluoroprotein	6.5	0.16	15	Hydrocarbon
AFFF, FFFP, and alcohol-resistant AFFF or FFFP	4.1	0.10	15	Hydrocarbon
Alcohol-resistant foams	Consult manufacturer for listings on specific products		15	Flammable and combustible liquids requiring alcohol-resistant foam



**5.9.2.2** The minimum number of fixed or portable hose streams required shall be as specified in Table 5.9.2.2 and shall provide protection of the area.

**Table 5.9.2.2 Supplemental Foam Hose Stream Requirements Diameter of Largest Tank**

Diameter of Largest Tank		Minimum Number of Hose Streams Required
m	ft	
Up to 19.5	Up to 65	1
19.5 to 36	65 to 120	2
Over 36	Over 120	3

**5.9.2.3** The equipment for producing each foam stream shall have a solution application rate of at least 189 L/min (50 gpm), with the minimum number of hose streams shown in Table 5.9.2.2.

**5.9.2.4** Additional foam-producing materials shall be provided to allow operation of the hose stream equipment simultaneously with tank foam installations as specified in Table 5.9.2.4.

**Table 5.9.2.4 Hose Stream Operating Times, Supplementing Tank Foam Installations**

Diameter of Largest Tank		Minimum Operating Time* (minutes)
m	ft	
Up to 10.5	Up to 35	10
10.5 to 28.5	35 to 95	20
Over 28.5	Over 95	30

\*Based on simultaneous operation of the required minimum number of hose streams discharging at a rate of 189 L/min (50 gpm).

## Chapter 6 Medium- and High-Expansion Systems

**6.1\* General Information and Requirements.** This chapter shall apply to requirements for a design of medium- and high-expansion foam systems.

### 6.2 Use and Limitations.

**6.2.1** Medium- and high-expansion foams shall be specifically evaluated to verify the applicability of medium- or high-expansion foam as a fire control agent for the type of hazard.

**6.3\* Hazards Protected.** Hazards that medium- and high-expansion foam systems shall be permitted to protect include the following:

- (1) Ordinary combustibles
- (2) Flammable and combustible liquids
- (3) Combinations of (1) and (2)
- (4) Liquefied natural gas (high-expansion foam only)

**6.3.1** Susceptibility of the protected hazard to water damage shall be evaluated.

**6.3.2\*** Medium- and high-expansion foam systems shall not be used on fires in the following hazards except where component evaluation, including tests, indicates acceptability:

- (1) Chemicals, such as cellulose nitrate, that release oxygen or other oxidizing agents to sustain combustion
- (2) Energized unenclosed electrical equipment
- (3) Water-reactive metals such as sodium, potassium, and NaK (sodium-potassium alloys)
- (4) Hazardous water-reactive materials, such as triethyl-aluminum and phosphorus pentoxide
- (5) Liquefied flammable gas

**6.4 Types of Systems.** The types of systems within the scope of this standard shall be provided as follows:

- (1) Total flooding systems
- (2) Local application systems
- (3) Portable foam-generating devices

### 6.5 Systems Protecting One or More Hazards.

**6.5.1** Systems shall be permitted to be used to protect one or more hazards or groups of hazards by means of the same supply of foam concentrate and water.

**6.5.2** Where, in the opinion of the AHJ, two or more hazards can be simultaneously involved in fire by reason of their proximity, each hazard shall be protected with an individual system, or the system shall be arranged to discharge on all potentially involved hazards simultaneously.

### 6.6\* Personnel Safety.

**6.6.1\*** Where possible, the location of foam discharge points relative to building exits shall be arranged to facilitate evacuation of personnel.

**6.6.1.1\*** To re-enter a foam-filled building, a coarse water spray shall be permitted to be used to cut a path in the foam. Personnel shall not enter the foam.

**6.6.1.2\*** A canister-type gas mask shall not be worn in the foam.

**6.6.1.2.1** If emergency reentry is essential, self-contained breathing apparatus shall be used in conjunction with a life-line.

**6.6.1.3** Unenclosed electrical apparatus shall be de-energized upon system actuation unless it has been deemed unnecessary by competent evaluation.

### 6.6.2\* Electrical Clearances.

**6.6.2.1** All system components shall be located to maintain minimum clearances from live parts as shown in Table 6.6.2.1.

**6.6.2.2** The clearances given are for altitudes of 1000 m (3281 ft) or less.

**6.6.2.2.1\*** At altitudes in excess of 1000 m (3281 ft), the clearance shall be increased at the rate of 1 percent for each 100 m (328 ft) increase in altitude above 1000 m (3281 ft).

**6.6.2.2.2** To coordinate the required clearance with the electrical design, the design BIL of the equipment being protected shall be used as a basis, although this is not material at nominal line voltages of 161 kV or less.

**6.6.2.2.3** At voltages higher than 161 kV, uniformity in the relationship between design BIL kV and the various electrical system voltages has not been established in practice and is dependent on several variables; thus, the required clearances to ground shall be based on the design BIL used rather than on the nominal line or ground voltage.

**Table 6.6.2.1 Clearance from Medium- and High-Expansion Foam Equipment to Live Uninsulated Electrical Components**

Nominal Line Voltage (kV)	Nominal Voltage to Ground (kV)	Design BIL* (kV)	Minimum Clearance	
			mm	in.
To 15	To 9	110	178	7
23	13	150	254	10
34.5	20	200	330	13
46	27	250	432	17
69	40	350	635	25
115	66	550	940	37
138	80	650	1118	44
161	93	750	1321	52
196-230	114-132	900	1600	63
		1050	1930	76
		1175	2210	87
		1300	2489	98
287-380	166-220	1425	2769	109
		1550	3048	120
500	290	1675	3327	131
		1800	3607	142
		1925	3886	153
		2100	4267	168
500-700	290-400	2300	4674	184

\*Basic insulation level (BIL) values are expressed as kilovolts (kV), the number being the crest value of the full wave impulse test that the electrical equipment is designed to withstand.

**6.6.2.2.4** The clearance between uninsulated energized parts of the electrical system equipment and any portion of the medium- or high-expansion foam system shall not be less than the minimum clearance provided elsewhere for electrical system insulations on any individual component.

## 6.7 Operation and Control of Systems.

### 6.7.1\* Detection of Fires.

**6.7.1.1** Automatic detection shall be used for fixed systems.

**6.7.1.1.1\*** Removal of automatic detection shall be permitted when approved by the AHJ.

**6.7.1.2\*** Automatic detection shall be by listed or approved methods or devices capable of detection and indicating heat, smoke, or flame. Automatic detection devices shall be installed in accordance with *NFPA 72*.

**6.7.1.3** Detection by the use of combustible vapor detectors or an abnormal condition in the hazard, such as process trouble, shall be arranged using approved industrial practices as specified by an engineering study.

**6.7.1.4\*** A reliable source of energy shall be used in detection systems.

**6.7.1.4.1** The power supply for electrical detection systems shall be independent of the supply for the protected area.

**6.7.1.4.2** Arrangement of the power supply shall be in accordance with requirements of *NFPA 72* for continuity of power supplies.

**6.7.2 Supervision.** Supervision of automatic detection and actuation equipment shall be provided and arranged so that

there will be an immediate indication of failure, preferably at a constantly attended location.

### 6.7.3 Alarms.

**6.7.3.1** Audible alarms shall be installed to indicate the operation of the system, to alert personnel, and to indicate failure of any supervised device or equipment.

**6.7.3.2** Such devices shall be of such a type and shall be provided in such numbers and at such locations as are necessary to accomplish their purpose satisfactorily.

**6.7.3.3** An alarm shall be provided to show that the system has operated.

**6.7.3.4** Alarms shall be provided to give ample warning of discharge where hazard(s) to personnel exist.

**6.7.3.5** Alarms indicating failure of supervised devices or equipment shall give prompt and positive indication of any failure and shall be distinctive from alarms indicating operation or hazardous conditions.

### 6.7.4\* Operating Devices.

**6.7.4.1** Operating devices shall include foam generators, valves, proportioners, eductors, discharge controls, and shutdown equipment.

**6.7.4.1.1** Operation shall be controlled by listed or approved mechanical, electrical, hydraulic, or pneumatic means.

**6.7.4.1.2** A reliable source of energy shall be used.

**6.7.4.1.3** The electrical power supply for an electrically operated medium- or high-expansion foam system shall be as reliable as a fire pump circuit in accordance with *NFPA 20*.

**6.7.4.2** All operating devices shall be approved for the service they will encounter and shall not be rendered inoperative or susceptible to accidental operation.

**6.7.4.2.1** Provision shall be made to protect piping that is normally filled with liquid from freezing.

**6.7.4.3** All devices shall be located, installed, or suitably protected so that they are not subject to mechanical, chemical, climatic, or other conditions that will render them inoperative.

**6.7.4.4** Manual controls for actuation and shutdown shall be conveniently located and accessible at all times, including the time of fire and system operation.

**6.7.4.4.1** Remote control stations for manual actuation shall be considered where the area is large, where egress is difficult, or where required by the AHJ.

**6.7.4.4.2** Manual controls for actuation shall operate the system to the same extent as the automatic control.

**6.7.4.5** All automatically operated equipment controlling the generation and distribution of foam shall be provided with approved independent means for emergency manual operation.

**6.7.4.5.1** If the means for manual actuation of the system required in 6.7.1 provide approved positive operation independent of the automatic actuation, it shall be permitted to be used as the emergency means.

**6.7.4.5.2** The emergency means, preferably mechanical, shall be accessible and located close to the equipment controlled.



**6.7.4.5.3** If possible, the system shall be designed so that complete emergency actuation shall be permitted to be accomplished from one location.

**6.7.4.6** All required door and window closers, vent openers, and electrical equipment shutdown devices shall be considered integral parts of the system and shall function simultaneously with the system operation.

**6.7.4.7** All manual operating devices shall be identified with signs as to the hazards they protect.

## **6.8 Foam Concentrate.**

### **6.8.1 Quality.** (*See Annex G.*)

**6.8.1.1** The foam concentrate used in the system shall be listed for use with the equipment.

**6.8.1.2** The quality of the concentrate for performance under the installation requirements of this standard shall be determined by tests.

### **6.9 Air Supply.**

**6.9.1** Air from outside the hazard area shall be used for foam generation unless data is provided to show that air from inside the hazard can be successfully employed.

**6.9.2** The data shall be specific for the products of combustion to be encountered and shall provide factors for increasing foam discharge rates over those given in 6.12.8 if fire tests indicate that need.

**6.9.3** Vents from the fire area shall be located to prevent recirculation of combustion products or other materials deleterious to the formation of foam into foam generator air inlets.

### **6.10 Foam-Generating Apparatus Location.**

**6.10.1 Accessibility for Inspection and Maintenance.** Foam-generating apparatus shall be located and arranged so that inspection, testing, recharging, and other maintenance is facilitated and interruption of protection is held to a minimum.

#### **6.10.2\* Protection Against Exposure.**

**6.10.2.1** Foam-generating equipment shall be located as close as possible to the hazard(s) it protects, but not where it will be unduly exposed to a fire or explosion.

**6.10.2.2** Foam generators installed inside the hazard area shall be listed to resist or be protected against fire exposure for the duration of the fire.

**6.10.2.3** Such protection shall be permitted to be in the form of insulation, water spray or sprinklers, or other method as determined by an engineering study.

**6.10.2.4** In certain applications, additional generators shall be permitted to be substituted for fire exposure protection based on results of fire tests.

### **6.11 Distribution Systems.**

**6.11.1 Piping and Fittings.** Piping and fittings shall conform to the requirements of Chapter 4.

#### **6.11.2 Arrangement and Installation of Piping and Fittings.**

**6.11.2.1** A listed strainer for use with the proportioner and foam generator shall be provided in the water line upstream of the water valve.

**6.11.2.2** Supplemental strainers shall be permitted to be used as recommended by the foam equipment manufacturer.

### **6.11.3 Ducts.**

**6.11.3.1** Foam distribution and air inlet ducts shall be designed, located, installed, and suitably protected so that they are not subject to undue mechanical, chemical, or other damage.

**6.11.3.2** Duct closures such as selector valves, gates, or doors shall be of the quick-opening type, so as to allow free passage of the foam.

**6.11.3.2.1** When duct closures are located where they are subjected to fire or heat exposure, either inside or outside the area to be protected, special care shall be taken to ensure positive operation.

**6.11.3.3** Ducts shall be designed and installed so that undue turbulence is avoided, and the actual foam discharge rate shall be determined by test or other method acceptable to the AHJ.

### **6.12 Total Flooding Systems General Information.**

**6.12.1 Description.** A total flooding system shall consist of fixed foam-generating apparatus complete with a piped supply of foam concentrate and water, arranged to discharge into an enclosed space or enclosure around the hazard.

**6.12.2\* Applications.** Total flooding systems shall be permitted to be used where a permanent enclosure is provided around the hazard to enable the required amount of fire-extinguishing medium to accumulate at the proper depth and to be maintained for a period of time required to ensure fire control or extinguishment in a specific combustible material.

#### **6.12.3 General Requirements.**

**6.12.3.1** Total flooding systems shall be designed, installed, tested, and maintained in accordance with the applicable requirements of this standard.

**6.12.3.2** Only listed or approved equipment and devices shall be used in these systems.

#### **6.12.4 Total Flooding Enclosure Specifications.**

##### **6.12.4.1\* Leakage.**

**6.12.4.1.1 Openings.** Openings below design filling depth, such as doorways and windows, shall be arranged to close automatically before, or simultaneously with, the start of the foam discharge, with due consideration for evacuation of personnel.

**6.12.4.1.1.1** Openings shall be designed to maintain closure during a fire and shall be capable of withstanding pressures of foam and sprinkler water discharge.

**6.12.4.1.1.2** Where openings cannot be protected by automatic closing devices, the total flooding system shall be designed to compensate for the probable loss of foam.

(A) The system design shall be tested to ensure proper performance.

(B) If the foam system is permitted to start prior to complete closure of the space to be filled, additional foam output shall be allowed to compensate for the losses.

(C) This shall be verified by test based on the individual site conditions.

##### **6.12.4.1.2 Ventilation.**

**6.12.4.1.2.1** Where outside air is used for foam generation, high-level venting shall be provided for air that is displaced by the foam.

**6.12.4.1.2.2** Venting velocity shall not exceed 305 m/min (1000 ft/min) in free air.

**6.12.4.1.2.3** The required venting shall consist of openings, either normally open or normally closed and arranged to open automatically when the system operates.

**6.12.4.1.2.4** Where design criteria demand exhaust fans, they shall be approved for high-temperature operation and installed with consideration for protection of switches, wiring, and other electrical devices to ensure equal reliability of exhaust fan performance. Operation of the fans shall not compromise foam generator operations.

**6.12.4.1.2.5** Where forced-air ventilating systems interfere with the proper buildup of foam, they shall be automatically shut down or closed.

### 6.12.5 Foam Requirements.

**6.12.5.1 General.** Total flooding medium- or high-expansion foam shall be discharged at a rate required to fill the enclosure to a depth above the hazard before an unacceptable degree of damage occurs.

#### 6.12.5.2 Foam Depth.

##### 6.12.5.2.1 High-Expansion Foam.

**6.12.5.2.1.1** The minimum total depth of foam shall be not less than 1.1 times the height of the highest hazard but in no case less than 0.6 m (2 ft) over this hazard.

**6.12.5.2.1.2** For flammable or combustible liquids, the required depth over the hazard shall be permitted to be considerably greater than the requirement of 6.12.5.2.1.1 and shall be no less than the depth determined by tests. Tests shall duplicate the anticipated fire event in the protected area.

##### 6.12.5.2.2 Medium-Expansion Foam.

**6.12.5.2.2.1** Required depth over the hazard shall vary with expansion.

**6.12.5.2.2.2** Depth shall be determined by tests. (See 6.12.6.3 and Annex G.)

### 6.12.6 Submergence Volume for High-Expansion Foams.

**6.12.6.1** Submergence volume for sprinkler protected areas shall be defined as the depth as specified in 6.12.5.2.2.2 multiplied by the floor area of the space to be protected in accordance with 6.12.3.

**6.12.6.2** Submergence volume for unsprinklered rooms of combustible construction or finish shall be based on the entire volume, including concealed spaces.

**6.12.6.3** The volume occupied by vessels, machinery, or other permanently located equipment shall be permitted to be deducted when determining the submergence volume.

**6.12.6.4** The volume occupied by stored material shall not be deducted when determining the submergence volume.

### 6.12.7 Submergence Time for High-Expansion Foams.

**6.12.7.1\*** Recommended times to achieve submergence volume for various types of hazards and building construction shall be as shown in Table 6.12.7.1 and in accordance with NFPA 220, Table 4.1.1.

**6.12.7.2** Shorter submergence times shall be permitted to be required depending on the factors included in 6.12.8.

**6.12.7.3** The submergence time shall be based on a maximum of 30 seconds delay between fire detection and start of foam discharge.

**6.12.7.4** Any delays in excess of 30 seconds shall be deducted from the submergence times in Table 6.12.7.1.

**6.12.7.5** Where use of high-expansion foam on polar solvents is contemplated, the foam equipment supplier shall substantiate suitability for the intended use.

### 6.12.8\* Rate of Discharge.

**6.12.8.1 Medium-Expansion Foam.** The rate of discharge for medium-expansion foam shall be determined by tests.

#### 6.12.8.2 High-Expansion Foam.

**6.12.8.2.1\*** The rate of foam discharge necessary for extinguishment or control to permit overhaul shall be dependent on the strength of sprinkler protection, the nature and configuration of the hazard, the vulnerability of the structure and contents to fire, and the loss potential to life, property, and production.

**6.12.8.2.2** The foam discharge rate shall meet the foam depth requirements and submergence times of Table 6.12.7.1, with compensation for normal foam shrinkage, foam leakage, and breakdown effects of sprinkler discharge.

#### 6.12.8.2.3 Calculation.

**6.12.8.2.3.1\*** The minimum rate of discharge or total generator capacity shall be calculated from the following formula:

$$R = \left( \frac{V}{T} + R_S \right) \times C_N \times C_L \quad [6.12.8.2.3.1]$$

where:

$R$  = rate of discharge in m<sup>3</sup>/min (ft<sup>3</sup>/min)

$V$  = submergence volume in m<sup>3</sup> (ft<sup>3</sup>)

$T$  = submergence time in minutes

$R_S$  = rate of foam breakdown by sprinklers in m<sup>3</sup>/min (ft<sup>3</sup>/min)

$C_N$  = compensation for normal foam shrinkage

$C_L$  = compensation for leakage

**6.12.8.2.3.2\*** The factor ( $R_S$ ) for compensation for breakdown by sprinkler discharge shall be determined either by test or, in the absence of specific test data, by the following formula:

$$R_S = S \times Q \quad [6.12.8.2.3.2]$$

where:

$S$  = foam breakdown in m<sup>3</sup>/min · L/min (ft<sup>3</sup>/min · gpm) of sprinkler discharge.

$S$  shall be 0.0748 m<sup>3</sup>/min · L/min (10 ft<sup>3</sup>/min · gpm)

$Q$  = estimated total discharge from maximum number of sprinklers expected to operate in L/min (gpm)

**6.12.8.2.3.3** The factor ( $C_N$ ) for compensation for normal foam shrinkage shall be 1.15, which is an empirical factor based on average reduction in foam quantity from solution drainage, fire, wetting of surfaces, absorbency of stock, and so forth.

**6.12.8.2.3.4\*** The factor ( $C_L$ ) for compensation for loss of foam due to leakage around doors and windows and through unclosable openings shall be determined by the design engineer after evaluation of the structure. This factor shall not be



**Table 6.12.7.1 Maximum Submergence Time for High-Expansion Foam Measured from Start of Foam Discharge in Minutes**

Hazard	Construction Type			
	Type II (000), Type III (200), Type V (000)		Type I (all), Type II (222, 111), Type IV (2HH), Type V (111)	
	Sprinklered	Not Sprinklered	Sprinklered	Not Sprinklered
Flammable liquids [flash points below 38°C (100°F)] having a vapor pressure not exceeding 276 kPa (40 psia)	3	2	5	3
Combustible liquids [flash points of 38°C (100°F) and above]*	4	3	5	3
Low-density combustibles (i.e., foam rubber, foam plastics, rolled tissue, or crepe paper)	4	3 <sup>†</sup>	6	4 <sup>†</sup>
High-density combustibles (i.e., rolled paper kraft or coated banded)	7	5 <sup>†</sup>	8	6 <sup>†</sup>
High-density combustibles (i.e., rolled paper kraft or coated unbanded)	5	4 <sup>†</sup>	6	5 <sup>†</sup>
Rubber tires	7	5 <sup>†</sup>	8	6 <sup>†</sup>
Combustibles in cartons, bags, or fiber drums	7	5 <sup>†</sup>	8	6 <sup>†</sup>

\*Polar solvents are not included in this table. Flammable liquids having boiling points lower than 38°C (100°F) might require higher application rates. See NFPA 30.

<sup>†</sup>These submergence times might not be directly applicable to storage piled above 4.6 m (15 ft) or where fire spread through combustible contents is very rapid.

permitted to be less than 1.0 even for a structure completely tight below the design filling depth. This factor shall be permitted to be as high as 1.2 for a building with all openings normally closed, depending on foam expansion ratio, sprinkler operation, and foam depth.

#### 6.12.9 Quantity.

**6.12.9.1** High-expansion foam concentrate and water shall be provided to permit continuous operation of the entire system for 25 minutes or to generate four times the submergence volume, whichever is less, but in no case less than enough for 15 minutes of full operation.

**6.12.9.2** The quantity for medium-expansion foam shall be determined by tests developed by an independent testing laboratory.

**6.12.9.3** Reserve supplies shall be provided in accordance with 6.12.9.

#### 6.12.10\* Maintenance of Submergence Volume for High-Expansion Foam.

**6.12.10.1** To ensure control or extinguishment, the submergence volume shall be maintained for at least 60 minutes for unsprinklered locations and 30 minutes for sprinklered locations.

**6.12.10.2** Where the hazard consists of flammable or combustible liquids in noncombustible containers, the time in 6.12.10.1 shall be permitted to be reduced.

#### 6.12.10.3 Method.

**6.12.10.3.1** The submergence volume shall be permitted to be maintained by continuous or intermittent operation of any or all of the generators provided.

**6.12.10.3.2\*** Arrangements and procedures shall be provided to maintain the submergence volume without waste of foam concentrate.

**6.12.10.4\* Overhaul.** Overhaul procedures shall be preplanned to prevent loss of control by submergence of the hazard.

**6.12.10.5 Distribution.** The medium- and high-expansion foam generators shall be located such that a relatively even buildup of foam will take place throughout the protected area during the discharge period.

### 6.13 Local Application Systems.

#### 6.13.1 General Information.

**6.13.1.1 Description.** A local application system shall consist of fixed foam-generating apparatus complete with a piped supply of foam concentrate and water that is arranged to discharge foam directly onto a fire or spill hazard.

#### 6.13.1.2\* Uses.

**6.13.1.2.1** Local application systems shall be permitted to be used for the extinguishment or control of fires in flammable or combustible liquids, liquefied natural gas (LNG), and ordinary Class A combustibles where the hazard is not totally enclosed.

**6.13.1.2.2** For multiple-level or three-dimensional fire hazards where total building flooding is impractical, the individual hazard shall be provided with containment facilities.

#### 6.13.2 General Requirements.

**6.13.2.1** Local application systems shall be designed, installed, tested, and maintained in accordance with the applicable requirements in this standard.

**6.13.2.2** Only listed or approved equipment, devices, and agents shall be used in these systems.

### **6.13.3 Hazard Specifications.**

**6.13.3.1 Extent of Hazard.** The hazard shall include all areas to or from which fire shall spread.

#### **6.13.3.2\* Location of Hazard.**

**6.13.3.2.1** Local application medium- and high-expansion foam systems shall be permitted to be used to protect hazards located indoors, under partial shelter, or completely outdoors.

**6.13.3.2.2** Provisions shall be made to compensate for winds and other effects of weather.

#### **6.13.3.3 Foam Requirements for Flammable and Combustible Liquids and Solids.**

**6.13.3.3.1 General.** Foam shall be discharged at a rate to cover the hazard to a depth of at least 0.6 m (2 ft) within 2 minutes.

##### **6.13.3.3.2 Quantity.**

**6.13.3.3.2.1** Foam concentrate and water shall be provided to permit continuous operation of the entire system for at least 12 minutes.

**6.13.3.3.2.2** Reserve supplies shall be provided in accordance with 6.12.9.

##### **6.13.3.3.3 Arrangement.**

**6.13.3.3.3.1** Discharge outlets shall be arranged to ensure that foam is delivered over all areas that constitute the hazard.

**6.13.3.3.3.2** Where parts of the hazard are elevated or raised up from the ground or floor line, the arrangement of the system shall be such that foam will be delivered to, and retained on, such parts in the required depth to ensure prompt and final extinguishment.

### **6.14\* Foam Applications for Liquefied Natural Gas (LNG).**

#### **6.14.1\* System Design Considerations.**

**6.14.1.1** The determination of the high-expansion foam system design shall depend on an analysis specific to the individual site.

**6.14.1.2** The analysis shall include effects of heat exposure on adjacent plant equipment.

**6.14.1.3** Automatic alarms and actuation shall be required for fixed systems.

**6.14.1.3.1** Where an engineering study shows that automatic protection is not required, the system shall be permitted to be activated manually.

#### **6.14.2\* Foam Discharge Rate per Unit Area.**

**6.14.2.1** The discharge rate per unit area shall be established by tests and shall be able to achieve a positive and progressive reduction in radiation within the time limitations established in the analysis.

**6.14.2.2** The discharge rate per unit area determined by the test in Section G.4 shall be increased by the necessary factor to account for the initial vaporization rate and the configuration of the hazard.

**6.14.2.3** After steady-state control conditions have been reached, the discharge rate per unit area established in the test for maintenance of fire control shall be used to maintain control.

#### **6.14.3 Quantity.**

**6.14.3.1** The initial quantity of foam concentrate shall permit a continuous application at the initial design rate for fire control to reach steady-state conditions.

**6.14.3.2** Additional foam concentrate supplies shall be on hand to provide control maintenance for the calculated fire duration.

**6.14.3.3\* Foam System Arrangement.** The foam system shall have foam outlets arranged to supply foam to cover the design fire area within the specified time.

### **6.15 Portable Foam-Generating Devices.**

#### **6.15.1 General Information.**

##### **6.15.1.1 Description.**

**6.15.1.1.1** Portable foam-generating devices consist of a foam generator, manually operable and transportable, connected by means of hose, or piping and hose, to a supply of water and foam concentrate.

**6.15.1.1.2** The proportioning equipment shall be integral to or separate from the foam generator.

**6.15.1.1.3** A separate foam concentrate supply shall be permitted to be provided for each unit, or solution shall be permitted to be piped from central proportioning equipment.

##### **6.15.1.2 General Requirements.**

**6.15.1.2.1** Portable foam-generating devices and associated equipment shall be used and maintained in accordance with the applicable requirements in this standard.

**6.15.1.2.2** Only listed or approved equipment and devices shall be used.

**6.15.2 Hazard Specifications.** Portable foam-generating devices shall be permitted to be used to combat fires in all hazards covered in this chapter.

#### **6.15.3 Location and Spacing.**

**6.15.3.1** Portable foam-generating devices that are preconnected to a water or solution supply shall be placed where they are accessible and shall have enough hose to reach the most distant hazard they are expected to protect.

**6.15.3.2** Foam concentrate shall be accessible for immediate use.

**6.15.3.3** Portable foam generators shall be located such that they are not exposed to the hazard.

**6.15.3.4** When portable foam generators are not preconnected to a water or solution supply, their associated equipment shall be located and arranged for immediate transport to all designated hazards.

#### **6.15.4 Foam Requirements.**

##### **6.15.4.1 Rate and Duration of Discharge.**

**6.15.4.1.1** The rate and duration of discharge, and consequently the quantity of foam concentrate and water, shall be determined by the type and potential size of hazard.



**6.15.4.1.2** To the extent that the specific hazards are identified, the applicable requirements of this chapter shall apply.

**6.15.4.1.3 Simultaneous Use of Portable Foam-Generating Devices.** Where simultaneous use of two or more devices is possible, supplies of foam concentrate and water shall be accessible to supply the maximum number of devices that are physically possible to be used at any one time.

### **6.15.5 Equipment Specifications.**

#### **6.15.5.1 Hose.**

**6.15.5.1.1** Hose used to connect the generator to the water or solution supplies shall be listed lined hose meeting requirements of NFPA 1961.

**6.15.5.1.2** The hose size and length shall be selected with consideration to the hydraulics of the entire system.

**6.15.5.1.3** Hose shall be stored in an arrangement that will permit immediate use and shall be protected against the weather.

#### **6.15.5.2 Electric Power Supply and Connections.**

**6.15.5.2.1** Power supply and connections needed for operation of the generator shall be capable of transmitting the required power and shall be selected for the intended use.

**6.15.5.2.2** All power cables shall be sufficiently rugged to withstand abuse in service, shall be impervious to water, and shall contain a ground wire.

**6.15.5.2.3** Electrical connectors shall be waterproof.

**6.15.6\* Training.** All personnel shall be properly trained in the operation of portable foam-generating equipment and in the necessary fire-fighting techniques.

## **Chapter 7 Compressed Air Foam Systems**

### **7.1 General.**

**7.1.1** This chapter shall provide requirements for the correct use of compressed air foam system components.

**7.1.2** All components shall be listed for their intended use.

**7.1.2.1** Where listings for components do not exist, components shall be approved.

### **7.2 Water Supplies.**

#### **7.2.1 Quality.**

**7.2.1.1** The water supply to compressed air foam systems shall be permitted to be hard or soft, fresh or salt, but shall be of a quality so that adverse effects on foam formation or foam stability do not occur.

**7.2.1.2** No corrosion inhibitors, emulsion breaking chemicals, or any other additives shall be present without prior consultation with the foam concentrate supplier.

#### **7.2.2 Quantity.**

**7.2.2.1** The water supply shall be of a quantity to supply all the discharge devices and compressed air foam hoses that shall be permitted to be used simultaneously for the specified time.

**7.2.2.2** This quantity of water shall include not only the volume required for the compressed air foam apparatus but also

water that shall be permitted to be used in other fire-fighting operations, in addition to the normal plant requirements.

**7.2.3 Pressure.** The pressure available at the inlet to the compressed air foam system under required flow conditions shall be at least the minimum pressure for which the system has been designed.

**7.2.4 Temperature.** Water temperatures shall be between 4°C (40°F) and 37.8°C (100°F).

**7.2.5 Design.** The water system shall be designed and installed in accordance with NFPA 24.

**7.2.6 Storage.** Water supply shall be protected against freezing in climates where freezing temperatures are expected.

### **7.3 Foam Concentrate.**

#### **7.3.1 Quality.**

**7.3.1.1** Foam concentrate shall be listed.

**7.3.1.2** The foam concentrate used in a compressed air foam system shall be that listed for use with the equipment.

**7.3.1.2.1** The performance of the system shall be dependent on the composition of the foam concentrate as listed with associated fuels and protection storage arrangement (consult applicable standard for storage arrangement protection).

**7.3.1.2.2** The quality of the concentrate for proper performance under the installation requirements of this standard shall be determined by suitable tests.

**7.3.2 Quantity.** The amount of foam concentrate in the system shall be at least sufficient for the largest single hazard protected, or a group of hazards that are to be protected simultaneously.

#### **7.3.3 Storage Tanks.**

**7.3.3.1** Storage tanks shall be of corrosion-resisting materials and construction compatible with the foam concentrate.

**7.3.3.1.1** Consideration shall be given to design of the storage tanks to minimize evaporation of concentrate.

**7.3.3.2** Markings shall be provided on storage tanks to identify the type of concentrate and its intended concentration in solution.

**7.3.4 Storage Conditions.** Foam concentrate shall be stored within the listed temperature limitations.

#### **7.3.5 Reserve Supply of Foam Concentrate.**

**7.3.5.1** A reserve supply of foam concentrate sufficient to meet system design requirements shall be provided in order to put the system back into service after operation.

**7.3.5.2** The reserve supply shall be in separate tanks or compartments, in drums or cans on the premises, or available from an approved outside source within 24 hours.

#### **7.3.6 Compatibility of Foam Concentrate.**

**7.3.6.1** Different types of foam concentrates shall not be mixed for storage.

**7.3.6.2** Different brands of the same type of concentrate shall not be mixed unless data are provided by the manufacturer to prove that they are compatible and are accepted by the AHJ.

## 7.4 Air or Nitrogen Supply.

### 7.4.1 Quantity.

**7.4.1.1 Primary Supply.** The amount of air or nitrogen shall be at least sufficient for the largest single hazard protected, or a group of hazards that are to be protected simultaneously.

**7.4.1.2 Reserve Supply.** A reserve supply of air or nitrogen sufficient to meet system design requirements shall be provided in order to put the system back into service after operation or available from an approved outside source within 24 hours.

### 7.4.2 Storage Containers.

**7.4.2.1** Storage containers shall be listed.

**7.4.2.2** Pressurized storage containers shall be designed to comply with all transportation requirements from the point of origin to the destination.

**7.4.2.2.1** Containers shall be designed, fabricated, inspected, certified, and stamped in accordance with Section VIII of ASME *Boiler and Pressure Vessel Code*.

**7.4.2.3** Pressurized storage containers shall not be located where they are subject to severe weather conditions or to mechanical, chemical, or other damage.

**7.4.2.4** Each pressurized storage container shall be provided with a releasing device.

**7.4.3 Supervision.** Air or nitrogen pressure shall be supervised for high and low pressure.

**7.4.4 Regulators.** Regulators controlling the air or nitrogen pressure for compressed air foam systems shall be listed for the intended purpose.

**7.4.5 Plant Air.** Plant air shall be permitted to be utilized where the facility has an air supply that complies with the requirements of a dedicated main and reserve air supply, including the quality, quantity, pressure, and reliability requirements of the listing, and shall be subject to the approval of the AHJ.

**7.4.6 Air Compressor.** Air compressors used as a dedicated source of air supply shall be listed for use on fire protection systems.

**7.5 Compressed Air Foam-Generating Method.** The method used to generate compressed air foam shall be listed.

### 7.6 Distribution Systems.

**7.6.1 Piping.** Pipe shall be in accordance with 4.7.2.3.

**7.6.2 Fittings.** All pipe fittings shall be in accordance with 4.7.3.

### 7.7 Compressed Air Foam Discharge Devices.

**7.7.1** Compressed air foam discharge devices shall be listed for the intended purpose.

**7.7.2** Discharge devices shall be located and installed so that they are not subject to mechanical, chemical, climatic, or other conditions that would render them inoperative.

### 7.8 Operation and Control of Systems.

**7.8.1** Operation and control of systems shall be in accordance with Section 4.9.

### 7.9 System Types.

**7.9.1** Compressed air foam systems conforming to this chapter shall be fixed deluge-type or fixed spray-type systems,

wherein compressed air foam shall discharge simultaneously from all nozzles upon system activation.

**7.9.2** The system shall be permitted to be designed to protect a single zone or multiple zones.

### 7.10 Limitations.

**7.10.1** Compressed air foam systems shall be designed and installed in accordance with their listing for the specific hazards and protection objectives specified in the listing.

**7.10.2** These limitations are described in the manufacturer's listed design manual, which shall be part of the listing of the system.

**7.11 System Design.** The system shall be designed in accordance with the manufacturer's design manual, which shall be part of the listing.

**7.12 Installation of Piping and Fittings.** Piping for compressed air foam systems shall be installed in accordance with NFPA 13.

**7.13 Installation of Automatic Detection.** Automatic detection devices shall be installed in accordance with NFPA 72.

### 7.14 CAFS Discharge Device Choice and Location.

**7.14.1** Discharge devices shall be of the type listed for the intended purpose.

**7.14.2** Discharge devices shall be located in accordance with listing limitations on spacing, floor coverage, and alignment.

**7.15 Discharge Density.** The design discharge density shall be in accordance with the applicable occupancy standards and in accordance with the manufacturer's listing but in no case less than 1.63 L/min · m<sup>2</sup> (0.04 gpm/ft<sup>2</sup>) for hydrocarbon fuel applications and 2.3 L/min · m<sup>2</sup> (0.06 gpm/ft<sup>2</sup>) for alcohol and ketone applications.

**7.15.1** Where fixed spray-type systems are used to protect three-dimensional equipment, the minimum density shall be applied over the projected area of rectangular prism envelope for the equipment and its appurtenances.

### 7.16 Discharge Duration.

**7.16.1** The system shall be designed to discharge compressed air foam for a minimum period of 10 minutes over the entire area for deluge-type systems and a minimum of 5 minutes for fixed spray-type systems and shall be in accordance with the manufacturer's listing.

**7.16.2** Back-up fire sprinkler protection shall be permitted to be applied as required by the AHJ.

### 7.17 System Flow Calculation.

**7.17.1 General.** Compressed air foam flow involves a mixture of both hydraulic and pneumatic elements, which shall be addressed together in the system design to preserve the foam bubble structure until foam is discharged on a hazard.

**7.17.2** System flow calculations shall be performed using a calculation method for compressed air foam within the limitations of the manufacturer's design manual.

**7.17.3** Compressed air foam piping lengths and configurations of fittings and nozzles shall be in accordance with the manufacturer's listed limitations.

**7.18 Plans and Specifications.** Plans and specifications shall be in accordance with Chapter 8.

**7.19 Testing and Acceptance.** Compressed air foam systems shall be tested in accordance with Chapter 11.

**7.20 Maintenance.** Compressed air foam systems shall be maintained in accordance with Chapter 12.

## Chapter 8 Specifications and Plans

**8.1\* Approval of Plans.** Plans shall be submitted to the AHJ for approval before installation or modification to an existing system.

**8.2 Specifications.** Specifications for foam systems shall be developed and shall include the requirements of 8.2.1 through 8.2.3.

**8.2.1** The specifications shall designate the AHJ and shall indicate whether submission of plans is required.

**8.2.2** The specifications shall state that the installation shall conform to this standard and shall meet the approval of the AHJ.

**8.2.3\*** The specifications shall include the specific tests required to meet the approval of the AHJ.

### 8.3 Plans.

**8.3.1** Preparation of plans shall be entrusted only to fully experienced and responsible persons.

**8.3.2** These plans shall be drawn to an indicated scale or shall be dimensioned.

**8.3.3** The plans shall include or be accompanied by the following information, where applicable:

- (1) Name of owner and occupant
- (2) Location, including street address
- (3) Point of compass
- (4) Full height cross section, or schematic diagram, including structural member information construction of dike and tank
- (5) Size of supply main and whether dead end or circulating — if dead end, direction and distance to nearest circulating main — and water flow test results and system elevation relative to test hydrant
- (6) Other sources of water supply with pressure or elevation
- (7) Make, type, model, and model number of discharge devices
- (8) Pipe type and schedule of wall thickness
- (9) Nominal pipe size and cutting lengths of pipe (or center-to-center dimensions).
- (10) Types of fittings and joints, and locations of all welds and bends. The contractor shall specify on drawing any sections to be shop welded and types of fittings or formations to be used.
- (11) Types and locations of hangers, sleeves, braces, and methods of securing foam chambers or other discharge devices when applicable
- (12) All control valves, check valves, drain pipes, and test connections
- (13) Piping provisions for flushing
- (14) For hydraulically designed systems, the information on the hydraulic data nameplate
- (15) Graphic representations of the scale used on all plans
- (16) Name and address of contractor
- (17) Hydraulic reference points shown on the plan that correspond with comparable reference points on the hydraulic calculation sheets

- (18) Information about backflow preventers (manufacturer, size, type)
- (19) Sizes and locations of hydrants, showing sizes and numbers of outlets and whether outlets are to be equipped with independent gate valves. Whether hose houses and equipment are to be provided, and by whom, shall be indicated. Static and residual hydrants that were used in flow tests shall be shown
- (20) Sizes, locations, and piping arrangements of fire department connections
- (21) Physical details of the hazard, including the location, arrangement, and hazardous materials involved
- (22) Type and percentage of foam concentrate
- (23) Required solution application rate
- (24) Submergence volume calculations
- (25) Water requirements
- (26) Calculations specifying required amount of concentrate
- (27)\*Hydraulic calculations
- (28) Calculation specifying required amount of air
- (29) CAFS flow calculations report
- (30) Identification and capacity of all equipment and devices
- (31) Location of piping, detection devices, operating devices, generators, discharge outlets, and auxiliary equipment
- (32) Schematic wiring diagram
- (33) Explanations of any special features

**8.3.4** Complete plans and detailed data describing pumps, drivers, controllers, power supply, fittings, suction and discharge connections, and suction conditions shall be submitted by the engineer or contractor to the AHJ for approval before installation.

**8.3.5** Where field conditions necessitate any change affecting system performance from the approved plan, revised “as installed” plans shall be supplied for approval to the AHJ.

**8.3.6** Charts that specify head, delivery, efficiency, and brake horsepower curves of pumps shall be furnished by the contractor.

### 8.3.7 Hydraulic Calculations.

**8.3.7.1 General.** Hydraulic calculations shall be prepared on forms that include a summary sheet, detailed worksheets, and a graph sheet.

**8.3.7.2 Summary Sheet.** The summary sheet shall contain the following information, where applicable:

- (1) Date
- (2) Location
- (3) Name and owner and occupant
- (4) Building number or other identification
- (5) Description of hazard
- (6) Name and address of contractor or designer
- (7) Name of approving authority
- (8) System design requirements, as follows:
  - (a) Design area of foam application, m<sup>2</sup> (ft<sup>2</sup>)
  - (b) Minimum rate of foam
  - (c) Area per foam chamber or discharge device, m<sup>2</sup> (ft<sup>2</sup>)
- (9) Total foam requirements as calculated, including allowance for inside hose, outside hydrants, and exposure protection (such as dike area protection)

**8.3.7.3 Detailed Worksheets.** Detailed worksheets or computer printouts shall contain the following information:

- (1) Sheet number
- (2) Foam chamber or discharge device description and discharge constant (*K*)



- (3) Hydraulic reference points
- (4) Flow in L/min (gpm)
- (5) Pipe size
- (6) Pipe lengths, center-to-center of fittings
- (7) Equivalent pipe lengths for fittings and devices
- (8) Friction loss in bar/m (psi/ft) of pipe
- (9) Total friction loss between reference points
- (10) Elevation head in bar (psi) between reference points
- (11) Required pressure in bar (psi) at each reference points
- (12) Notes to indicate starting points or reference to other sheets or to clarify data shown

**8.3.7.4 Graph Sheet.** A graphic representation of the complete hydraulic calculation shall be plotted on semi-exponential graph paper ( $Q^{1.85}$ ) and shall include the following:

- (1) Water supply curve
- (2) Foam system demand
- (3) Hose allowance, where applicable

## Chapter 9 Installation Requirements

### 9.1 Foam Concentrate Pumps.

**9.1.1** Foam concentrate pump discharge pressure shall not exceed the working pressure of the concentrate piping or components in the system.

**9.1.2** Positive displacement pumps and centrifugal pumps are capable of overpressuring the system and shall be provided with means of pressure relief from the discharge to the supply side of the circuit to prevent excessive pressure and temperature.

### 9.2 Flushing.

**9.2.1** Pumps shall be provided with a means for flushing with water.

**9.2.2** Foam concentrate piping systems shall be provided with flush inlet and outlet connections.

### 9.3 Power Supply.

**9.3.1** Power supply for the drivers of foam concentrate pumps shall be installed in accordance with NFPA 20 and NFPA 70.

**9.3.2** Power supplies shall be arranged such that disconnecting power from the protected facility during a fire does not disconnect the power supply to the foam concentrate pump feeder circuit.

### 9.3.3 Controller.

**9.3.3.1** A controller governing the start-up of foam concentrate pumps with electric drivers of 30 horsepower or less shall be listed as a limited service controller.

**9.3.3.2** A controller governing the start-up of foam concentrate pumps with electric drivers of greater than 30 horsepower shall be listed as a full service fire pump controller.

**9.3.3.3** A controller governing the start-up of foam concentrate pumps with diesel engine drivers shall be listed as a diesel engine fire pump controller.

### 9.3.4\* Service Disconnecting Means.

**9.3.4.1** A service disconnecting means in the feeder circuits to limited service controllers shall be permitted, where al-

lowed by the AHJ, provided the disconnecting means is supervised for the correct position.

**9.3.4.2** Supervision for correct position shall be performed by one of the following:

- (1) Central station, proprietary, or remote station signaling electrical supervision service
- (2) Local electrical supervision through use of a signaling service that will cause the sounding of an audible signal at a constantly attended point
- (3) Locking the disconnect in the correct position with monthly recorded inspections

### 9.4 Low-Expansion System Piping.

**9.4.1** All piping inside of dikes or within 15 m (50 ft) of tanks not diked shall be buried under at least 0.3 m (1 ft) of earth or, if aboveground, shall be supported and protected against mechanical injury.

**9.4.2\*** For systems that apply foam to a tank's liquid surface from the top side, all piping within the dike or within 15 m (50 ft) of tanks not diked shall be designed to absorb the upward force and shock caused by a tank roof rupture.

**9.4.3\*** One flange or union joint shall be provided in each riser at a convenient location, preferably directly below the foam maker, to permit hydrostatic testing of the piping system up to this joint.

**9.4.4** Hose connections for semi-fixed foam systems on fixed-roof (cone) tanks shall terminate outside the dike area at least one tank diameter from the tank but in no case less than 15 m (50 ft).

**9.4.5** The inlets to the piping shall be fitted with corrosion-resistant metal connections, compatible with the equipment supplying foam solution to the system, and provided with plugs or caps.

### 9.5 Valves in Low-Expansion Systems.

**9.5.1** The laterals to each foam discharge outlet on fixed roof tanks shall be separately valved outside the dike in the following circumstances:

- (1) All fixed systems
- (2) Any laterals of a semi-fixed system not supplied by an individual hose connection

**9.5.1.1** Valves shall be located either in the central foam station or at points where the laterals branch from the common supply line.

**9.5.1.2** These valves shall not be located within the dike.

**9.5.1.3** Valves shall be located at a distance of at least one tank diameter from the tank but in no case less than 15 m (50 ft).

**9.5.1.4** Shutoff valves shall be permitted to be located at shorter distances where remotely operated, subject to the approval of the AHJ.

**9.5.2** Where two or more foam proportioners are installed in parallel and discharge into the same outlet header, valves shall be provided between the outlet of each device and the header.

**9.5.3** The water line to each proportioner inlet shall be separately valved.

**9.5.4** For subsurface applications, each foam delivery line shall be provided with a valve and a check valve unless the

latter is an integral part of the high back-pressure foam maker or pressure generator to be connected at the time of use.

**9.5.5** Where product lines are used for foam, product valving shall be arranged to ensure that foam enters only the tank to be protected.

**9.5.6** Drain valves that are accessible shall be provided for low points in underground and aboveground piping.

**9.5.7\* Bladder Tank Valves.**

**9.5.7.1** For bladder tank systems with multiple risers, the water supply feed to the bladder tank shall be arranged to prevent the discharge of foam concentrate into risers that have been isolated, to prevent further discharge into the hazard.

**9.5.7.2** For single-riser systems, the water feed to the bladder tank shall be located above the system control valve.

**9.6 Hangers, Supports, and Protection for Pipework.**

**9.6.1** Where protecting hazards where there is a possibility of explosion, pipework shall be routed to afford the best protection against damage.

**9.6.2** The supply piping to foam outlets that protect a given hazard in a fire area shall not pass over another hazard in the same fire area.

**9.6.3** All hangers shall be of approved types.

**9.6.4** Tapping or drilling of load-bearing structural members shall not be permitted where unacceptable weakening of the structure would occur.

**9.6.5** Attachments shall be made to existing steel or concrete structures and equipment supports.

**9.6.6** Where systems are of such a design that the standard method of supporting pipe for protection purposes cannot be used, the piping shall be supported in such a manner as to produce the strength equivalent to that afforded by the standard means of support.

**9.7 Hose Requirements.** Unlined fabric hose shall not be used with foam equipment.

**9.8 Test Connections.** Valves and hose connections shall be installed to facilitate testing of proportioning equipment.

**Chapter 10 Low-Expansion Foam Systems for Marine Applications**

**10.1\* General.**

**10.1.1** This chapter shall cover design information for the use of low-expansion foam systems that are necessary for marine applications where required by the AHJ.

**10.1.2** The provisions of Chapters 4, 5, 6, and 8 of this standard shall not be applicable unless specifically referenced.

**10.1.3\* Components.**

**10.1.3.1** All components shall be listed or approved for their intended application and shall be approved for use in a marine environment.

**10.1.3.2** Each manufacturer shall maintain a system design manual describing basic system design arrangements and denoting each of the manufacturers' products within the system.

**10.1.4** Foam concentrates shall be approved.

**10.1.4.1** The concentrate used in a foam system for protecting a flammable or combustible liquid shall be approved for hydrocarbons in accordance with a test method equivalent to the 9.29 m<sup>2</sup> (100 ft<sup>2</sup>) hydrocarbon method given in Annex F.

**10.1.4.2** Four consecutive fire tests shall be completed — two using sea water and two using freshwater.

**10.1.4.3\*** Concentrates intended for use on polar solvent systems shall be approved for hydrocarbons in accordance with 10.1.4.1 and approved for use on polar solvents in accordance with a method comparable to UL 162.

**10.1.5** The foam supply shall conform to the requirement of 4.3.2.2.

**10.1.6** The water supply shall conform to the requirements of 4.2.1.1 through 4.2.1.3.

**10.1.7** The foam system shall be capable of being actuated, including introduction of foam solution into the foam main within 3 minutes of notification of a fire.

**10.2 Fixed Low-Expansion Foam Systems for Machinery Spaces.**

**10.2.1\*** Where installed, systems protecting machinery spaces shall be capable of discharging the required quantity of expanded foam to provide a foam depth of at least 150 mm (6 in.) over the largest area over which oil is expected to spread.

**10.2.2** The minimum foam solution application rate shall be 6.5 L/min·m<sup>2</sup> (0.16 gpm/ft<sup>2</sup>) for a minimum of 5 minutes.

**10.2.3** The system shall be capable of generating foam for extinguishing hydrocarbon fires.

**10.2.4** Means shall be provided for effective distribution of the foam through a permanent system of piping and control valves to discharge outlets and for foam to be directed by fixed foam outlets.

**10.2.5** The foam expansion ratio shall not exceed 12:1.

**10.2.6** Where a deck foam system is also installed, the foam supply and proportioning system shall not be required to be separate.

**10.2.7** The quantity of foam concentrate shall be that required to meet the single largest system demand.

**10.2.8 Controls.**

**10.2.8.1** System controls shall be simple to operate and grouped together in a location accessible during fire conditions in the protected area.

**10.2.8.2** Instructions in permanent lettering shall be affixed to the equipment or in a position adjacent thereto.

**10.2.8.3** Remotely controlled devices shall have local mechanical override.

**10.3 Fixed Low-Expansion Foam Systems on Deck for Petroleum and Chemical Tankers.**

**10.3.1\* Purpose.** The purpose of this section shall be to provide guidance for the design and arrangement of deck foam systems that are expected to provide the following performance:

- (1) Extinguish deck spill fires and maintain a foam blanket while hot metal cools.

- (2) Control or suppress cargo manifold fires except those involving three-dimensional pressurized liquid fires.
- (3) Suppress or control tank fires involving a portion of the cargo area, assuming that the top of the tank(s) within the design area is open to weather and that the trajectory of the foam is not obstructed.
- (4) Provide protection for the crew while arrangements are being made to abandon ship.
- (5) During lightering operations, the deck foam system flowing water shall protect the exposed vessel from fire on an adjacent ship while preparations are made to get the exposed vessel under way.
- (6) The deck foam system is not intended to provide extinguishment, suppression, or control of incidents resulting from major explosions or collisions that cause the fire to exceed the area of the single largest tank.
- (7) The deck foam system shall be designed and arranged to withstand the effects of weather, vibration, corrosion, strain, and impact expected during the ship's operation.
- (8) Suppress vapors from an unignited spill on deck.

### 10.3.2 Control Station.

**10.3.2.1** The main control station for the system shall be located aft of the cargo area and be operable in the event of fire in the main area protected.

**10.3.2.2\*** Operating instructions and diagrams of piping systems and valves shall be provided in clear and permanent lettering and shall be affixed to the equipment or in a position visible thereto.

**10.3.2.2.1** The diagrams shall show which valves are to be opened in the event the system must be activated.

**10.3.2.2.2** The diagrams shall explain thoroughly and clearly all the steps necessary to put the system into operation.

**10.3.2.2.3** Each valve shall be labeled describing its function.

**10.3.2.3** The control station shall be provided with emergency lighting.

**10.3.3\* Fire Main Capacity.** Operation of a deck foam system at its required foam solution flow rate shall still permit the simultaneous use of the required number of streams of water and other services provided by the fire main system.

**10.3.4\* Rate of Application.** The rate of application of foam solution for fires on deck shall not be less than the greatest of 10.3.4.1 or 10.3.4.2.

**10.3.4.1** Rate of application for hydrocarbon fuels shall be as follows:

- (1) Deck spill calculation:  $6.50 \text{ L/min}\cdot\text{m}^2$  ( $0.16 \text{ gpm/ft}^2$ ) over 10 percent of the cargo block deck area, where the cargo block deck area is the maximum breadth of the ship multiplied by the total longitudinal extent of the cargo tank spaces
- (2) Largest tank calculation:  $9.78 \text{ L/min}\cdot\text{m}^2$  ( $0.24 \text{ gpm/ft}^2$ ) of the horizontal sectional area of the single largest tank
- (3) Largest monitor calculation:  $3.0 \text{ L/min}\cdot\text{m}^2$  ( $0.074 \text{ gpm/ft}^2$ ) of the area protected by the largest monitor, such area being entirely forward of the monitor, but not less than  $1250 \text{ L/min}$  ( $330 \text{ gpm}$ )

**10.3.4.2** Rate of application for polar solvents shall be as follows:

- (1) Since required foam application rates are permitted to vary, polar solvents are placed in representative groups based upon fire performance tests.
- (2) Fire tests are used to determine the minimum foam design application rate for the group and are conducted using one or more solvents representing the most difficult extinguishment case or the actual polar solvent.
- (3) The following minimum foam design application rates and polar solvent groupings shall be specified in the foam manufacturer's system design manual and shall be approved:
  - (a) Deck spill calculation: the highest required foam application rate for any polar solvent that is permitted to be transported by the ship, applied over 10 percent of the cargo block deck area, where the cargo block deck area is the maximum breadth of the ship multiplied by the total longitudinal extent of the cargo tank spaces
  - (b) Most demanding tank calculation: 150 percent of the highest required foam application rate, for any polar solvent that is permitted to be transported by the ship, applied over the horizontal sectional area of the single largest tank
  - (c) Where dedicated cargo tanks are specifically designed for a particular polar solvent and such solvent is not permitted to be carried in other tanks, the foam system design is permitted to take into consideration this limitation.
  - (d) Largest monitor calculation: 45 percent of the highest required foam application rate for any polar solvent that is permitted to be transported by the ship, applied over the area protected by the foam monitor, such area being entirely forward of the monitor, but not less than  $1250 \text{ L/min}$  ( $330 \text{ gpm}$ )

### 10.3.5 Discharge Duration.

**10.3.5.1\*** Foam concentrate shall be provided to supply the system for 30 minutes.

**10.3.5.2** For ships that are both transporting only hydrocarbons and using gas inerting of cargo vapor spaces, the discharge duration shall be permitted to be 20 minutes.

**10.3.5.3** Allowance shall be made to fill all foam solution and concentrate piping and still provide the required duration.

**10.3.5.4\*** Minimum discharge duration shall be based on the actual capacity of the installed equipment.

### 10.4\* Foam Outlet Devices.

**10.4.1** One hundred percent of the required foam application shall be by using one or two monitors located immediately aft of the protected area.

**10.4.2** On tankers less than 4000 metric tons dead weight, hand hoses only shall be permitted to be installed in lieu of monitors specified in 10.4.1, provided that the capacity of each hand hose is at least 25 percent of the total foam solution flow rate.

### 10.5 Monitors.

**10.5.1** The capacity of any monitor shall be at least  $3.02 \text{ L/min}\cdot\text{m}^2$  ( $0.074 \text{ gpm/ft}^2$ ) of the deck area protected by that monitor, with such area being entirely forward of the monitor.

**10.5.2** The capacity of each monitor shall be not less than 50 percent of the required foam application rate and not less than 1250 L/min (330 gpm).

**10.5.3** The distance from the monitor to the farthest extremity of the protected area forward of the monitor shall be not more than 75 percent of the monitor throw in still air conditions.

**10.5.4** Foam monitors and hand hoseline connections shall be situated both port and starboard at the front of the accommodation space facing the cargo tanks deck.

**10.5.5** If provided, these monitors shall be located at least 2.5 m (8.2 ft) above the main deck and shall be directly accessible to the deck above the freeboard deck.

**10.5.6** The foam system shall be capable of delivering foam to the entire cargo block deck area.

**10.5.6.1** Ships fitted with bow or stern loading and unloading arrangements shall be provided with one or more additional monitors located to protect the bow or stern arrangements.

**10.5.6.2** The area of the cargo line fore or aft of the cargo block area shall be provided with monitor protection.

**10.5.6.3** Foam monitors shall be mounted on platforms.

**10.5.6.4** Platforms shall permit 360-degree access around the monitors.

**10.5.6.5** Platforms shall be raised to allow the monitors an unobstructed throw insofar as practical.

**10.5.6.6** The monitor isolation valve shall be accessible from the monitor platform.

**10.5.6.7** Platforms higher than 2 m (6.5 ft) shall be provided with handrails or chain rails.

**10.5.6.8** Access to the monitor platform shall be via walkway or permanent ladder.

**10.5.6.9** Provisions shall be made for securing monitors while at sea.

#### **10.5.7 Monitors.**

**10.5.7.1** Monitors over 3785 L/min (1000 gpm) shall be provided with two operator handholds or one handwheel for each swivel.

**10.5.7.2** Monitors shall be designed to prevent unwanted movement due to reaction forces.

**10.5.7.3** Monitors shall be capable of being locked into position while operating at full flow.

#### **10.6 Hand Hoselines.**

**10.6.1** Hand hoselines shall be provided to ensure flexibility of action during fire-fighting operations and to cover areas obstructed from monitors.

**10.6.2** The capacity of any hand hoseline shall be not less than 401 L/min (106 gpm), and the hand hoseline throw in still air conditions shall be not less than 15 m (50 ft).

**10.6.3** The number and location of foam solution outlets shall be such that foam from at least two hand hoselines shall be permitted to be simultaneously directed onto any part of the cargo block deck area.

**10.6.4** Hand hoselines and hydrants shall be mounted on monitor platforms or at deck level.

#### **10.7 Hydraulic Calculations.**

**10.7.1** Hydraulic calculations shall be performed in accordance with NFPA 15. Foam solution shall be considered to have the same hydraulic characteristics as water.

**10.7.2** Foam concentrate hydraulic calculations shall be performed in accordance with the foam concentrate manufacturer's system design manual.

**10.7.3** Orifices shall be permitted to balance flows to monitors and fixed foam outlets.

#### **10.8 Isolation Valves.**

**10.8.1** Isolation valves shall be provided in the water, foam concentrate, and foam solution mains (immediately forward of any monitor position) to isolate damaged sections. In addition, each monitor and hose station shall have an isolation valve.

**10.8.2** Isolation valves shall be operable from accessible locations.

**10.8.3** Monitor isolation valves shall be in accordance with 10.5.6.3 through 10.5.6.9.

**10.8.4** All isolation valves shall be installed with the bonnet above the horizontal.

**10.8.5** Isolation valves shall be provided with a ready means for visual indication of valve position.

#### **10.9 Hangers, Supports, and Protection of Pipework.**

**10.9.1** Pipework shall be routed to afford protection against damage.

**10.9.2\*** All hangers and piping supports shall be designed for marine applications.

**10.9.3\*** Deck foam solution piping shall be independent of fire main piping.

**10.9.4** Where the fire main and foam main are connected to a common monitor, check valves shall be installed.

**10.9.5\*** The system shall be arranged to prevent the possibility of freezing.

**10.9.5.1** Portions of the system exposed to weather shall be self-draining.

**10.9.5.2** Wet or pressurized portions of the system shall be protected against freezing.

#### **10.10 Testing and Inspection.**

**10.10.1\*** Foam systems shall be inspected and tested in accordance with Chapters 10 and 11.

**10.10.2** Annual testing shall include tests conducted in accordance with Section 11.6.

**10.10.3** The system supplier or owner shall provide to the ship's crew a system use, inspection, and testing videotape.

#### **10.11 Foam System Concentrate Storage.**

**10.11.1** Foam concentrate storage shall be in compliance with 4.3.2.4.

**10.11.1.1\*** The primary deck foam concentrate storage tank shall be located on or above the freeboard deck level in the space containing the system control station described in 10.3.2.



**10.11.1.2** All foam concentrate shall be stored in an accessible location unlikely to be cut off in the event of fire or explosion and not having direct opening or exposure to the cargo area.

**10.11.2** Foam concentrate tanks shall be in compliance with 4.3.2.3.

**10.11.2.1\*** Tanks shall have expansion domes.

**10.11.2.2** Tanks shall be fitted with baffles to prevent sloshing.

**10.11.2.3** Each concentrate storage tank shall be provided with a brass, stainless steel, or other corrosion-resistant pressure vacuum (PV) vent.

**10.11.2.4** Each tank shall have a support structure for mounting the tank to the ship's structure.

**10.11.2.5** Each tank shall have a sump or other means to prevent clogging of the foam concentrate suction pipe in the event of sedimentation or other foreign materials in the tank.

**10.11.2.6** The foam concentrate suction pipe shall take suction above the bottom of the sump.

**10.11.3** Tanks shall be of a design and materials designed for constant sloshing of the liquid against the tank structure.

**10.11.4** Each tank shall have a manway or openings for internal inspection and access.

**10.11.5** Tank suction and return connections shall terminate near the bottom of the tank so as to reduce the chance of premature foaming due to agitation during system operation.

**10.11.6** Atmospheric tanks shall be provided with means for continuous refilling of the tank.

**10.11.7** Foam concentrate storage shall be within the foam concentrate manufacturer's recommended temperature limitations.

**10.11.7.1** Storage spaces shall be provided with heat to prevent freezing of the foam concentrate and piping.

**10.11.7.2** Storage shall be in compliance with 4.3.2.4 and 4.3.2.4.1.

**10.11.8** Foam concentrate compatibility shall be in compliance with 4.4.1 and 4.4.2. The foam concentrate storage tank shall be provided with a label specifying foam manufacturer, foam type, and quantity.

**10.11.9** Only one type of foam concentrate shall be carried on board.

## **10.12 Supply Arrangements.**

**10.12.1\*** Foam proportioning shall be by the balanced pressure proportioning method employing a dedicated foam concentrate pump.

**10.12.2** Other types of systems acceptable to the AHJ shall be permitted.

**10.12.3\*** Foam concentrate pumps shall be in compliance with Section 4.6.

**10.12.4\*** Foam and water pump motors and controllers shall comply with IEEE 45 or equivalent.

**10.12.5** Foam and water pumps shall be capable of operation during loss of the main power system.

**10.12.6** Electric power for foam pumps, water pumps, and other electrical components of the foam system shall be in accordance with the provisions of 4.3 and 4.3.5 of SOLAS Regulations II-2 applicable to fire pumps.

**10.12.7** Where diesel pumps are provided, they shall be connected to a listed diesel pump controller.

**10.12.8** The deck foam system piping shall not be routed through, immediately adjacent to, or immediately above the cargo pump room.

## **10.13 Piping Materials.**

**10.13.1** Piping shall be in compliance with Table 10.13.1; other materials shall be permitted to be used provided they have physical properties and corrosion resistance equivalent to the piping identified in Table 10.13.1 and are approved by the AHJ.

**10.13.2** Pipe in areas subject to fire exposure, including radiant and conducted heat, shall be of steel or other alloy rated for the pressure, possible fire temperature exposure, and environmental conditions expected.

**10.13.3** Foam concentrate piping shall be constructed of material compatible with, and not affected by, the concentrate.

**10.13.4** Foam concentrate piping shall not be galvanized.

**10.13.5\*** Pipe thread joint sealants used for foam concentrate lines shall be in compliance with the foam concentrate manufacturer's recommendations.

## **Chapter 11 Testing and Acceptance**

### **11.1 Inspection and Visual Examination.**

**11.1.1** Foam systems shall be examined visually to determine that they have been installed in accordance with approved plans and specifications.

**11.1.2** Foam systems shall be inspected for such items as conformity with installation plans; continuity of piping; removal of temporary blinds; accessibility of valves, controls, and gauges; and proper installation of vapor seals, where applicable.

**11.1.3** Devices shall be checked for identification and operating instructions.

### **11.2 Flushing after Installation.**

**11.2.1** In order to remove foreign materials that have entered both underground and aboveground water supply mains during installation, the water supply mains shall be flushed thoroughly at the maximum practicable rate of flow before connection is made to system piping.

**11.2.2** The minimum rate of flow for flushing shall not be less than the water demand rate of the system, as determined by the system design.

**11.2.3** The flow shall be continued to ensure thorough cleaning.

**11.2.4** All foam system piping shall be flushed after installation, using the system's normal water supply with foam-forming materials shut off, unless the hazard cannot be subjected to water flow.



**Table 10.13.1 Piping Materials**

Service	Pipe	Valves	Fittings	Takedown Joints
Seawater or foam solution (up to 225 psi and 350°F)	Carbon steel, seamless or electric resistance weld, standard wall, galvanized* <sup>†</sup> , ASTM A53, Type E or S, Gr. A or ASTM A106, Gr. A Schedule 40 minimum	<i>Body:</i> Carbon steel, ASTM A216 Gr. WCB or ductile iron, ASTM A395 <i>Trim:</i> Bronze or 316 SS <i>Ends:</i> Flanged ANSI B16.5 Class 150	<i>3 in. and larger:</i> Wrought steel, standard wall, galvanized per ANSI B16.9, 150 lb minimum <i>2 in. and smaller:</i> Socket weld steel, 2000#, galvanized per ANSI B16.11 ASTM A234 Gr. WPB	<i>3 in. and larger:</i> Slip-on or butt weld flange <i>2 in. and smaller:</i> Socket weld flange ANSI B16.5 Class 150, ASTM A105
Foam concentrate (in the hazard area)	Carbon steel, seamless or electric resistance weld, standard wall. ASTM A53, Type E or S, Gr. A or ASTM A106, Gr. A OR Stainless steel, seamless, standard wall pipe ASTM A312 Gr. TP304L or TP316L	<i>Body:</i> Carbon steel, ASTM A216 Gr. WCB or ASTM A105 <i>Trim:</i> 304L or 316L SS <i>Ends:</i> Flanged ANSI B16.5 Class 150 or screwed OR <i>Body:</i> Forged stainless steel, ASTM A182 Gr. F304L or F316L <i>Trim:</i> 304L or 316L SS <i>Ends:</i> Flanged ANSI B16.5 Class 150 or screwed	Socket weld or threaded carbon steel, 2000# per ANSI B16.11 ASTM A234 Gr. WPB OR Socket weld or threaded stainless steel, 2000# per ANSI B16.11 ASTM A182 Gr. F304L or F316L	Screwed or socket weld flange per ANSI B16.5 Class 150 ASTM A105 or ASTM A182 Gr. 304L or Gr. 316L OR Screwed or socket weld union, 2000# per ANSI B16.11 ASTM A105 or ASTM A182 Gr. 304L or Gr. 316L

For SI units: 1 psi = 6.895 kPa;  $\frac{5}{9}$  (degrees F - 32) = degrees C.

Note: Standards shown are minimum acceptable. Equivalent foreign standards can be used if approved.

\*System can be assembled using black steel pipe and fittings, hot dip galvanized after fabrication.

<sup>†</sup>Where pipe and fittings are galvanized, all disturbed areas are to be repaired using a cold galvanizing product.

**11.2.5** Where flushing cannot be accomplished, pipe interiors shall be visually examined for cleanliness during installation.

**11.2.5.1** All compressed air foam system piping interiors shall be carefully visually examined and, if necessary, cleaned during installation of the pipe.

**11.2.5.2** Compressed air foam system piping shall be flushed after installation, using the system's air supply in lieu of flushing with water.

### 11.3\* Acceptance Tests.

**11.3.1** The completed system shall be tested by qualified personnel to meet the approval of the AHJ.

**11.3.2** These tests shall be used to determine that the system has been installed in accordance with approved plans and specifications, and that it functions as intended.

### 11.4 Pressure Tests.

**11.4.1** All piping, except piping handling expanded foam for other than subsurface application, shall be subjected to a 2-hour hydrostatic pressure gauge test at 1379 kPa (200 psi) or 345 kPa (50 psi) in excess of the maximum pressure anticipated, whichever is greater, in accordance with NFPA 13.

**11.4.2** Drainage pitch for all normally dry horizontal piping shall be verified.

### 11.5 Operating Tests.

**11.5.1** Before acceptance, all operating devices and equipment shall be tested for function.

**11.5.2** Tests for total flooding systems shall establish that all automatic closing devices for doors, windows, and conveyor openings, and automatic equipment interlocks, as well as automatic opening of heat and smoke vents or ventilators, will function upon system operation.

**11.5.3** Tests shall include a complete check of electrical control circuits and supervisory systems to ensure operation and supervision in the event of failure.

#### 11.5.4 Water Supply Test.

**11.5.4.1** The main drain valve shall be opened and remain open until the system residual pressure stabilizes.

**11.5.4.2** The static and residual pressures shall be recorded on the contractor's material and test certificate.

**11.5.5 Operating Test for Control Valves.** All control valves shall be fully closed and opened under system water pressure to ensure proper operation.

**11.5.6** Operating instructions provided by the supplier and device identification shall be verified.

### 11.6\* Discharge Tests.

**11.6.1** Where conditions permit, flow tests shall be conducted to ensure that the hazard is fully protected in conformance with the design specification.

**11.6.2** The following data shall be required:

- (1) Static water pressure
- (2) Residual water pressure at the control valve and at a remote reference point in the system
- (3) Actual discharge rate
- (4) Consumption rate of foam-producing material
- (5) Concentration of the foam solution

**11.6.2.1** For compressed air foam systems, the following data shall be recorded as part of any discharge test:

- (1) Static water pressure
- (2) Residual water pressure at the control valve
- (3) System air pressure
- (4) Concentration of the foam solution

**11.6.3\*** The foam proportioning system shall be permitted to be tested with a listed or approved method that does not require discharge of foam concentrate. (*See Annex D.*)

**11.6.4** The foam concentrate induction rate of a proportioner, expressed as a percentage of the foam solution flow (water plus foam concentrate), shall be within minus 0 percent to plus 30 percent of the manufacturer's listed concentrations, or plus 1 percentage point, whichever is less. For information tests for physical properties of foam, see Annex D.

**11.7 Approval of Low-, Medium-, and High-Expansion Foam Systems.** The installing contractor shall perform the following tasks:

- (1) Notify the AHJ and the property owner or the property owner's authorized representative of the time and date testing will be performed
- (2) Perform all acceptance tests required by this chapter
- (3)\*Complete and sign the contractor's material and test certificate for low-, medium-, and high-expansion foam systems

**11.8 System Restoration.** After acceptance tests are completed, the system shall be flushed and restored to operational condition.

## Chapter 12 Maintenance

**12.1\* Inspection, Testing, and Maintenance.**

**12.1.1** At least annually, all foam systems shall be thoroughly inspected and checked for correct operation.

**12.1.2** The inspection shall include performance evaluation of the foam concentrate or premixed solution quality or both.

**12.1.3** Test results that deviate more than 10 percent from those recorded in acceptance testing shall be discussed immediately with the manufacturer.

**12.1.4** The goal of this inspection and testing shall be to ensure that the system is in full operating condition and that it remains in that condition until the next inspection.

**12.1.5** The inspection report, with recommendations, shall be filed with the owner.

**12.1.6** Between the regular service contract inspections or tests, the system shall be inspected by competent personnel following an approved schedule.

**12.2\* Foam-Producing Equipment.**

**12.2.1** Proportioning devices, their accessory equipment, and foam makers shall be inspected.

**12.2.2** Fixed discharge outlets equipped with frangible seals shall be provided with inspection means to permit maintenance and for inspection and replacement of vapor seals.

**12.2.3 Compressed Air Foam-Producing Equipment.**

**12.2.3.1** Compressed air foam-generating equipment and accessories shall be inspected annually.

**12.2.3.2** Discharge devices shall be visually inspected annually for evidence of mechanical damage.

**12.3 Piping.**

**12.3.1** Aboveground piping shall be examined to determine its condition and to verify that proper drainage pitch is maintained.

**12.3.2** Pressure tests of normally dry piping shall be made when visual inspection indicates questionable strength due to corrosion or mechanical damage.

**12.3.3** Underground piping shall be spot-checked for deterioration at least every 5 years.

**12.4 Strainers.** Strainers shall be inspected in accordance with manufacturer's instructions and shall be cleaned after each use and flow test.

**12.5 Detection and Actuation Equipment.** Control valves, including all automatic and manual-actuating devices, shall be tested at regular intervals.

**12.6 Foam Concentrate Inspection.**

**12.6.1** At least annually, an inspection shall be made of foam concentrates and their tanks or storage containers for evidence of excessive sludging or deterioration.

**12.6.2** Samples of concentrates shall be sent to the manufacturer or qualified laboratory for quality condition testing.

**12.6.3** When the foam type and brand of foam are known, the quality testing shall confirm the product meets the manufacturer's specifications.

**12.6.4** Quantity of concentrate in storage shall meet design requirements, and tanks or containers shall normally be kept full, with space allowed for expansion.

**12.7 High-Pressure Cylinders.** High-pressure cylinders used in compressed air foam systems shall not be recharged without a hydrostatic test (and remarking) if more than 5 years have elapsed from the date of the last test. Cylinders that have been in continuous service without discharging shall be permitted to be retained in service for a maximum of 12 years, after which they shall be discharged and retested before being returned to service.

**12.8 Operating Instructions and Training.**

**12.8.1** Operation, system deactivation, and maintenance instructions and layouts shall be posted at control equipment with copies of each on file.

**12.8.2** All persons who are expected to inspect, test, maintain, or operate apparatus shall be thoroughly trained, and training shall be kept current.

## Annex A Explanatory Material

*Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.*

**A.1.1** Fire-fighting foam is an aggregate of air-filled bubbles formed from aqueous solutions and is lower in density than flammable liquids. It is used principally to form a cohesive floating blanket on flammable and combustible liquids and prevents or extinguishes fire by excluding air and cooling the fuel. It also prevents reignition by suppressing formation of flammable vapors. It has the property of adhering to surfaces, which provides a degree of exposure protection from adjacent fires. Foam can be used as a fire prevention, control, or extinguishing agent for flammable liquid hazards. Foam for these hazards can be supplied by fixed piped systems or portable foam-generating systems. Foam can be applied through foam discharge outlets, which allow it to fall gently on the surface of the burning fuel. Foam can also be applied by portable hose streams using foam nozzles or large-capacity monitor nozzles or subsurface injection systems.

Foam can be supplied by overhead piped systems for protection of hazardous occupancies associated with potential flammable liquid spills in the proximity of high-value equipment or for protection of large areas. The foam used for flammable liquid spills is in the form of a spray or dense “snow-storm.” The foam particles coalesce on the surface of the burning fuel after falling from the overhead foam outlets, which are spaced to cover the entire area at a uniform density. (For systems required to meet both foam and water spray design criteria, see NFPA 16.)

Large-spill flammable liquid fires can be fought with mobile equipment, such as an aircraft crash truck or industrial foam truck equipped with agent and equipment capable of generating large volumes of foam at high rates. Foam for this type of hazard can be delivered as a solid stream or in a dispersed pattern. Standards for industrial foam trucks include NFPA 1901, and standards for aircraft crash trucks include NFPA 414.

Foam does not break down readily and, when applied at an adequate rate, has the ability to extinguish fire progressively. As application continues, foam flows easily across the burning surface in the form of a tight blanket, preventing reignition on the surfaces already extinguished. Foam is not suitable for three-dimensional flowing liquid fuel fires or for gas fires.

To determine where foam protection is required, see applicable standards such as NFPA 30. Foam can be applied to protect the surface of a flammable liquid that is not burning. The foam concentrate manufacturer should be consulted to determine the optimum method of application, rate of discharge, application density, and frequency of reapplication required to establish and maintain the integrity of the foam blanket.

**A.3.2.1 Approved.** The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an

organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

**A.3.2.2 Authority Having Jurisdiction (AHJ).** The phrase “authority having jurisdiction,” or its acronym AHJ, is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

**A.3.2.4 Listed.** The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

**A.3.3.2 Concentration.** The type of foam concentrate used determines the percentage of concentration required. For example, a 3 percent foam concentrate is mixed in the ratio of 97 parts water to 3 parts foam concentrate to make foam solution.

**A.3.3.3 Discharge Devices.** Examples include, but are not limited to, sprinklers, spray nozzles, and hose nozzles.

**A.3.3.3.3 Non-Air-Aspirating Discharge Devices.** When discharging AFFF or FFFP solution, they generate an effective AFFF or FFFP with a discharge pattern similar to the water discharge pattern.

**A.3.3.4.2 Type I Discharge Outlet.** The foam trough shown schematically in Figure A.3.3.4.2(a) consists of sections of steel sheet formed into a chute that is securely attached to the inside tank wall so that it forms a descending spiral from the top of the tank to within 1.2 m (4 ft) of the bottom. [See Figure A.3.3.4.2(b).]

In Figure A.3.3.4.2(b), note that one brace [13 mm ( $\frac{1}{2}$  in.) plate, 305 mm (12 in.) long] should be provided at each shell course. This brace helps maintain the shell in place during the early stages of the fire and prevents buckling before cooling water is applied.


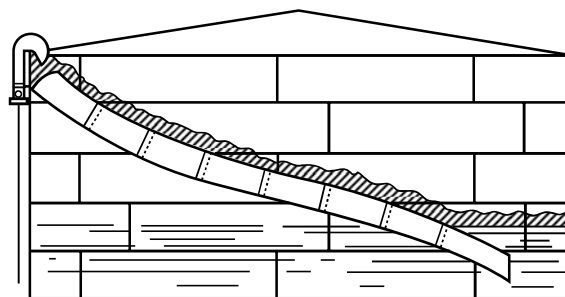


FIGURE A.3.3.4.2(a) Foam Trough.

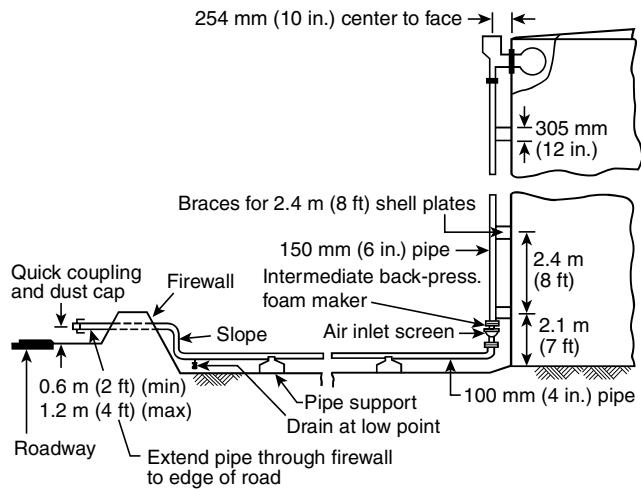

**FIGURE A.3.3.4.2(b) Typical Air Foam Piping for Intermediate Back-Pressure Foam System.**

**A.3.3.5 Eductor (Inductor).** An air foam hose nozzle with built-in eductor is the type of proportioner in which the jet in the foam maker is utilized to draft the concentrate (see Figure A.3.3.5). The bottom of the concentrate container should be not more than 1.8 m (6 ft) below the level of the foam maker. The length and size of hose or pipe between the concentrate container and the foam maker should conform to the recommendations of the manufacturer. Hydrocarbon surfactant-type foam concentrates are synthetic foaming agents generally based on a hydrocarbon surface active agent. They produce foams of widely different character (expansion and drainage times), depending on the type of foam-producing devices employed. In general, such foams do not provide the stability and burn-back resistance of protein-type foams or the rapid control and extinguishment of AFFF, but they can be useful for petroleum-product spill fire fighting in accordance with their listings and approvals. There are hydrocarbon-base foaming agents that have been listed as foaming agents, wetting agents, or combination foaming/wetting agents. The appropriate listings should be consulted to determine correct application rates and methods.


**A.3.3.5.1 In-Line Eductor.** This eductor is used for installation in a hoseline, usually at some distance from the foam maker or playpipe, as a means of drafting air foam concentrate from a container. (See Figure A.3.3.5 and Figure A.3.3.5.1.)

The in-line eductor must be designed for the flow rate of the particular foam maker or playpipe with which it is to be used. The device is very sensitive to downstream pressures and accordingly is designed for use with specified lengths of hose or pipe located between it and the foam maker.

The pressure drop across the eductor is approximately one-third of the inlet pressure.

The elevation of the bottom of the concentrate container should not be more than 1.8 m (6 ft) below the eductor.

**A.3.3.10 Foam.** Air foam is made by mixing air into a water solution containing a foam concentrate, by means of suitably designed equipment. It flows freely over a burning liquid surface and forms a tough, air-excluding, continuous blanket that seals volatile combustible vapors from access to air. It resists disruption from wind and draft or heat and flame attack and is capable of resealing in case of mechanical rupture. Fire-

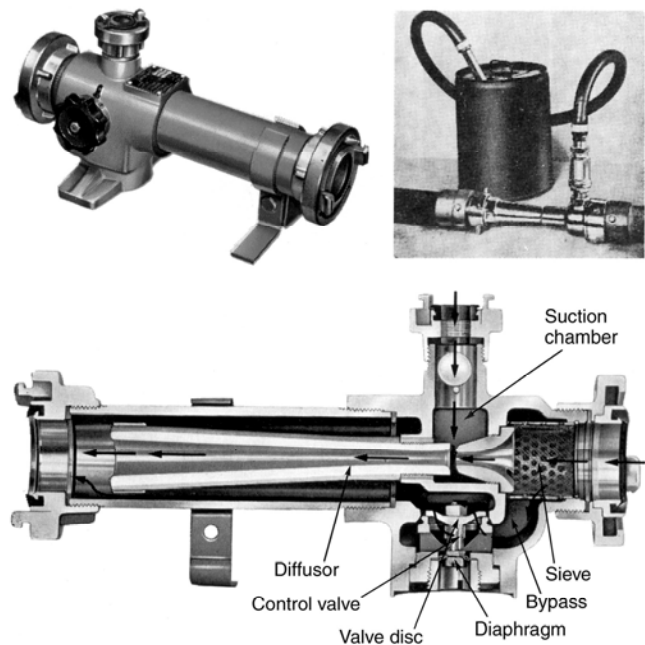

**FIGURE A.3.3.5 In-Line Eductor.**



**FIGURE A.3.3.5.1 Air Foam Hose Nozzle with Built-in Eductor.**

fighting foams retain these properties for relatively long periods of time. Foams also are defined by expansion and are arbitrarily subdivided into three ranges of expansion. These ranges correspond broadly to certain types of usage described below. The three ranges are as follows:

- (1) Low-expansion foam — expansion up to 20
- (2) Medium-expansion foam — expansion from 20 to 200
- (3) High-expansion foam — expansion from 200 to approximately 1000

**A.3.3.12 Foam Concentrate.** For the purpose of this document, “foam concentrate” and “concentrate” are used interchangeably.



**A.3.3.12.1 Alcohol-Resistant Foam Concentrate.** There are three general types. One is based on water-soluble natural polymers, such as protein or fluoroprotein concentrates, and also contains alcohol-insoluble materials that precipitate as an insoluble barrier in the bubble structure. The second type is based on synthetic concentrates and contains a gelling agent that surrounds the foam bubbles and forms a protective raft on the surface of water-soluble fuels; these foams can also have film-forming characteristics on hydrocarbon fuels. The third type is based on water-soluble natural polymers, such as fluoroprotein, and contains a gelling agent that protects the foam from water-soluble fuels. This foam can also have film-forming and fluoroprotein characteristics on hydrocarbon fuels. Alcohol-resistant foam concentrates are generally used in concentrations of 3 percent to 10 percent solutions, depending on the nature of the hazard to be protected and the type of concentrate.

**A.3.3.12.2 Aqueous Film-Forming Foam Concentrate (AFFF).** The foam formed acts as a barrier both to exclude air or oxygen and to develop an aqueous film on the fuel surface that is capable of suppressing the evolution of fuel vapors. The foam produced with AFFF concentrate is dry chemical compatible and thus is suitable for combined use with dry chemicals.

**A.3.3.12.3 Film-Forming Fluoroprotein Foam Concentrate (FFFP).** In addition to an air-excluding foam blanket, this concentrate also can deposit a vaporization-preventing film on the surface of a liquid fuel. It is diluted with water to form 3 percent to 6 percent solutions depending on the type. This concentrate is compatible with certain dry chemicals.

**A.3.3.12.5 Fluoroprotein Foam Concentrate.** This type of foam utilizes a protein base plus stabilizing additives and inhibitors to protect against freezing, corrosion, and bacterial decomposition, and it also resists fuel pickup. The foam is usually diluted with water to form a 3 percent or 6 percent solution and is dry chemical compatible.

**A.3.3.12.6 Medium- and High-Expansion Foam Concentrate.** This equipment can be air-aspirating or blower-fan type.

**A.3.3.12.7 Protein Foam Concentrate.** These concentrates are diluted with water to form 3 percent to 6 percent solutions depending on the type. They are compatible with certain dry chemicals.

**A.3.3.12.8.1 Other Synthetic Foam Concentrate.** In general, its use is limited to portable nozzle foam application for spill fires within the scope of their listings. The applicable listings should be consulted to determine proper application rates and methods.

**A.3.3.14.2 Foam Generators — Blower Type.** The blower can be powered by electric motors, internal combustion engines, air, gas, or hydraulic motors or water motors. The water motors are usually powered by foam solution.

**A.3.3.16 Foam Solution.** For the purpose of this document, “foam solution” and “solution” are used interchangeably.

**A.3.3.17.1 Compressed Air Foam System (CAFS).** Discharge of CAFS begins with automatic actuation of a detection system, or with manual actuation that opens valves permitting compressed air foam generated in the mixing chamber to flow through a piping system and to discharge over the area served by the discharge devices or hoses. Compressed air foam systems are permitted to protect flammable and combustible liquids.

Compressed air foam systems are not permitted to be used on the following fire hazards:

- (1) Chemicals, such as cellulose nitrate, that release sufficient oxygen or other oxidizing agents to sustain combustion
- (2) Energized, unenclosed electrical equipment
- (3) Water-reactive metals such as sodium, potassium, and NaK (sodium-potassium alloys)
- (4) Hazardous water-reactive materials such as triethylaluminum and phosphorous pentoxide
- (5) Liquefied flammable gas

**A.3.3.17.3 Mobile System.** For mobile systems, see NFPA 1901.

**A.3.3.17.5 Semifixed System.** The fixed piping installation might or might not include a foam maker. Necessary foam-producing materials are transported to the scene after the fire starts and are connected to the piping.

**A.3.3.18 Foam-Generating Methods.** Foam nozzle and monitor streams can also be employed for the primary protection of process units and buildings, subject to the approval of the authority having jurisdiction. The discharge characteristics of the equipment selected to produce foam nozzle and monitor streams for outdoor storage tank protection should be verified by actual tests to make certain that the streams will be effective on the hazards involved. [See Figure A.3.3.18(a) through Figure A.3.3.18(e).]

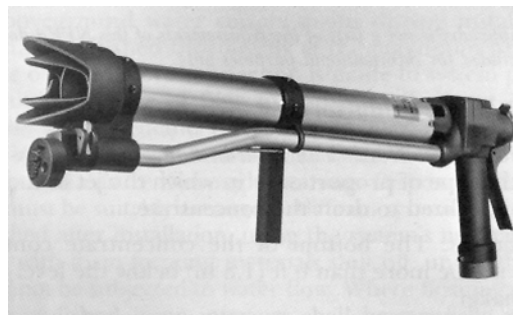


FIGURE A.3.3.18(a) Handline Foam Nozzle.



FIGURE A.3.3.18(b) Adjustable Straight Stream-to-Fan Pattern Foam-Water Monitor.



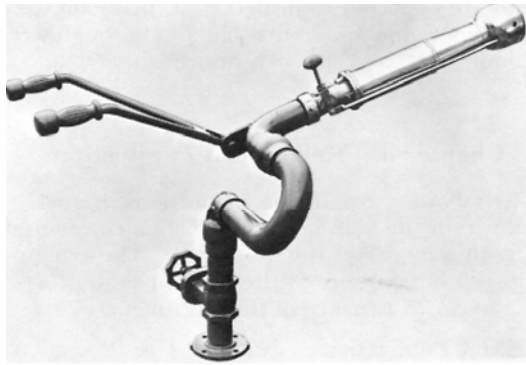


FIGURE A.3.3.18(c) Adjustable Straight Stream-to-Spray Foam-Water Monitor.

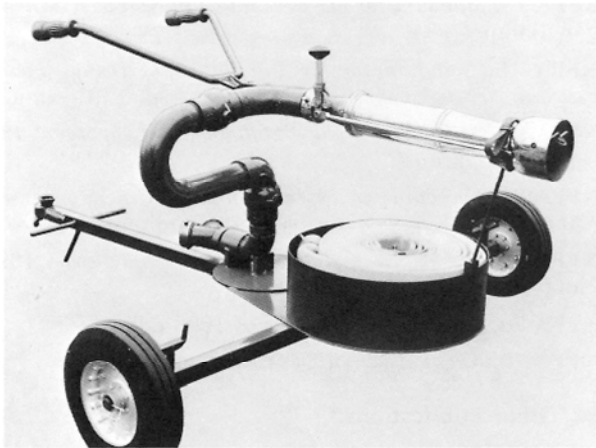


FIGURE A.3.3.18(d) Wheeled Portable Foam-Water Monitor.

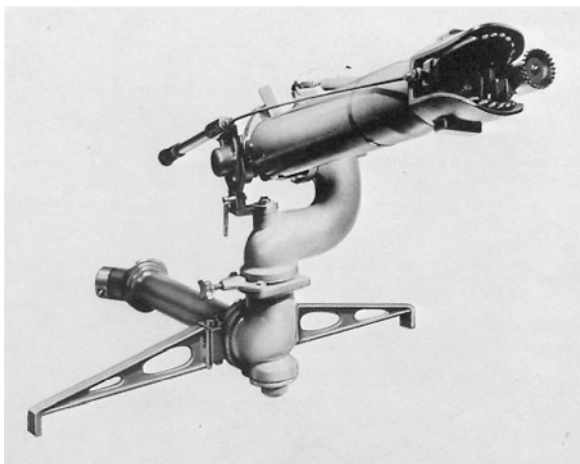


FIGURE A.3.3.18(e) Portable Foam-Water Monitor.

**A.3.3.18.1 Compressed Air Foam-Generating Method.** The resulting compressed air foam flows through piping or hoses to the hazard being protected.

**A.3.3.19 Handline.** The nozzle reaction usually limits the solution flow to about 1135 L/min (300 gpm).

**A.3.3.21.1 Fixed Monitor (Cannon).** The monitor can be fed solution by permanent piping or hose.

**A.3.3.22.1 Foam Nozzle or Fixed Foam Maker.** They are constructed so that one or several streams of foam solution issue into a space with free access to air. Part of the energy of the liquid is used to aspirate air into the stream, and turbulence downstream of this point creates a stable foam capable of being directed to the hazard being protected. Various types of devices can be installed at the end of the nozzle to cause the foam to issue in a wide pattern or a compacted stream.

**A.3.3.22.2 Self-Educting Nozzle.** The foam concentrate is mixed with the water at the desired proportioning injection rate.

**A.3.3.23 Pressure Foam Maker (High Back Pressure or Forcing Type).** Sufficient velocity energy is conserved in this device so that the resulting foam can be conducted through piping or hose to the hazard being protected.


**A.3.3.24.1 Balanced Pressure Pump-Type Proportioning.** By means of an auxiliary pump, foam compound is injected into the water stream passing through an inductor. The resulting foam solution is then delivered to a foam maker or playpipe. The proportioner can be inserted into the line at any point between the water source and foam maker or playpipe. (See Figure A.3.3.24.1.) To operate, the main water valve is opened and a reading of the pressure indicated on the duplex gauge is taken. When both gauge hands are set at the same point, the correct amount of foam concentrate is being injected into the water stream. This reading is done automatically by the use of a differential pressure diaphragm valve.

Metered proportioning has the following limitations:


- (1) The capacity of the proportioner can be varied from approximately 50 percent to 200 percent of its rated capacity.
- (2) The pressure drop across the proportioner ranges from 34 kPa to 207 kPa (5 psi to 30 psi), depending on the volume of water flowing through the proportioner within the capacity limits of item (1).
- (3) A separate pump is needed to deliver concentrate to the proportioner.

**A.3.3.24.1.1 In-Line Balanced Pressure Proportioning.** A bladder tank in conjunction with a water pressure-reducing valve upstream of the proportioner can be utilized in place of the foam concentrate pump package. See Figure A.3.3.24.1.1(a) and Figure A.3.3.24.1.1(b).

**A.3.3.24.2 Coupled Water-Motor Driven Pump Proportioning.** The positive displacement pump draws the foam concentrate from an atmospheric storage tank and feeds it into the water flow, which passes through the water motor. The ratio between the volumes transferred per rotation of the two devices determines the proportioning ratio. Variation of the system pressure, volumetric flow rotate, or viscosity of the foam concentrate will not affect the proportioning ratio because of the positive displacement character of the two devices. See Figure A.3.3.24.2.

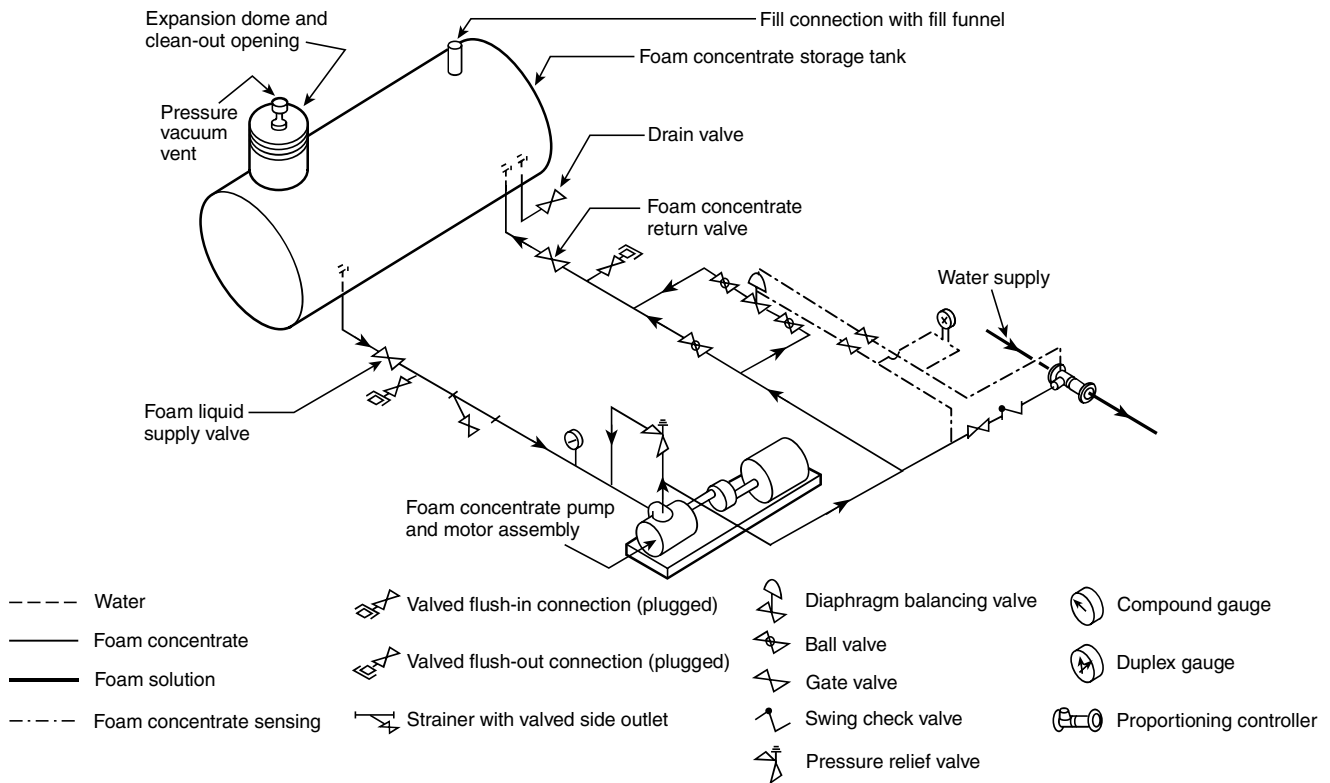

**FIGURE A.3.3.24.1 Balanced Pressure Proportioning (Pump-Type) with Single Injection Point.**

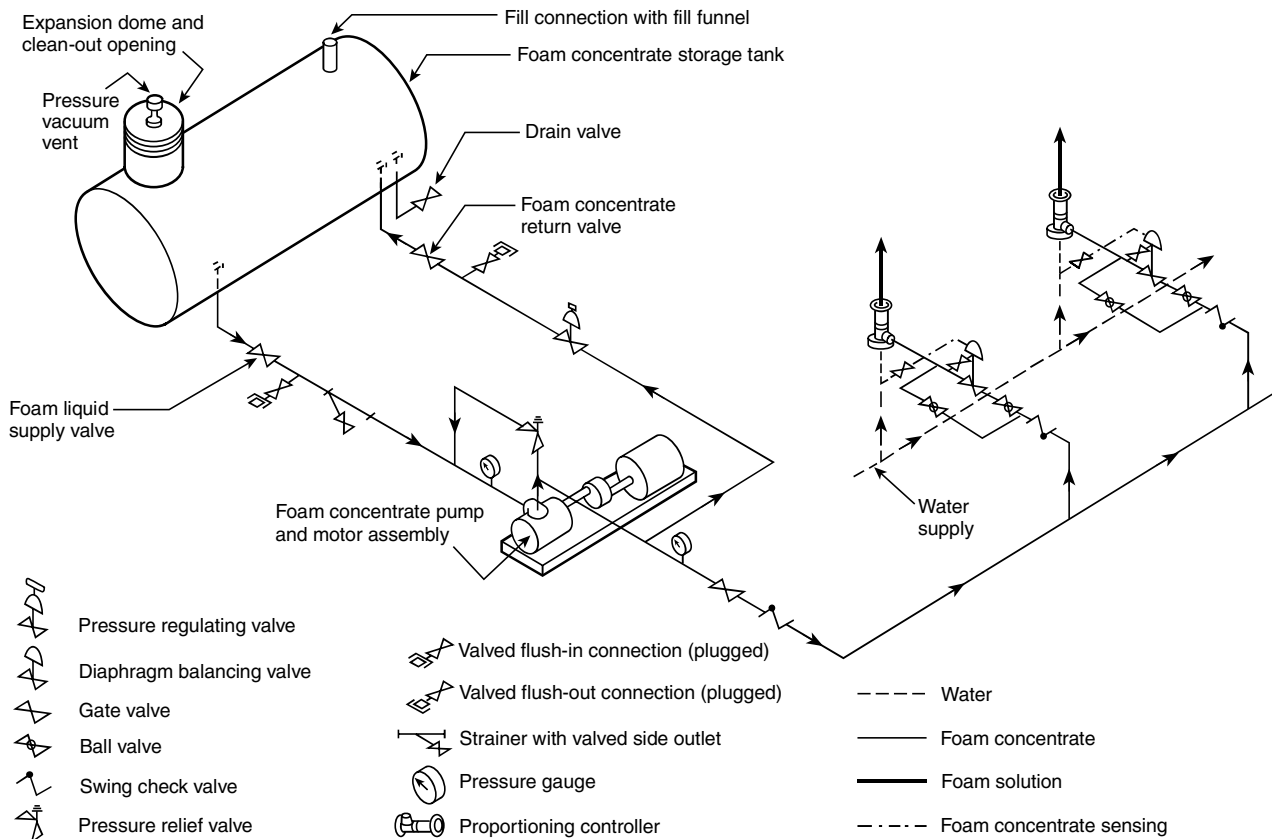

**FIGURE A.3.3.24.1.1(a) In-Line Balanced Pressure (Pump-Type) Proportioning with Multiple Injection Points.**

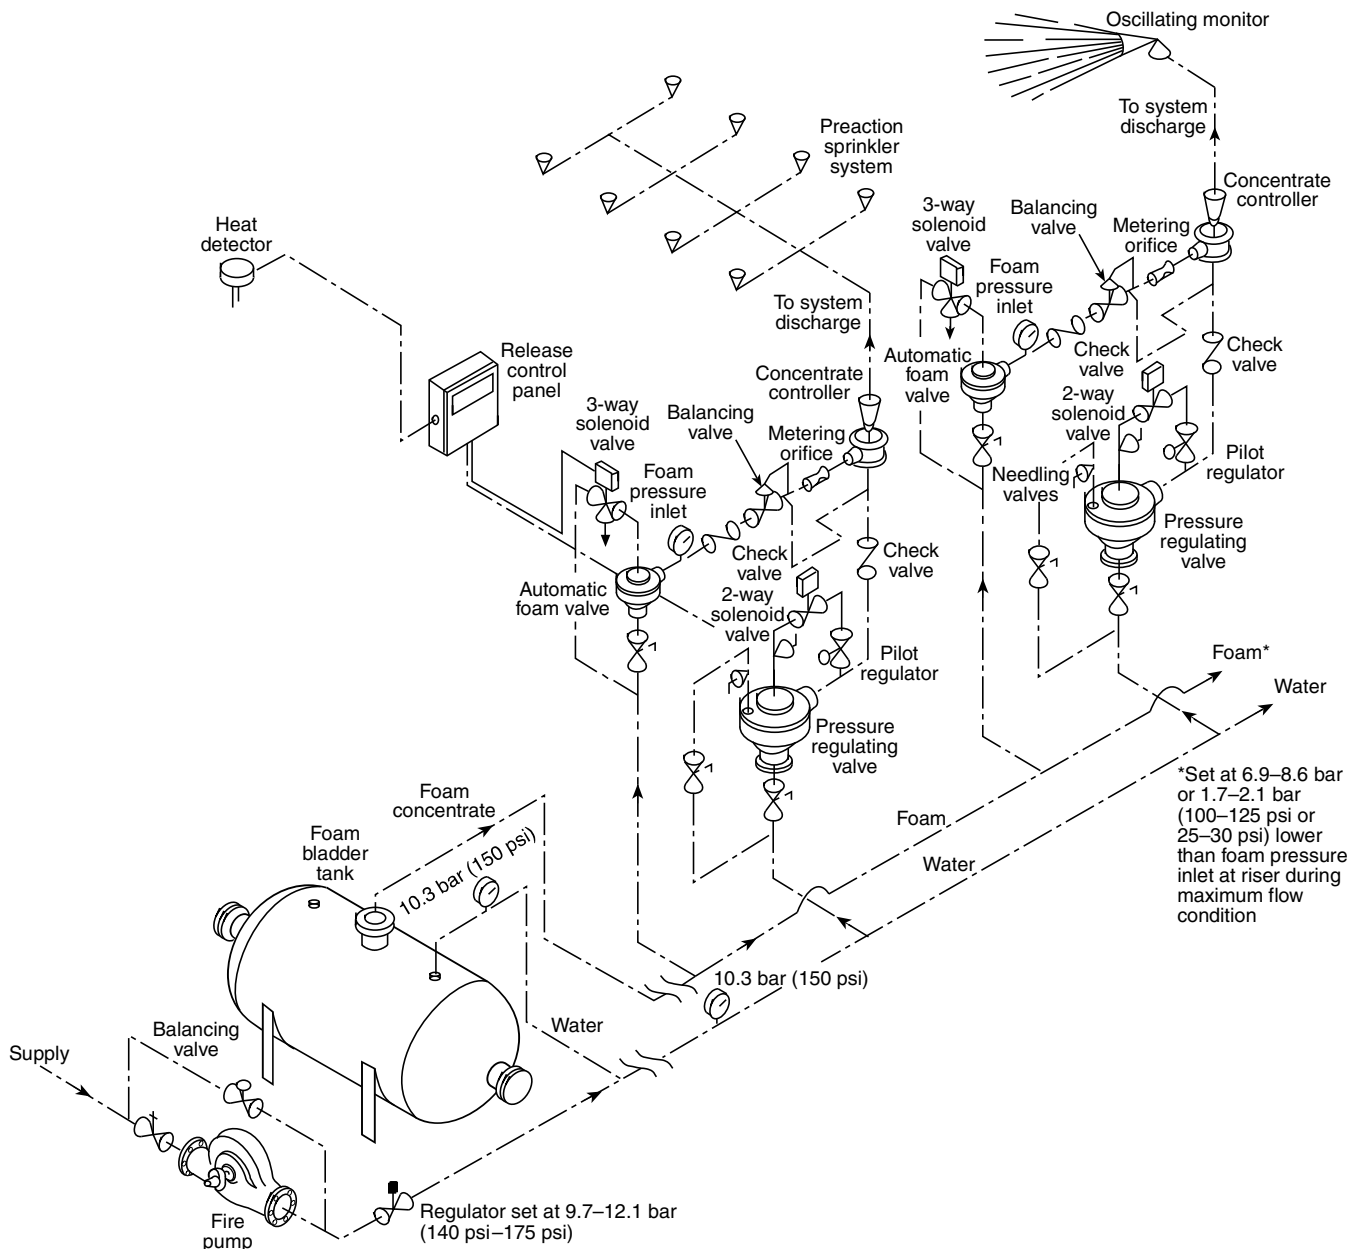


FIGURE A.3.3.24.1.1(b) In-Line Balanced Pressure (Bladder Tank Type) Proportioning with Multiple Injection Points.

**A.3.3.24.3 Direct Injection Variable Pump Output Proportioning.** Direct injection foam proportioning systems utilize a foam concentrate pump to inject foam concentrate directly into the water stream. Foam proportioning system operation is not affected by water pressure or interrupted while the foam concentrate tank is refilled. Direct injection foam proportioning systems are generally automatic regulation proportioning systems. Automatic flow-sensing direct injection foam proportioning systems utilize an in-line flowmeter(s) to monitor the system operating conditions. System operating data is transmitted to an electronic control, which controls the foam pump output to maintain the desired proportioning ratio. The following two different flow sensing systems are available:

(1) An electronic control receives electronic signals corresponding to the proportioning ratio from the control

panel and water flow data from the flowmeter. The electronic control then commands the foam concentrate pump module to deliver foam concentrate at the proportional rate. [See Figure A.3.3.24.3(a).]

(2) An electronic control receives electronic signals corresponding to the foam concentrate flow from a foam concentrate flowmeter, the proportioning ratio from the control panel, and water flow data from the water flowmeter. The electronic control controls the proportioning ratio through a foam concentrate metering valve shown in Figure A.3.3.24.3(b). In a water motor foam proportioning system, a water motor drives a positive displacement foam concentrate pump. The water motor can be of either a positive displacement type or a turbine type. Water motor foam proportioning systems are automatic regulating proportioning

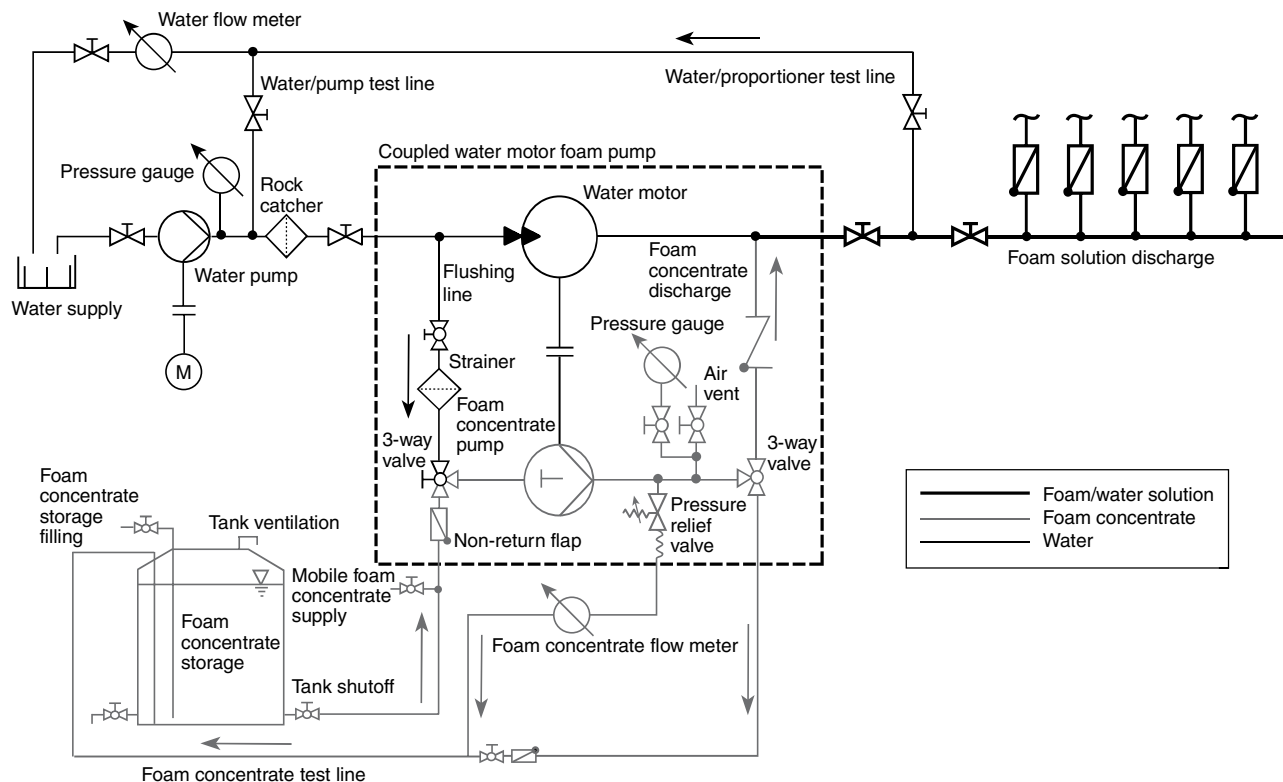


FIGURE A.3.3.24.2 Coupled Water-Motor Driven Pump Proportioning System.


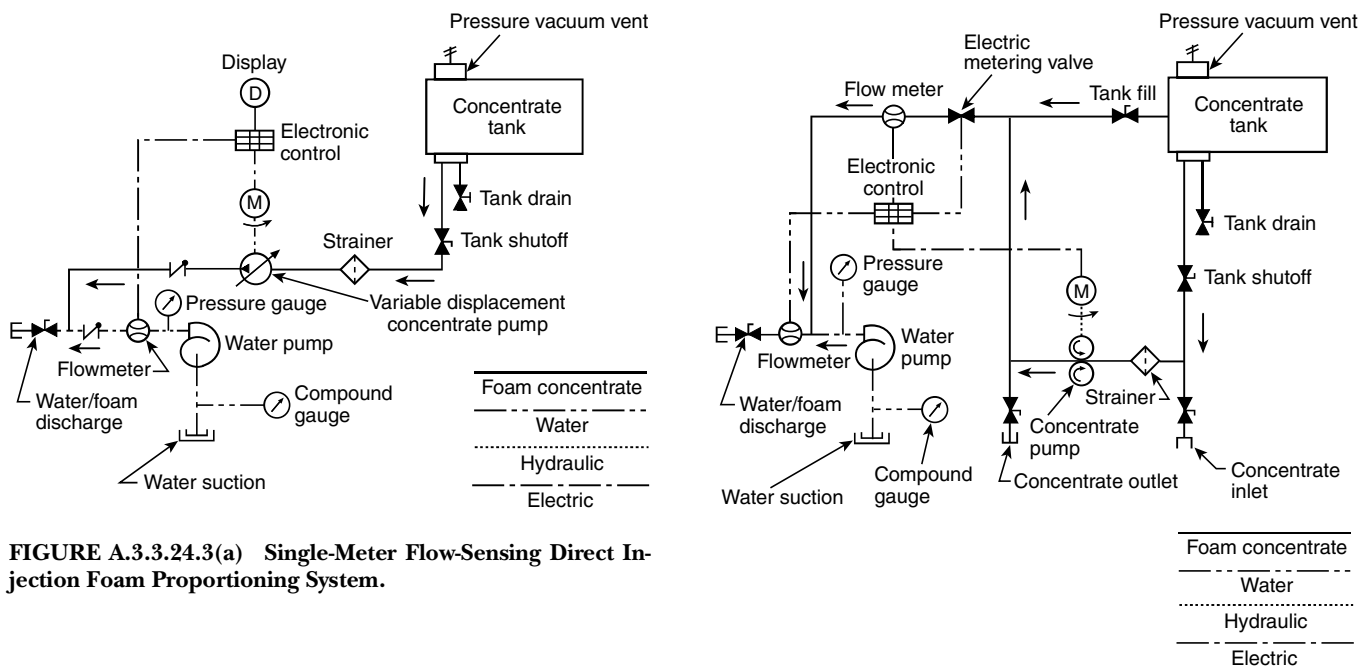


FIGURE A.3.3.24.3(a) Single-Meter Flow-Sensing Direct Injection Foam Proportioning System.


FIGURE A.3.3.24.3(b) Dual-Meter Flow-Sensing Direct Injection Foam Proportioning System.

systems. Where a positive displacement water motor drives the foam concentrate pump, the ratio of the water motor displacement to the displacement of the foam concentrate pump is the ratio of the desired foam solution. A positive displacement water motor proportioning system requires no external power. [See Figure A.3.3.24.3(c).]

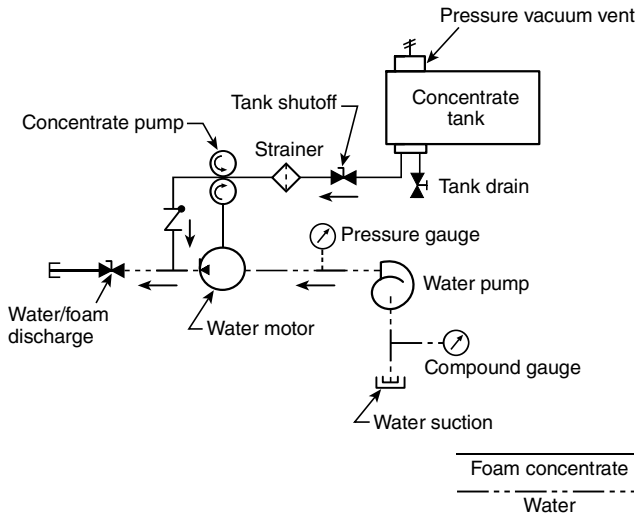

**FIGURE A.3.3.24.3(c) Water Motor Foam Proportioning System.**

A water turbine-driven foam proportioning system uses a water turbine to power a positive displacement foam concentrate pump. Flowmeters sense the foam concentrate pump output and the water flow, sending signals to an electronic control that controls the proportioning ratio by adjusting the water turbine speed. [See Figure A.3.3.24.3(d).]

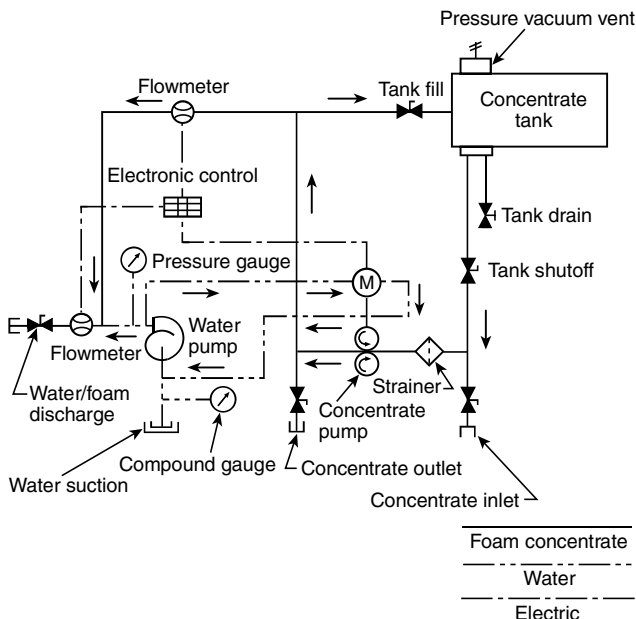


**FIGURE A.3.3.24.3(d) Water Turbine-Driven Flow-Sensing Direct Injection Foam Proportioning System.**

**A.3.3.26 Pump Proportioner (Around-the-Pump Proportioner).** This device consists of an eductor installed in a bypass line between the discharge and suction of a water pump. A small portion of the discharge of the pump flows through this eductor and draws the required quantity of air foam concentrate from a container, delivering the mixture to the pump suction. Variable capacity can be secured by the use of a manually controlled multiported metering valve. [See Figure A.5.2.6.1(a).]

A pump proportioner has the following limitations:

- (1) The pressure on the water suction line at the pump must be essentially zero gauge pressure or must be on the vacuum side. A small positive pressure at the pump suction can cause a reduction in the quantity of concentrate educted or cause the flow of water back through the eductor into the concentrate container. (See Figure A.3.3.26.)
- (2) The elevation of the bottom of the concentrate container should not be more than 6 ft (1.8 m) below the proportioner. (See Figure A.3.3.26.)

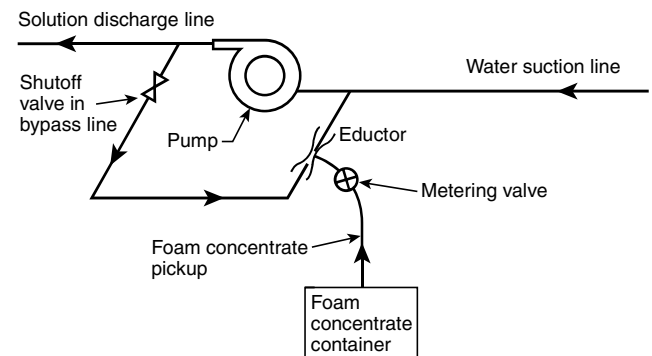

**FIGURE A.3.3.26 Around-the-Pump Proportioner.**

- (3) The bypass stream to the proportioner uses from 38 L/min to 151 L/min (10 gpm to 40 gpm) of water depending on the size of the device and on the pump discharge pressure. This factor must be recognized in determining the net delivery of the water pump.

**A.3.3.28 Spreading Coefficient.** Spreading coefficient is given by the following equation:

$$S = T_c - T_s - T_i \quad \text{[A.3.3.28]}$$

where:

- $S$  = spreading coefficient in dynes/cm
- $T_c$  = surface tension of cyclohexane in dynes/cm
- $T_s$  = surface tension of the foam solution in dynes/cm
- $T_i$  = the interfacial tension between the foam solution and the cyclohexane in dynes/cm

**A.3.3.29.2 Pressure Proportioning Tank.** This method employs water pressure as the source of power. With this device, the water supply pressurizes the foam concentrate storage tank. At the same time, water flowing through an adjacent venturi or orifice creates a pressure differential. The low-pressure area of the venturi is connected to the foam concentrate tank, so that the difference between the water supply pressure and this low-pressure area forces the foam concentrate through a metering orifice and into the venturi. Also, the differential across the venturi varies in proportion to the flow,




so one venturi will proportion properly over a wide flow range. The pressure drop through this unit is relatively low. [See Figure A.3.3.29.2(a).]

A special test procedure is available to permit the use of a minimum amount of concentrate when the pressure proportioner system is testing.

The pressure proportioning tank has the following limitations:

- (1) Foam concentrates with specific gravities similar to water can create a problem when mixed.
- (2) The capacity of these proportioners can be varied from approximately 50 percent to 200 percent of their rated capacity.

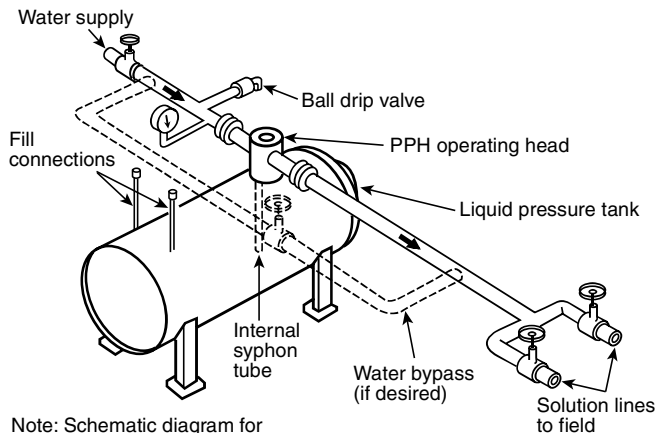

Note: Schematic diagram for clarity only. Does not necessarily show all required valves.


**FIGURE A.3.3.29.2(a) Typical Arrangement of Pressure Proportioning Tank.**

- (3) The pressure drop across the proportioner ranges from 34 kPa to 207 kPa (5 psi to 30 psi), depending on the volume of water flowing within the capacity limits of item (2).
- (4) When the concentrate is exhausted, the system must be turned off, and the tank drained of water and refilled with foam concentrate.
- (5) Since water enters the tank as the foam concentrate is discharged, the concentrate supply cannot be replenished during operation, as with other methods.
- (6) This system proportions at a significantly reduced percentage at low flow rates and should not be used below minimum design flow rate.

A diaphragm (bladder) pressure proportioning tank also uses water pressure as a source of power. This device incorporates all the advantages of the pressure proportioning tank with the added advantage of a collapsible diaphragm that physically separates the foam concentrate from the water supply.

Diaphragm pressure proportioning tanks operate through a similar range of water flows and according to the same principles as pressure proportioning tanks. The added design feature is a reinforced elastomeric diaphragm (bladder) that can be used with all concentrates listed for use with that particular diaphragm (bladder) material. [See Figure A.3.3.29.2(b).]

The proportioner is a modified venturi device with a foam concentrate feed line from the diaphragm tank connected to the low-pressure area of the venturi. Water under pressure passes through the controller, and part of this flow is diverted into the water feed line to the diaphragm tank. This water pressurizes the tank, forcing the diaphragm filled with foam concentrate to slowly collapse. This forces the foam concentrate out through the foam concentrate feed line and into the low-pressure area of the proportioner controller. The concentrate is metered by use of an orifice or metering valve and mixes in the proper proportion

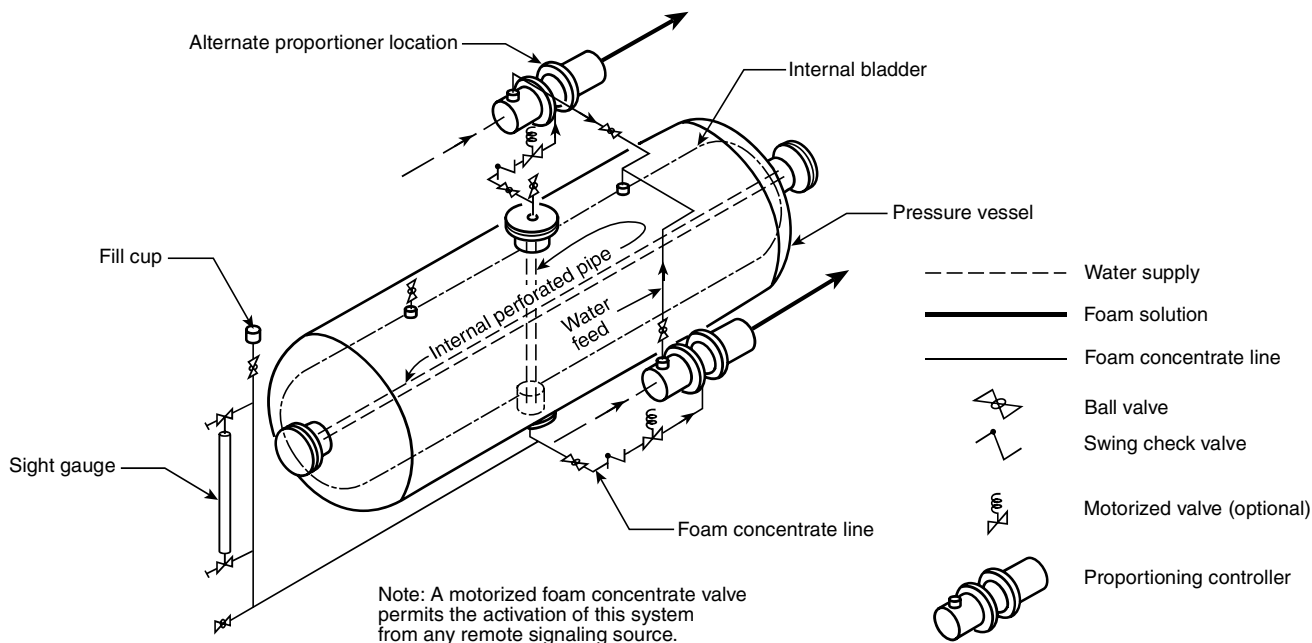

**FIGURE A.3.3.29.2(b) Diaphragm (Bladder) Proportioning Tank.**

with the main water supply, sending the correct foam solution downstream to the foam makers.

The limitations are the same as those listed for the pressure proportioning tank, except that the system can be used for all types of concentrates.

**A.4.1** A foam system consists of a water supply, a foam concentrate supply, proportioning equipment, a piping system, foam makers, and discharge devices designed to distribute foam effectively over the hazard. Some systems include detection devices.

**A.4.1.1** FM Approvals Class 5130, *Approval Standard for Foam Extinguishing Systems*; UL Subject 139, *High-Expansion Foam-Extinguishing System Equipment and Concentrates*; or UL Standard 162, *Standard for Safety Foam Equipment and Liquid Concentrates* should be consulted for possible listing requirements.

**A.4.2.1.1.1** Recycled water, processed water, or gray water can be utilized for foam production. When used, a competent evaluation for the suitability of the water quality should be conducted.

**A.4.2.1.2** Additional water supplies are recommended for cooling the hot tank shell to assist the foam in sealing against the shell. Some foams are susceptible to breakdown and failure to seal as a result of heating the tank shell due to prolonged burning prior to agent discharge.

**A.4.2.1.4** Higher or lower water temperatures can reduce foam efficiency.

**A.4.3.1.2** Some concentrates are suitable for use both on hydrocarbon fuels and on water-miscible or polar fuels and solvents.

**A.4.3.1.4(4)** The method of measurement should be identified, including the device used and parameters such as temperature, spindle number, and spindle speed in revolutions per minute (e.g., Brookfield viscometer).

**A.4.3.2.2** The level of concentrate in the storage tank should be monitored to ensure that an adequate supply is available at all times. The hazard requiring the largest foam solution flow rate does not necessarily dictate the total amount of foam concentrate required. For example, a Class II product tank requiring a flow of 1136 L/min (300 gpm) foam solution for 30 minutes would require 1022 L (270 gal) of 3 percent concentrate. A Class I product tank requiring a flow of 946 L/min (250 gpm) foam solution for 55 minutes would require 1563 L (412.5 gal) of 3 percent concentration.

**A.4.3.2.3.3** Some foam proportioning systems can have an inherent problem related to loss of foam concentrate and/or damage to bladder tanks or foam pumps if not shut down properly following system activation. There are two scenarios that can occur depending on the proportioning system arrangement. Bladder tank proportioning systems with the water feed line to the bladder tank(s) connected below the foam riser manual shutoff outside screw and yoke (OS&Y) gate valve can be vulnerable depending on the system shutdown procedure followed. When the riser shutoff valve is closed first, foam concentrate continues to flow into the depressurized riser through the proportioner foam metering orifice. If this condition continues, all foam concentrate in the bladder tank will be forced into the riser and foam solution distribution piping. In-line balanced pressure or balanced pressure foam pump-type proportioning systems can also experience a similar loss of foam concentrate depending on the system installation arrangement. If the water supply (riser OS&Y) valve is located before (up-

stream) the foam proportioner with the foam pump still running, the same potential for foam concentrate loss exists. When the water supply (riser OS&Y) valve is closed, the foam proportioner is no longer pressurized and foam concentrate will be forced through the proportioner and metering orifice into the riser. If allowed to continue, this condition will deplete the foam tank and possibly cause harm to the foam pump by running in a “dry” condition. Close the foam concentrate supply valve before shutting off the water supply valve, to prevent loss of concentrate. In the case of a pump-type system, it will allow foam to recirculate back to the foam tank until the foam pump is shut off. Alternatively, in the case of bladder tank systems, the water feed valve to the tank(s) could be closed, which would stop the foam injection process.

**A.4.3.2.4.1** Since such systems might or might not be operated for long periods after installation, the choice of proper storage conditions and maintenance methods largely determines the reliability and the degree of excellence of system operation when they are put into service.

**A.4.3.2.4.2** Foam concentrates are subject to freezing and to deterioration from prolonged storage at high temperatures. The storage temperature should be monitored to ensure that listed temperature limitations are not exceeded. Concentrates can be stored in the containers in which they are transported or can be transferred into large bulk storage tanks, depending on the requirements of the system. The location of stored containers requires special consideration to protect against exterior deterioration due to rusting or other causes. Bulk storage containers also require special design consideration to minimize the liquid surface in contact with air.

**A.4.4.1.1** Often, different brands of the same type of foam concentrates are found to be chemically compatible. However, before different brands of concentrates are mixed for long-term storage, evaluations should be made to determine such compatibility. A number of parameters should be considered and evaluated before concentrates are mixed for storage. In addition to the chemical compatibility, one should consider effects on proportioning and discharge hardware (many listings and approvals are very specific with regard to operating pressures, flow ranges, and materials of construction of hardware components). The application method should be the same for both foams being mixed. The system design application rate (density) might have to be changed if one of the foam concentrates being admixed is listed or approved at an application rate (density) that is higher than the one used for the initial design. This generally applies to alcohol-resistant foams since their listings and approvals are very application rate sensitive.

**A.4.4.2** Some expanded foam is not compatible with all dry chemical agents.

**A.4.5.1** Some alcohol-resistant foam proportioners require much higher flow rates to meet the minimum flow and proper proportioning percentage of the foam concentrate being used. In balanced pressure systems when the flow is less than the listed minimum, the foam percentage is less than the required where a smaller proportioner should be applied or an in-line balanced pressure proportioning system should be used when the flow rate is below the minimum listed flow rate the percentage is greater than the design percentage of the foam concentrate.

**A.4.6** Foam concentrate pumps are generally of the positive displacement variety. Centrifugal pumps might not be

suitable for use with foam concentrates exhibiting high-viscosity characteristics. The foam equipment manufacturer should be consulted for guidance.

**A.4.7.1** This section addresses the pipe section that contains foam concentrate from the foam concentrate storage tank to the side inlet of the proportioner or eductor.

**A.4.7.1.1** Some fluoroprotein from concentrates are incompatible with stainless steel pipe. Check with the manufacturer of the foam concentrate to ensure compatibility of the foam concentrate pipe material.

**A.4.7.1.2** Carbon steel pipe has been used for concentrate pipe. Some foam concentrates, in particular alcohol-resistant foam concentrates, are corrosive to the carbon steel pipe and could deteriorate the integrity of the pipe. Carbon steel pipe is also susceptible to oxidation when air is present in the pipe.

**A.4.7.1.7** Additional pressure may be required to start flow from a static condition. The friction losses associated with large pipe networks may have a significant impact.

**A.4.7.2** This section addresses the pipe section(s) that contains foam solution located from the flow-through outlet of the foam concentrate proportioner or eductor to the discharge device.

**A.4.7.2.1** Most deluge type foam water systems are subject to harsh environmental conditions, which can subject the foam solution feed line piping to internal to external corrosion. Types of systems that fall into this category include open head sprinklers, foam spray nozzles, monitors, foam chambers, fixed foam makers, fixed medium expansion foam makers, and high expansion foam systems. These systems are typically utilized for protection of fuel storage tanks, diked fuel containment areas, LNG facilities, truck and rail car loading racks, aircraft hangars, warehouses, marine docs, interior fuel storage tanks, refineries and manufacturing/processing areas.

The foam solution piping on these systems is exposed to thermal changes, air movement, and other environmental conditions that can cause condensation, and the resulting corrosion can lead to the formation of debris and pipe scale. This material can inhibit proper function of the foam system discharge devices due to blockage. To alleviate the problem of foam systems with piping that is normally open to the surrounding atmosphere, these types of systems are to be constructed using pipe fitting materials identified in 4.7.2.1 and 4.7.3.2.1. Corrosive atmospheres could require other coatings.

**A.4.7.3.1** Corrosive atmospheres could require other coatings.

**A.4.7.4.3** Welding is preferable where it can be done without introducing fire hazards.

**A.4.7.6** A hazard area generally includes all areas within dikes and within 15 m (50 ft) of tanks without dikes. Other areas that should be considered hazard areas include the following:

- (1) Locations more than 15 m (50 ft) from tanks without dikes, if the ground slope allows exposure from accidentally released flammable and combustible liquids
- (2) Extensive manifold areas where flammable and combustible liquids might be released accidentally
- (3) Other similar areas

The presence of flammable and combustible liquids within pipelines that do not possess the potential to release flammable and combustible liquids should not be considered as creating a hazard area. Ball valves can be used for foam concentrate proportioning systems.


**A.4.9.2.5** See applicable sections of *NFPA 72*.

**A.4.9.2.6** See Article 500 and other articles in Chapter 5 of *NFPA 70*.

**A.5.1** There have been cases reported where the application of foam through solid streams that were plunged into the flammable liquid has been believed to be the source of ignition of the ensuing fire. The ignitions have been attributed to static discharges resulting from splashing and turbulence. Therefore, any application of foam to an unignited flammable liquid should be as gentle as possible. Correct application methods with portable equipment might include a spray pattern or banking the foam stream off a backboard so that the foam flows gently onto the liquid surface. Also, correctly designed fixed foam chambers on tanks could be expected to deliver the foam fairly gently and not cause a problem. Covered (internal) floating roof tanks can experience two distinct types of fires: a full surface area fire (as a result of the floating roof sinking) or a seal fire. There have been few fires in double-deck or pontoon-type floating roof tanks where fixed roofs and venting are designed in accordance with *NFPA 30*. Prior to selecting the method of protection, the type of fire that will serve as the basis for design should be defined.

*Outdoor Fixed-Roof (Cone) Tanks.* Within the scope of this standard, fixed-roof (cone) tanks are defined as vertical cylindrical tanks with a fixed roof designed as a conical section, and they comply with the requirements set forth in *NFPA 30*. Typically, these tanks have a weak seam at the junction of the vertical side and roof. In the event of an internal explosion, the seam usually parts and the roof blows off, leaving the shell intact to retain the tank contents. The resulting fire involves the entire exposed surface of the product.

These systems are used for the protection of outdoor process and storage tanks. They include the protection of such hazards in manufacturing plants as well as in large tank farms, oil refineries, and chemical plants. These systems usually are designed for manual operation but, in whole or in part, can be automatic in operation. Foam systems are the preferred protection for large outdoor tanks of flammable liquids, as shown in Figure A.5.1.

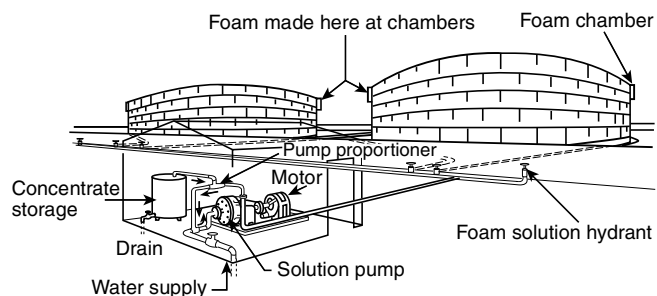

**FIGURE A.5.1 Schematic Arrangement of Air Foam Protection for Storage Tanks.**

**A.5.2.3** The requirements provided in this section are based on extrapolations of test experience and appropriate listings and reflect the limitations known to date. Foam can fail to seal against the tank shell as a result of prolonged free burning prior to agent discharge. If adequate water supplies are available, cooling of the tank shell is recommended. Where the entire liquid surface has been involved, fires in tanks up to 39 m (150 ft) in diameter have been extinguished with large-capacity foam monitors. Depending on the fixed-roof tank outage and fire intensity, the updraft



due to chimney effect can prevent sufficient foam from reaching the burning liquid surface to form a blanket. Foam should be applied continuously and evenly. Preferably, it should be directed against the inner tank shell so that it flows gently onto the burning liquid surface without undue submergence. This can be difficult to accomplish, as adverse winds, depending on velocity and direction, reduce the effectiveness of the foam stream. Fires in fixed-roof tanks with ruptured roofs that have only limited access for foam application are not easily extinguished by monitor application from ground level. Fixed foam monitors can be installed for protection of drum storage areas or diked areas.

**A.5.2.4.2.1** The specified minimum delivery rate for primary protection is based on the assumption that all the foam reaches the area being protected.

**A.5.2.4.2.2** Where protection is desired for hydrocarbons having a flash point above 93.3°C (200°F), a minimum discharge time of 35 minutes should be used.

**A.5.2.4.3** When some older types of alcohol-resistant foam concentrate are used, consideration should be given to solution transit time. Solution transit time (i.e., the elapsed time between injection of the foam concentrate into the water and the induction of air) might be limited, depending on the characteristics of the foam concentrate, the water temperature, and the nature of the hazard protected. The maximum solution transit time of each specific installation should be within the limits established by the manufacturer.


**A.5.2.4.3.1** In general, alcohol-resistant foams can be effectively applied through foam monitor or foam hose streams to spill fires of these liquids where the liquid depth does not exceed 25.4 mm (1 in.).

**A.5.2.4.3.2** If application results in foam submergence, the performance of alcohol-resistant foams usually deteriorates significantly, particularly where there is a substantial depth of fuel. The degree of performance deterioration depends on the degree of water solubility of the fuel (i.e., the more soluble, the greater the deterioration).


**A.5.2.5.1** For this application, discharge outlets are commonly called foam chambers. Most foam chambers are of a Type II discharge outlet design, since they are normally suitable for use with modern foams.

**A.5.2.5.2.1** It is recommended that, for tanks greater than 60 m (200 ft) in diameter, at least one additional discharge outlet should be added for each additional 465 m<sup>2</sup> (5000 ft<sup>2</sup>) of liquid surface or fractional part thereof. Since there has been limited experience with foam application to fires in fixed-roof tanks greater than 42 m (140 ft) in diameter, requirements for foam protection on such tanks are based on the extrapolation of data from successful extinguishments in smaller tanks. Tests have shown that foam can travel effectively across at least 30 m (100 ft) of burning liquid surface. On fixed-roof tanks of over 60 m (200 ft) diameter, subsurface injection can be used to reduce foam travel distances for tanks containing hydrocarbons only. Unless subsurface foam injection is utilized, a properly sized flanged connection should be installed on all atmospheric pressure storage tanks, regardless of present intended service, to facilitate the future installation of an approved discharge outlet if a change in service should require such installation. Figure A.5.2.5.2.1(a) and Figure A.5.2.5.2.1(b) are typical fixed foam discharge outlets or foam chambers.

**A.5.2.5.2.2** Type I discharge outlets are considered obsolete, and Type I outlets that are damaged effectively become Type II

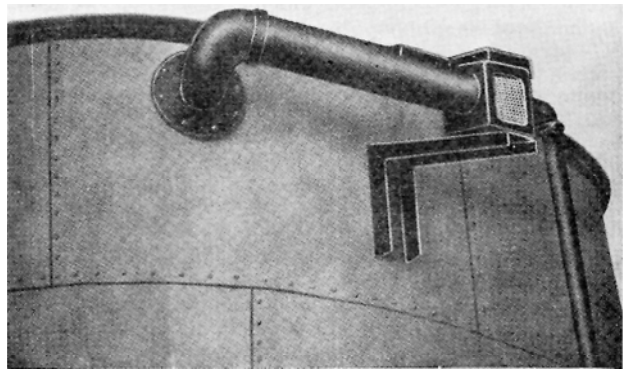

**FIGURE A.5.2.5.2.1(a) Air Foam Maker in Horizontal Position at Top of Storage Tank.**

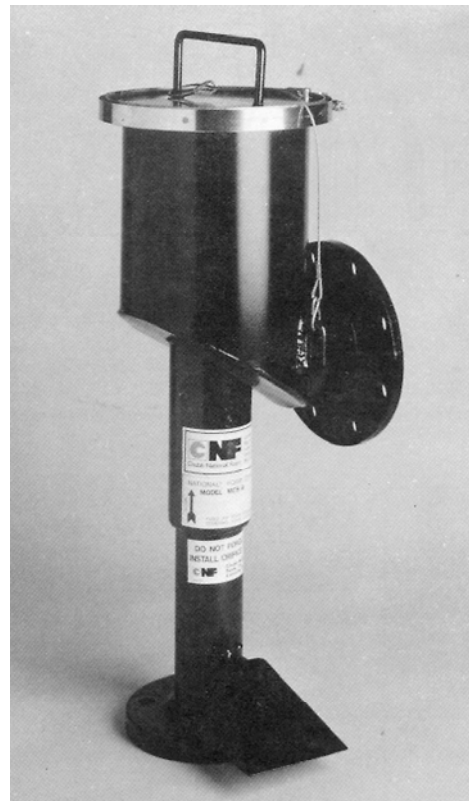

**FIGURE A.5.2.5.2.1(b) Foam Chamber and Foam Maker.**

outlets. Minimum discharge times and application rates for Type I outlets currently installed are provided in Table 5.2.5.2.2 for fixed-roof tanks storing hydrocarbons and in Table 5.2.5.3.4 for flammable and combustible liquids requiring alcohol-resistant foams.

**A.5.2.5.3** The system should be designed based on fighting a fire in one tank at a time. The rate of application for which the system is designed should be the rate computed for the protected tank considering both the liquid surface area and the type of flammable liquid stored. For example, the property contains a 12.2 m (40 ft) diameter tank storing ethyl alcohol and 10.7 m (35 ft) diameter tank storing isopropyl ether. The

liquid surface area of a 12.2 m (40 ft) diameter tank equals 116.8 m<sup>2</sup> (1257 ft<sup>2</sup>). Assuming the solution rate for ethyl alcohol is 4.1 L/min·m<sup>2</sup> (0.1 gpm/ft<sup>2</sup>), then 1257 gpm/ft<sup>2</sup> × 0.1 = 477 L/min (126 gpm). The liquid surface area of a 10.7 m (35 ft) diameter tank equals 89.4 m<sup>2</sup> (962 ft<sup>2</sup>).


Assuming the solution rate for isopropyl ether is 6.1 L/min·m<sup>2</sup> (0.15 gpm/ft<sup>2</sup>), then 962 ft<sup>2</sup> × 0.15 gpm/ft<sup>2</sup> = 144 gpm. For SI units: Solution rate = 89.4 × 6.1 = 545 L/min. In this example, the smaller tanks storing the more volatile product require the higher foam-generating capacity. In applying this requirement, due consideration should be given to the future possibility of change to a more hazardous service requiring greater rates of application. Unfinished solvents or those of technical grade can contain quantities of impurities or diluents. The proper rate of application for these, as well as for mixed solvents, should be selected with due regard to the foam-breaking properties of the mixture.

**A.5.2.5.3.2** Systems using these foams require special engineering consideration.


**A.5.2.6.1** Experience with fuel storage tank fire fighting has shown that the main problems are operational (i.e., difficulty in delivering the foam relatively gently to the fuel surface at an application rate sufficient to effect extinguishment). A properly engineered and installed subsurface foam system offers the potential advantages of less chance for foam-generation equipment disruption as a result of an initial tank explosion or the presence of fire surrounding the tank, and the ability to conduct operations a safe distance from the tank. Thus, the opportunity for establishing and maintaining an adequate foam application rate is enhanced. The following guidelines regarding fire attack are recommended. After necessary suction connections are made to the water supply and foam-maker connections are made to foam lines, foam pumping operations should be initiated simultaneously with opening of block valves permitting the start of foam flow to the tank. Solution pressure should be brought up to and maintained at design pressure.

When foam first reaches the burning liquid surface, there can be a momentary increase in intensity caused by the mechanical action of steam formation when the first foam contacts the heat of the fire. Initial flame reduction and reduction of heat is then usually quite rapid, and gradual reduction in flame height and intensity will occur as the foam closes in

against the tank shell and over the turbulent areas over foam injection points. If sufficient water supplies are available, cooling of the tank shell at and above the liquid level will enhance extinguishment and should be used. Care should be taken that water streams are not directed into the tank where they could disrupt the established foam blanket. After the fire has been substantially extinguished by the foam, some fire can remain over the point of injection. With flash points below 37.8°C (100°F) (Class IB and Class IC liquids), the fire over the turbulent area will continue until it is adequately covered by foam. With gasoline or equivalent liquids, when fire remains only over the area of injection, intermittent injection should be used so that foam will retrogress over the area during the time foam injection is stopped. Depending on local circumstances, it might be possible to extinguish any residual flickers over the turbulent area with portable equipment rather than continue the relatively high rate of application to the whole tank. If the tank contains a burning liquid capable of forming a heat wave, a slop-over can occur from either top-side or subsurface injection of foam, especially if the tank has been burning for 10 minutes or longer. Slop-over can be controlled by intermittent foam injection or reduction in foam-maker inlet pressure until slop-over ceases. Once slop-over has subsided, and in the case of liquids that do not form a heat wave, the pump rate should be continuous. Figure A.5.2.6.1 (a) and Figure A.5.2.6.1 (b) illustrate typical arrangements of semifixed subsurface systems.

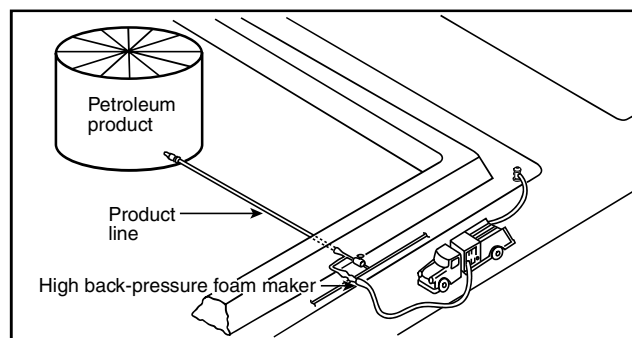

**FIGURE A.5.2.6.1 (a) Semifixed Subsurface Foam Installation.**

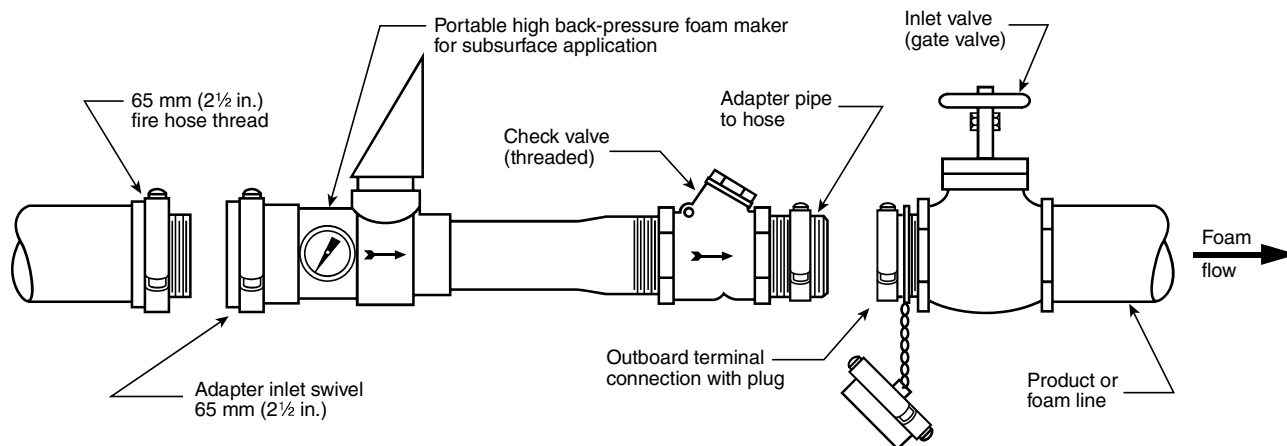

**FIGURE A.5.2.6.1 (b) Typical Connection for Portable High Back-Pressure Foam Maker for Subsurface Application in Semifixed System.**



**A.5.2.6.2** Figure A.5.2.6.2(a) through Figure A.5.2.6.2(c) should be used to determine foam velocity.

Expanded foam velocity also can be calculated by using the following formulas:

[A.5.2.6.2a]

$$\text{English velocity (ft/sec)} = \frac{\text{Expanded foam (gpm)}}{KA}$$

where:


gpm = gallons per minute

K = constant 449


A = area of ID of the injection pipe (ft<sup>2</sup>)

or

$$V = \frac{\text{gpm foam}}{d^2} \times 0.4085 \quad \text{[A.5.2.6.2b]}$$

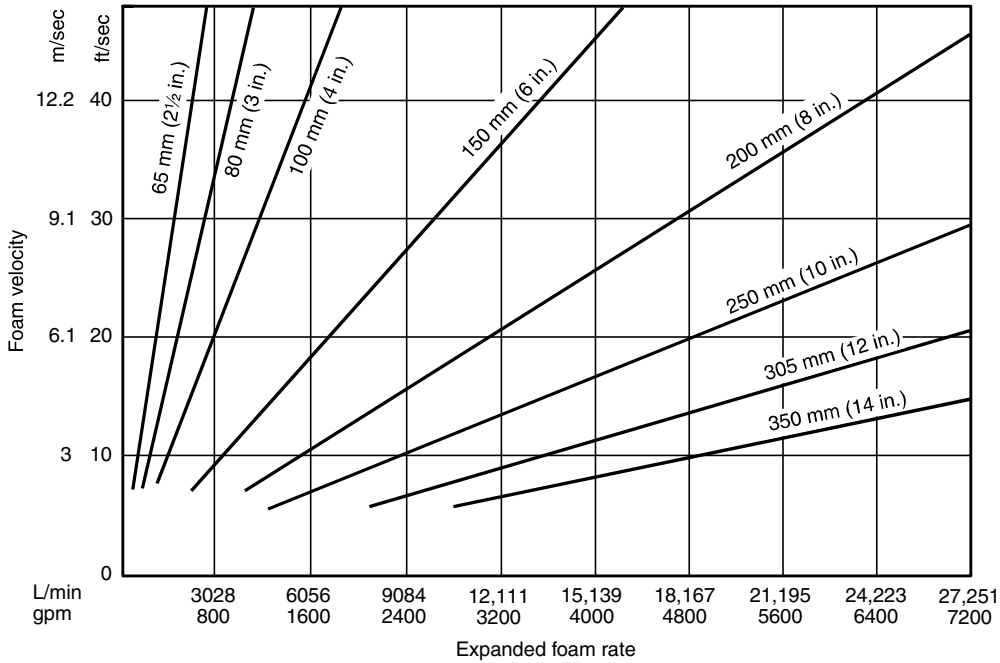

**FIGURE A.5.2.6.2(a) Foam Velocity vs. Pipe Size (2½ in., 3 in., 4 in., 6 in., 8 in., 10 in., 12 in., and 14 in.) — Standard Schedule 40 Pipe.**

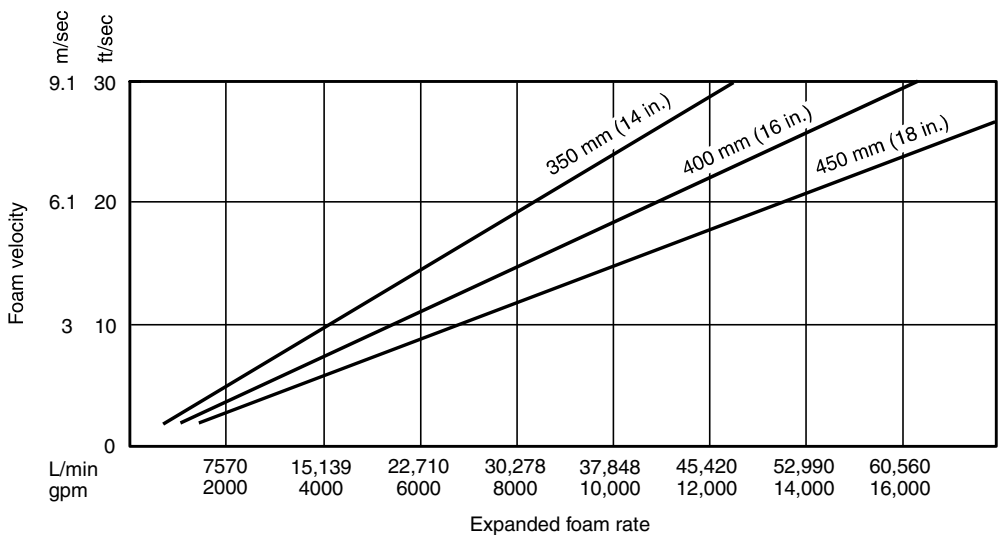

**FIGURE A.5.2.6.2(b) Foam Velocity vs. Pipe Size (14 in., 16 in., and 18 in.) — Standard Schedule 40 Pipe.**

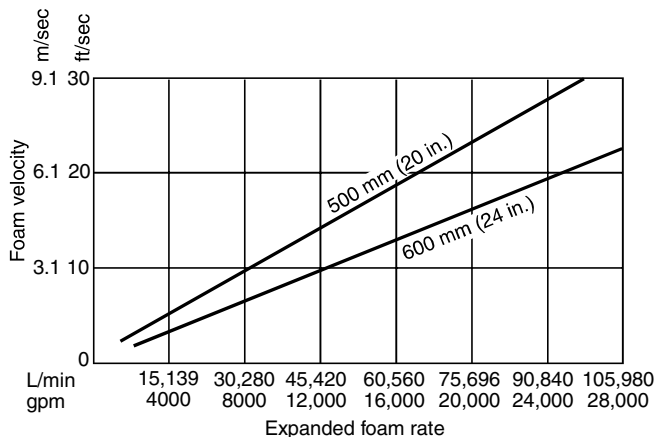


FIGURE A.5.2.6.2(c) Foam Velocity vs. Pipe Size (20 in. and 24 in.) — Standard Schedule 40 Pipe.

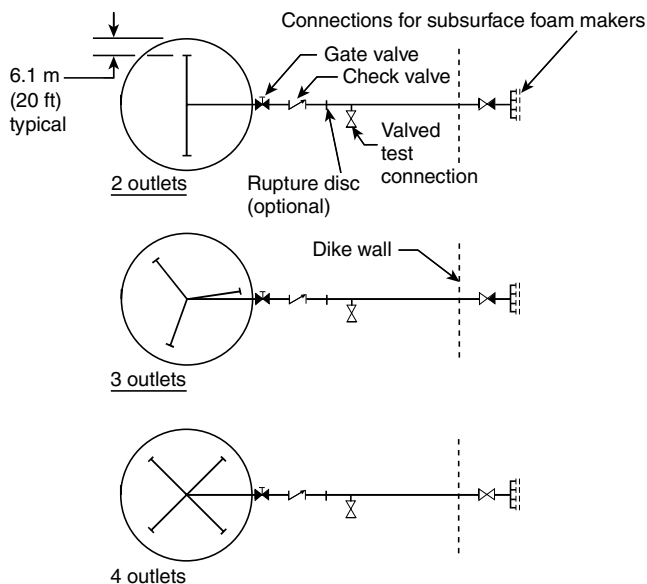


FIGURE A.5.2.6.2(d) Typical Arrangement of Semifixed Subsurface System.

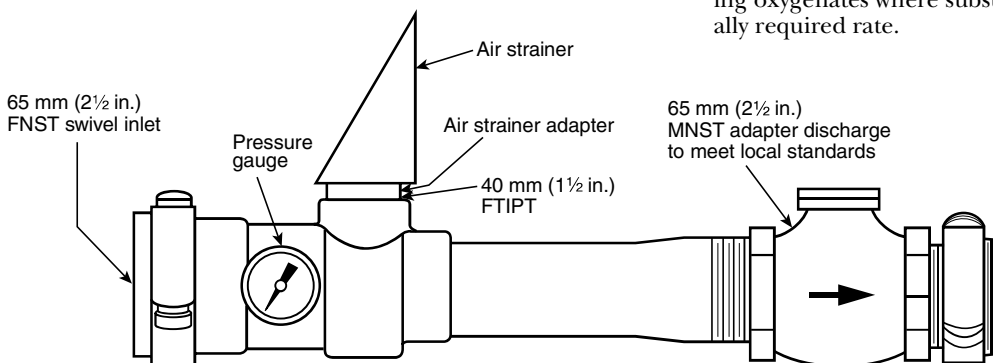


FIGURE A.5.2.6.3.1(a) Portable High Back-Pressure Foam Maker for Semifixed Systems.

where:  
 $d$  = pipe ID (in.)

[A.5.2.6.2c]

$$\text{Metric velocity (m/sec)} = \frac{L/\text{min foam}}{d^2} \times 21.22$$

where:  
 $d$  = pipe ID (mm)

Figure A.5.2.6.2(d) illustrates optional arrangements for multiple subsurface discharge outlets.

A.5.2.6.3 Figure A.5.2.6.3 illustrates a typical foam inlet tank connection.

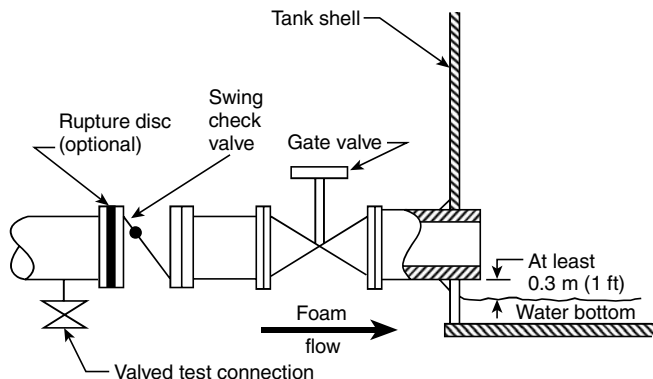


FIGURE A.5.2.6.3 Typical Tank Foam-Maker Discharge Connection for Subsurface Injection.

A.5.2.6.3.1 Liquid hydrocarbons that contain foam-destructive products might require higher application rates. Some foams might fail to extinguish fires in gasolines containing oxygenates where subsurface discharge is used at the usually required rate. Optimum fluoroprotein foam, AFFF, and FFFP characteristics for subsurface injection purposes should have expansion ratios between 2 and 4. [See Figure A.5.2.6.3.1(a) and Figure A.5.2.6.3.1(b).]

A.5.2.6.4 The back pressure consists of the static head plus pipe friction losses between the foam maker and the foam inlet to the tank. The friction loss curves, as shown in Figure A.5.2.6.4(a) and Figure A.5.2.6.4(b), are based on a maximum foam expansion of 4, which is the value to be used for friction loss and inlet velocity calculations.

A.5.2.6.5.2 Liquid hydrocarbons that contain foam-destructive products might require higher application rates. Some foams might fail to extinguish fires in gasolines containing oxygenates where subsurface discharge is used at the usually required rate.

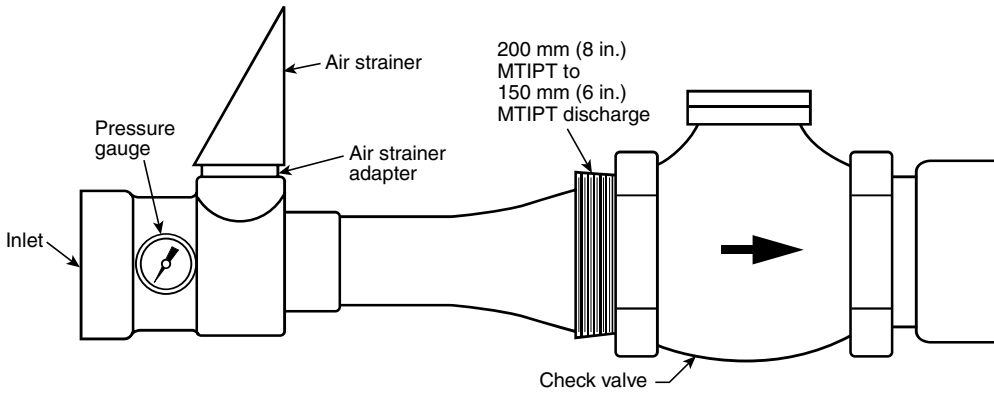


FIGURE A.5.2.6.3.1(b) Fixed High Back-Pressure Foam Maker for Fixed Systems.

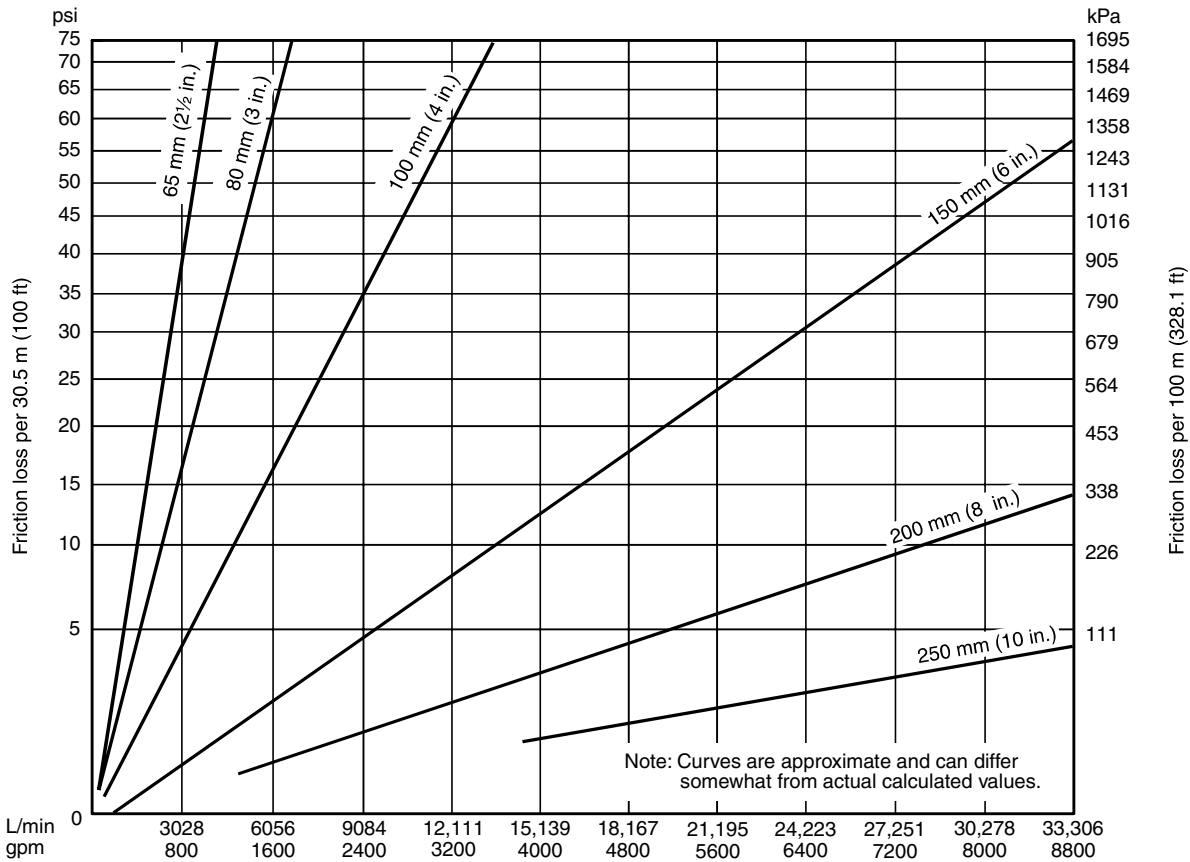


FIGURE A.5.2.6.4(a) Foam Friction Losses — 4 Expansion (2½ in., 3 in., 4 in., 6 in., 8 in., and 10 in.) — Standard Schedule 40 Pipe.

**A.5.2.7** This section describes the design criteria that are applicable to systems used to apply foam to the surface of fixed-roof (cone) storage tanks via a flexible hose rising from the base of the tank. Manufacturer recommendations should be followed for the design and installation of such systems. For semisubsurface system arrangement, see Figure A.5.2.7.

These systems are not considered appropriate for floating roof tanks with or without a fixed roof because the floating roof prevents foam distribution. The flexible foam delivery

hose is contained initially in a sealed housing and is connected to an external foam generator capable of working against the maximum product head. When operated, the hose is released from its housing, and the hose floats to the surface as a result of the buoyancy of the foam. Foam then discharges through the open end of the hose directly onto the liquid surface.

Consideration should be given to the following factors when selecting this type of system:

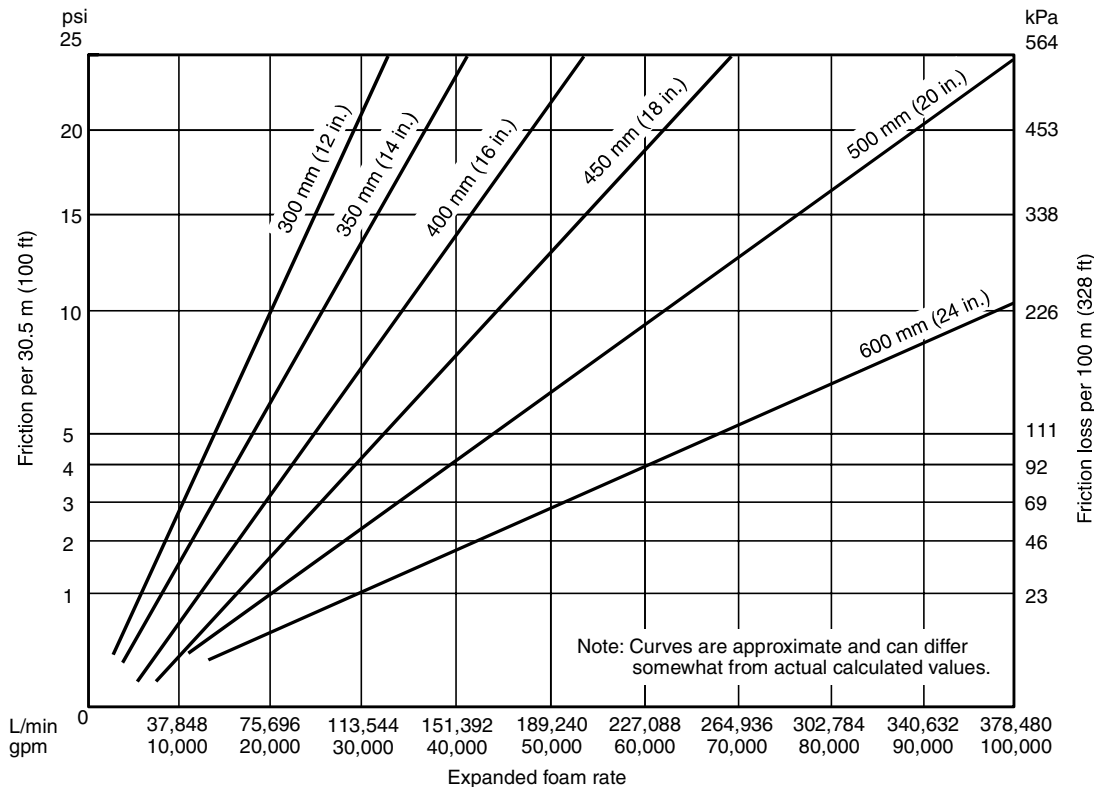


FIGURE A.5.2.6.4(b) Foam Friction Losses — 4 Expansion (12 in., 14 in., 16 in., 18 in., 20 in., and 24 in.) — Standard Schedule 40 Pipe.

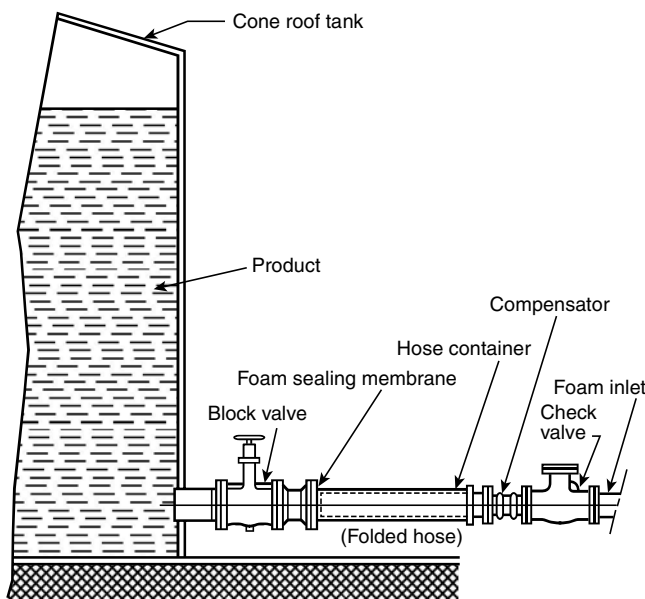


FIGURE A.5.2.7 Semisubsurface System Arrangement.

- (1) The total foam output should reach the surface of the burning liquid.
- (2) With large tanks, the semisubsurface units can be arranged to produce an even distribution over the fuel surface.
- (3) Any type of concentrate suitable for gentle surface application to the particular fuel can be used.
- (4) Foam-generating equipment and operating personnel can be located at a distance from the fire.
- (5) The system can be used for the protection of foam destructive liquids, provided the flexible hose is not affected by them.
- (6) Certain high-viscosity fuels might not be suitable for protection by this type of system.
- (7) There is no circulation of the cold fuel and, therefore, no assistance in extinguishment.
- (8) The system can be difficult to check, test, and maintain.
- (9) The high back-pressure foam generator has to produce foam at a pressure sufficient to overcome the head pressure of fuel as well as all friction losses in the foam pipe-work. Friction losses with foam differ from those with foam solution.

Design application rates and discharge times for hydrocarbons are typically the same as for Type II topside application systems [i.e.,  $4.1 \text{ L/min}\cdot\text{m}^2$  ( $0.1 \text{ gpm/ft}^2$ )]. Manufacturers should be consulted for appropriate application rates and design recommendations to be followed for protection of products requiring the use of alcohol-resistant foams.

Duration of discharge should be in accordance with Table A.5.2.7(a).

**Table A.5.2.7(a) Duration of Discharge for Semisubsurface Systems**

Product Stored Foam	Type Minimum	Discharge Time (minutes)
Hydrocarbons with flash point below 37.8°C (100°F)	Protein, AFFF, fluoroprotein, FFFP, and alcohol-resistant AFFF or FFFP	55
Flash point at or above 37.8°C (100°F)	All foams	30
Liquids requiring alcohol-resistant foams	Alcohol-resistant foams	55

Semisubsurface foam units should be spaced equally, and the number of units should be in accordance with Table A.5.2.7(b).

**A.5.3** Within the scope of this standard, open-top floating roof tanks are defined as vertical cylindrical tanks without fixed roofs that have double-deck or pontoon-type floating roofs and are constructed in accordance with the requirements of NFPA 30. The seal can be a mechanical shoe seal or tube seal. The tube seal can be equipped with a metal weather shield. Secondary seals of combustible or noncombustible materials can also be installed. [See Figure 5.3(a) through Figure 5.3(d).]

**A.5.3.3** Open-top floating roof tanks can be subject to two distinct types of fires: a seal fire or a full surface area fire (as a result of the floating roof sinking). Experience indicates that the most frequent type of fire involves only the seal of the floating roof tank. Prior to selection of the method of protection, the type of fire that will serve as the basis for design should be defined. (See NFPA 30 for fire protection requirements.)

Most fires in open-top floating roof tanks occur in the seal areas, and these fires can be extinguished with the foam systems described in Chapter 5. However, some fires involve the full surface area when the roof sinks. These fires are very infrequent and normally do not justify a fixed system to protect for this risk. Plans should be made to fight a full surface fire in a floating roof tank

**Table A.5.2.7(b) Minimum Number of Subsurface Units**

Tank Diameter		Minimum Number of Semisubsurface Units
m	ft	
Up to 24	Up to 80	1
Over 24 to 36	Over 80 to 120	2
Over 36 to 42	Over 120 to 140	3
Over 42 to 48	Over 140 to 160	4
Over 48 to 54	Over 160 to 180	5
Over 54 to 60	Over 180 to 200	6
Over 60	Over 200	6
		Plus 1 outlet for each additional 465 m <sup>2</sup> (5000 ft <sup>2</sup> )

with portable or mobile equipment. Large capacity foam monitor nozzles with capacities up to 22,712 L/min (6000 gpm) are currently available. If foam-proportioning devices are not provided with the foam monitors, additional foam-proportioning trucks might be required through mutual aid. Generally, the number of foam-proportioning trucks available at any location is not sufficient to fight a sunken floating roof fire, and outside assistance is required.

Generally, the fire water systems available in floating roof tank areas are not designed to fight a full surface fire, so additional water is required. Therefore, relay pumping with municipal or mutual aid water pumpers might be required to obtain enough water for foam generation.

Another aspect to consider is the amount of foam concentrate available. The foam application rate of 6.5 L/min·m<sup>2</sup> (0.16 gpm/ft<sup>2</sup>) of surface area listed in Chapter 5 might have to be increased for very large tanks. Therefore, the amount of foam concentrate available through mutual aid should be established prior to the fire. In some cases, it can be necessary to increase the on-site foam storage if mutual aid supplies are limited.

If it is decided to fight a fire in a tank with a sunken roof instead of protecting the adjacent facilities and allowing a controlled burnout, the most important aspect is to have planned ahead and held simulated drills. Coordinating the efforts of many different organizations and various pumping operations required for fighting potentially catastrophic fires requires well-developed plans and plenty of practice.

**A.5.3.4.3** The requirements given in this section are based on extrapolations of test experience and appropriate listings and reflect the limitations known to date. Foam can fail to seal against the tank shell as a result of prolonged free burning prior to agent discharge. If adequate water supplies are available, cooling of the tank shell is recommended.

**A.5.3.5.2** See Figure A.5.3.5.2(a) and Figure A.5.3.5.2(b).

**A.5.3.5.2.3** Since all the discharge outlets are supplied from a common (ring) foam solution main, some vapor seal devices might not rupture due to pressure variations encountered as the system is activated. [See Figure A.5.3.5.2(a) and Figure A.5.3.5.2(b).]

**A.5.3.5.4.5** Excessive dam openings for drainage should be prohibited to prevent loss of foam through the drainage slots.

**A.5.3.6** Use of foam handlines for the extinguishment of seal fires should be limited to open-top floating roof tanks of less than 76.2 m (250 ft) in diameter. The following design information applies to foam handline protection methods:

- (1) A foam dam should be installed in accordance with 5.3.5.4.
- (2) To establish a safe base for operation at the top of the tank, a single fixed foam discharge outlet should be installed at the top of the stairs. This fixed foam discharge outlet is supplied to provide coverage of the seal area for approximately 12.2 m (40 ft) on both sides of the top of the stairs.
- (3) The fixed foam discharge outlet should be designed to discharge at least 189.3 L/min (50 gpm).
- (4) To permit use of foam handlines from the windgirder, two 38.1 mm (1.5 in.) diameter valved hose connections should be provided at the top of the stairs in accordance with Figure A.5.3.6. The windgirder should be provided with a railing for the safety of the fire fighters.




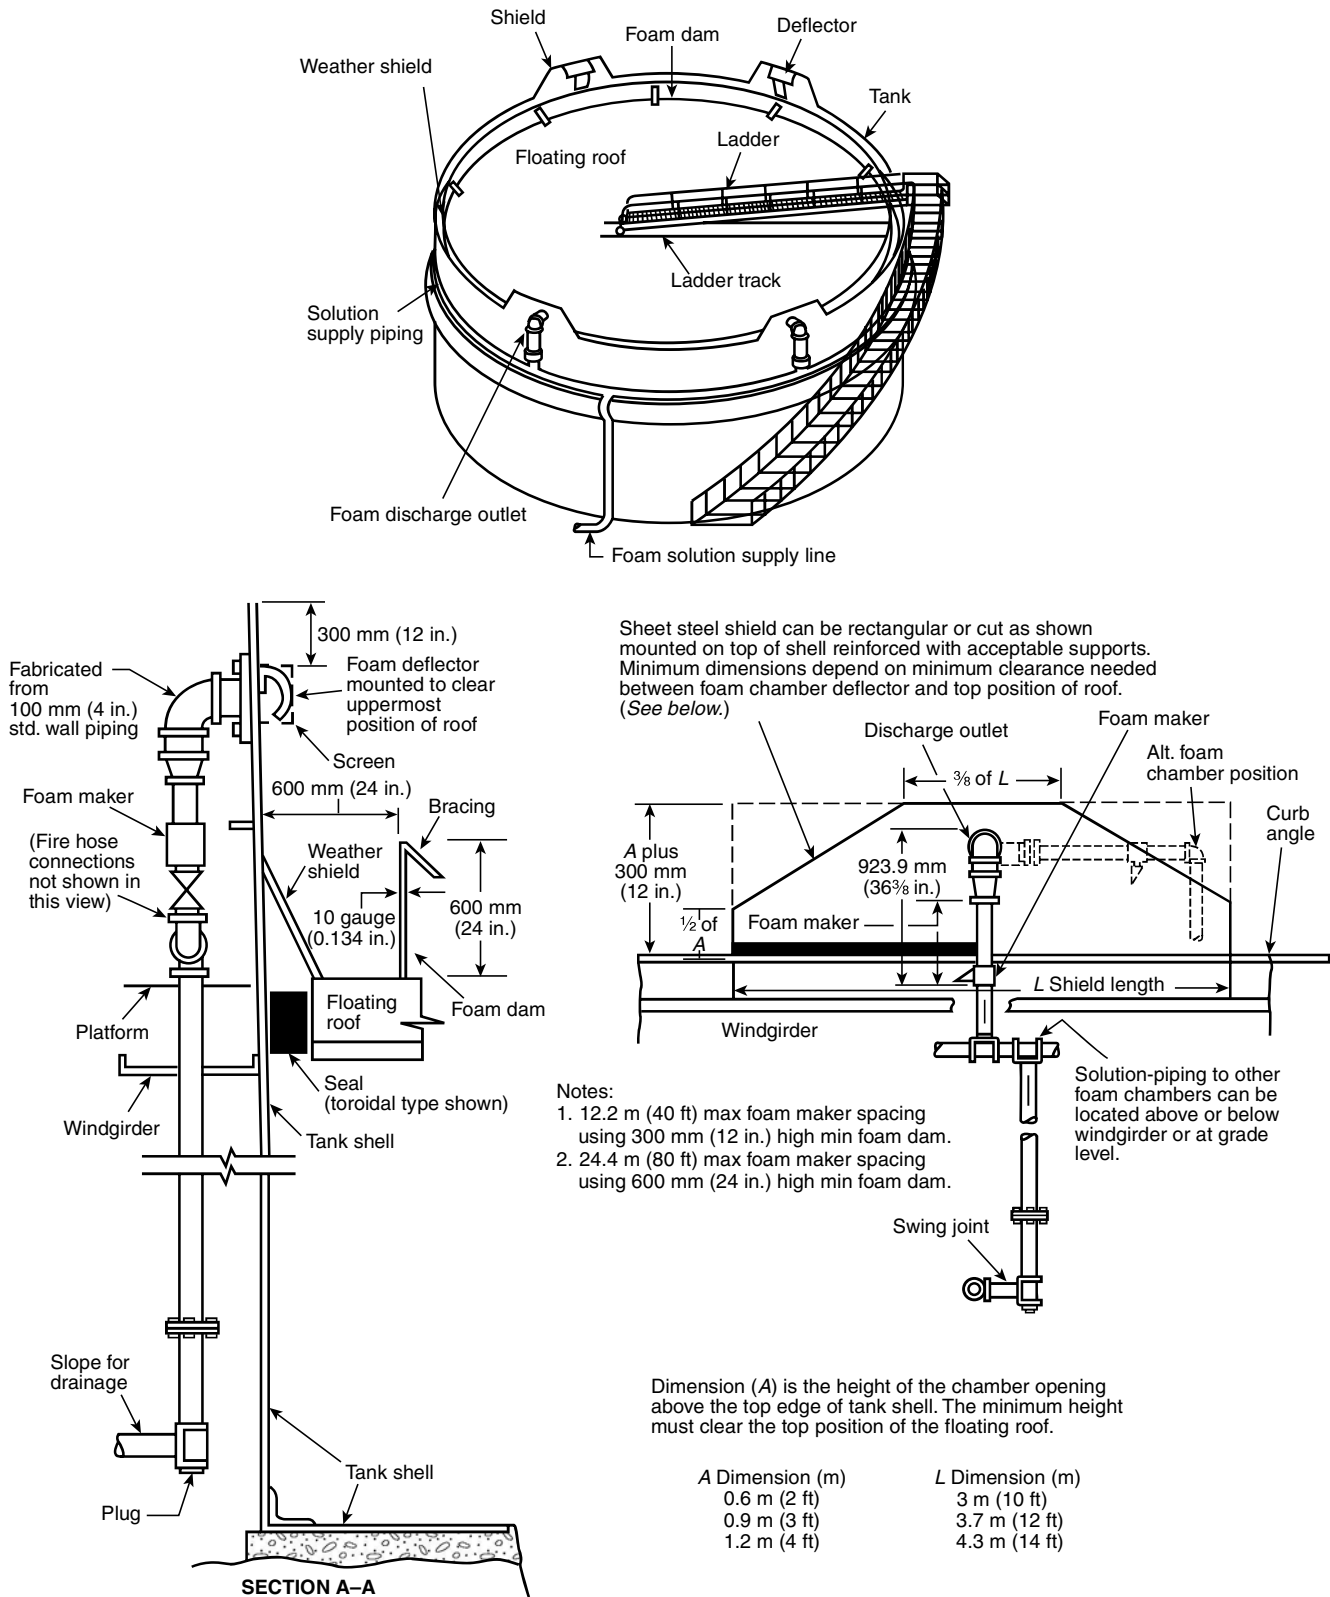


FIGURE A.5.3.5.2(a) Typical Foam Splash Board for Discharge Devices Mounted Above the Top of the Shell.

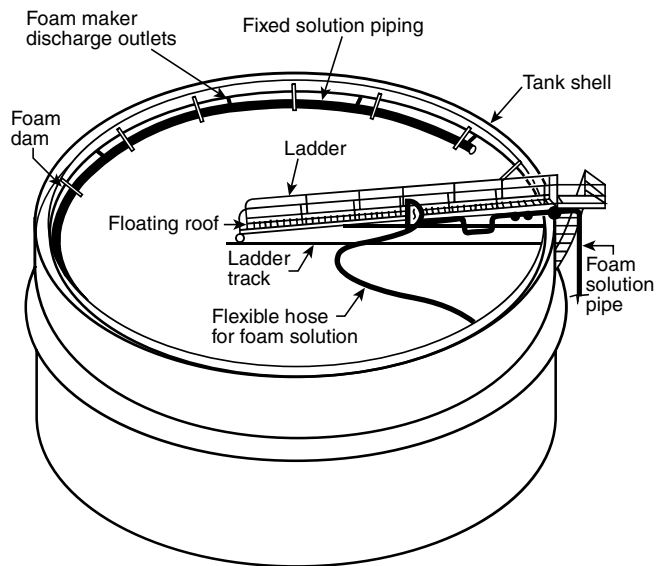

**FIGURE A.5.3.5.2(b) Fixed Foam Discharge Outlets Mounted on the Periphery of the Floating Roof.**

**A.5.4** Within the scope of this standard, covered (internal) floating roof tanks are defined as vertical cylindrical tanks with a fixed metal roof (cone or geodesic dome) equipped with ventilation at the top and containing a metal double-deck or pontoon-type floating roof or a metal floating cover supported by liquidtight metal flotation devices. They are constructed in accordance with the requirements of NFPA 30. (See Figure 5.4.)

**A.5.4.2(4)** Important fire-resistive properties of these roof/seal systems include:

- (1) Conductive top and bottom surfaces to prevent the buildup of static charge
- (2) Flame spread Class A rating of the top laminate
- (3) Buoyancy in accordance with API 650, Appendix H
- (4) Noncombustible material covering the vapor space will limit the spread of a potential rim-seal fire
- (5) Seamless construction with chemical bonds will ensure the roof system maintains its integrity in an explosion, preventing a full-surface fire

**A.5.4.2.3.4** The hazard requiring the highest foam solution flow rate does not necessarily dictate the total amount of foam concentrate required. The requirements given in this section are based on extrapolations of test experience and appropriate listings and reflect the limitations known to date. Foam can fail to seal against the tank shell as a result of prolonged free burning prior to agent discharge. If adequate water supplies are available, cooling of the tank shell is recommended.

**A.5.5.1** For other types of indoor hazards, see the design criteria requirements of NFPA 16.

**A.5.5.4.1** Systems using these foams require special engineering consideration.

**A.5.6** To minimize life and property loss, automation of foam systems protecting a truck loading rack should be taken into account. NFPA 16 states "Foam-water deluge and preaction systems shall be provided with automatic and auxiliary manual tripping means." [16:4.1.1]

Manual operation only can be provided where acceptable to the AHJ.

There are two methods of automating foam monitor systems for this application:

- (1) Completely automatic detection and actuation (See applicable sections of NFPA 72 for design criteria.)
- (2) Actuation by push-button stations or other means of manual release.

The speed of system operation is always critical in minimizing life and property loss.

**A.5.6.5.1** The correct choice of each monitor location is a very important factor in designing a foam monitor system. Traffic patterns, possible obstructions, wind conditions, and effective foam nozzle range affect the design. The appropriate monitors and nozzles should be located so that foam is applied to the entire protected area at the required application rate. Consult the manufacturer of the monitor nozzle for specific performance criteria related to stream range and foam pattern, discharge capacity, and pressure requirements. Manufacturers also should be consulted to confirm applicable listings and/or approvals.

**A.5.6.5.2** Although most systems are designed to protect the canopy area only, it is often desirable to protect the total curbed area around the loading rack or the entire length of the truck or rail car.

**A.5.7** Generally, portable monitors or foam hose streams or both have been adequate in fighting spill fires in diked areas. In order to obtain maximum flexibility due to the uncertainty of location and the extent of a possible spill in process areas and tank farms, portable or trailer-mounted monitors are more practical than fixed foam systems in covering the area involved. The procedure for fighting diked area spill fires is to extinguish and secure one area and then move on to extinguish the next section within the dike. This technique should be continued until the complete dike area has been extinguished.

**A.5.7.3.3** Fixed foam discharge outlets vary considerably in capacity and range area of coverage.


**A.5.7.3.4.2** Overhead application by foam-water sprinklers or nozzles could require supplementary low-level foam application to provide coverage below large obstructions. Overhead pipework can be susceptible to damage by explosion. Overhead application by foam-water sprinklers or nozzles might require supplementary low-level foam application to provide coverage below large obstructions. Overhead pipework can be susceptible to damage by explosion.

**A.5.7.3.5.3** Low-level foam discharge outlets might require supplementary overhead foam spray application to provide coverage or cooling for overhead structures or for tank surfaces.

**A.5.8** For the purpose of this standard, nondiked spill areas are areas where a flammable or combustible liquid spill can occur, uncontained by curbing, dike walls, or walls of a room or building.

In such cases it is assumed that any fire would be classified as a spill fire [i.e., one in which the flammable liquid spill has an average depth not exceeding 25.4 mm (1 in.) and is bounded only by the contour of the surface on which it is lying].

**A.5.9** Auxiliary foam hose streams can be supplied directly from the main system protecting the tanks (e.g., centralized fixed pipe system) or can be provided by additional equipment. The supplementary hose stream requirements provided

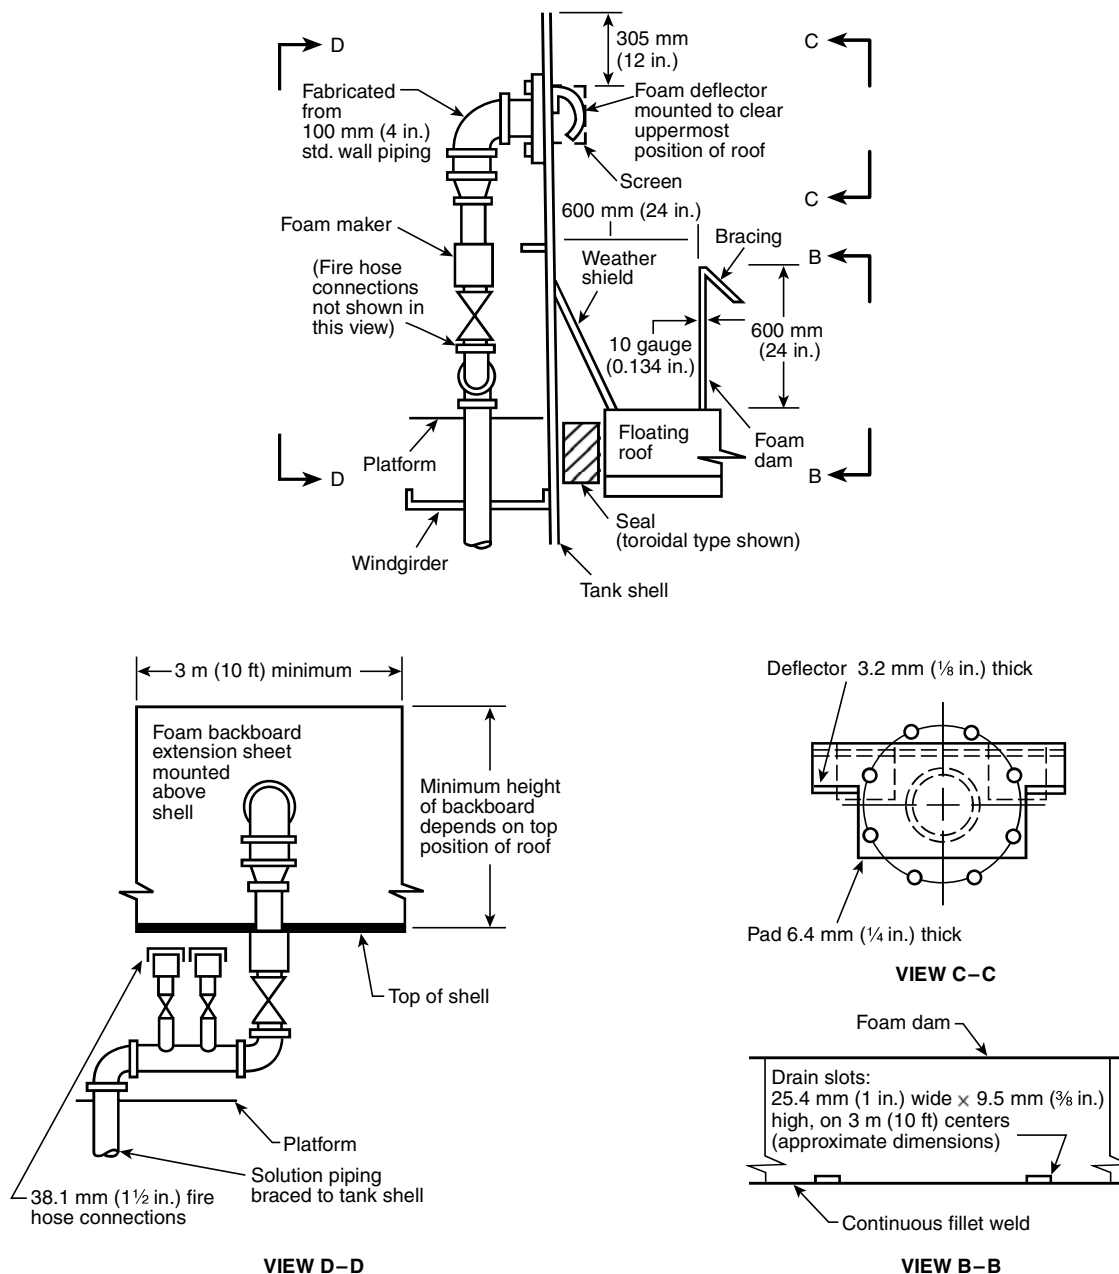

**FIGURE A.5.3.6 Typical Installation of Foam Handlines for Seal Area Fire Protection.**

herein are not intended to protect against fires involving major fuel spills; rather, they are considered only as first aid-type protection for extinguishing or covering small spills involving areas in square meters (square feet) equal to those covered by about six times the rated capacity [in L/min (gpm)] of the nozzle. Permanently installed foam hydrants, where used, should be located in the vicinity of the hazard protected and in safe and accessible locations. The location should be such that excessive lengths of hose are not required. Limitations on the length of hose that can be used depend on the pressure requirements of the foam nozzle.

**A.6.1** Medium- and high-expansion foam extinguishes fire by reducing the concentration of oxygen at the seat of the fire, by

cooling, by halting convection and radiation, by excluding additional air, and by retarding flammable vapor release. (See Annex C.)

**A.6.3** Use of high-expansion foam for polar solvents should be proven by fire tests using polar solvents that are to be used in the protected area.

**A.6.3.2** Under certain circumstances, it might be possible to utilize medium- or high-expansion foam systems for control of fires involving flammable liquids or gases issuing under pressure, but no general recommendations can be made in this standard due to the infinite variety of particular situations that can be encountered in actual practice. Ability to control or extinguish a

fire in a given hazard might depend on such factors as expansion, drainage, and fluidity. These factors will vary with the concentrate, equipment, water supply, and air supply.

**A.6.6** The discharge of large amounts of medium- or high-expansion foam can inundate personnel, while blocking vision, making hearing difficult, creating some discomfort in breathing, and causing spatial disorientation. This breathing discomfort will increase with a reduction in expansion ratio of the foam while the foam is under the effect of sprinkler discharge.

**A.6.6.1** Additional exits and other measures might be necessary to ensure safe evacuation of personnel.

**A.6.6.1.1** The foam is opaque, making it impossible to see when one is submerged in it. It is dangerous to enter a building in which there was a fire if one cannot see.

**A.6.6.1.2** The chemicals of the canister can react with the water of the foam and cause suffocation.

**A.6.6.2** As used in this standard, “clearance” is the air distance between medium- or high-expansion foam equipment, including piping and nozzles, and unenclosed or uninsulated live electrical components at other than ground potential. Since medium- or high-expansion foams are conductive, these clearances do not prevent conduction through foam. (See 6.6.1.3.) Up to electrical system voltages of 161 kV, the design BIL kV and corresponding minimum clearances, phase to ground, have been established through long use.

**A.6.6.2.1** The clearances are based on minimum general practices related to design basic insulation level (BIL) values.


**A.6.7.1** Fires or conditions likely to produce fire can be detected by human senses or by automatic means.

**A.6.7.1.1.1** In outdoor locations with minimal or no exposures or life hazards, such as LNG spill retention areas, immediate detection and suppression of a fire is not critical for protection of life and property. Detection by personnel and manual operation of a fixed system is considered acceptable.

**A.6.7.1.2** See NFPA 72.

**A.6.7.1.4** See applicable provisions of NFPA 72 for power supply requirements.

**A.6.7.4** A block diagram of a typical automatic medium- or high-expansion foam system is shown in Figure A.6.7.4(a). At the present time, foam generators for medium- and high-expansion foam are of two types, depending on the means for

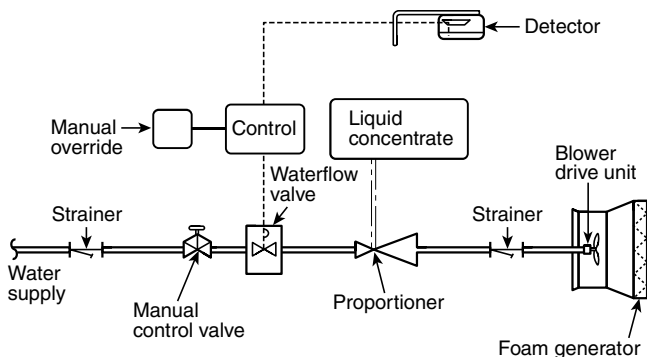

**FIGURE A.6.7.4(a) Block Diagram of Automatic Medium- or High-Expansion Foam System.**

introducing air — by aspirator or blower. In either case, the properly proportioned foam solution is made to impinge at appropriate velocity on a screen or porous or perforated membrane or series of screens in a moving airstream. The liquid films formed on the screen are distended by the moving airstream to form a mass of bubbles or medium- or high-expansion foam. The foam volume varies from about 20 to 1000 times the liquid volume, depending on the design of the generator. The capacity of foam generators is generally determined by the time required to fill an enclosure of known volume by top application within 1 minute to 5 minutes.

**Foam Generators — Aspirator Type.** Aspirator-type foam generators can be fixed or portable. Jet streams of foam solution aspirate sufficient amounts of air that is then entrained on the screens to produce foam. [See Figure A.6.7.4(b).] These generators usually produce foam with expansion ratios of not more than 250:1.

**Foam Generators — Blower Type.** Blower type foam generators can be fixed or portable. The foam solution is discharged as a spray onto screens through which an airstream developed by a fan or blower is passing. The blower can be powered by electric motors, internal combustion engines, air, gas, or hydraulic motors or water motors. The water motors are usually powered by foam solution. [See Figure A.6.7.4(c).]


**A.6.10.2** To determine its ability to withstand fire exposure from the hazard area, a generator and its associated piping and electrical wiring, protected in accordance with the manufacturers’ recommendations, should be started and operated satisfactorily after a 5-minute exposure 3 m (10 ft) above a 4.65 m<sup>2</sup> (50 ft<sup>2</sup>) *n*-heptane fire using 379 L (100 gal) of fuel. The test fire should be shielded to ensure flame impingement on the generator.

**A.6.12.2** Examples of hazards that can be permitted to be successfully protected by total flooding systems include rooms, vaults, storage areas, warehousing facilities, and buildings containing Class A and Class B combustibles either singly or in combination.

See NFPA 13.

**A.6.12.4.1** To assure the efficiency of a total flowing medium- or high-expansion foam system, the development and maintenance of a suitable quantity of foam within the particular enclosure to be protected is required. Leakage from the enclosure area should be avoided by sealing openings with doors and windows that close automatically.

**A.6.12.7.1** It is imperative that the integrity of primary structural members be maintained under fire exposure (which, in sprinklered structures, normally support the sprinkler system). Light, unprotected bar joists, and other similar types of

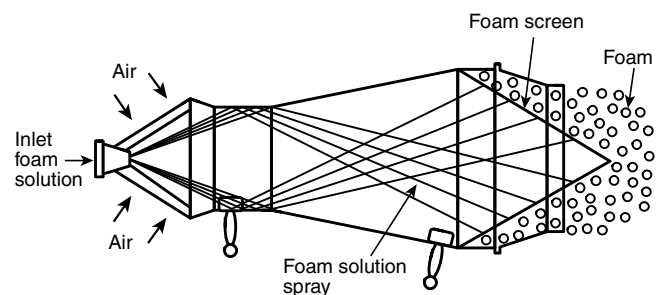

**FIGURE A.6.7.4(b) Aspirating-Type Foam Generator.**

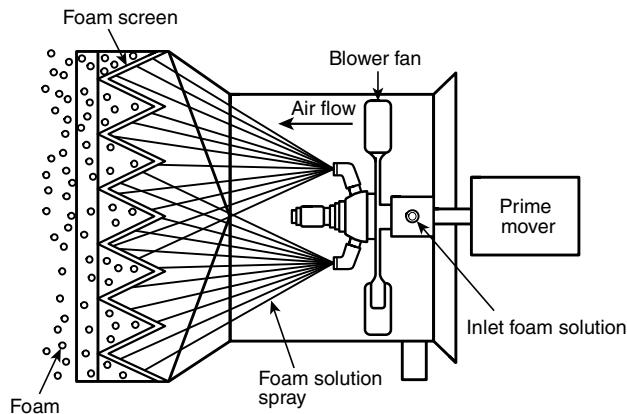
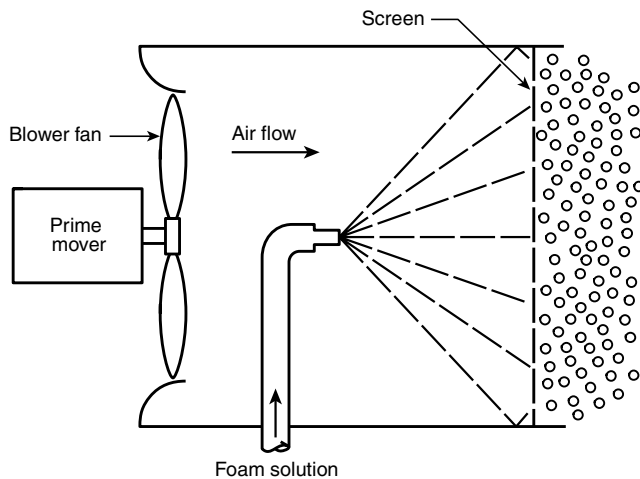


FIGURE A.6.7.4(c) Blower-Type Foam Generators.

supports are especially vulnerable to damage by fast-developing fires as compared to supports in heavy steel construction. Heavy, unprotected steel framing is also more vulnerable than fire-resistive (concrete) or protected structural members.

**A.6.12.8** Tests with foams of above 400:1 expansion ratio have shown that extinguishment times for flammable liquid fires increased significantly at rates of foam rise less than 0.9 m/min (3 ft/min). It is expected that at some expansion ratio below 400:1, lower rates of foam rise would be adequate, but insufficient tests have been conducted to identify this ratio.

**A.6.12.8.2.1** The rate also depends on foam properties, such as expansion ratio, water retention, effect of water contaminants, and temperature effects on water retention.

**A.6.12.8.2.3.1** The following are sample calculations of total high-expansion foam generator capacity:

*Calculation Using U.S. Units*

- (1) Given: Building size — 100 ft × 200 ft × 30 ft high.
- (2) Building construction — Light bar joist, Class I steel deck roof, adequately vented. Masonry walls with all openings closable.
- (3) Sprinkler protection — Wet system 10 ft × 10 ft spacing, 0.25 gpm/ft<sup>2</sup> density.

- (4) Occupancy — Vertically stacked unbanded rolled kraft paper 25 ft high.
- (5) Assume: Fire will open 50 sprinkler heads. Foam leakage around closed doors, drains, and so forth, hence  $C_L = 1.2$ .
- (6) Calculation
  - (a) Foam depth: Depth = 25 × 1.1 = 27.5 ft (This depth is greater than minimum cover of 2 ft.)
  - (b) Submergence volume:  $V = 100 \times 200 \times 27.5 = 550,000 \text{ ft}^3$
  - (c) Submergence time:  $T = 5$  minutes (from Table 6.12.7.1)
  - (d) Rate of foam breakdown by sprinklers:  
 $S = 10 \text{ ft}^3/\text{min} \cdot \text{gpm}$  [from 6.12.8.2.3.2]  
 $Q = \text{Number of heads} \times \text{area/head} \times \text{density}$   
 $= 50 \times (10 \times 10) \times 0.25 = 1250 \text{ gpm}$   
 $R_s = S \times Q = 10 \times 1250 = 12,500 \text{ ft}^3/\text{min}$
  - (e) Normal foam shrinkage:  $C_N = 1.15$  [from 6.12.8.2.3.3]
  - (f) Leakage:  $C_L = 1.2$  (assumption)
  - (g) Total generator capacity

[A.6.12.8.2.3.1a]

$$R = \left( \frac{V}{T} + R_s \right) \times C_N \times C_L$$

$$R = \left( \frac{550,000}{5} + 12,500 \right) \times 1.15 \times 1.2$$

$$R = 169,000 \text{ ft}^3/\text{min}$$

The number of generators required will depend upon the capacity of the generators available.

*Calculation Using SI Units*

- (1) Given: Building size — 30.5 m × 61 m × 9.1 m high.
- (2) Building construction — Same as U.S. units calculation.
- (3) Sprinkler protection — Wet system 3 m × 3 m spacing, 10.2 L/min · m<sup>2</sup> density.
- (4) Occupancy — Vertically stacked unbanded rolled kraft paper 7.6 m high.
- (5) Assume: Same assumption as U.S. units calculation.
- (6) Calculation
  - (a) Foam depth: Depth = 7.6 × 1.1 = 8.4 m (This depth is greater than minimum cover of 0.6 m.)
  - (b) Submergence volume:  $V = 30.5 \times 61 \times 8.4 = 15,628 \text{ m}^3$
  - (c) Submergence time:  $T = 5$  minutes (from Table 6.12.7.1)
  - (d) Rate of foam breakdown by sprinklers:  
 $S = 0.0748 \text{ m}^3/\text{min} \cdot \text{L}/\text{min}$  [from 6.12.8.2.2(2)]  
 $Q = \text{Number of heads} \times \text{area/head} \times \text{density}$   
 $= 50 \times (3 \times 3) \times 10.2 = 4590 \text{ L}/\text{min}$   
 $R_s = S \times Q = 0.0748 \times 4590 = 343 \text{ m}^3/\text{min}$
  - (e) Normal foam shrinkage:  $C_N = 1.15$  [from 6.12.8.2.2(3)]
  - (f) Leakage:  $C_L = 1.2$  (assumption)
  - (g) Total generator capacity:

[A.6.12.8.2.3.1b]

$$R = \left( \frac{V}{T} + R_s \right) \times C_N \times C_L$$

$$R = \left( \frac{15,628}{5} + 343 \right) \times 1.15 \times 1.2$$

$$R = 4787 \text{ m}^3/\text{min}$$

**A.6.12.8.2.3.2** Where sprinklers are present in an area to be protected by high-expansion foam, simultaneous operation will cause breakdown of the foam. The rate of breakdown will depend on the number of sprinklers operating and the subsequent total rate of water discharge. The number of sprinklers expected to operate will depend on various factors as outlined in NFPA 13.



**A.6.12.8.2.3.4** It is essential that uncontrolled leakage be reduced to an absolute minimum through the use of foamtight barriers at all openings below the effective hazard control level or depth. There will be an increased rate of foam escape as its fluidity is increased by anticipated sprinkler discharge. Such leakage through drains, trenches, under doors, around windows, and so forth can be minimized by use of suitable automatic closures, seals, or mechanisms. Additional generator capacity should be added to compensate for the aggregate losses where foam escapement cannot be effectively controlled.

**A.6.12.10** The choice of a total flooding foam system for protection of a hazard does not necessarily imply that it is expected that the system will completely extinguish the fire or even so nearly extinguish it as to render the fire incapable of regaining the offensive. Rather, the effect sought might often be speedy control with minimum fire damage to contents not involved in the fire.

When high-expansion foam is establishing or has established control of a fire, care must be exercised that control is not lost. The following points should be kept in mind; depending on the particular fire, some or all might be vital:

- (1) All persons should be aware of the necessity for tight closure. Employees, brigade members, and the fire department should move rapidly to close any openings through which foam is being lost. Improvised closures can be made of practically any available material such as fine mesh screening, plastic, plywood, or cardboard.
- (2) If the material involved is liable to sustain deep-seated fires, such as furniture, packaged material, fibers, and rolls of paper, particular care must be exercised in opening up the areas and removing the foam. Even where only surface fire is thought possible, as in flammable liquids, smoldering Class A material can cause reignition.
- (3) A "soaking" period should elapse before foam is removed. This period can be as long as an hour and should be predetermined based on the fuel in the area.

**A.6.12.10.3.2** Additional foam concentrate could be needed should reignition occur.

**A.6.12.10.4** The following points should be considered during overhaul operations:

- (1) All foam and sprinkler systems that are shut off should have personnel standing by valves to turn them back on if this should become necessary.
- (2) Foam supplies should be replenished if depleted.
- (3) Hand hoselines should be charged and manned. Personal protective equipment should be donned. Self-contained breathing apparatus must be worn in the "ready" position so there will be no delay in putting it in service.
- (4) Foam should be removed first from the fire area and should be coordinated with overhaul and salvage operations. The total loss will be kept to a minimum if thoughtless operations are avoided. Once the fire is under control, undue haste to extinguish the last ember can greatly increase the loss.
- (5) Caution should be taken in entering previously foam-filled areas, particularly in structures with pits or openings in the floor.
- (6) The area should be well ventilated, but openings through which foam might be lost should be kept to a minimum and manned for closing if this should become necessary.
- (7) Consideration should be given to disposal of the foam to prevent any undue hazard to adjacent areas.

**A.6.13.1.2** These systems are best adapted to the protection of essentially flat surfaces such as confined spills, open tanks, drainboards, curbed areas, pits, trenches, and so forth.

**A.6.13.3.2** Fences constructed of ordinary metal window screen mesh have been shown to provide an effective barrier that allows confinement of medium- and high-expansion foam to a protected area.

**A.6.14** High-expansion foam has been shown to be effective in controlling LNG spill test fires and in reducing downwind vapor concentration from unignited LNG spill test fires in confined areas up to 111 m<sup>2</sup> (1200 ft<sup>2</sup>).

Special provisions for liquefied natural gas (LNG) fire and vapor control are as follows:

- (1) *Application concepts for fire control.* Tests sponsored by the American Gas Association (AGA) have shown that the amount of radiation from a burning LNG spill can be reduced by as much as 95 percent with some high-expansion foams. This reduction is due in part to the foam barrier, which reduces vaporization by blocking heat feedback from the flames to the LNG. Foams having a low-expansion ratio contain a great deal of water at ambient temperature that tends to increase the vaporization rate when it drains into the LNG. In the AGA tests, control was established with expansion ratios greater than 250:1, although an expansion ratio of about 500:1 proved most effective. Different brands of foam show considerable variation in their ability to control LNG fires. A rapidly draining foam will increase the LNG vaporization rate and exaggerate the fire intensity. The drier foam remaining is less resistant to thermal effects and breaks down more readily. Other factors such as bubble size, fluidity, and linear burn rate can affect fire control. Therefore, test results on LNG fires, including the test described in Section G.4 should be reviewed before selecting a foam for LNG fire control.
- (2) *Downwind vapor hazard control.* When first evolved from a spill, unignited LNG vapors are heavier than air. As these vapors are heated by sunlight or by contact with the air, they eventually become buoyant and disperse upward. Before this upward dispersal occurs, however, high vapor concentrations can form downwind of an unignited spill at or near ground level. High-expansion foam can be used to reduce this vapor concentration by adding heat from the water in the foam to the LNG vapors as they pass through the foam blanket. Because of the induced buoyancy, the application of high-expansion foam can reduce downwind gas concentrations at ground level. Expansions in the range of 750:1 to 1000:1 have been found to provide the most effective dispersion control, but the higher expansions can be adversely affected by wind. However, as with fire control, ability to control vapor dispersion varies among different foams and should be demonstrated by tests.

See NFPA 59A for information on fire protection requirements for LNG facilities.

**A.6.14.1** LNG fire and vapor control reference publications are as follows:

- (1) American Gas Association Project IS-3-1, "LNG Spills on Land," November 15, 1973.
- (2) American Gas Association Project IS-100-1, "An Experimental Study on the Mitigation of Flammable Vapor Dispersion and Fire Hazards Immediately Following LNG Spills on Land," February 1974.



- (3) Gremeles, A. E., and Drake, E. M., "Gravity Spreading and Atmospheric Dispersion of LNG Vapor Clouds," Fourth International Symposium on Transport of Hazardous Cargoes by Sea and Inland Waterways, Jacksonville, FL, October 1975.
- (4) Humbert-Basset, R., and Montet, A., "Flammable Mixture Penetration in the Atmosphere from Spillage of LNG," Third International Conference on LNG, Washington, DC, September 1972.
- (5) "Liquefied Natural Gas/Characteristics and Burning Behavior," Conch Methane Services, Ltd., 1962.
- (6) "LNG Vapor Concentration Reduction and Fire Control with MSAR High Expansion Foam," Mine Safety Appliances Research Corp., Evans City, PA.
- (7) Schneider, Alan L., "Liquefied Natural Gas Safety Research Overview," National Technical Information Service, Springfield, VA, December 1978.
- (8) Welker, J., et al., "Fire Safety Aboard LNG Vessels." January 1976.
- (9) Wesson, H. R., Welker, J. R., and Brown, L. E., "Control LNG Spill Fires," *Hydrocarbon Processing*, December 1972. This paper contains 105 additional references on many aspects of LNG safety research, including the use of high-expansion foam on LNG.

Since time to initiate actuation is a critical factor in LNG fire control, special attention should be given to heat effects and potential fire spread to adjacent areas during the time period for application of foam into the LNG spill.

**A.6.14.2** Application rates are generally established by specific fire tests such as that in Section G.4, where the equipment, water supply, fuel, and physical and chemical makeup of the candidate foam concentrate are carefully controlled. While these tests can be useful for comparing various foams, they often give minimum application rates because they are conducted under ideal weather conditions with no obstructions or barriers to fire control. The final design rates are generally 3 to 5 times the test rates. Thus, the rates can vary significantly from one foam agent to another.

**A.6.14.3.3** The minimum foam depth at any point in the hazard area will vary, but most designs have attempted to obtain 0.45 m to 0.91 m (1½ ft to 3 ft) of foam depth over the LNG spill area within the time established in the analysis.

**A.6.15.6** Successful extinguishment of fire with portable foam-generating devices is dependent on the individual ability and technique of the operator.

**A.8.1** It is good practice for the owner or his or her designated representative (i.e., architect, contractor, or other authorized person) to review the basic hazard or modifications with the AHJ to obtain guidance and preliminary approval of the proposed protection concept. The possibility and extent of damage by the agent should be evaluated when selecting any extinguishing system. In certain cases, such as tanks or containers of edible oils, cooking oils, or other food-processing agents, or in other cases where contamination through the use of foam could increase the loss potential substantially, the AHJ should be consulted regarding the type of extinguishing agent preferred.

**A.8.2.3** The cost of testing beyond the requirements of this standard, but requested by the AHJ, should be considered. The specification should indicate how testing costs are to be met.

**A.8.3.3(27)** See Chapter 23 of NFPA 13 for hydraulic calculation procedures.

**A.9.3.4** Limited service controllers generally do not have a service disconnect means. In order to perform routine inspection and maintenance safely, it might be desirable to provide an external service disconnect. Special care must be taken to ensure that the disconnect is not left in a position rendering the foam concentrate pump inoperable.

**A.9.4.2** One of the following designs can be used:

- (1) Piping less than 100 mm (4 in.) in diameter
  - (a) Where piping is buried, a swing joint or other means should be provided at each tank riser to absorb the upward force. The swing joint should consist of approved standard weight steel, ductile, or malleable iron fittings.
  - (b) Where piping is supported aboveground, it should not be secured for a distance of 15 m (50 ft) from the tank shell to provide flexibility in an upward direction so that a swing joint is not needed. If there are threaded connections within this distance, they should be back welded for strength.
- (2) The vertical piping of 100 mm (4 in.) in diameter and greater on the protected tank should be provided with one brace at each shell course. This design should be permitted to be used in lieu of swing joints or other approved aboveground flexibility, as specified in A.9.4.2(1)(a) and A.9.4.2(1)(b). This riser can be welded to the tank by means of steel brace plates positioned perpendicular to the tank and centered on the riser pipe.

**A.9.4.3** With all-welded construction, this could be the only joint that can be opened.

**A.9.5.7** Failure to isolate the water supply feed to the bladder tank can cause a continuation of foam concentrate discharge into the system riser. This continued discharge can cause damage to the bladder and siphon tube inside the tank and can waste foam concentrate. Risers that have filled with foam concentrate due to this issue can be inadvertently drained, thus contaminating the environment with foam concentrate.

**A.10.1** The provisions of this marine chapter were developed based on knowledge of practices of this standard, SOLAS, the IBC Code, and USCG regulations and guidance. In order to harmonize the requirements of this chapter with the practices of these other standards, the values given in the metric conversions in Chapter 11 should be considered the required value.

**A.10.1.3** Approvals of specialized foam equipment components are typically based on compliance with a standard equivalent to UL 162. Component review should include the following:

- (1) Fire suppression effectiveness
- (2) Reliability
- (3) Mechanical strength
- (4) Corrosion resistance
- (5) Material compatibility
- (6) Proper operation
- (7) Stress, shock, and impact
- (8) Exposure to salt water, sunlight, temperature extremes, and other environmental elements
- (9) Proportioning system test data (demonstrating acceptable injection rate over the intended flow range of the system)
- (10) Foam stream range data (based on still air testing with monitor and nozzle combinations)
- (11) Foam quality test data (demonstrating satisfactory performance corresponding to small-scale fire test nozzle foam quality)

Quality control of specialty foam proportioning and application equipment as well as foam concentrates should be achieved through a listing program that includes a manufacturing follow-up service, independent certification of the production process to ISO 9001, or a similar quality control program approved by the AHJ.

**A.10.1.4.3** Foams for polar solvents are first tested for hydrocarbon performance using a test derived from Federal Specification O-F-555C that was published from 1969 through 1990. The foams are further tested for polar solvent system application on the basis of 4.6 m<sup>2</sup> (50 ft<sup>2</sup>) fire test performance in accordance with UL 162. Approved manufacturers' deck system design application rates and operating times incorporate design factors that are applied to the fire test application rates and times.

**A.10.2.1** This system is intended to supplement, not replace, any required total flooding machinery space fire suppression system. Foam systems comprising a portion of required primary machinery space protection can require longer application times.

**A.10.3.1** Although shipboard foam systems share many similarities with tank farm foam systems on land, there are important differences between shipboard and land-based fire protection. These differences, identified in (1) through (15), result in foam system designs and arrangements that differ from systems used in what can appear to be similar land-based hazards. The differences are as follow:

- (1) Foam fire tests of the type described in Annex F are very severe.
- (2) There is limited data regarding use of systems meeting USCG or IMO requirements on actual fires.
- (3) There is little or no separation between tanks.
- (4) The vessel might be widely separated from other hazards or might be alongside another vessel or a terminal.
- (5) The vessel might not have access to immediate fire-fighting assistance.
- (6) Fires resulting from catastrophic events, such as explosions and collisions, historically are beyond the onboard fire-fighting capabilities of the involved vessels, necessitating use of outside fire-fighting assistance. Many large fires have taken several days to extinguish.
- (7) The number of fire-fighting personnel is limited to the available crew.
- (8) Fires not substantially controlled within the first 20 minutes can exceed the capability of the crew and the onboard system.
- (9) Ships are subject to rolling, pitching, and yawing, which can cause sloshing of the burning liquid and reduced performance of the foam blanket.
- (10) Application of foam to the fire is likely to be much faster than on land because the deck foam system is in place and can be activated simply by starting a pump and opening certain valves. There is little or no set-up time.
- (11) Tank fires do not seem to occur unless preceded by an explosion.
- (12) Explosions can cause substantial damage to foam systems. They can have unpredictable results on the vessel structure, including bending deck plating in such a way as to obstruct foam application. They can also cause involvement of any number of tanks or spaces.
- (13) Most tankers use inert gas systems to reduce vapor spaces above cargo tanks to less than 8 percent oxygen, thereby reducing the likelihood of an explosion.

- (14) Ships pay the cost of transporting their fire suppression systems on every voyage.
- (15) There is a finite amount of space on each ship design. Tanker deck foam monitors are located at or above the elevation of top of the tank as contrasted with typical tank farm arrangements where monitors must project foam up and over the rim of a tank.

**A.10.3.2.2** Color coding the valves aids in identification. For example, all valves that are to be opened might be painted some distinctive color.

**A.10.3.3** A fire main system can provide other services in addition to fire protection. Other services, which could be left operational during a fire, need to be included in calculations.

**A.10.3.4** Rates of application are as follows:

- (1) Differences between this section and SOLAS or the IBC Code: The application rates prescribed in this section for hydrocarbon fuels are higher than the rates given in the International Maritime Organization's International Convention for the Safety of Life at Sea (SOLAS) Chapter 212, Regulation 61, as follows:
  - (a) For deck spills, this section requires 6.5 L/min·m<sup>2</sup> (0.16 gpm/ft<sup>2</sup>) applied over the 10 percent of the cargo block versus 5.98 L/min·m<sup>2</sup> (0.147 gpm/ft<sup>2</sup>) in SOLAS. This difference is based on a long history of fire extinguishment experience using 6.5 L/min·m<sup>2</sup> (0.16 gpm/ft<sup>2</sup>). It is also understood that the value 6.5 L/min·m<sup>2</sup> (0.16 gpm/ft<sup>2</sup>) is generally regarded as the minimum foam application rate for industrial hazards and reflects the minimum application rate on the fuel surface, not at the discharge device. Thus, loss of foam due to wind, obstructions, and so forth, should be compensated for to provide 6.5 L/min·m<sup>2</sup> (0.16 gpm/ft<sup>2</sup>) on the liquid surface.
  - (b) For the single largest tank, this section requires 9.77 L/min·m<sup>2</sup> (0.24 gpm/ft<sup>2</sup>) over the single largest hydrocarbon tank versus 5.98 L/min·m<sup>2</sup> (0.147 gpm/ft<sup>2</sup>) in SOLAS. This difference is based on the need to deliver a minimum of 6.5 L/min·m<sup>2</sup> (0.16 gpm/ft<sup>2</sup>) onto the surface of the burning fuel and takes into consideration the impact of wind, evaporation, and thermal updrafts. This value is consistent with recent experience with the extinguishment of shore-based storage tanks using mobile foam equipment similar to the monitors used in deck foam systems.
  - (c) For polar solvents, the *International Bulk Chemical Code (IBC Code)* provides two design methods. The first method requires a foam application rate of 20.3 L/min·m<sup>2</sup> (0.5 gpm/ft<sup>2</sup>) without restriction to the type of chemicals that can be carried or where on the ship's cargo block they can be carried. The second method allows arrangements with application rates lower than 20.3 L/min·m<sup>2</sup> (0.5 gpm/ft<sup>2</sup>). This method is allowed if the country where the vessel is registered has determined through fire tests that the actual foam application rate at each cargo tank is adequate for the chemicals carried in that tank. The design practices given in this section comply with the second method of the *IBC Code*.
- (2) For reliance on monitor application, it is recognized that for land applications this standard generally restricts monitor application of foam according to tank diameter

and surface area. A significant difference between monitor applications on land and those on tank ships is that the monitors on tank ships are located at or above the elevation of the top of the tank. Therefore, shipboard systems do not suffer losses of agent associated with long throws getting foam up and over tank rims. Additionally, tank ship monitors can be placed in operation immediately after an incident, as there is little or no set-up time and each monitor is required to be sized to deliver at least 50 percent of the required foam application rate.

- (3) The application rates given in this section incorporate design factors that allow the results of small-scale fire tests to be applied to full-scale fires. Design factors include scaling factors that allow the results of small-scale tests to be extrapolated to large scale. In addition, compensation factors are included to account for losses expected from wind, thermal updraft, stream break-up, plunging, and other adverse conditions. The application rates and incorporated design factors are shown in Table A.10.3.4.
- (4) The design philosophy given in this standard reflects that outlined in NVIC 11-82. NVIC 11-82 assumes that the minimum single tank design application rate will be  $6.5 \text{ L/min}\cdot\text{m}^2$  ( $0.16 \text{ gpm/ft}^2$ ). It then allows monitors to be calculated using 45 percent of the single tank rate. SOLAS and the IBC Code require the monitor to be calculated at 50 percent of the single tank rate. However, SOLAS starts with a single tank application rate of  $6 \text{ L/min}\cdot\text{m}^2$  ( $0.147 \text{ gpm/ft}^2$ ) so that 50 percent of that rate exactly equals  $3 \text{ L/min}\cdot\text{m}^2$  ( $0.0735 \text{ gpm/ft}^2$ ), which is 45 percent of the NVIC 11-82 minimum application rate of  $6.5 \text{ L/min}\cdot\text{m}^2$  ( $0.16 \text{ gpm/ft}^2$ ). The IBC Code also requires monitors to be sized for 50 percent of the single tank flow rate.

**A.10.3.5.1** Foam application durations given in this section are generally lower than those given in other sections of this standard. This difference is based on historically quick deployment of marine deck foam systems and also takes into account all of the factors listed in A.10.3.1.

**A.10.3.5.4** The flow rates during an actual system discharge will generally be greater than the minimum rates calculated during system design because pumps, eductors, and nozzles are typically not available in sizes for the exact minimum flow rate needed. Therefore, this equipment will typically be selected at the next larger commercially available size. Because the system, built of components larger than the minimum required, will flow foam at a rate greater than the minimum calculated, the foam concentrate will be used faster than the

minimum usage rate. Since the concentrate will be used at a rate higher than the minimum, the storage quantity should be sized to provide the actual delivery rate during the entire required discharge duration.

**A.10.4** Although foam handlines are required for supplementary protection, it is not practical to rely on handlines for primary fire fighting. Therefore, all required foam application must be provided by monitors that cover the protected area.

**A.10.9.2** Pipe should be uniformly supported to prevent movement due to gravity, heaving of the vessel in heavy weather, impact, and water hammer. Pipe should be supported by steel members.

**A.10.9.3** Deck foam system piping is not a substitute for any portion of a vessel's fire main system. Conversely, the requirement is intended to clarify that foam injected into the ship's fire main is not a substitute for a dedicated foam system on the weather deck. The requirement is not intended to prevent the proportioning of foam into a ship's fire main. Such a capability may be of great value during a machinery space fire or any other fire involving flammable liquids.

**A.10.9.5** The system should be arranged to prevent ice from forming in any portion of the system. Sloped piping and manual low point drains are considered to meet the requirement that the system be self-draining.

**A.10.10.1** Refer to the environmental report (*Annex E*) for further information related to environmental issues when system discharge tests are performed.

**A.10.11.1.1** The primary foam concentrate tank is the tank containing the supply calculated to satisfy the requirements of 10.3.4 and 10.3.5. The location of emergency back-up supplies and supplies of concentrate for refilling the primary tank are not subject to the storage location restrictions of 10.11.2. However, all foam concentrate storage is subject to other provisions of this chapter such as those regarding prevention of freezing and foam compatibility.

**A.10.11.2.1** Corrosion occurs at the air/foam/tank interface. Therefore, the small surface area of this interface in the tank dome results in less corrosion than if the interface occurs in the body of the tank. Tank domes are also used to reduce the available free surface subject to sloshing. Sloshing causes premature foaming and adversely affects foam proportioning. In addition, sloshing can cause cracking or other damage to the tank. Foam also evaporates, so the use of a pressure vacuum (PV) vent is necessary. A PV vent allows air to enter the tank as

**Table A.10.3.4 Foam Application Rates**

Fuel	Scenario	100 ft <sup>2</sup> Test Fire	Scaling Design Factor	Fuel Surface Application Rate	Compensation Design Factor	Required Application Rate
Hydrocarbon	Deck spill	$2.4 \text{ L/min}\cdot\text{m}^2$ ( $0.06 \text{ gpm/ft}^2$ )	2.67 (8/3)	$6.5 \text{ L/min}\cdot\text{m}^2$ ( $0.16 \text{ gpm/ft}^2$ )	1.0	$6.5 \text{ L/min}\cdot\text{m}^2$ ( $0.16 \text{ gpm/ft}^2$ )
Hydrocarbon	Single largest tank	$2.4 \text{ L/min}\cdot\text{m}^2$ ( $0.06 \text{ gpm/ft}^2$ )	2.67	$6.5 \text{ L/min}\cdot\text{m}^2$ ( $0.16 \text{ gpm/ft}^2$ )	1.5	$9.8 \text{ L/min}\cdot\text{m}^2$ ( $0.24 \text{ gpm/ft}^2$ )
Polar	Deck spill	Rate $\geq 2.4 \text{ L/min}\cdot\text{m}^2$ ( $0.06 \text{ gpm/ft}^2$ ) as determined by test	2.67	Test rate $\times 2.67$ $\geq 6.5 \text{ L/min}\cdot\text{m}^2$ ( $0.16 \text{ gpm/ft}^2$ )	1.0	$\geq 6.5 \text{ L/min}\cdot\text{m}^2$ ( $0.16 \text{ gpm/ft}^2$ )
Polar	Single largest tank	Rate $\geq 2.4 \text{ L/min}\cdot\text{m}^2$ ( $0.06 \text{ gpm/ft}^2$ ) as determined by test	2.67	Test rate $\times 2.67$ $\geq 6.5 \text{ L/min}\cdot\text{m}^2$ ( $0.16 \text{ gpm/ft}^2$ )	1.5	$\geq 9.8 \text{ L/min}\cdot\text{m}^2$ ( $0.24 \text{ gpm/ft}^2$ )



liquid is discharged, allows air to leave the tank as liquid fills the tank, and allows the PV valve to prevent evaporation of the concentrate.

**A.10.12.1** Examples of acceptable arrangements are shown in Figure A.3.3.24.1 and Figure A.3.3.24.1.1(a). Consideration should be given to the need for spare or redundant critical equipment.

**A.10.12.3** Where foam concentrate pumps are flushed with sea water, the pump should be constructed of materials suitable for use with sea water.

**A.10.12.4** Portions of TP 127 are generally considered equivalent to IEEE 45.

**A.10.13.5** Some pipe joint sealants are soluble in foam concentrate.

**A.11.3** Acceptance tests should encompass the following:

- (1) A foam system will extinguish a flammable liquid fire if operated within the proper ranges of solution pressure and concentration and at sufficient discharge density per square foot (square meter) of protected surface. The acceptance test of a foam system should ascertain the following:
  - (a) All foam-producing devices are operating at system design pressure and at system design foam solution concentration.
  - (b) Laboratory-type tests have been conducted, where necessary, to determine that water quality and foam liquid are compatible.
- (2) The following data are considered essential to the evaluation of foam system performance:

- (a) Static water pressure
- (b) Stabilized flowing water pressure at both the control valve and a remote reference point in the system
- (c) Rate of consumption of foam concentrate

The concentration of foam solution should be determined. The rate of solution discharge can be computed from hydraulic calculations utilizing recorded inlet or end-of-system operating pressure or both. The foam liquid concentrate consumption rate can be calculated by timing a given displacement from the storage tank or by refractometric or conductivity means. The calculated concentration and the foam solution pressure should be within the operating limit recommended by the manufacturer.

**A.11.6** The rate of concentrate consumption can be measured by timing a given displacement from the foam concentrate storage tank, but only in systems where the storage tank is small enough and the test run time is long enough so that this can be accomplished with reasonable accuracy.

**A.11.6.3** FM Approvals Class 5138, *Assessment Standard for Proportioning Testing*, should be consulted for possible listing requirements.

**A.11.7(3)** A sample material and test certificate is provided in Figure A.11.7(3).

**A.12.1** Flushing of the concentrate pump might be necessary at periodic intervals or following complete discharge of concentrate.

**A.12.2** Regular service contracts are recommended.



<b>Contractor's Material and Test Certificate for Low-Expansion Foam</b>											
<p><b>PROCEDURE</b>                      Upon completion of work, inspection and tests shall be made by the contractor's representative and witnessed by an owner's representative. All defects shall be corrected and system left in service before contractor's personnel finally leave the job.</p> <p>A certificate shall be filled out and signed by both representatives. Copies shall be prepared for approving authorities, owners, and contractor. It is understood the owner's representative's signature in no way prejudices any claim against contractor for faulty material, poor workmanship, or failure to comply with approving authority's requirements or local ordinances.</p>											
Property name							Date				
Property address											
<b>Plans</b>	Accepted by approving authorities (names)										
	1 _____										
	2 _____										
	3 _____										
Address											
1 _____											
2 _____											
3 _____											
Installation conforms to accepted plans								<input type="checkbox"/> Yes <input type="checkbox"/> No			
Equipment used is approved								<input type="checkbox"/> Yes <input type="checkbox"/> No			
If no, explain deviations											
<b>Instructions</b>	Has person in charge of fire equipment been instructed as to location of control valves and care and maintenance of this new equipment? <input type="checkbox"/> Yes <input type="checkbox"/> No										
	If no, explain										
	Have copies of the following been left on premises?									<input type="checkbox"/> Yes <input type="checkbox"/> No	
	1. System components instructions <input type="checkbox"/> Yes <input type="checkbox"/> No										
2. Care and maintenance instructions <input type="checkbox"/> Yes <input type="checkbox"/> No											
3. NFPA 25 <input type="checkbox"/> Yes <input type="checkbox"/> No											
4. With whom have the copies been left? _____ <input type="checkbox"/> Yes <input type="checkbox"/> No											
<b>Location of system</b>	Supplies buildings					Square footage					
	_____					_____					
	_____					Total square footage					
<b>Discharge devices</b>	Make		Model		Year of manufacture		Orifice size	Quantity		Other	
	_____		_____		_____		_____	_____		_____	
<b>Pipe and fittings</b>	Type of pipe _____					_____					
	Type of fittings _____					_____					
<b>Alarm valve or flow indicator</b>	Alarm device							Maximum time to operate thru test connection			
	Type		Make		Size	Model		Min.		Sec.	
	_____		_____		_____	_____		_____		_____	
<b>Dry pipe operating test</b>	Dry valve				Q. O. D.						
	Make	Size	Model	Serial no.	Type		Make	Size	Model	Serial no.	
	_____	_____	_____	_____	<input type="checkbox"/> Accelerator		_____	_____	_____	_____	
		Time to trip thru test connection		Water pressure		Air pressure	Trip point air pressure	Time water reached test outlet <sup>1</sup>		Alarm operated properly	
		Min.	Sec.	PSI		PSI	PSI	Min.	Sec.	Yes	No
	Without Q. O. D.	_____	_____	_____		_____	_____	_____	_____	_____	_____
	With Q. O. D.	_____	_____	_____		_____	_____	_____	_____	_____	_____
If no, explain											
<p><small><sup>1</sup>Measured from time inspector's test connection is opened.</small></p> <p>© 2014 National Fire Protection Association <span style="float: right;">NFPA 11 (p. 1 of 3)</span></p>											

FIGURE A.11.7(3) Sample Material and Test Certificate.

<b>Deluge &amp; preaction valves</b>	Operation <input type="checkbox"/> Pneumatic <input type="checkbox"/> Electric <input type="checkbox"/> Hydraulic				
	Piping supervised? <input type="checkbox"/> Yes <input type="checkbox"/> No		Detecting media supervised? <input type="checkbox"/> Yes <input type="checkbox"/> No		
	Does valve operate from the manual trip, remote, or both control stations? <input type="checkbox"/> Yes <input type="checkbox"/> No				
	Is there an accessible facility in each circuit for testing? If no, explain <input type="checkbox"/> Yes <input type="checkbox"/> No				
	Make	Model	Does each circuit operate supervision loss alarm? Yes No	Does each circuit operate valve release? Yes No	Maximum time to operate release Min. Sec.
<b>Backflow preventers</b>	Make	Model	Size		
<b>Foam</b>	High flow rate _____ gpm @ _____ psi Results fall within -0% to +30% for balanced pressure system: <input type="checkbox"/> Yes <input type="checkbox"/> No Low flow rate _____ gpm @ _____ psi Results fall within -0% to +30% for balanced pressure system: <input type="checkbox"/> Yes <input type="checkbox"/> No For positive pressure systems with pump or pressure controlled bladder tank and in-line balanced pressure type proportioning systems: -0% to +30% or greater: <input type="checkbox"/> Yes <input type="checkbox"/> No Foam concentrate induction rate -0% to +30% of manufacturers listed induction rate or 1 percentage point, whichever is less at listed flow rates: <input type="checkbox"/> Yes <input type="checkbox"/> No Balanced pressure proportioning systems produce the minimum percentage of manufacturers requirements -0% at minimum listed flow rate: <input type="checkbox"/> Yes <input type="checkbox"/> No Positive pressure proportioning with pumps or pressure-controlled bladder tanks produce the maximum percentage of manufacturers requirement +30% or 1 percentage point, whichever is less at the minimum listed flow rate: <input type="checkbox"/> Yes <input type="checkbox"/> No Variable pressure orifice type proportioners produce the percentage -0% to +30% or 1 percentage point, whichever is less: <input type="checkbox"/> Yes <input type="checkbox"/> No Foam discharge was collected and disposed of properly: <input type="checkbox"/> Yes <input type="checkbox"/> No Approved simulated foam concentrates were used for this test: <input type="checkbox"/> Yes <input type="checkbox"/> No Type _____ All foam residue was removed from the piping system by flushing with clean water <input type="checkbox"/> Yes <input type="checkbox"/> No				
<b>Test description</b>	<b>Hydrostatic:</b> Hydrostatic tests shall be made at not less than 200 psi (13.6 bar) for 2 hours or 50 psi (3.4 bar) above static pressure in excess of 150 psi (10.2 bar) for 2 hours. Differential dry-pipe valve clappers shall be left open during the test to prevent damage. All aboveground piping leakage shall be stopped. Maximum static pressure: _____ <b>Pneumatic:</b> Establish 40 psi (2.7 bar) air pressure and measure drop, which shall not exceed 1 1/2 psi (0.1 bar) in 24 hours. Test pressure tanks at normal water level and air pressure and measure air pressure drop, which shall not exceed 1 1/2 psi (0.1 bar) in 24 hours.				
<b>Tests</b>	All piping hydrostatically tested at _____ psi (_____ bar) for _____ hrs. If no, state reason				
	Dry piping pneumatically tested <input type="checkbox"/> Yes <input type="checkbox"/> No				
	Equipment operates properly <input type="checkbox"/> Yes <input type="checkbox"/> No				
	Do you as the sprinkler contractor certify that additives and corrosive chemicals, sodium silicate or derivatives of sodium silicate, brine, or other corrosive chemicals were not used for testing systems or stopping leaks? <input type="checkbox"/> Yes <input type="checkbox"/> No				
	Drain test	Reading of gauge located near water supply test connection: _____ psi (_____ bar)		Residual pressure with valve in test pipe open wide _____ psi (_____ bar)	
<b>Blank testing gaskets</b>	Underground mains and lead-in connections to system risers flushed before connection made to sprinkler piping. Verified by copy of the U Form No. 85B <input type="checkbox"/> Yes <input type="checkbox"/> No Other Explain				
	Flushed by installer of underground sprinkler piping <input type="checkbox"/> Yes <input type="checkbox"/> No				
	If powder-driven fasteners are used in concrete, has representative sample testing been satisfactorily completed? <input type="checkbox"/> Yes <input type="checkbox"/> No If no, explain				
<b>Blank testing gaskets</b>	Number used	Locations			Number removed
	Welded piping <input type="checkbox"/> Yes <input type="checkbox"/> No				
	If yes . . . .				
	Do you certify as the sprinkler contractor that welding procedures comply with the requirements of at least AWS B2.1? <input type="checkbox"/> Yes <input type="checkbox"/> No				
	Do you certify that the welding was performed by welders qualified in compliance with the requirements of at least AWS B2.1? <input type="checkbox"/> Yes <input type="checkbox"/> No				
Do you certify that welding was carried out in compliance with a documented quality control procedure to ensure that all discs are retrieved, that openings in piping are smooth, that slag and other welding residue are removed, and that the internal diameters of piping are not penetrated? <input type="checkbox"/> Yes <input type="checkbox"/> No					

FIGURE A.11.7(3) Continued

<b>Cutouts (discs)</b>	Do you certify that you have a control feature to ensure that all cutouts (discs) are retrieved? <input type="checkbox"/> Yes <input type="checkbox"/> No	
<b>Hydraulic data nameplate</b>	Nameplate provided <input type="checkbox"/> Yes <input type="checkbox"/> No	If no, explain _____
<b>Remarks</b>	Date left in service with all control valves open: _____	
<b>Signatures</b>	Name of sprinkler contractor _____	
	Address _____	
	Phone _____	
	Fax _____	
	Tests witnessed by _____	
	For property owner (signed) _____	Title _____ Date _____
	For sprinkler contractor (signed) _____	Title _____ Date _____
Additional explanation and notes		
© 2014 National Fire Protection Association		
NFPA 11 (p. 3 of 3)		

FIGURE A.11.7(3) *Continued***Annex B Storage Tank Protection Summary****B.1 Storage Tank Protection Summary Table.** See Table B.1.

*This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.*

**Table B.1 Storage Tank Protection Summary**

Foam Application Method	Fixed-Roof (Cone) Tanks and Pan-Type Floating Roof Tanks	No. of Chambers	Applicable Floating Roof Tanks (Open-Top or Covered) Annular Seal Area
<b>Top Side Foam Application</b>			
Number of foam outlets required	Up to 24.4 m (80 ft) dia.	1 foam chamber	1—For each 12.2 m (40 ft) of circumference with a 304.8 mm (12 in.) high foam dam
	24.7 to 36.6 m (81 to 120 ft) dia.	2 foam chambers	1—For each 24.4 m (80 ft) of circumference with a 609.6 mm (24 in.) high foam dam <i>(See 5.3.3.1 and Section 5.4.)</i>
	36.9 to 42.7 m (121 to 140 ft) dia.	3 foam chambers	
	43 to 48.8 m (141 to 160 ft) dia.	4 foam chambers	
	49.1 to 54.9 m (161 to 180 ft) dia.	5 foam chambers	
55.2 to 61 m (181 to 200 ft) dia.	6 foam chambers		
	Over 61.3 m (201 ft) dia.	1 additional for each 465 m <sup>2</sup> (5000 ft <sup>2</sup> )	
	<i>(See Table 5.2.5.2.1.)</i>		
Hydrocarbon application rates	4.1 L/min · m <sup>2</sup> (0.10 gpm/ft <sup>2</sup> ) of liquid surface		12.2 L/min · m <sup>2</sup> (0.30 gpm/ft <sup>2</sup> ) of annular ring area, above seal, between tank wall and foam dam <i>(See Section 5.3.)</i>
	<i>(See Table 5.2.5.2.2.)</i>		
Polar solvent rates	See Manufacturer's Approval Report.		Not covered by NFPA 11

*(continues)*

Table B.1 *Continued*

Foam Application Method	Fixed-Roof (Cone) Tanks and Pan-Type Floating Roof Tanks		Applicable Floating Roof Tanks (Open-Top or Covered) Annular Seal Area	
	No. of Chambers			
Hydrocarbon application rates	Flash point 37.8°C to 60°C (100°F to 140°F)	Type I 20 min	Type II 30 min	20 min
	Flash point below 37.8°C (100°F) Crude petroleum	30 min 30 min	55 min 55 min	(See Section 5.3.)
Polar solvents	Type I	30 min		Not covered by NFPA 11
	Type II	55 min		
<b>Foam Outlets Under Floating Roof Tank Seals or Metal Secondary Seal</b>				
Number required	Not applicable			<p>Mechanical shoe seal</p> <p>1 — For each 39.6 m (130 ft) of tank circumference (no foam dam required)</p> <p>Tube seal — Over 152 mm (6 in.) from top of seal to top of pontoon with foam outlets under metal weather shield or secondary seal</p> <p>1 — For each 18.3 m (60 ft) of tank circumference (no foam dam required)</p> <p>Tube seal — Less than 152 mm (6 in.) from top of seal to top of pontoon with foam outlets under metal weather shield or secondary seal</p> <p>1 — For each 18.3 m (60 ft) of tank circumference [foam dam at least 305 mm (12 in.) high required] (See 5.3.5.4.)</p>
Hydrocarbon application rates	Not applicable			<p>Top-of-seal protection with foam dam at 12.2 L/min·m<sup>2</sup> (0.30 gpm/ft<sup>2</sup>) of annular ring area. All below-the-seal with or without foam dam at 20.4 L/min·m<sup>2</sup> (0.50 gpm/ft<sup>2</sup>)</p> <p>20 min — with foam dam or under metal weather shield or secondary seal</p>
Discharge times	Not applicable			20 min — with foam dam or under metal weather shield or secondary seal
Polar solvents	Not applicable			Not covered by NFPA 11
<b>Foam Handlines and Monitors for Tank Protection</b>				
Size of tank	Monitors for tanks up to 18.3 m (60 ft) in diameter			Monitors not recommended
	Hand hoses for tanks less than 9.2 m (30 ft) in diameter and less than 6.1 m (20 ft) high (See 5.2.4.2.2.)			Handlines are suitable for extinguishment of rim fires in open-top floating roof tanks (See 5.3.4.)
Hydrocarbon application rates	6.5 L/min·m <sup>2</sup> (0.16 gpm/ft <sup>2</sup> ) (See 5.2.4.2.2.)			6.5 L/min·m <sup>2</sup> (0.16 gpm/ft <sup>2</sup> ) For rim fires in open-top floating roof tanks (See 5.2.4.2.2.)
Discharge times	Flash point below 37.8°C (100°F)	65 min		Use same times as for open-top floating roof tank rim fires
	Flash point 37.8°C to 60°C (100°F to 140°F)	50 min		
	Crude oil (See 5.2.4.2.2.)	65 min		
<b>Subsurface Application Outlets</b>				
Number required	Same as table for foam chambers. See above. (See 5.2.6.2.8.)			Not recommended

Table B.1 *Continued*

Foam Application Method	Fixed-Roof (Cone) Tanks and Pan-Type Floating Roof Tanks	No. of Chambers	Applicable Floating Roof Tanks (Open-Top or Covered) Annular Seal Area
Hydrocarbon application rates	Minimum 4.1 L/min·m <sup>2</sup> (0.1 gpm/ft <sup>2</sup> ) of liquid surface Maximum 8.2 L/min·m <sup>2</sup> (0.2 gpm/ft <sup>2</sup> ) Foam velocity from outlet shall not exceed 3.05 m/sec (10 ft/sec) for Class IB liquids or 6.1 m/sec (20 ft/sec) for all other liquids (See 5.2.6.5.1.)		Not recommended
Discharge times	Flash point 37.8°C (100°F) to 60°C (140°F) Flash point below 37.8°C (100°F) Crude petroleum (See 5.2.6.5.1.)	30 min 55 min 55 min	Not recommended
Polar solvents	Not recommended		Not recommended

### Annex C Medium- and High-Expansion Foam

*This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.*

**C.1** High-expansion foam is an agent for control and extinguishment of Class A and Class B fires and is particularly suited as a flooding agent for use in confined spaces. Development of the use of high-expansion foams for fire-fighting purposes started with the work of the Safety in Mines Research Establishment of Buxton, England, based on the difficult problem of fires in coal mines. It was found that by expanding an aqueous surface active agent solution to a semistable foam of about 1000 times the volume of the original solution, it was possible to force the foam down relatively long corridors, thus providing a means for transporting water to a fire inaccessible to ordinary hose streams.

This work led to the development of specialized high-expansion foam-generating equipment for fighting fires in mines, for application in municipal industrial fire fighting, and for the protection of special hazard occupancies. Medium-expansion foam was developed to meet the need for a foam that was more wind resistant than high-expansion foam for outdoor applications.

*Description.* Medium- and high-expansion foams are aggregations of bubbles that are mechanically generated by the passage of air or other gases through a net, screen, or other porous medium that is wetted by an aqueous solution of surface active foaming agents. Under proper conditions, fire-fighting foams of expansions from 20:1 to 1000:1 can be generated. These foams provide a unique agent for transporting water to inaccessible places; for total flooding of confined spaces; and for volumetric displacement of vapor, heat, and smoke. Tests have shown that, under certain circumstances, high-expansion foam, when used in conjunction with water sprinklers, will provide more positive control and extinguishment than either extinguishment system by itself. High-piled storage of rolled paper stock is an example. Optimum efficiency in any one type of hazard depends to some extent on the rate of application and the foam expansion and stability. Medium- and high-expansion foams, which are generally made from the same type of concentrate, differ mainly in their expansion characteristics. Medium-expansion foam can be used on solid fuel and liquid fuel fires where some degree of in-depth cover-

age is necessary — for example, for the total flooding of small enclosed or partially enclosed volumes such as engine test cells and transformer rooms. Medium-expansion foam can provide quick and effective coverage of flammable liquid spill fires or some toxic liquid spills where rapid vapor suppression is essential. It is effective both indoors and outdoors.

High-expansion foam can also be used on solid- and liquid-fuel fires, but the in-depth coverage it provides is greater than for medium-expansion foam. Therefore, it is most suitable for filling volumes in which fires exist at various levels. For example, experiments have shown that high-expansion foam can be used effectively against high-rack storage fires, provided that the foam application is started early and the depth of foam is rapidly increased. It also can be used to extinguish fires in enclosures, such as in basement and underground passages, where it might be dangerous to send personnel. It can be used to control fires involving liquefied natural gases (LNGs) and liquefied petroleum gases (LPGs) and to provide vapor dispersion control for LNG and ammonia spills.

High-expansion foam is particularly suited for indoor fires in confined spaces. Its use outdoors can be limited because of the effects of wind and lack of confinement. Medium- and high-expansion foam have the following effects on fires:

- (1) Where generated in sufficient volume, medium- and high-expansion foam can prevent the free movement of air, which is necessary for continued combustion.
- (2) Where forced into the heat of a fire, the water in the foam is converted to steam, thus reducing the oxygen concentration by dilution of the air.
- (3) The conversion of the water to steam absorbs heat from the burning fuel. Any hot object exposed to the foam will continue the process of breaking the foam, converting the water to steam, and cooling.
- (4) Because of its relatively low surface tension, solution from the foam that is not converted to steam will tend to penetrate Class A materials. However, deep-seated fires might require overhaul.
- (5) Where accumulated in depth, medium- and high-expansion foam can provide an insulating barrier for protection of exposed materials or structures not involved in a fire and can thus prevent fire spread.
- (6) For LNG fires, high-expansion foam will not normally extinguish a fire, but it will reduce the fire intensity by blocking radiation feedback to the fuel.



- (7) Class A fires are controlled when the foam completely covers the fire and burning material. If the foam is sufficiently wet and is maintained long enough, the fire can be extinguished.
- (8) Class B fires involving high-flash-point liquids can be extinguished when the surface is cooled below the flash point. Class B fires involving low-flash-point liquids can be extinguished when a foam blanket of sufficient depth is established over the liquid surface. Refrigerated or cryogenic liquefied flammable gas fires can be safely controlled, and vapor concentrations downwind of unignited spills can be reduced by application of high-expansion foam when the vapor density at ambient temperature and pressure is less than that of air. High-expansion foam should not be applied to refrigerated liquefied petroleum gas (LPG) fires unless careful consideration is given to the resulting possibly hazardous condition. Extinguishment can occur with evolution of heavier-than-air vapors beneath the foam blanket. The vapors will accumulate or drain from beneath the foam blanket to low areas with the danger of vapor cloud formation or reignition or both. For LPG fire control, see *Control and Extinguishment of LPG Fires*, D. W. Johnson, et al.

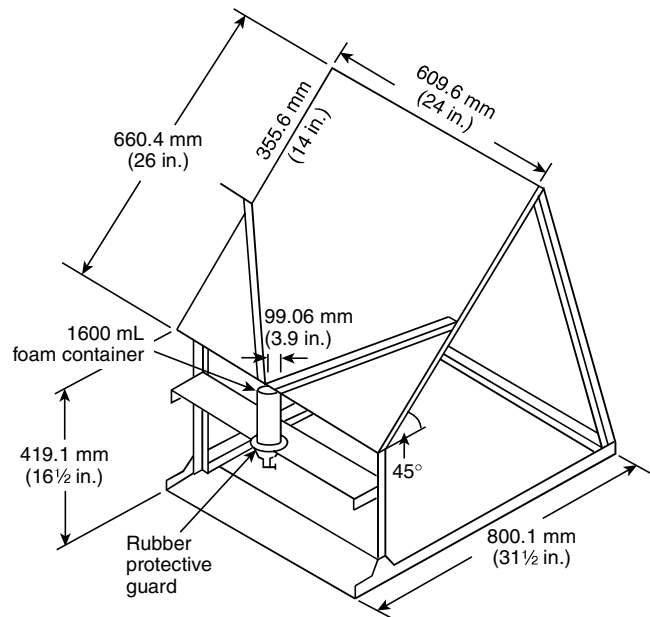


FIGURE D.1.1(a) Foam Sample Collector.

## Annex D Tests for Foam Systems

*This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.*

### D.1 Procedures for Measuring Expansion and Drainage Rates of Foams.

**D.1.1 Foam Sampling.** The object of foam sampling is to obtain a sample of foam typical of the foam to be applied to burning surfaces under anticipated fire conditions. Because foam properties are readily susceptible to modification through the use of improper techniques, it is extremely important that the prescribed procedures are followed.

A collector is designed chiefly to facilitate the rapid collection of foam from low-density patterns. In the interest of standardization, it is used also for all sampling, except where pressure-produced foam samples are being drawn from a line tap. A backboard is inclined at a 45-degree angle suitable for use with vertical streams falling from overhead applicators as well as horizontally directed streams. [See Figure D.1.1(a) and Figure D.1.1(b).]

The standard container is 200.67 mm (7.9 in.) deep and 99.06 mm (3.9 in.) inside diameter (1600 mL) and preferably made of 1.55 mm ( $\frac{1}{16}$  in.) thick aluminum or brass. The bottom is sloped to the center, where a 6.4 mm ( $\frac{1}{4}$  in.) drain fitted with a 6.4 mm ( $\frac{1}{4}$  in.) valve is provided to draw off the foam solution. [See Figure D.1.1(b).]

**D.1.2 Turrets or Handline Nozzles.** It is presumed that the turret or nozzle is capable of movement during operation to facilitate collection of the sample. It is important that the foam samples taken for analysis represent as nearly as possible the foam reaching the burning surface in a normal fire-fighting procedure. With adjustable stream devices, samples should be taken from both the straight stream position and the fully dispersed position and possibly from other intermediate positions. Initially, the collector should be placed at the proper distance from the nozzle to serve as the center of the ground pattern. The nozzle or turret should be placed in operation while it is directed off to one side of the collector.

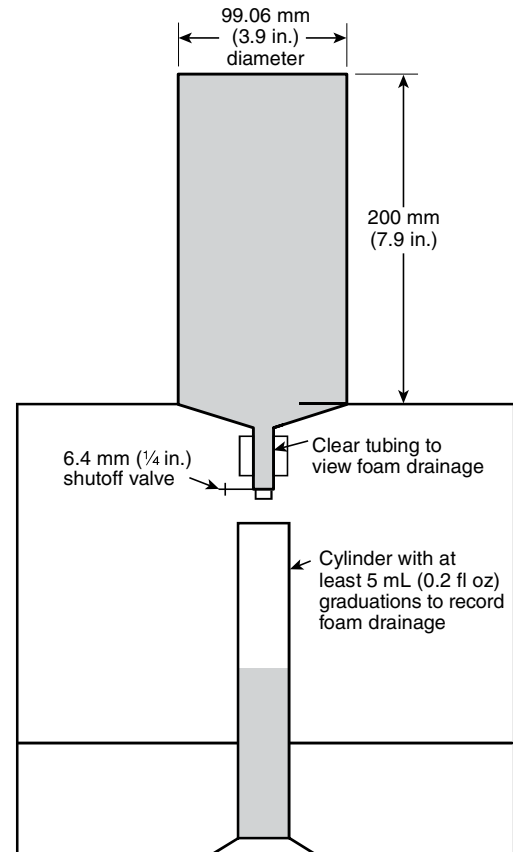


FIGURE D.1.1(b) 1600 mL Foam Container.

After the pressure and operation have become stabilized, the stream is swung over to center on the collector. When a sufficient foam volume has accumulated to fill the sample containers, usually within only a few seconds, a stopwatch is started for each of the two samples in order to provide the “zero” time for the drainage test described later. Immediately, the nozzle is turned away from the collector, the sample containers removed, and the top struck off with a straight edge. After all foam has been wiped off from the outside of the container, the sample is ready for analysis.

**D.1.3 Overhead Devices.** It is presumed that the devices are fixed and not capable of movement. Prior to starting up the stream, the collector is situated within the discharge area where it is anticipated a representative foam pattern will occur. The two sample containers are removed before the collector is positioned. The foam system is activated and permitted to achieve equilibrium, after which time the technician, wearing appropriate clothing, enters the area without delay. The sample containers are placed and left on the collector board until adequately filled. Stopwatches are started for each of the samples to provide the “zero” time for the drainage rate test described later. During the entry and retreat of the operator through the falling foam area, the containers should be suitably shielded from extraneous foam. Immediately after the samples are removed from under the falling foam, the top should be struck off with a straight edge and all foam wiped off from the outside of the container. The sample is then ready for analysis.

**D.1.4 Pressure Foam.** It is presumed that foam is flowing under pressure from a foam pump or high-pressure aspirator toward an inaccessible tank outlet. A 25.4 mm (1 in.) pipe tap fitted with a globe valve should be located as close to the point of foam application as practicable. The connection should terminate in an approximate 457 mm (18 in.) section of flexible rubber tubing to facilitate filling the sample container. When drawing the sample, the valve should be opened as wide as possible without causing excessive splashing and air entrainment in the container. Care should be exercised to eliminate air pockets in the sample. As each container is filled, a stopwatch is started to provide the “zero” time for the drainage test described later. Any excess foam is struck off the top with a straight edge, and all foam clinging to the outside of the container is wiped off. The sample is then ready for analysis.

**D.1.5 Foam Chambers.** In some instances where the foam makers are integral with the foam chambers on the top ring of a tank, the methods of sampling described in D.1.1 through D.1.4 might not be workable. In this case, it will be necessary to improvise, making sure any unusual procedures or conditions are pointed out in reporting the results. Where access can be gained to a flowing foam stream, the splinter can be inserted into the edge of the stream to split off a portion for the sample. The other alternative is to scoop foam from a layer or blanket already on the surface. Here an attempt should be made to obtain a full cross section of foam from the entire depth but without getting any fuel below the foam layer. The greatest difficulty inherent in sampling from a foam blanket is the undesirable lag-in-time factor involved in building up a layer deep enough to scoop a sample. At normal rates of application, it can take a few minutes to build up the several inches in depth required, and this time is likely to affect the test results. The degree of error thus incurred will in turn depend on the

type of foam involved, but it can vary from zero percent to several hundred percent. In a Moeller tube installation, it is advisable to sample right alongside the tube as foam oozes out in sufficient volume. Immediately after filling the container, a stopwatch is started to provide the “zero” time for the drainage test described later. Any excess foam is struck off the top with a straight edge, and all foam wiped off from the outside of the container. The sample is then ready for analysis.

**D.1.6 Foam Testing.** The foam samples, as obtained in the procedures described in D.1.1 through D.1.5, are analyzed for expansion, 25 percent drainage time, and foam solution concentration. It is recommended that duplicate samples be obtained whenever possible and the results averaged for the final value. However, when a shortage of personnel or equipment or both creates a hardship, one sample should be considered acceptable.

The following apparatus is required:

- (1) Two 1600 mL (54.1 fl oz) sample containers
- (2) One foam collector board
- (3) One balance [triple beam balance, 2610 g (5.7 lb) capacity]

**D.1.7 Procedure.** Prior to the testing, the empty containers fitted with a drain hose and clamp should be weighed to obtain the tare weight. (All containers should be adjusted to the same tare weight to eliminate confusion in handling.) Each foam sample is weighed to the nearest gram and the expansion calculated from the following equation:

$$\frac{1600}{(\text{full weight} - \text{empty weight})} = \text{Expansion} \quad [\text{D.1.7}]$$

**D.1.8 Foam 25 Percent Drainage Time Determination.** The rate at which the foam solution drops out from the foam mass is called the drainage rate and is a specific indication of degree of water retention ability and the fluidity of the foam. A single value is used to express the relative drainage rates of different foams in the “25 percent drainage time,” which is the time in minutes that it takes for 25 percent of the total solution contained in the foam in the sample containers to drain.

The following apparatus are required:

- (1) Two stopwatches
- (2) One sample stand
- (3) 100 mL (3.38 fl oz) capacity plastic graduates

**D.1.9 Procedure.** This test is performed on the same sample as used in the expansion determination. Dividing the net weight of the foam sample by 4 will give the 25 percent volume (in milliliters) of solution contained in the foam. To determine the time required for this volume to drain out, the sample container should be placed on a stand, as indicated in Figure D.1.1(b), and the accumulated solution in the bottom of the container should be drawn off into a graduate at regular, suitable intervals. The time intervals at which the accumulated solution is drawn off are dependent on the foam expansion. For foams of expansion 4 to 10, 30-second intervals should be used, and for foams of expansion 10 and higher, 4-minute intervals should be used because of the slower drainage rate of these foams. In this way, a time-drainage-volume relationship is obtained, and after the 25 percent volume has been exceeded, the 25 percent drainage time is interpolated from the data. The following example shows how this is done. The net weight of the foam sample is 180 grams. Since 1 gram

of foam solution occupies a volume of essentially 1 mL (0.03 fl oz), the total volume of foam solution contained in the given sample is 180 mL (6.1 fl oz).

$$\text{Expansion} = \frac{1600}{180 \text{ mL}} = 8.9 \quad [\text{D.1.9a}]$$

$$25\% \text{ volume} = \frac{180 \text{ mL}}{4} = 45 \text{ mL} \quad [\text{D.1.9b}]$$

The time-solution volume data is recorded as shown in Table D.1.9.

The 25 percent volume of 45 mL (1.52 fl oz) falls between the 2.0- and 2.5-minute period. The proper increments to add to the lower value of 2.0 minutes is determined by interpolation of the data:

[D.1.9c]

$$\frac{45 \text{ mL (25\% vol.)} - 40 \text{ mL (2.0 min vol.)}}{50 \text{ mL (2.5 min vol.)} - 40 \text{ mL (2.0 min vol.)}} = \frac{5}{10} = \frac{1}{2}$$

The 25 percent drainage time is halfway between 2.0 and 2.5 minutes, or 2.25 minutes, which is rounded off to 2.3 minutes.

An effort should be made to conduct foam tests with water temperatures between 15.6°C and 26.7°C (60°F and 80°F). The water, air, and foam temperatures should be noted in the results. Lower water temperature tends to depress the expansion values and increase the drainage time values. When handling fast-draining foams, remember that they lose their solution rapidly and that the expansion determination should be carried out with speed in order not to miss the 25 percent drainage volume. The stopwatch is started at the time the foam container is filled and continues to run during the time the sample is being weighed. It is recommended that expansion weighing be deferred until after the drainage curve data has been received.

**Table D.1.9 Foam Sample Drain Time**

Time (minutes)	Drained Solution Volume	
	mL	fl oz
0	0	0
0.5	10	0.34
1.0	20	0.68
1.5	30	1.0
2.0	40	1.4
2.5	50	1.7
3.0	60	2.0

## D.2 Foam Solution Concentration Determination.

**D.2.1 General.** This test is used to determine the percent concentration of a foam concentrate in the water being used to generate foam. It typically is used as a means of determining the accuracy of a system's proportioning equipment. It is also used to measure the concentration of surrogate liquids described in D.5.2.2 or to perform the initial foam concentration test using the water equivalency method described in D.5.2.3. If the level of foam concentrate injection varies widely from that of the design, it can abnormally influence the expansion and drainage foam quality values, which can influence the foam's fire performance. There are two acceptable methods

for measuring foam concentrate percentage in water. Both methods are based on comparing foam solution test samples to premeasured solutions that are plotted on a baseline graph of percent concentration versus instrument reading.

**D.2.1.1 Refractive Index Method.** A handheld refractometer is used to measure the refractive index of the foam solution samples. This method is not particularly accurate for AFFF or alcohol-resistant AFFFs since they typically exhibit very low refractive index readings. For this reason, the conductivity method might be preferred where these products are used.

**D.2.1.1.1 Equipment.** A base (calibration) curve is prepared using the following apparatus:

- (1) Four 100 mL (3.4 fl oz) or larger plastic bottles with caps
- (2) One measuring pipette [10 mL (0.34 fl oz)] or syringe [10 cc (0.34 fl oz)]
- (3) One 100 mL (3.4 fl oz) or larger graduated cylinder
- (4) Three plastic-coated magnetic stirring bars
- (5) One handheld refractometer — American Optical Model 10400 or 10441, Atago NI, or equivalent
- (6) Standard graph paper
- (7) Ruler or other straight edge


**D.2.1.1.2 Procedure.** Using water and foam concentrate from the system to be tested, make up three standard solutions using the 100 mL (3.4 fl oz) or larger graduate. These samples should include the nominal intended percentage of injection, the nominal percentage plus 1 percent, and the nominal percentage minus 1 percent. Place the water in the 100 mL (3.4 fl oz) or larger graduate (leaving adequate space for the foam concentrate), and then carefully measure the foam concentrate samples into the water using the syringe. Use care not to pick up air in the foam concentrate samples. Pour each measured foam solution from the 100 mL (3.4 fl oz) or larger graduate into a 100 mL (3.4 fl oz) plastic bottle. Each bottle should be marked with the percent solution it contains. Add a plastic stirring bar to the bottle, cap it, and shake it thoroughly to mix the foam solution.

After the foam solution samples are thoroughly mixed, a refractive index reading should be taken of each percentage foam solution sample. This is done by placing a few drops of the solution on the refractometer prism, closing the cover plate, and observing the scale reading at the dark field intersection. Since the refractometer is temperature compensated, it can take 10 seconds to 20 seconds for the sample to be read properly. It is important to take all refractometer readings at ambient temperatures of 10°C (50°F) or above. Using standard graph paper, plot the refractive index readings on one axis and the percent concentration readings on the other. (See Figure D.2.1.1.2.)

This plotted curve will serve as the known baseline for the test series. Set the solution samples aside in the event the measurements need to be checked.


**D.2.1.1.3 Sampling and Analysis.** Collect foam solution samples from the proportioning system, using care to be sure the sample is taken at an adequate distance downstream from the proportioner being tested. Take refractive index readings of the sample and compare them to the plotted curve to determine the percentage of the samples.

**D.2.1.2 Conductivity Method.** This method is based on changes in electrical conductivity as foam concentrate is added to water. A handheld conductivity meter, shown in Figure D.2.1.2, is used to measure the conductivity of foam solutions in microsiemenunits. Conductivity is a very accurate method, provided

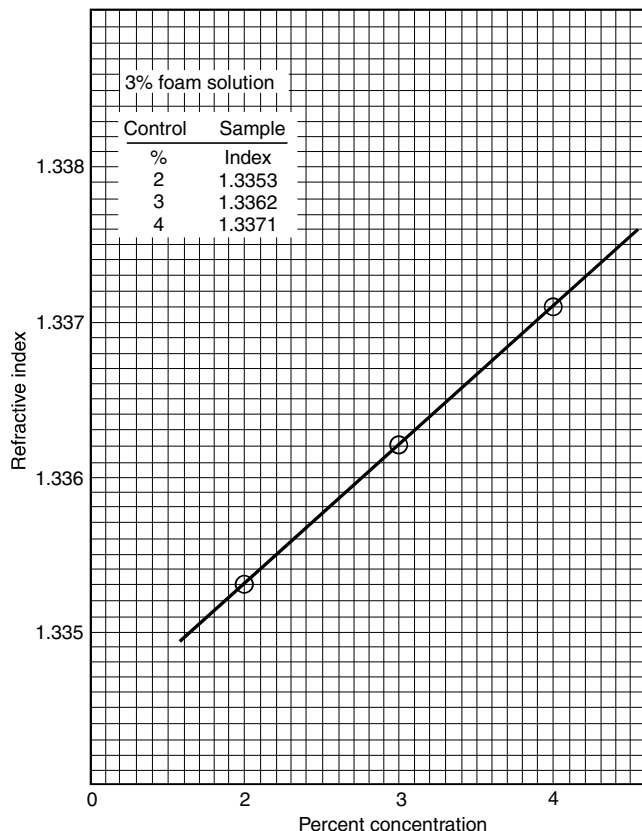

**FIGURE D.2.1.1.2 Typical Graph of Refractive Index Versus Foam Concentration.**

there are substantial changes in conductivity, as foam concentrate is added to the water in relatively low percentages. Since salt or brackish water is very conductive, this method might not be suitable due to small conductivity changes as foam concentrate is added. It will be necessary to make foam and water solutions in advance to determine if adequate changes in conductivity can be detected if the water source is salty or brackish.

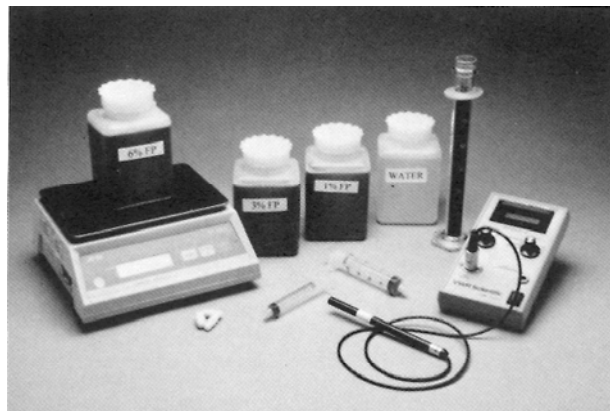

**FIGURE D.2.1.2 Equipment Needed for Conductivity Method of Proportioning Measurement.**

**D.2.1.2.1 Equipment.** Prepare a base (calibration) curve using the following apparatus:

- (1) Four 100 mL (3.4 fl oz) or larger plastic bottles with caps
- (2) One measuring pipette [10 mL (0.34 fl oz)] or syringe [10 cc (0.34 fl oz)]
- (3) One 100 mL (3.4 fl oz) or larger graduated cylinder
- (4) Three plastic-coated magnetic stirring bars
- (5) A portable temperature compensated conductivity meter — Omega Model CDH-70, VWR Scientific Model 23198-014, or equivalent
- (6) Standard graph paper
- (7) Ruler or other straight edge

**D.2.1.2.2 Procedure.** Using the water and foam concentrate from the system to be tested, make up three standard solutions using the 100 mL (3.4 fl oz) or larger graduate. These samples should include the nominal intended percentage of injection, the nominal percentage plus 1 percent, and the nominal percentage minus 1 percent. Place the water in the 100 mL (3.4 fl oz) or larger graduate (leaving adequate space for the foam concentrate), and then carefully measure the foam concentrate samples into the water using the syringe. Use care not to pick up air in the foam concentrate samples. Pour each measured foam solution from the 100 mL (3.4 fl oz) or larger graduate into a 100 mL (3.4 fl oz) or larger plastic bottle. Each bottle should be marked with the percent solution it contains. Add a plastic stirring bar to the bottle, cap it, and shake it thoroughly to mix the foam solution.

After making the three foam solutions in this manner, measure the conductivity of each solution. Refer to the instructions that came with the conductivity meter to determine proper procedures for taking readings. It will be necessary to switch the meter to the correct conductivity range setting in order to obtain a proper reading. Most synthetic-based foams used with freshwater result in foam solution conductivity readings of less than 2000 microsiemens. Protein-based foams generally produce conductivity readings in excess of 2000 in freshwater solutions. Due to the temperature compensation feature of the conductivity meter, it can take a short time to obtain a consistent reading.


Once the solution samples have been measured and recorded, set the bottles aside for control sample reference. The conductivity readings then should be plotted on the graph paper. (See Figure D.2.1.2.2.) It is most convenient to place the foam solution percentage on the horizontal axis and the conductivity readings on the vertical axis.

Use a ruler or straight edge to draw a line that approximates connecting all three points. While it might not be possible to hit all three points with a straight line, they should be very close. If not, repeat the conductivity measurements and, if necessary, make new control sample solutions until all three points plot in a nearly straight line. This plot will serve as the known base (calibration) curve to be used for the test series.

**D.2.1.2.3 Sampling and Analysis.** Collect foam solution samples from the proportioning system, using care to be sure the sample is taken at an adequate distance downstream from the proportioner being tested. Using foam solution samples that are allowed to drain from expanded foam can produce misleading conductivity readings and, therefore, this procedure is not recommended.

Once one or more samples have been collected, read their conductivity and find the corresponding percentage from the base curve prepared from the control sample solutions.



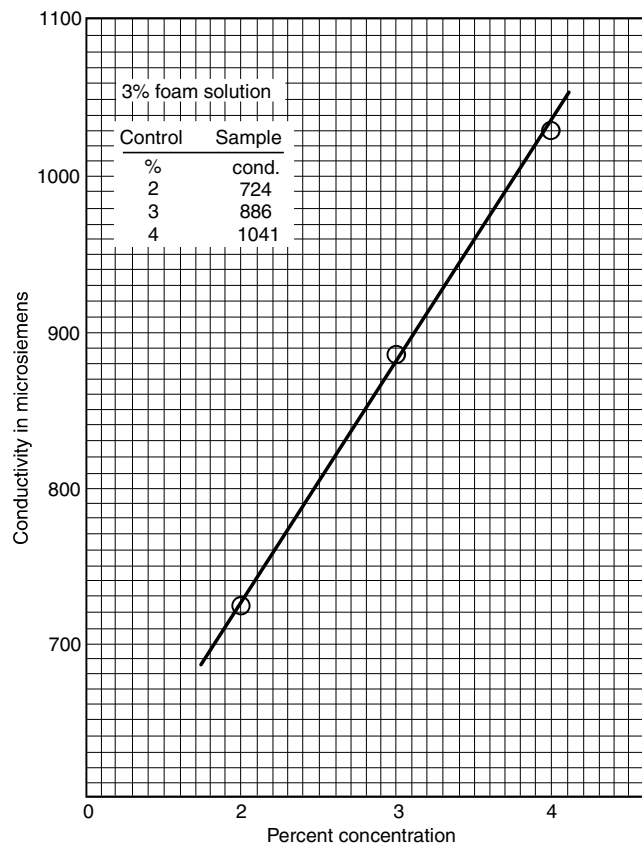

**FIGURE D.2.1.2.2** Typical Graph of Conductivity Versus Foam Concentration.

**D.3 Interpretation of Foam Test Results.** Where the intent of conducting the tests described in D.1 and D.2 is to check the operating efficiency or standby condition, it is necessary only to compare the results with the manufacturers' standards. The manufacturers should be consulted if any appreciable deviations occur.

After a short period of experience with the test procedure, it will be observed that foams exist in a wide variety of physical properties. Not only can the expansion vary in value from 3 to 20, but at the same time the 25 percent drainage time can also vary from a few seconds to several hours.

These variations result in foams that range in appearance from a watery consistency to the stiffest whipped cream.

It is observed here that the foam solution rapidly drains out of the very watery foams, while the dropout is very slow with the stiff foams. It is not possible to make a foam that is fluid and free flowing and, at the same time, able to hold onto its foam solution. From the standpoint of quickly forming a cohesive foam blanket and rapid flow around obstructions, a fluid-type foam is desirable; however, foams of this nature lose their water more rapidly, which may reduce their resistance to flame burnback and shorten the effective time of sealability. On the other hand, foams that retain their water for a long time are stiff and do not spread readily over a burning area. Thus, good fire-fighting practice indicates a compromise between these two opposite foam properties in order to obtain an optimum foam. An optimum foam is defined as that foam, with physical properties defined by expansion and drainage time, that will

extinguish a fire faster, at a lower application rate, or with less water consumed than any other foam.

Numerous test fires conducted in the course of research and development work have shown that the characteristics of an optimum foam depend on the type of the fire and the manner of foam application. Experience over many years of satisfactory results has supported this viewpoint. For example, in a large fuel storage tank, foam may be gently applied from one chamber and be required to flow 19.8 m (65 ft) across a burning surface to seal off the fuel. In this case, the optimum foam is physically different from that applied in a splashing manner from a turret that can direct the foam application as needed, where the foam has to flow no more than 1067 mm (42 in.) to form a seal. The formation of a complete specification for the various methods of application has not as yet been accomplished; however, for guidance purposes, the best data available to date are presented.

**D.4 Inspection of Foam Concentrate.** In order to determine the condition of the apparatus and foam concentrate and in order to train personnel, foam should be produced annually with portable foam nozzles. Following this operation, the concentrate container (can) should be cut open and examined for deposits of sludge, scale, and so forth, which are capable of impairing the operation of the equipment.

Where the concentrate is stored in tanks, a sample should be drawn from the bottom of the tank annually, and actual foam production tested as specified above, using a portable foam nozzle and the withdrawn sample to verify the quality of foam produced. In the event that sludging of the concentrate is noted, the manufacturer should be promptly consulted.

#### D.5 Foam Injection Rate Tests.

**D.5.1 Test Using Foam Concentrate.** The major focus when evaluating foam system performance is to confirm proper function of the foam proportioning system. This is done by conducting a foam injection rate test. Manufacturer's recommendations should be followed. It is recommended that the test be performed at the design demand flow rate of the system and at the lowest possible design point.

The rate of concentrate flow can be measured by timing a given displacement from the storage tank. Solution concentration can be measured by either refractometric or conductivity means (see Section D.2), or it can be calculated from solution and concentrate flow rates. Solution flow rates can be calculated by utilizing recorded inlet or end-of-system operating pressures, or both.

#### D.5.2 Tests Using Alternative Listed and Approved Methods.


**D.5.2.1 General.** Foam injection rate testing can now be performed using surrogate, nonfoaming, environmentally-acceptable, test liquids in lieu of foam discharge, or water as a surrogate for the foam concentrate. Both methods have advantages and disadvantages, but both serve to reduce the need to discharge foam concentrate. It is recommended that system proportioning verification discharge tests be performed at the actual demand of the system, and at the lowest possible actual demand flow.

Both methods employ portable data acquisition instrumentation and software to enable fast, real-time data monitoring and recording. Typically measurements include conductivity (translates to percent injection rate) of the proportioned solution stream, system flow rate, and several pressures on the proportioning system. Conductivity and flow are measured by means of in-line electronic instrumentation installed in flow



meters that are placed on the test outlet side of the proportioning system. Pressure transducers are installed temporarily at strategic locations where measurements are desired.

**D.5.2.2 Surrogate Liquid Test Method.** In this approach, surrogate test liquids are formulated specifically to simulate the flow behavior (viscosity characteristics) and approximate conductivity or refractive index of the foam concentrate used in the system. An example of a graph generated from the recorded data is shown in Figure D.5.2.2(a).

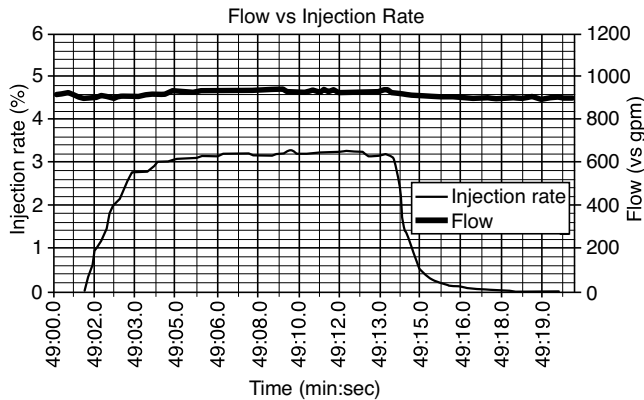


**FIGURE D.5.2.2(a) Plot of Real-Time Test Data Gathered from Surrogate Liquid Injection Rate Test.**

For initial system commissioning, the surrogate liquid can be placed directly in the foam system tank for injection rate tests and then flushed out before filling the tank with foam concentrate. After the system has been filled with foam concentrate it can still be tested using a surrogate test liquid, but installation of some additional connections on the proportioning system piping are required. These additional connections enable the surrogate test liquid to be injected into the proportioning system in place of the foam concentrate already in the foam storage tank. Since there are many types of proportioning systems, the test set-up arrangement varies according to the system type.

Figure D.5.2.2(b) through Figure D.5.2.2(d) are illustrations of surrogate liquid test set-up arrangements for types of the most commonly used proportioning systems.

**D.5.2.3 Water Equivalency Method.** In this approach, water is used as a surrogate liquid in place of foam concentrate. The initial acceptance test(s) are conducted with the actual foam concentrate using equipment similar to that shown in Figures Figure D.5.2.2(b) and Figure D.5.2.2(c): real-time pressure, flow, and conductivity measurements are recorded with the actual foam concentrate to determine that the system is proportioning accurately. Immediately following this test, a water equivalency test at the exact same pressure and flows as in the initial foam discharge test is performed after isolating the foam concentrate tank. Example test setups are shown in Figures Figure D.5.2.3(a) and Figure D.5.2.3(b). This provides a baseline for comparison using water only for follow-on routine inspections and tests.

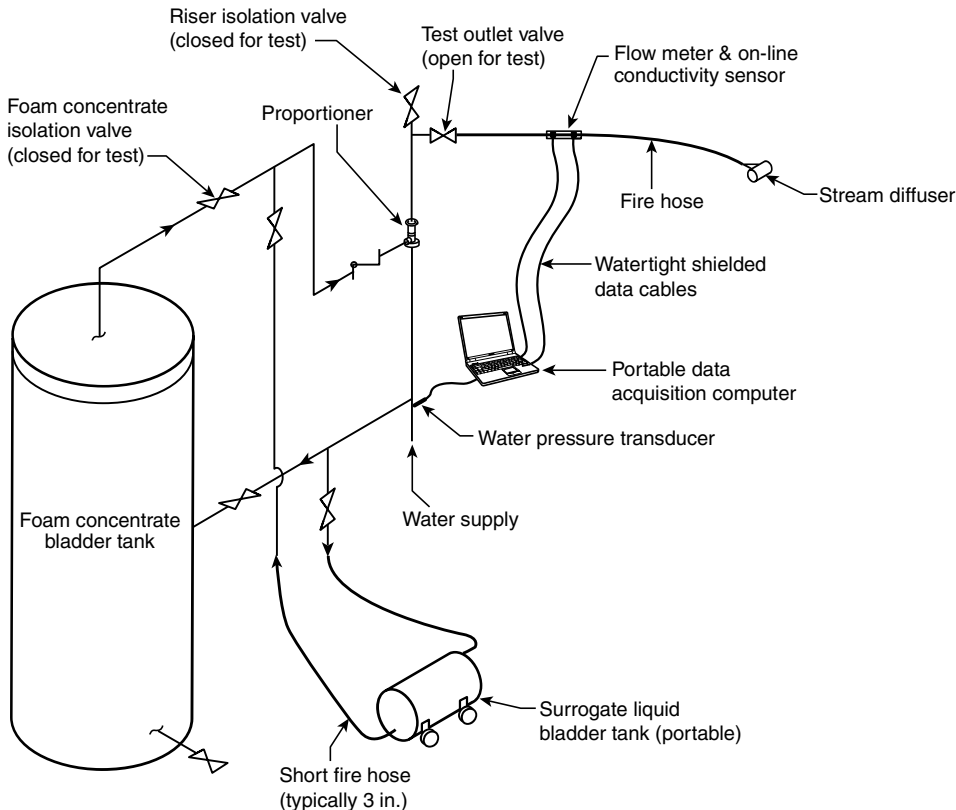

**FIGURE D.5.2.2(b) Bladder Tank Proportioning System (Containing Foam) Setup for Surrogate Liquid Type Test.**

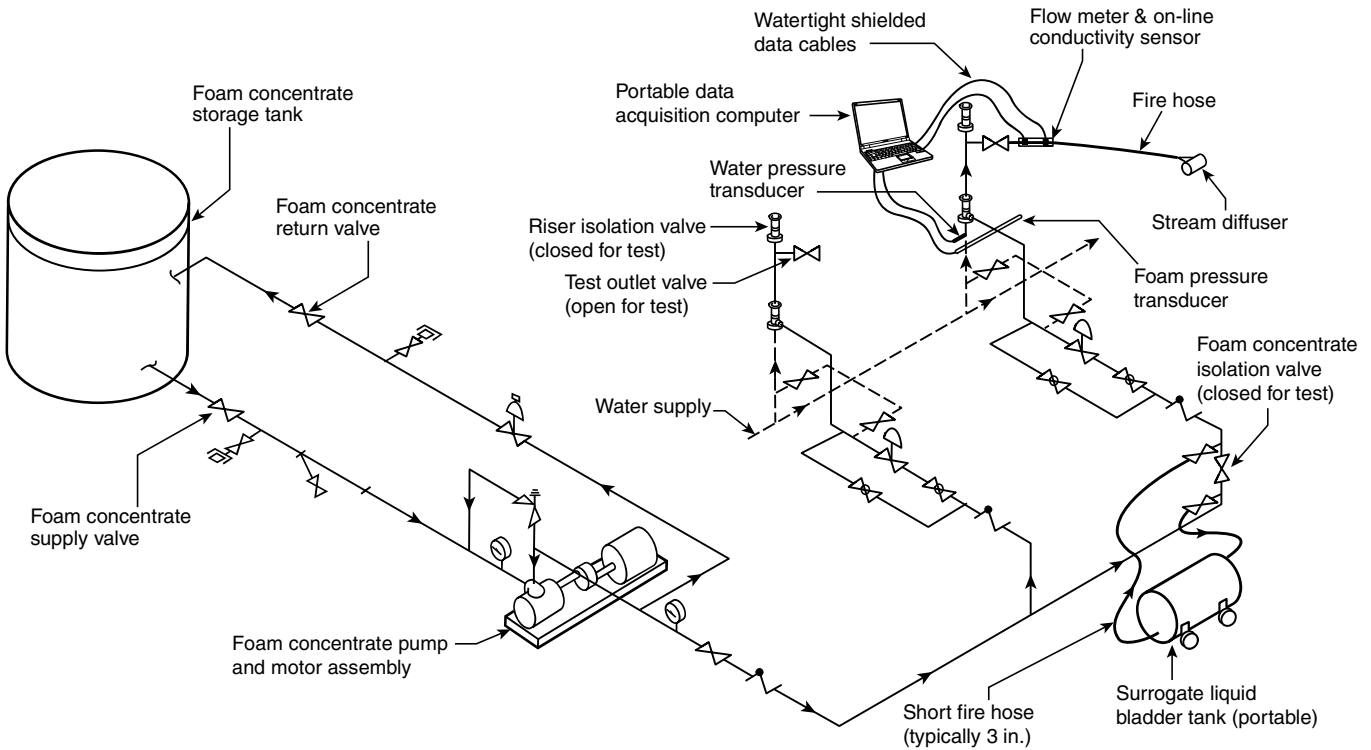


FIGURE D.5.2.2(c) In-Line Balanced Pressure (Pump Type) System Using Surrogate Liquid Method.



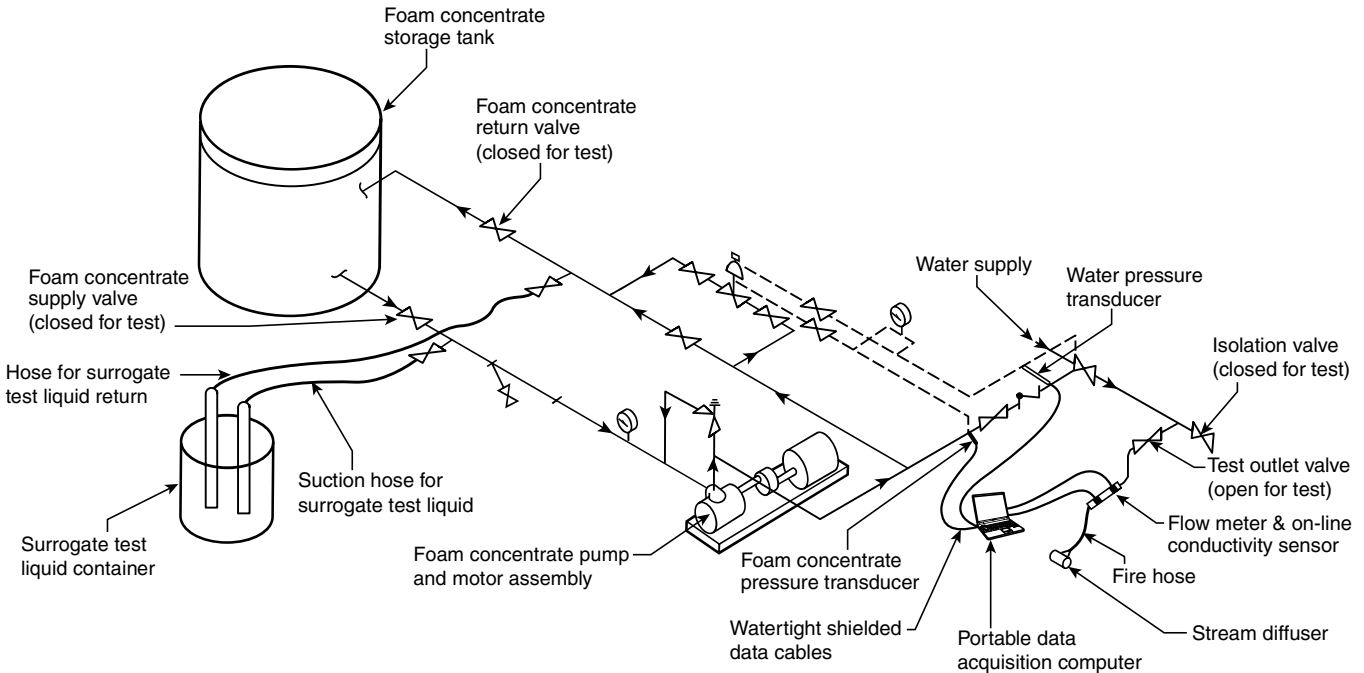


FIGURE D.5.2.2(d) Balanced Pressure Pump System Using Surrogate Liquid Method.

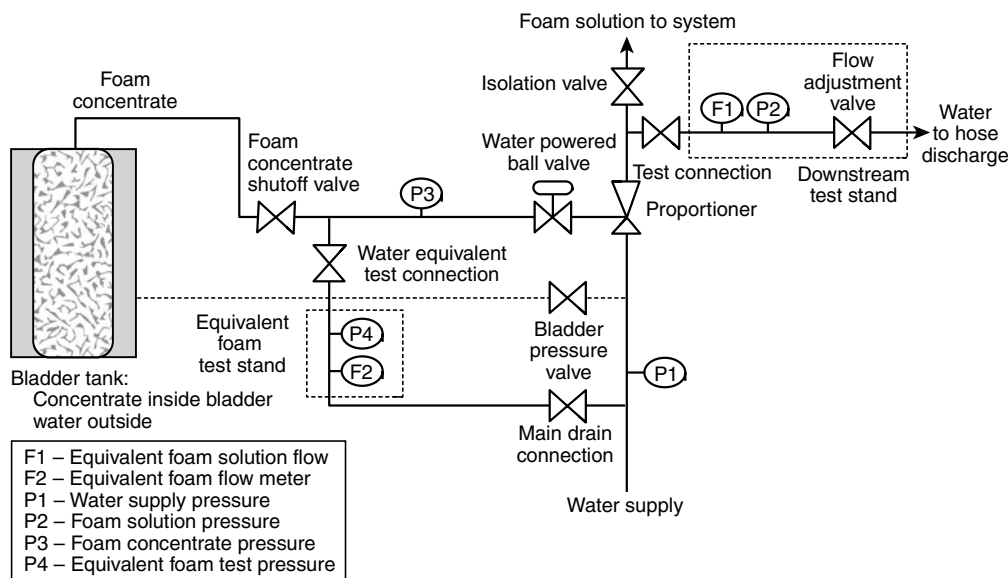

**FIGURE D.5.2.3(a) Test Set-up Schematic for Initial and Follow-on Water Equivalency Tests with Bladder Tank System.**

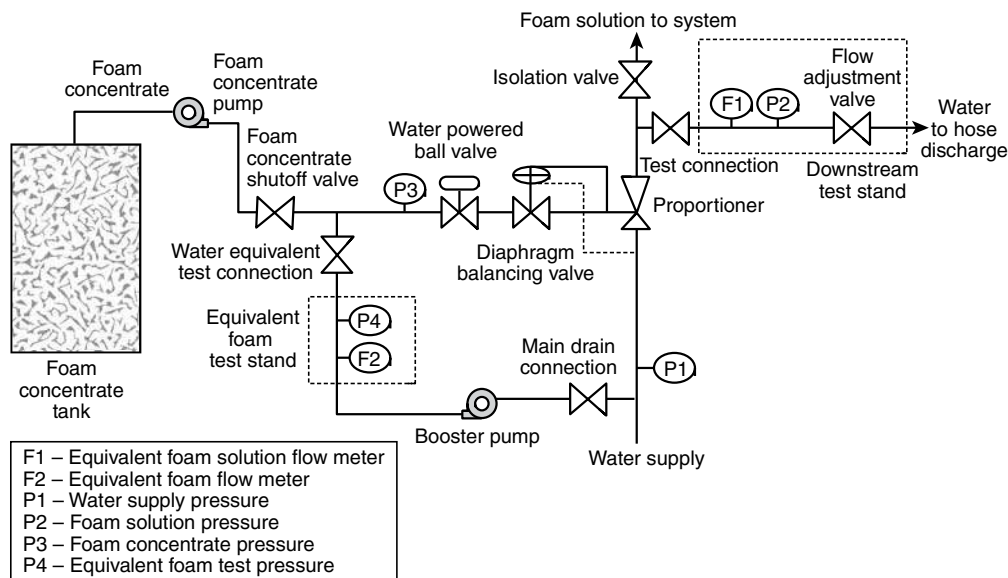

**FIGURE D.5.2.3(b) Test Set-up Schematic for Initial and Follow-on Water Equivalency Tests with Balanced Pressure Valve System.**

This method is appropriate for use with aqueous film-forming foam (AFFF) and high-expansion foam. It should not be used with viscous foam concentrates such as alcohol-resistant aqueous film-forming foam (AR-AFFF).

**D.5.3 Alternative Test Methods.** Surrogate methods for foam injection tests continue to be developed. The following techniques describe alternative methods that have been proposed as alternatives to foam injection rate testing, but they have yet to undergo formal listing or approval processes.

**D.5.3.1 Vehicle Tests.** ARFF and municipal fire-fighting vehicles are required to go through periodic foam nozzle discharge tests to ensure proper function of their foam propor-

tioning systems. Traditionally, these tests have been done by discharging foam solution with all of the associated issues involved in containment and disposal. New technology is now available to enable testing these vehicles using water or a water-based surrogate liquid containing an environmentally benign biodegradable dye. The dye in the surrogate test liquid can be detected in the proportioned solution stream by means of colorimetry instrumentation. When water is used as the surrogate test liquid, a flow meter system measures the water injection rate.

**D.5.3.2 Positive Pressure Pump Direct Injection.** A water motor foam-proportioning pump system provides a means to

verify concentrate proportioning by the flow method described in D.5.1. The volumetric flow rate of the extinguishing water, as well as the volumetric flow rate of the foam concentrate, is measured using pressure/flow instrumentation, without mixing both liquids. These flows can be used to calculate the proportioning rate. By using an adjustable pressure relief valve at the positive displacement foam pump, the back pressure on that pump can be set to the same pressure level as the extinguishing water.

## Annex E Foam Environmental Issues

*This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.*

**E.1 Overview.** Fire-fighting foams as addressed in this standard serve a vital role in fire protection throughout the world. Their use has proven to be essential for the control of flammable liquid fire threats inherent in airport operations, fuel farms and petroleum processing, highway and rail transportation, marine applications, and industrial facilities. The ability of foam to rapidly extinguish flammable liquid spill fires has undoubtedly saved lives, reduced property loss, and helped minimize the global pollution that can result from the uncontrolled burning of flammable fuels, solvents, and industrial liquids.

However, with the ever-increasing environmental awareness, recent concern has focused on the potential adverse environmental impact of foam solution discharges. The primary concerns are toxicity, biodegradability, persistence, treatability in wastewater treatment plants, and nutrient loading. All of these are of concern when the end-use foam solutions reach natural or domestic water systems.

**E.1.1** The purpose of this annex is to address the following:

- (1) Provide foam users with summary information on foam environmental issues
- (2) Highlight applicable regulatory status
- (3) Offer guidelines for coping with regulations, and provide suggested sources for additional information
- (4) Encourage planning for foam discharge scenarios (including prior contact with local wastewater treatment plant operators)

**E.1.2** It should be emphasized that it is not the intent of this annex to limit or restrict the use of fire-fighting foams. The foam committee believes that the fire safety advantages of using foam are greater than the risks of potential environmental problems. The ultimate goal of this section is to foster use of foam in an environmentally responsible manner so as to minimize risk from its use.

**E.2 Scope.** The information provided in this section covers foams for Class B combustible and flammable liquid fuel fires. Foams for this purpose include protein foam, fluoroprotein foam, film-forming fluoroprotein foam (FFFP), and synthetic foams such as aqueous film-forming foam (AFFF).

This section is primarily concerned with the discharge of foam solutions to wastewater treatment facilities and to the environment. The discharge of foam concentrates, while a related subject, is a much less common occurrence. All manufacturers of foam concentrate deal with clean-up and disposal of spilled concentrate in their material safety data sheets and product literature. Disposal of foam concentrates is also addressed in E.9.5.

**E.3 Discharge Scenarios.** A discharge of foam water solution is most likely to be the result of one of four scenarios:

- (1) Manual fire-fighting or fuel-blanketing operations
- (2) Training
- (3) Foam equipment system and vehicle tests
- (4) Fixed system releases

These four scenarios include events occurring at such places as aircraft facilities, fire fighter training facilities, and special hazards facilities (such as flammable/hazardous warehouses, bulk flammable liquid storage facilities, and hazardous waste storage facilities). Each scenario is considered separately in E.3.1 through E.3.4.

**E.3.1 Fire-Fighting Operations.** Fires occur in many types of locations and under many different circumstances. In some cases, it is possible to collect the foam solution used; and in others, such as in marine fire fighting, it is not. These types of incidents include aircraft rescue and fire-fighting operations, vehicular fires (i.e., cars, boats, train cars), structural fires with hazardous materials, and flammable liquid fires. Foam water solution that has been used in fire-fighting operations will probably be heavily contaminated with the fuel or fuels involved in the fire. It is also likely to have been diluted with water discharged for cooling purposes.

In some cases, the foam solution used during fire department operations can be collected. However, it is not always possible to control or contain the foam. This can be a consequence of the location of the incident or the circumstances surrounding it.

Event-initiated manual containment measures are the operations usually executed by the responding fire department to contain the flow of foam water solution when conditions and manpower permit. Those operations include the following measures:

- (1) Blocking sewer drains: this is a common practice used to prevent contaminated foam water solution from entering the sewer system unchecked. It is then diverted to an area suitable for containment.
- (2) Portable dikes: these are generally used for land-based operations. They can be set up by the fire department personnel during or after extinguishment to collect run-off.
- (3) Portable booms: these are used for marine-based operations, which are set up to contain foam in a defined area. These generally involve the use of floating booms within a natural body of water.

**E.3.2 Training.** There are specially designed training foams available from most foam manufacturers that simulate aqueous film-forming (AFFF) during live training but do not contain fluorosurfactants. These foams are normally biodegradable, have minimal environmental impact, and can be safely sent for treatment to the local wastewater treatment plant. Because they do not contain fluorosurfactants, training foams also have reduced burn back resistance that allows for more repeat fire training sessions. Fire fighters and other foam users should work with the authority having jurisdiction (AHJ) to ensure that the use of training foams meets all local and application-specific live training requirements. In some cases training foams can also be used as a substitute for AFFF in vehicle and equipment testing.

Training should be conducted under circumstances conducive to the collection of spent foam. Some fire training facilities have had elaborate systems designed and constructed to collect foam solution, separate it from the fuel, treat it, and

— in some cases — reuse the treated water. At a minimum, most fire training facilities collect the foam solution for discharge to a wastewater treatment facility. Training can include the use of special training foams or actual fire-fighting foams. Training facility design should include a containment system. The wastewater treatment facility should first be notified and should give permission for the agent to be released at a prescribed rate.

**E.3.3 System Tests.** Testing primarily involves engineered, fixed foam fire-extinguishing systems. Two types of tests are conducted on foam systems: acceptance tests, conducted pursuant to installation of the system; and maintenance tests, usually conducted annually to ensure the operability of the system.

In the execution of both acceptance and maintenance tests, only a small amount of foam concentrate should be discharged to verify the correct concentration of foam in the foam water solution. Designated foam water test ports can be designed into the piping system so that the discharge of foam water solution can be directed to a controlled location. The controlled location can consist of a portable tank that would be transported to an approved disposal site by a licensed contractor. The remainder of the acceptance test and maintenance test should be conducted using only water.

The standard now explicitly recognizes proportioning test methods which limit or eliminate the need to discharge foam concentrate. These methods are permitted in 11.6.3 and are described in detail in Section D.5.

**E.3.4 Fixed System Releases.** This type of release is generally uncontrolled, whether the result of a fire incident or a malfunction in the system. The foam solution discharge in this type of scenario can be dealt with by event-initiated operations or by engineered containment systems. Event-initiated operations encompass the same temporary measures that would be taken during fire department operations: portable dikes, floating booms, and so forth. Engineered containment would be based mainly on the location and type of facility, and would consist of holding tanks or areas where the contaminated foam water solution would be collected, treated, and sent to a wastewater treatment facility at a prescribed rate.

**E.4 Fixed Systems.** Facilities can be divided into those without an engineered containment system and those with an engineered containment system.

**E.4.1 Facilities Without Engineered Containment.** Given the absence of any past requirements to provide containment, many existing facilities simply allow the foam water solution to flow out of the building and evaporate into the atmosphere or percolate into the ground. The choices for containment of foam water solution at such facilities fall into two categories: event-initiated manual containment measures and installation of engineered containment systems.

Selecting the appropriate choice depends on the location of the facility, the risk to the environment, the risk of an automatic system discharge, the frequency of automatic system discharges, and any applicable rules or regulations.

“Event-initiated manual containment measures” will be the most likely course of action for existing facilities without engineered containment systems. This can fall under the responsibility of the responding fire department and include such measures as blocking storm sewers, constructing temporary dikes, and deploying floating booms. The degree of such measures will primarily be dictated by location as well as available resources and manpower.

The installation of “engineered containment systems” is a possible choice for existing facilities. Retrofitting an engineered containment system is costly and can adversely affect facility operations. There are special cases, however, that can warrant the design and installation of such systems. Such action is a consideration where an existing facility is immediately adjacent to a natural body of water and has a high frequency of activation.

**E.4.2 Facilities with Engineered Containment.** Any engineered containment system will usually incorporate an oil/water separator. During normal drainage conditions (i.e., no foam solution runoff), the separator functions to remove any fuel particles from drainage water. However, when foam water solution is flowing, the oil/water separator must be bypassed so that the solution is diverted directly to storage tanks. This can be accomplished automatically by the installation of motorized valves set to open the bypass line upon activation of the fixed fire-extinguishing systems at the protected property.

The size of the containment system is dependent on the duration of the foam water flow, the flow rate, and the maximum anticipated rainfall in a 24-hour period. Most new containment systems will probably only accommodate individual buildings. However, some containment systems can be designed to accommodate multiple buildings, depending upon the topography of the land and early identification in the overall site planning process.

The specific type of containment system selected will also depend upon location, desired capacity, and function of facilities in question. The systems include earthen retention systems, belowground tanks, open-top inground tanks, and sump and pump designs (i.e., lift stations) piped to aboveground or inground tanks.

The earthen retention designs consist of open-top earthen berms, which usually rely upon gravity-fed drainage piping from the protected building. They can simply allow the foam water solution to percolate into the ground or can include an impermeable liner. Those containing an impermeable liner can be connected to a wastewater treatment facility or can be suction pumped out by a licensed contractor.

Closed-top, belowground storage tanks can be the least environmentally acceptable design approach. They usually consist of a gravity-fed piping arrangement and can be suction pumped out or piped to a wastewater treatment facility. A potential and frequent problem associated with this design is the leakage of groundwater or unknown liquids into the storage tank.

Open-top, belowground storage tanks are usually lined concrete tanks that can rely on gravity-fed drainage piping or a sump and pump arrangement. These can accommodate individual or multiple buildings. They must also accommodate the maximum anticipated rainfall in a 24-hour period. These are usually piped to a wastewater treatment facility.

Aboveground tanks incorporate a sump and pump arrangement to closed, aboveground tanks. Such designs usually incorporate the use of one or more submersible or vertical shaft, large-capacity pumps. These can accommodate individual or multiple buildings.

**E.4.3 New Facilities.** The decision to design and install a fixed foam water solution containment system is dependent on the location of the facility, the risk to the environment, possible impairment of facility operations, the design of the fixed foam system (i.e., automatically or manually activated), the ability of the responding fire department to execute event-initiated containment measures, and any pertinent regulations.



New facilities might not warrant the expense and problems associated with containment systems. Where the location of a facility does not endanger groundwater or any natural bodies of water, this can be an acceptable choice, provided the fire department has planned emergency manual containment measures.

Where conditions warrant the installation of engineered containment systems, there are a number of considerations. They include size of containment, design and type of containment system, and the capability of the containment system to handle individual or multiple buildings. Engineered containment systems can be a recommended protective measure where foam extinguishing systems are installed in facilities that are immediately adjacent to a natural body of water. These systems can also be prudent at new facilities, where site conditions permit, to avoid impairment of facility operations.

**E.5 Disposal Alternatives.** The uncontrolled release of foam solutions to the environment should be avoided. Alternative disposal options are as follows:

- (1) Discharge to a wastewater treatment plant with or without pretreatment
- (2) Discharge to the environment after pretreatment
- (3) Solar evaporation
- (4) Transportation to a wastewater treatment plant or hazardous waste facility

Foam users, as part of their planning process, should make provisions to take the actions necessary to utilize whichever of these alternatives is appropriate for their situation. Section E.6 describes the actions that can be taken, depending on the disposal alternative that is chosen.

#### **E.6 Collection and Pretreatment of Foam Solutions Prior to Disposal.**

**E.6.1 Collection and Containment.** The essential first step in employing any of these alternatives is collection of the foam solution. As noted above, facilities that are protected by foam systems normally have systems to collect and hold fuel spills. These systems can also be used to collect and hold foam solution. Training facilities are, in general, designed so that foam solution can be collected and held. Fire fighters responding to fires that are at other locations should attempt, insofar as is practical, to collect foam solution run-off with temporary dikes or other means.

**E.6.2 Fuel Separation.** Foam solution that has been discharged on a fire and subsequently collected will usually be heavily contaminated with fuel. Since most fuels present their own environmental hazards and will interfere with foam solution pretreatment, an attempt should be made to separate as much fuel as possible from the foam solution. As noted in E.4.2, the tendency of foam solutions to form emulsions with hydrocarbon fuels will interfere with the operation of conventional fuel-water separators. An alternative is to hold the collected foam solution in a pond or lagoon until the emulsion breaks and the fuel can be separated by skimming. This can take from several hours to several days. During this time, agitation should be avoided to prevent the emulsion from reforming.

#### **E.6.3 Pretreatment Prior to Discharge.**

**E.6.3.1 Dilution.** Foam manufacturers and foam users recommend dilution of foam solution before it enters a wastewater treatment plant. There is a range of opinion on the optimum

degree of dilution. It is generally considered that the concentration of foam solution in the plant influent should not exceed 1700 ppm (588 gal of plant influent per gallon of foam solution). This degree of dilution is normally sufficient to prevent shock loading and foaming in the plant. However, each wastewater treatment plant must be considered as a special case, and those planning a discharge of foam solution to a wastewater treatment facility should discuss this subject with the operator of the facility in advance.

Diluting waste foam solution 588:1 with water is an impractical task for most facilities, especially when large quantities of foam solution are involved. The recommended procedure is to dilute the foam solution to the maximum amount practical and then meter the diluted solution into the sewer at a rate which, based on the total volume of plant influent, will produce a foam solution concentration of 1700 ppm or less.

For example, if the discharge is to be made to a 6 million gal/day treatment plant, foam solution could be discharged at the rate of 7 gpm (6,000,000 gal/day divided by 1440 minutes/day divided by 588 equals 7 gpm). The difficulties of metering such a low rate of discharge can be overcome by first diluting the foam solution by 10:1 or 20:1, permitting discharge rates of 70 gpm or 140 gpm respectively. Dilution should also be considered if the foam solution is to be discharged to the environment in order to minimize its impact.

**E.6.3.2 Defoamers.** The use of defoamers will decrease, but not eliminate, foaming of the foam solution during pumping, dilution, and treatment. The foam manufacturer should be consulted for recommendations as to the choice of effective defoamers for use with a particular foam concentrate.

**E.6.3.3 Method for Determining the Effective Amount of Antifoam Apparatus.** The effective amount of antifoam is determined by using the following apparatus:

- (1) Balance — 1600 g capacity minimum — readability 0.2 g maximum
- (2) One 2 L beaker or similar container
- (3) One 1 gal plastic or glass jug with cap
- (4) Eyedropper
- (5) Optional — 10 mL pipette

**E.6.3.3.1 Procedure.** Proceed with the following instructions to determine the effective amount of antifoam:

- (1) In the 2 L beaker, weigh out 1 g (1 mL) of antifoam using an eyedropper or the pipette.
- (2) Add 999 g of water.
- (3) Mix well.
- (4) Weigh out 1000 g of the solution to be defoamed and place it in the gallon jug.
- (5) Add 10 g (10 mL) of the diluted antifoam to the gallon jug using the eyedropper or pipette, cap it, and shake vigorously.
- (6) If the solution in the jug foams, go back to step 5 and repeat this step until little or no foam is generated by shaking the jug; keep a record of the number of grams (mL) that are required to eliminate the foaming.
- (7) The number of grams (mL) of diluted antifoam required to eliminate foaming is equal to the number of parts per million (ppm) of the antifoam as supplied that must be added to the solution to be defoamed.
- (8) Calculate the amount of neat antifoam to be added as follows:

$$W = 8.32 V \times D \div 1,000,000 \quad [\text{E.6.3.3.1}]$$



where:

$W$  = lb of antifoam required

$V$  = Volume of solution to be defoamed in U.S. gal

$D$  = ppm of antifoam required

*Example:* 10,000 gal of foam solution require defoaming. The procedure above has determined that 150 ppm of antifoam are needed to defoam this solution:  $8.32 \times 10,000 \times 150 \div 1,000,000 = 12.48$  lb.

- (9) The amount of antifoam to be added will normally be quite small compared to volume of the solution to be defoamed. The antifoam must be uniformly mixed with the solution to be defoamed. It will aid in the achievement of this objective if the antifoam is diluted as much as is practical with water or the solution to be defoamed prior to addition to the solution containment area. The solution in the containment area must then be agitated to disperse the antifoam uniformly. One method of doing this is to use a fire pump to draft out of the containment area and discharge back into it using a water nozzle set on straight stream. Alternatively, if suitable metering equipment is available, antifoam as supplied or diluted antifoam can be metered into the solution discharge line at the proper concentration.

**E.7 Discharge of Foam Solution to Wastewater Treatment Facilities.** Biological treatment of foam solution in a wastewater treatment facility is an acceptable method of disposal. However, foam solutions have the potential to cause plant upsets and other problems if not carefully handled. The reasons for this are explained in E.7.1 through E.7.4.

**E.7.1 Fuel Contamination.** Foam solutions have a tendency to emulsify hydrocarbon fuels and some polar fuels that are only slightly soluble in water. Water-soluble polar fuels will mix with foam solutions. The formation of emulsions will upset the operation of fuel/water separators and potentially cause the carryover of fuel into the waste stream. Many fuels are toxic to the bacteria in wastewater treatment plants.

**E.7.2 Foaming.** The active ingredients in foam solutions will cause copious foaming in aeration ponds, even at very low concentrations. Aside from the nuisance value of this foaming, the foaming process tends to suspend activated sludge solids in the foam. These solids can be carried over to the outfall of the plant. Loss of activated sludge solids can also reduce the effectiveness of the wastewater treatment. This could cause water quality problems such as nutrient loading in the waterway to which the outfall is discharged. Because some surfactants in foam solutions are highly resistant to biodegradation, nuisance foaming can occur in the outfall waterway.

**E.7.3 BOD (Biological Oxygen Demand).** Foam solutions have high BODs compared to the normal influent of a wastewater treatment plant. If large quantities of foam solution are discharged to a wastewater treatment plant, shock loading can occur, causing a plant upset.

Before discharging foam solutions to a wastewater treatment plant, the plant operator should be contacted. This should be done as part of the emergency planning process. The plant operator will require, at a minimum, a Material Safety Data Sheet (MSDS) on the foam concentrate, an estimate of the five-day BOD content of the foam solution, an estimate of the total volume of foam solution to be discharged, the time period over which it will be discharged, and, if the foam concentrate is protein-based, an estimate of the ammonia nitrogen content of the foam solution.

The foam manufacturer will be able to provide BOD and ammonia nitrogen data for the foam concentrate, from which the values for foam solution can be calculated. The other required information is site-specific and should be developed by the operator of the facility from which the discharge will occur.

**E.7.4 Treatment Facilities.** Foam concentrates or solutions can have an adverse effect on microbiologically based oily water treatment facilities. The end user should take due account of this before discharging foam systems during testing or training.

**E.8 Foam Product Use Reporting.** Federal, state, and local environmental jurisdictions have certain chemical reporting requirements that apply to chemical constituents within foam concentrates. In addition, there are also requirements that apply to the flammable liquids to which the foams are being applied. For example, according to the U.S. Environmental Protection Agency (EPA), the guidelines in E.8.1 through E.8.4 must be followed.

**E.8.1** Releases of ethylene glycol in excess of 5000 lb are reportable under Sections 102(b) and 103(a) of U.S. EPA Comprehensive Environmental Response Compensation and Liability Act (CERCLA). Ethylene glycol is commonly used as a freeze-point suppressant in many foam concentrates.

**E.8.2** As of June 12, 1995, the EPA issued a final rule [60 FR 30926] on several broad categories of chemicals, including the glycol ethers. The EPA has no reportable quantity for any of the glycol ethers. Thus foams containing glycol ethers are not subject to EPA reporting. Consult the foam manufacturer's MSDS to determine if glycol ethers are contained in a particular foam concentrate.

**E.8.3** The EPA does state that CERCLA liability continues to apply to releases of all compounds within the glycol ether category, even if reporting is not required. Parties responsible for releases of glycol ethers are liable for the costs associated with cleanup and any natural resource damages resulting from the release.

**E.8.4** The end user should contact the relevant local regulating authority regarding specific current regulations.

**E.9 Environmental Properties of Hydrocarbon Surfactants and Fluorochemical Surfactants.** Fire-fighting foam agents contain surfactants. Surfactants or surface active agents are compounds that reduce the surface tension of water. They have both a strongly "water-loving" portion and a strongly "water-avoiding" portion.

Dish soaps, laundry detergents, and personal health care products such as shampoos are common household products that contain hydrocarbon surfactants.

Fluorochemical surfactants are similar in composition to hydrocarbon surfactants; however, a portion of the hydrogen atoms have been replaced by fluorine atoms. Unlike chlorofluorocarbons (CFCs) and some other volatile fluorocarbons, fluorochemical surfactants are not ozone depleting and are not restricted by the Montreal Protocol or related regulations. Fluorochemical surfactants also have no effect on global warming or climate change. AFFF, fluoroprotein foam, and FFFP are foam liquid concentrates that contain fluorochemical surfactants.

There are environmental concerns with use of surfactants that should be kept in mind when these products are used for

extinguishing fires or for fire training. These concerns are as follows:

- (1) All surfactants have a certain level of toxicity.
- (2) Surfactants used in fire-fighting foams cause foaming.
- (3) Surfactants used in fire-fighting foams can be persistent. (This is especially true of the fluorine-containing portion of fluorochemical surfactants.)
- (4) Surfactants can be mobile in the environment. They can migrate with water in aquatic ecosystems and leach through soil in terrestrial ecosystems.

E.9.1 through E.9.5 explain what each of these properties means and how these compounds should be handled.

**E.9.1 Toxicity of Surfactants.** Fire-fighting agents, used responsibly and following material safety data sheet instructions, pose little toxicity risk to people. The toxicity of the surfactants in fire-fighting foams, including the fluorochemical surfactants, is a reason to prevent unnecessary exposure to people and to the environment. It is a reason to contain and treat all fire-fighting foam wastes whenever feasible. One should always make plans to contain wastes from training exercises and to treat them according to the suppliers' disposal recommendations as well as the requirements of local authorities.

Water that foams when shaken due to contamination from fire-fighting foam should not be ingested. Even when foaming is not present, it is prudent to evaluate the likelihood of drinking water supply contamination and to use alternate water sources until one is certain that surfactant concentrations of concern no longer exist. Suppliers of fire-fighting foams should be able to assist in evaluating the hazard and in recommending laboratories that can do appropriate analysis when necessary.

**E.9.2 Surfactants and Foaming.** Many surfactants can cause foaming at very low concentrations. This can cause aesthetic problems in rivers and streams, and both aesthetic and operational problems in sewers and wastewater treatment systems. When too much fire-fighting foam is discharged at once to a wastewater treatment system, serious foaming can occur. The bubbles of foam that form in the treatment system can trap and bring flocks of the activated sludge that treat the water in the treatment system to the surface. If the foam blows off the surface of the treatment system, it leaves a black or brown sludge residue where the foam lands and breaks down.

If too much of the activated sludge is physically removed from the treatment system in foam, the operation of the treatment system can be impaired. Other waste passing through the system will then be incompletely treated until the activated sludge concentration again accumulates. For this reason, the rate of fire-fighting foam solution discharged to a treatment system has to be controlled. Somewhat higher discharge rates can be possible when antifoaming or defoaming agents are used. Foam concentrate suppliers can be contacted for guidance on discharge rates and effective antifoaming or defoaming agents.

**E.9.3 Persistence of Surfactants.** Surfactants can biodegrade slowly and/or only partially biodegrade. The fluorochemical surfactants are known to be very resistant to chemical and biochemical degradation. This means that, while the non-fluorochemical portion of these surfactants can break down, the fluorine-containing portion can likely remain. This means that after fire-fighting foam wastes are fully treated, the residual waste could still form some foam when shaken. It could

also still have some toxicity to aquatic organisms if not sufficiently diluted.

**E.9.4 Mobility of Surfactants.** Tests and experience have shown that some surfactants or their residues can leach through at least some soil types. The resistance of some surfactants to biodegradation makes the mobility of such surfactants a potential concern. While a readily biodegradable compound is likely to degrade as it leaches through soil, this will not happen to all surfactants. Thus, if allowed to soak into the ground, surfactants that do not bind to soil components can eventually reach groundwater or flow out of the ground into surface water. If adequate dilution has not occurred, surfactants can cause foaming or concerns about toxicity. Therefore, it is inappropriate to allow training waste to continually seep into soil, especially in areas where water resources could be contaminated.

**E.9.5 Environmental Regulation of Fluorochemical Surfactants.** Fluorochemical surfactants and related fluorochemical polymers are used in many applications besides fire-fighting foams, including paper and packaging, textiles, leather and carpet treatment, and coatings. Some of these fluorochemicals and/or their persistent degradation products have been found in living organisms, a fact that has drawn the concern of environmental authorities worldwide and led to both regulatory and nonregulatory actions to reduce emissions. The focus of these actions has been on fluorochemicals that contain eight carbons (C8) or more, such as PFOS (perfluorooctane sulfonate) and PFOA (perfluorooctanoic acid).

3M used a unique process to manufacture the fluorochemical surfactants contained in its fire-fighting foams. Called electrochemical fluorination (ECF), fluorochemicals produced by this process both contain and degrade into PFOS. 3M stopped the manufacture of PFOS-based foams in 2002, and regulations in the United States, Canada, and the European Union act as a ban on new production. EPA regulations do not restrict the use of old stocks of PFOS foam in the United States. Regulations in the EU and Canada require old stocks of PFOS foam to be removed from service in 2011 and 2013, respectively. Excess stocks of PFOS foam concentrate can be destroyed by high-temperature incineration at any approved hazardous waste destruction facility.

All current manufacturers use a process called telomerization to produce the fluorochemical surfactants contained in their fire-fighting foams. Chemicals produced by this process are generally referred to as telomers. Telomer-based foams do not contain or degrade into PFOS. They are not made with PFOA but can contain trace levels as a contaminant of the manufacturing process.

Rather than regulate emissions of PFOA, EPA developed a global stewardship program where fluorochemical manufacturers have voluntarily agreed to reduce 95 percent by year-end 2010 and work to eliminate by year-end 2015 emissions of PFOA, PFOA precursors, and higher homologue chemicals. As a result, telomer-based fluorochemicals that are used in fire-fighting foams after 2015 are likely to contain only six carbons (C6) or less in order to comply with the EPA program. Reformulation and re-approvals (where needed) of most current foam products is ongoing by foam manufacturers to meet the 2015 target date.

**E.9.6 Minimizing Emissions of Fluorochemical Surfactants.** Because of their persistent nature, emissions of fluorochemical surfactants to the environment should be minimized whenever possible using the following techniques:





- (1) Use training foams that do not contain fluorochemical surfactants
- (2) Use surrogate liquid test methods for testing fixed systems and vehicle foam proportioning systems
- (3) Provide for containment, treatment, and proper disposal of foam discharges
- (4) Develop plans for dealing with unplanned releases of foam concentrate for foam solution to minimize environmental impact
- (5) Follow applicable industry standards on the design, installation, and maintenance of foam systems and extinguishers
- (6) Minimize false discharges from fixed foam systems by using approved detection, actuation, and control systems as required by industry standards
- (7) Where appropriate, consider treating collected wastewater with granular activated carbon (GAC) or a membrane process such as reverse osmosis to remove the fluorochemical surfactants prior to disposal

## Annex F Test Method for Marine Fire-Fighting Foam Concentrates Protecting Hydrocarbon Hazards

*This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.*

**F.1 Introduction.** The following test method has been specifically developed for use in demanding marine applications. It is derived from Federal Specification O-F-555C, which is no longer in print. It specifically incorporates a large surface area of 9.29 m<sup>2</sup> (100 ft<sup>2</sup>), sealability testing, and a burnback test conducted 15 minutes after fire extinction. The test method given here incorporates a high freeboard that is subject to high temperatures; both conditions add to the difficulty of this test method. This test method uses gasoline, a highly challenging test fuel, and requires that fresh fuel be used for each test. This test utilizes a square pan. The geometry of the pan's corners better simulates the complex steel shapes found in ships' cargo holds and bilges than round fire test pans used in other test methods. The test method employs a fixed nozzle, thus removing any bias caused by an operator applying foam at the test facility.

**F.2 Test Facility.** The test should be conducted at a test facility acceptable to the AHJ.

### F.3 Test Apparatus.

**F.3.1 Pan.** The test pan should be of 10-gauge steel minimum construction measuring 3 m (10 ft) long × 3 m (10 ft) wide × 0.9 m (3 ft) deep. The sides of the pan should be properly reinforced to prevent warpage due to heat generated during the test.

**F.3.2 Nozzle.** The test nozzle should be as shown in Figure F.3.2. Alternate nozzles should be approved by the AHJ. The nozzle should flow 22.7 L/min (6.0 gpm) at 688.5 kPa (100 psi) inlet pressure.

**F.3.3 Fuel.** A minimum of 284 L (75 gal) of gasoline is needed to be floated on a sufficient quantity of potable water so that the fuel surface is 0.6 m (2 ft) below the top edge of the tank. For each succeeding test the pan should be completely emptied of the fuel and foam residue from the previous test. The gasoline should be commercial unleaded regular motor fuel with an octane rating between 82 and 93 per Federal Specification VV-G-1690. The fuel temperature should be not less than 21°C (70°F). An alternate test fuel can be used provided

that it has properties equivalent to the unleaded fuel specified above and has been approved by the AHJ.

**F.3.4 Synthetic Sea Water.** The composition should be as described in ASTM D 1141.

### F.3.5 Conversion Factors.

- 1 L/min·m<sup>2</sup> = 0.0245 gpm/ft<sup>2</sup>
- 6 L/min·m<sup>2</sup> = 0.147 gpm/ft<sup>2</sup>
- 3 L/min·m<sup>2</sup> = 0.0735 gpm/ft<sup>2</sup>
- 1 gpm/ft<sup>2</sup> = 40.7 L/min·m<sup>2</sup>
- 0.24 gpm/ft<sup>2</sup> = 9.77 L/min·m<sup>2</sup>

### F.4 Test Procedure.


**F.4.1 Fire Extinguishment.** Foam concentrate should be subjected to four consecutive fire tests by discharging through a 22.7 L/min (6 gpm) nozzle at an inlet gauge pressure maintained at 688.5 kPa (100 psi) ± 13.8 kPa (2 psi), and a water temperature of 20 ± 5°C (68 ± 8°F). The concentrate should be at approximately the same temperature as the water. Two of the tests should be conducted with freshwater, and two of the tests should be conducted with salt water as described in F.3.4. The foam liquid solution should be premixed and applied at a rate of 3.0 percent by volume for 3 percent foams, 6.0 percent for 6 percent foams, and so forth. The nozzle should be positioned in the middle of one side of the test pan with the nozzle tip 406.4 mm (16 in.) directly above the top edge of the test pan. The fire should be permitted to burn freely for 60 seconds before foam application. The foam should be directed across the fire to strike the approximate center of the back side of the pan, 304.8 mm (12 in.) above the fuel level and should be applied for a 5-minute period. (If prior to the test, foam is discharged into the pan to align the nozzle for proper foam stream impact position on the back side of the pan, such foam should be removed from the pan prior to the test.) The following procedures should take place:

- (1) Observations. Observations and records are as follows:
  - (a) Record the period required, after start of foam application, for the foam to spread over the fuel surface as "coverage" time.
  - (b) Record the period for the fire to be extinguished except for licks of flame at the edges of the foam blanket as "control" time.
  - (c) Record the period for complete extinguishment as "extinguishment" time.
- (2) Record. Record the name of the manufacturer, foam type, trade name, batch number, and date of manufacture.



**F.4.2 Sealability.** A lighted torch should be passed continuously over the foam blanket starting 10 minutes after the end of foam discharge. Fourteen minutes after completion of foam application, the lighted torch should be applied over the foam blanket for 1 minute with the torch touching the foam blanket but not penetrating the foam blanket by more than 12.7 mm (½ in.). The torch should touch the blanket at least every 0.6 m (2 ft) along the sides of the test pan, at points where the foam blanket appears significantly less than the average thickness, in all four corners of the pan, and at random points in the main area of the pan. However, the torch should not be dragged through the foam.

**F.4.3 Burnback.** One of the methods described in F.4.3.1 and F.4.3.2 should be used.

**F.4.3.1 Method 1.** Fifteen minutes after completion of the foam application, an opening 23,220 mm<sup>2</sup> (36 in.<sup>2</sup>) should be made in the foam blanket approximately 0.6 m (2 ft) from the side of the

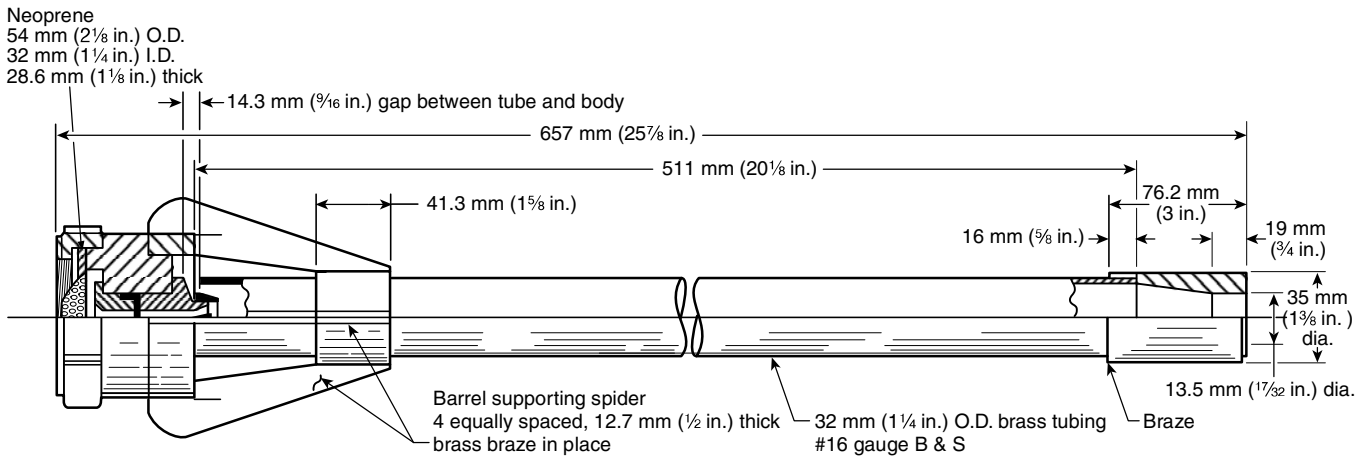

Note: All parts brass, except where shown

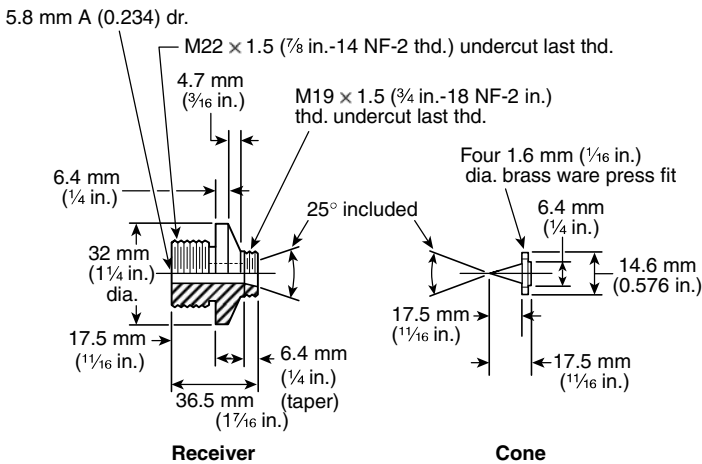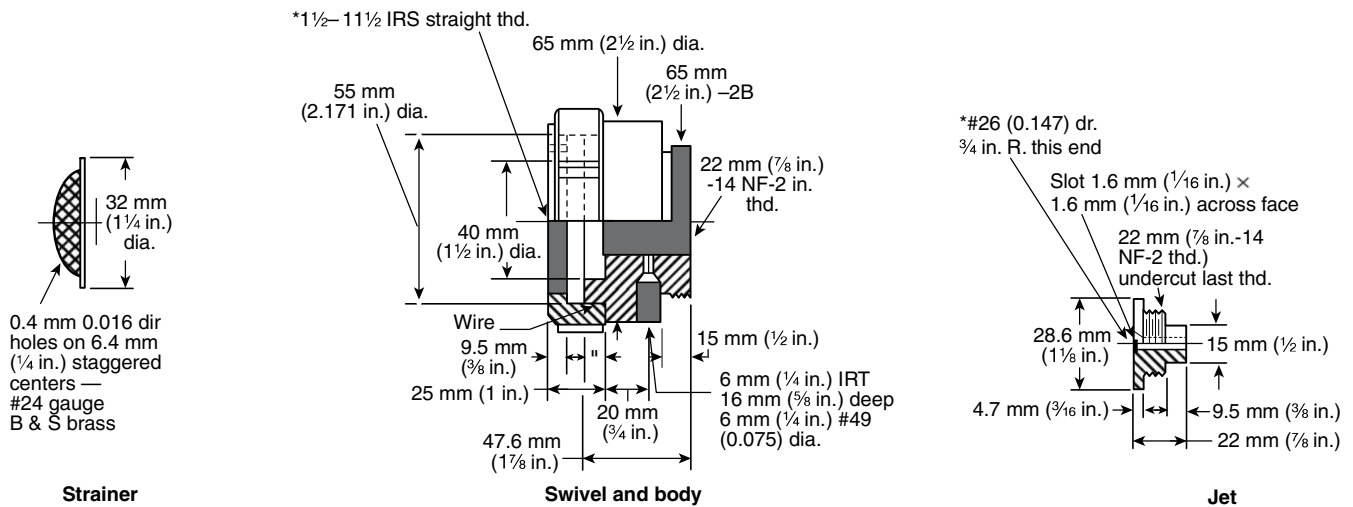

\*Metric conversion not available.

FIGURE F.3.2 Test Nozzle.



pan. The exposed fuel should be reignited with a torch and permitted to burn for 5 minutes. After the 5-minute burning period, the area involved in flames should be determined.

**F.4.3.2 Method 2.** As an alternative to Method 1, two 0.3 m (1 ft) diameter stove pipes should be placed in the foam blanket during the sealability test, at least 0.6 m (2 ft) from the sides of the pan, and the foam inside the stove pipes should be removed. At 15 minutes after the end of the foam discharge, the exposed fuel inside the stove pipes should be ignited by torch and permitted to burn for 1 minute. The first stove pipe should then be removed. After an additional 4-minute burning period, the area involved in flames should be determined. If, upon removal of the pipe, foam covers the exposed fuel area and extinguishes the fire, the fuel inside the second stove pipe should be ignited and allowed to burn freely for 1 minute. The second stove pipe should then be removed, and the area involved at 20 minutes after the end of foam discharge should be determined. If, upon removal of the second pipe, the foam again covers the exposed fuel and extinguishes the fire, no further burnback tests are necessary.

### F.5 Acceptance Criteria.

**F.5.1 Fire Performance.** The foam as received should have a coverage time of not more than 2 minutes, a control time of not more than 5 minutes, and complete fire extinguishment in not more than 5 minutes after start of foam application.

**F.5.2 Sealability.** The foam blanket should protect the fuel below the foam from reignition by a lighted torch for a period of not less than 15 minutes after the end of foam application. Any ignition of fuel vapors above the foam blanket should result in complete self-extinguishment prior to the end of the test period. Record in detail the type, location, and duration of any burning observed.

### F.5.3 Burnback.

**F.5.3.1 Method 1.** The foam blanket should prevent the spread of fire beyond an area approximately  $0.25 \text{ m}^2$  ( $2.7 \text{ ft}^2$ ).

**F.5.3.2 Method 2.** The area involved in flames should not exceed  $0.25 \text{ m}^2$  ( $2.7 \text{ ft}^2$ ).

**F.6 Foam Quality.** Foam quality tests should be conducted using the same batch of premix as used during the fire tests. Foam expansion and 25 percent drainage tests should be performed as explained in Annex D.

**F.7 Procedures in Case of Failure.** Four consecutive successful tests are recommended. Failure of any one test will result in another series of four consecutive tests being performed successfully.


## Annex G Foam Concentrate Quality

*This annex is not a part of the requirements of this NFPA document but is included for informational purposes only.*

**G.1 Fire Performance Test for Class A Materials.** Suitable tests based on fire performance on Class A fires with a flammable liquid accelerant, performance on Class B fires, and performance on liquefied natural gas (LNG) fires are described in this annex. The purpose of this test is to provide a reproducible Class A fire situation where foam is required to move a substantial distance at a slow rate to work the fire. The time to move this distance and to fill to the top of the test combustibles is the foam transit time. The effect of the transit

time is to give age to the foam during the period of its slow movement from foam generator to fire.

The test should be conducted in an open-top pen or building of suitable construction and suitable dimensions. To prevent the velocity of foam movement from being too high, the width of the pen or building times 100 should give a figure not smaller than the capacity in cubic feet per minute of the foam generator used in the test. The height of the sides of the pen or building should be about 3 m (10 ft). If the fluidity of the foam permits, the height can be less. However, the foam should neither flow over the sides of the pen nor contact the ceiling of the building during the test. The foam generator should be set at one end of the pen or building, and the fire should be set 3 m (10 ft) from the opposite end. The distance between the foam generator and the fire should be as required to give the desired foam transit time. (See Figure G.1.)

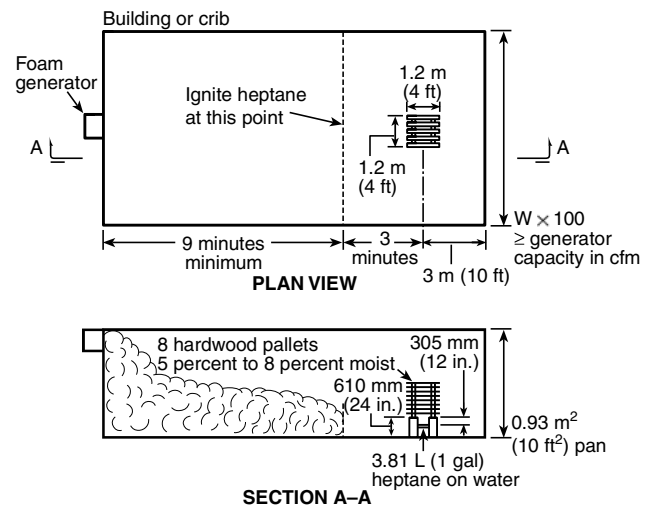

**FIGURE G.1 Fire Performance Test.**

Foam should be produced by a generator in which the expansion ratio is approximately that produced by the generator proposed for installation.

The test fire should be made with a stack of eight standard 1.2 m × 1.2 m (4 ft × 4 ft) hardwood pallets dried to a moisture content between 5 and 8 percent, set on suitable noncombustible supports not more than 610 mm (24 in.) above the floor. Beneath the pallets should be a  $0.93 \text{ m}^2$  ( $10 \text{ ft}^2$ ) pan containing 3.8 L (1 gal) of heptane or naphtha floating on water. The surface of the flammable liquid should be approximately 305 mm (12 in.) below the bottom boards of the bottom pallet.

The first test of each series should be a timed fill without a fire to determine the foam transit time. The location of the leading edge of the foam as it progresses across the floor of the pen or building should be timed at suitable intervals. Also, the time should be noted when the foam reaches the edge of the pan. This data will permit estimating, with reasonable accuracy, the location of the leading edge of the foam 3 minutes before the foam reaches the edge of the pan. Thereafter, during each fire test, the heptane should be ignited when the foam reaches that point corresponding to 3 minutes in advance of reaching the pan. In this manner, the fire is given a reproducible 3-minute preburn. This fill test can be terminated when the foam has filled to the top of the wood pallets and the foam transit time has been determined.

The minimum foam transit time should be 12 minutes (150 percent of the maximum submergence time of 8 minutes, from Table 6.12.7.1). To be considered successful under the foam transit time condition, the foam should give adequate control of the test fire. The foam generator should be run for a maximum of 30 minutes. Adequate control should be interpreted as the absence of active burning within the test stack while the stack is covered with foam.

**G.2 Quality Control Test.** The air and solution temperatures are to be maintained between 15.6°C and 18.3°C (60°F and 65°F). The laboratory scale expansion and drainage test described in the following list has been found suitable for quality control purposes:

- (1) Mix foam solution.
- (2) Fill foam solution can with solution.
- (3) Weigh foam solution can and thread onto apparatus.
- (4) Apply 172 kPa (25 psi) air pressure to liquid.
- (5) Start blower and adjust damper to approximately  $\frac{1}{3}$  opening. (The damper might have to be adjusted later in order for the desired expansion ratio to be obtained.)
- (6) Open solenoid. Adjust liquid pressure to 103 kPa (15 psi) using liquid metering valve. (Later readjustment might be necessary.)
- (7) As foam forms at screen, catch first droplets in beaker. Keep liquid in beaker to add to residue in foam can.
- (8) Allow drainage drum to fill with expanded foam. Start timer and shut off solenoid when drum is full.
- (9) Add liquid from step 7 to foam solution can and weigh again. Record total milliliters used. (1 g is approximately 1 mL.)
- (10) Record liquid drainage in milliliters at 1-minute intervals for 5 minutes, then at 10-minute intervals.
- (11) Plot time versus percent drained and record expansion ratio.

[G.2(a)]

$$\text{Percent drained} = \frac{\text{Total mL drained to given time} \times 100}{\text{Total mL used}}$$

$$\text{Expansion ratio} = \frac{\text{Drum volume mL}}{\text{Total mL used}} \quad \text{[G.2b]}$$

See Figure G.2(a) and Figure G.2(b).

**G.3 Fire Performance Test for Class B Materials.** The purpose of this test is to provide a reproducible Class B fire situation where foam is required to move a substantial distance at a slow rate toward the fire. The time to move this distance and to fill to the top of the test pan is the foam transit time. The effect of the transit time is to give age to the foam during the period of its slow movement from foam generator to fire. The test should be conducted in an open-top pen or building of suitable construction and suitable dimensions. To prevent the velocity of foam movement from being too high, the width of the pen or building times 100 gives a figure not smaller than the capacity in cubic feet per minute of the foam generator used in the test. The height of the sides of the pen or building should be 3 m (10 ft). If the fluidity of the foam permits, the height can be less. However, the foam must neither flow over the sides of the pen nor contact the ceiling of the building during the test. The foam generator should be set at one end of the pen or building, and the fire should be 3 m (10 ft) from the opposite end. The distance between the foam generator and the fire is as required to give the desired foam transit time.


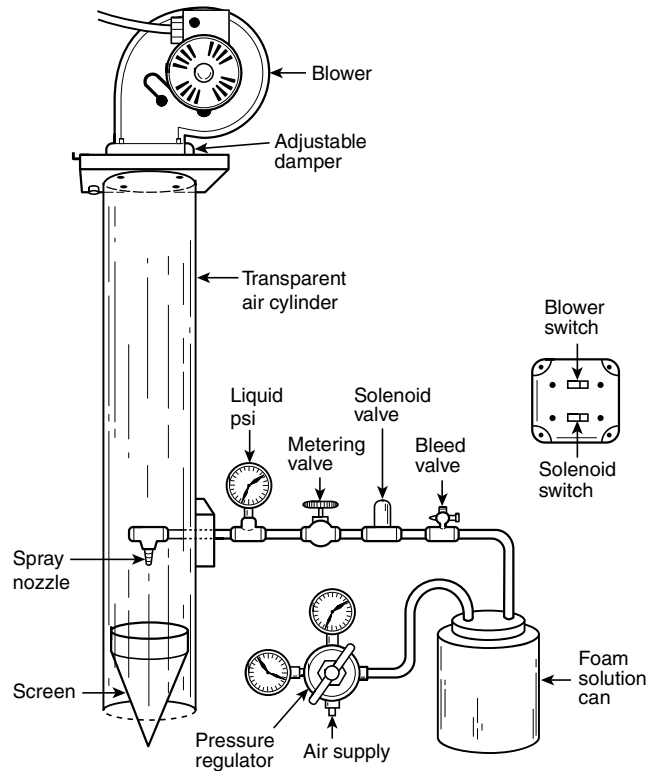


FIGURE G.2(a) High-Expansion Foam Quality Test Generator.

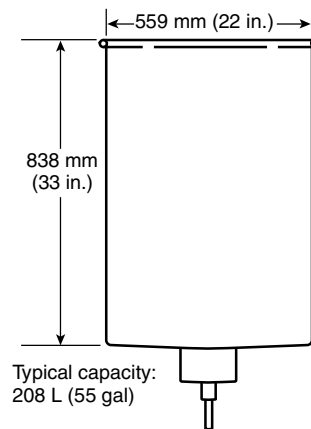

Note: Drum dimensions can vary  $\pm 5$  percent from the typical values shown.

FIGURE G.2(b) Typical Drainage Drum for High-Expansion Foam Expansion and Drainage Test.

Foam should be produced by a generator in which the expansion ratio is approximately equal to that produced by the generator for installation.

Flammable liquid fire tests are conducted using a 4.6 m<sup>2</sup> (50 ft<sup>2</sup>) steel pan, square in shape, and 300 mm (12 in.) in depth, filled with a 50 mm (2 in.) layer of *n*-heptane and a 100 mm (4 in.) layer of water to obtain a freeboard of 150 mm (6 in.). The test pan is located on the floor.

The fuel is ignited and foam discharge is started to allow the fuel to burn for approximately 1 minute before the foam

reaches the top edge of the pan. Observations as to transit time and whether or not the fire is extinguished are made.

The minimum foam transit time is 7.5 minutes. To be considered successful under the foam transit time condition, the foam must extinguish the test fire. The foam generator can be run for a maximum of 15 minutes.

The results of these tests should be recorded in the format illustrated in Table G.3.

**G.4 Standard Evaluation Test of High-Expansion Foam Systems for LNG Fires.** The purpose of this standard test is to evaluate the effectiveness of high-expansion foam systems applied to LNG fires for fire control.

Definitions are as follows:

- (1) *Fire control time* is the elapsed time from the beginning of foam application until the average radiation levels, 1½ pool widths from the pool center measured in the crosswind direction, have reached 10 percent of the initial steady-state uncontrolled values.
- (2) *Foam discharge rate per unit area* is the expanded foam flow rate in cubic feet per minute per square foot of LNG surface area.

Test equipment is as follows:

- (1) A test pit configured as shown in Figure G.4
- (2) Four wide-angle, water-cooled radiometers with continual recording instruments for each
- (3) Weather instruments for measuring temperature and relative humidity and measuring and recording wind velocity and direction during the tests
- (4) Stopwatches
- (5) Calibrated equipment for measuring water and foam concentrate flows or foam solution flows if premixed
- (6) A foam generator calibrated to determine its performance curve of water pressure, output, expansion ratio, and expanded foam drainage rate

Test procedure is as follows:

- (1) All test instrumentation must be checked or calibrated prior to conducting the tests.
- (2) The foam solution rate, foam concentrate proportioning ratio or total solution flow rate if the solution is premixed, and foam generator inlet solution pressure as specified by the equipment manufacturer should be set and maintained throughout the test.
- (3) Radiometers should be positioned as shown in Figure G.4.
- (4) As shown in Figure G.4, a single foam generator should be centered along the upwind side of the pool. A single foam application rate must be established and cannot be changed after ignition. All foam generated should be

applied to the test pit. The control time will commence at the time of first visible foam at the application point.

- (5) The water flow and foam concentrate flow, or the solution flow, if premixed, should be monitored and recorded to ensure proper proportioning and application rates.
- (6) At the start of the test, the wind should be not more than 9 knots (10 mph or 16 km/hr) with maximum gusts to 13 knots (15 mph or 24 km/hr). For optimum test conditions with minimum LNG vaporization, standing water should not be in the pit.
- (7) At least 204 L/m<sup>2</sup> (5 gal/ft<sup>2</sup>) of LNG, with a storage temperature not warmer than -151°C (-240°F) and an analysis of at least 85 percent methane, should be discharged into the pit. The first ignition of the pit must occur within 30 minutes of the beginning of discharge.
- (8) After ignition, there must be a preburn until the fire stabilizes as indicated by the radiometers, but not longer than 45 seconds.
- (9) Foam application should commence, and the fire control time should be measured.
- (10) Once control is established, the discharge rate per unit area for maintenance of fire control should be determined by shutting off the foam and allowing the fire to build up to 25 percent of initial intensity, then reapplying the foam until radiation levels are reduced to 10 percent of the initial uncontrolled intensity. A minimum of three cycles should be repeated.

Data in the test report includes the following:

- (1) Date and time of tests
- (2) Location of tests
- (3) Testing agency
- (4) Model of equipment and materials tested
- (5) Temperature, relative humidity, wind speed and direction, water temperature and quality (potable or nonpotable and fresh or salt), and general weather conditions for each test
- (6) Initial LNG analysis before discharge into pit
- (7) Depth of LNG in pit
- (8) Foam generator performance data
- (9) Data for all recording and measuring devices
- (10) Pit dimensions, orientation, and test setup
- (11) Application rates, expansion ratios, and supporting measurements
- (12) Curve showing time versus radiation levels, marked to show control times and beginning and end of foam application for each test

**Table G.3 Foam Type Test Report Format**

Test No.	Fire Type	Time Generator Started After Ignition		Time to Cover Pan		Inlet Pressure (psi)	No Visible Flame		Fire Control		Fire Extinguished		Generator Off	
		Min	Sec	Min	Sec		Min	Sec	Min	Sec	Min	Sec	Min	Sec
—	—	—	—	—	—	—	—	—	—	—	—	—	—	—
—	—	—	—	—	—	—	—	—	—	—	—	—	—	—

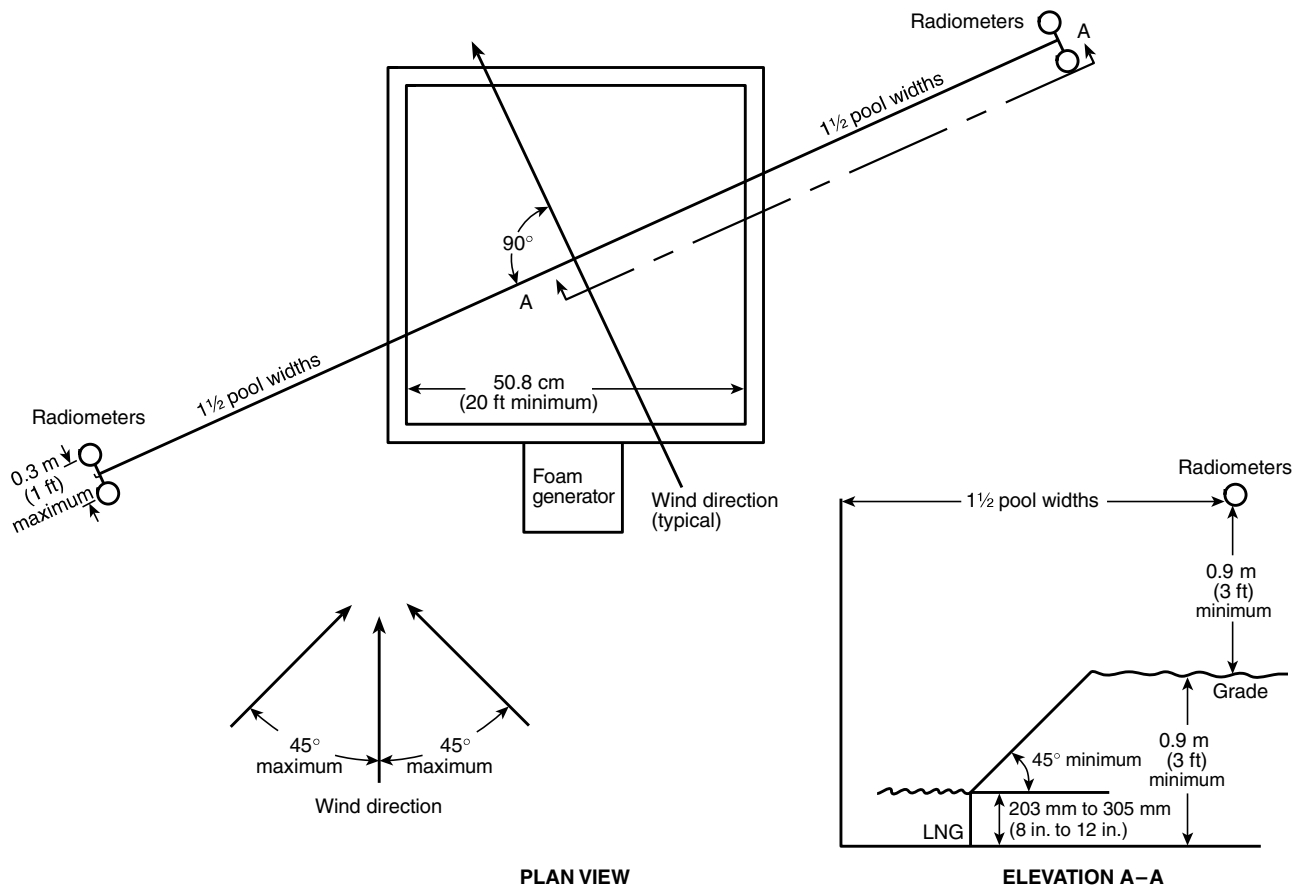


FIGURE G.4 High-Expansion Foam Standard Evaluation Test Pit.

## Annex H Informational References

**H.1 Referenced Publications.** The documents or portions thereof listed in this annex are referenced within the informational sections of this standard and are not part of the requirements of this document unless also listed in Chapter 2 for other reasons.

**H.1.1 NFPA Publications.** National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 2016 edition.

NFPA 16, *Standard for the Installation of Foam-Water Sprinkler and Foam-Water Spray Systems*, 2015 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 2015 edition.

NFPA 59A, *Standard for the Production, Storage, and Handling of Liquefied Natural Gas (LNG)*, 2013 edition.

NFPA 70<sup>®</sup>, *National Electrical Code*<sup>®</sup>, 2014 edition.

NFPA 72<sup>®</sup>, *National Fire Alarm and Signaling Code*, 2016 edition.

NFPA 414, *Standard for Aircraft Rescue and Fire-Fighting Vehicles*, 2012 edition.

NFPA 1901, *Standard for Automotive Fire Apparatus*, 2016 edition.

### H.1.2 Other Publications.

**H.1.2.1 AGA Publications.** American Gas Association, 400 N. Capitol Street, N.W., Washington, DC 20001.

Project IS-3-1. November 15 1973. LNG Spills on Land.

Project IS-100-1. February 1974. An Experimental Study on the Mitigation of Flammable Vapor Dispersion and Fire Hazards Immediately Following LNG Spills on Land.

**H.1.2.2 ASTM Publications.** ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM D 1141, *Standard Practice for the Preparation of Substitute Ocean Water*, 1998.

**H.1.2.3 FM Publications.** FM Global 1175 Boston-Providence Turnpike, P.O. Box 9102, Norwood, MA 02062.

FM 5130, *Approval Standard for Foam Extinguishing Systems*, 2011.

FM Approvals 5138, *Assessment Standard for Proportioning Equipment*, April 2011.

**H.1.2.4 IEEE Publications.** IEEE, Three Park Avenue, 17th Floor, New York, NY 10016-5997.

IEEE 45, *Recommended Practice for Electric Installations on Shipboard*, 2002.

**H.1.2.5 IMO Publications.** International Maritime Organization, 4 Albert Embankment, London SE1 7SR, United Kingdom.

IBC Code, *International Code for the Construction and Equipment of Ships Carrying Dangerous Chemicals in Bulk*, 2007.

*Safety of Life at Sea (SOLAS)*, Regulation 61, Chapter 212.

**H.1.2.6 ISO Publications.** International Organization for Standardization, 1 ch.de la Voie-Creuse, Case Postale 56, CH-1211 Genève 20 Switzerland.

ISO 9001, *Quality Management Systems—Requirements*, 2008.

**H.1.2.7 TC Publications.** Transport Canada, 330 Sparks Street, Ottawa, ON K1A 0N8, Canada.

TP 127 E, *Ships Electrical Standards*, Revision 02, May 2008.

**H.1.2.8 U.S. Government Publications.** U.S. Government Printing Office, Washington, DC 20402.

Federal Specification O-F-555C, *Foam Liquid, Fire Extinguishing Mechanical* (out of print).

Federal Specification VV-G-1690, “Gasoline, Automotive, Leaded or Unleaded,” 1989.

Federal Register Volume 60, Issue 112, pp. 30926-30962, July 12, 1995.

U.S. Coast Guard Navigation and Vessel Inspection Circulars. 1982. NVIC 11-82, *Deck Foam Systems for Polar Solvents*.

U.S. Coast Guard Navigation and Vessel Inspection Circulars. 1992. *Guidance for Acceptance of the National Board of Boiler and Pressure Vessel Inspectors (NBBI) National Board Inspection Code (NBIC) for Repairs and Alterations to Boilers and Pressure Vessels*.

Comprehensive Environmental Response Compensation and Liability Act (CERCLA), 42 U.S.C. 1906 et seq.

**H.1.2.9 UL Publications.** Underwriters laboratories Inc., 333 Pfingsten Road, Northbrook, IL 60062–2096.

UL 139, *Outline of Investigation for Medium- and High-Expansion Foam-Extinguishing System Equipment and Concentrates*, 2014.

UL 162, *Standard for Safety Foam Equipment and Liquid Concentrates*, 1999.

**H.1.2.10 Other Publications.** Conch Methane Services, Ltd. 1962. “Liquefied Natural Gas/Characteristics and Burning Behavior.”

Gremeles, A. E., and E. M. Drake. October 1975. “Gravity Spreading and Atmospheric Dispersion of LNG Vapor Clouds.” Jacksonville, FL: Fourth International Symposium on Transport of Hazardous Cargoes by Sea and Inland Waterways.

Humbert-Basset, R. and A. Montet. September 1972. “Flammable Mixture Penetration in the Atmosphere from Spillage of LNG.” Washington, DC: Third International Conference on LNG.

D. W. Johnson et al., *Control and Extinguishment of LPG Fires*, Applied Technology Corp., DOEEV-6020–1, August 1980.

Mine Safety Appliances Research Corp. “LNG Vapor Concentration Reduction and Fire Control with MSAR High Expansion Foam.” Evans City, PA.

Schneider, A. L. December 1978. *Liquefied Natural Gas Safety Research Overview*. Springfield, VA: National Technical Information Service.

Welker, J. et al. January 1976. “Fire Safety Aboard LNG Vessels.”

Wesson, H. R., J. R. Welker, and L. E. Brown. December 1972. “Control LNG Spill Fires.” *Hydrocarbon Processing*.

**H.2 Informational References.** The following documents or portions thereof are listed here as informational resources only. They are not a part of the requirements of this document.

*The Montreal Protocol on Substances that Deplete the Ozone Layer* United Nations Environment Programme, Nairobi, Kenya, 2000.

**H.3 References for Extracts in Informational Sections.** NFPA 16, *Standard for the Installation of Foam-Water Sprinkler and Foam-Water Spray Systems*, 2015 edition.



## Index

Copyright © 2015 National Fire Protection Association. All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document that it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of NFPA.

<b>-A-</b>	
<b>Administration</b> .....	Chap. 1
Application .....	1.3
Equivalency .....	1.5
Purpose .....	1.2
Retroactivity .....	1.4
Scope .....	1.1, A.1.1
Units and Formulas .....	1.6
<b>Approved</b>	
Definition .....	3.2.1, A.3.2.1
<b>Authority Having Jurisdiction (AHJ)</b>	
Definition .....	3.2.2, A.3.2.2
<b>-C-</b>	
<b>Combustible Liquid</b>	
Class IIIA Liquid	
Definition .....	3.3.1.2
Class II Liquid	
Definition .....	3.3.1.1
Class IIIB Liquid	
Definition .....	3.3.1.3
Definition .....	3.3.1
<b>Compressed Air Foam Systems</b> .....	Chap. 7
Air or Nitrogen Supply .....	7.4
Air Compressor .....	7.4.6
Plant Air .....	7.4.5
Quantity .....	7.4.1
Primary Supply .....	7.4.1.1
Reserve Supply .....	7.4.1.2
Regulators .....	7.4.4
Storage Containers .....	7.4.2
Supervision .....	7.4.3
CAFS Discharge Device Choice and Location .....	7.14
Compressed Air Foam Discharge Devices .....	7.7
Compressed Air Foam-Generating Method .....	7.5
Discharge Density .....	7.15
Discharge Duration .....	7.16
Distribution Systems .....	7.6
Fittings .....	7.6.2
Piping .....	7.6.1
Foam Concentrate .....	7.3
Compatibility of Foam Concentrate .....	7.3.6
Quality .....	7.3.1
Quantity .....	7.3.2
Reserve Supply of Foam Concentrate .....	7.3.5
Storage Conditions .....	7.3.4
Storage Tanks .....	7.3.3
General .....	7.1
Installation of Automatic Detection .....	7.13
Installation of Piping and Fittings .....	7.12
Limitations .....	7.10
Maintenance .....	7.20
Operation and Control of Systems .....	7.8
Plans and Specifications .....	7.18
System Design .....	7.11
System Flow Calculation .....	7.17
General .....	7.17.1
System Types .....	7.9
Testing and Acceptance .....	7.19
Water Supplies .....	7.2
Design .....	7.2.5
Pressure .....	7.2.3
Quality .....	7.2.1
Quantity .....	7.2.2
Storage .....	7.2.6
Temperature .....	7.2.4
<b>Concentration</b>	
Definition .....	3.3.2, A.3.3.2
<b>-D-</b>	
<b>Definitions</b> .....	Chap. 3
Design for Full Surface Fire .....	5.4.2.2
Design for Seal Area Fire .....	5.4.2.3
Basis of Design .....	5.4.2.3.4, A.5.4.2.3.4
Supplementary Protection .....	5.4.2.3.3
<b>Discharge Devices</b>	
Air-Aspirating Discharge Devices	
Definition .....	3.3.3.1
Compressed Air Foam Discharge Devices	
Definition .....	3.3.3.2
Definition .....	3.3.3, A.3.3.3
Non-Air-Aspirating Discharge Devices	
Definition .....	3.3.3.3, A.3.3.3.3
<b>Discharge Outlet</b>	
Definition .....	3.3.4
Fixed Foam Discharge Outlet	
Definition .....	3.3.4.1
Type I Discharge Outlet	
Definition .....	3.3.4.2, A.3.3.4.2
Type II Discharge Outlet	
Definition .....	3.3.4.3
<b>-E-</b>	
<b>Eductor (Inductor)</b>	
Definition .....	3.3.5, A.3.3.5
In-Line Eductor	
Definition .....	3.3.5.1, A.3.3.5.1
<b>Expansion</b>	
Definition .....	3.3.6
<b>Explanatory Material</b> .....	Annex A
<b>-F-</b>	
<b>Film Formation</b>	
Definition .....	3.3.7
<b>Fire</b>	
Class B Fire	
Definition .....	3.3.8.2
Class A Fire	
Definition .....	3.3.8.1
Definition .....	3.3.8
<b>Flammable (Class I) Liquid</b>	
Class IB Liquid	
Definition .....	3.3.9.2
Class IC Liquid	
Definition .....	3.3.9.3
Class IA Liquid	
Definition .....	3.3.9.1
Definition .....	3.3.9
<b>Foam</b>	
Compressed Air Foam (CAF)	
Definition .....	3.3.10.1
Definition .....	3.3.10, A.3.3.10



- Foam Chamber**  
 Definition ..... 3.3.11
- Foam Concentrate**  
 Alcohol-Resistant Foam Concentrate  
 Definition ..... 3.3.12.1, A.3.3.12.1  
 Aqueous Film-Forming Foam Concentrate (AFFF)  
 Definition ..... 3.3.12.2, A.3.3.12.2  
 Definition ..... 3.3.12, A.3.3.12  
 Film-Forming Fluoroprotein Foam Concentrate (FFFP)  
 Definition ..... 3.3.12.3, A.3.3.12.3  
 Film-Forming Foam  
 Definition ..... 3.3.12.4  
 Fluoroprotein Foam Concentrate  
 Definition ..... 3.3.12.5, A.3.3.12.5  
 Medium- and High-Expansion Foam Concentrate  
 Definition ..... 3.3.12.6, A.3.3.12.6  
 Protein Foam Concentrate  
 Definition ..... 3.3.12.7, A.3.3.12.7  
 Synthetic Foam Concentrate  
 Definition ..... 3.3.12.8
- Foam Concentrate Quality** ..... Annex G
- Foam Concentrate Type**  
 Definition ..... 3.3.13
- Foam Environmental Issues** ..... Annex E
- Foam Generators**  
 Definition ..... 3.3.14  
 Foam Generators — Aspirator Type  
 Definition ..... 3.3.14.1  
 Foam Generators — Blower Type  
 Definition ..... 3.3.14.2, A.3.3.14.2
- Foam Injection**  
 Definition ..... 3.3.15  
 Semisubsurface Foam Injection  
 Definition ..... 3.3.15.1  
 Subsurface Foam Injection  
 Definition ..... 3.3.15.2
- Foam Solution**  
 Definition ..... 3.3.16, A.3.3.16  
 Premixed Foam Solution  
 Definition ..... 3.3.16.1
- Foam System Types**  
 Compressed Air Foam System (CAFS)  
 Definition ..... 3.3.17.1, A.3.3.17.1  
 Definition ..... 3.3.17  
 Fixed System  
 Definition ..... 3.3.17.2  
 Mobile System  
 Definition ..... 3.3.17.3, A.3.3.17.3  
 Portable System  
 Definition ..... 3.3.17.4  
 Semifixed System  
 Definition ..... 3.3.17.5, A.3.3.17.5
- Foam-Generating Methods**  
 Compressed Air Foam-Generating Method  
 Definition ..... 3.3.18.1, A.3.3.18.1  
 Definition ..... 3.3.18, A.3.3.18
- H-**
- Handline**  
 Definition ..... 3.3.19, A.3.3.19
- I-**
- Inductor**  
 Definition ..... 3.3.20
- Informational References** ..... Annex H
- Installation Requirements** ..... Chap. 9  
 Flushing ..... 9.2  
 Foam Concentrate Pumps ..... 9.1  
 Hangers, Supports, and Protection for Pipework ..... 9.6  
 Hose Requirements ..... 9.7  
 Low-Expansion System Piping ..... 9.4  
 Power Supply ..... 9.3  
 Controller ..... 9.3.3  
 Service Disconnecting Means ..... 9.3.4, A.9.3.4  
 Test Connections ..... 9.8  
 Valves in Low-Expansion Systems ..... 9.5  
 Bladder Tank Valves ..... 9.5.7, A.9.5.7
- L-**
- Labeled**  
 Definition ..... 3.2.3
- Listed**  
 Definition ..... 3.2.4, A.3.2.4
- Low-Expansion Foam Systems for Marine Applications** ..... Chap. 10  
 Fixed Low-Expansion Foam Systems for Machinery  
 Spaces ..... 10.2  
 Controls ..... 10.2.8  
 Fixed Low-Expansion Foam Systems on Deck for Petroleum  
 and Chemical Tankers ..... 10.3  
 Control Station ..... 10.3.2  
 Discharge Duration ..... 10.3.5  
 Fire Main Capacity ..... 10.3.3, A.10.3.3  
 Purpose ..... 10.3.1, A.10.3.1  
 Rate of Application ..... 10.3.4, A.10.3.4  
 Foam Outlet Devices ..... 10.4, A.10.4  
 Foam System Concentrate Storage ..... 10.11  
 General ..... 10.1, A.10.1  
 Components ..... 10.1.3, A.10.1.3  
 Hand Hoselines ..... 10.6  
 Hangers, Supports, and Protection of Pipework ..... 10.9  
 Hydraulic Calculations ..... 10.7  
 Isolation Valves ..... 10.8  
 Monitors ..... 10.5  
 Monitors ..... 10.5.7  
 Piping Materials ..... 10.13  
 Supply Arrangements ..... 10.12  
 Testing and Inspection ..... 10.10
- Low-Expansion System Design** ..... Chap. 5  
 Diked Areas — Outdoor ..... 5.7, A.5.7  
 Diked Areas Involving Flammable or Combustible  
 Liquids Requiring Alcohol-Resistant Foams ..... 5.7.4  
 Methods of Application ..... 5.7.3  
 Fixed Foam Discharge Outlets ..... 5.7.3.3, A.5.7.3.3  
 Fixed Foam-Water Sprinklers or Nozzles ..... 5.7.3.4  
 Fixed Low-Level Foam Discharge Outlets ..... 5.7.3.5  
 Foam Monitors ..... 5.7.3.5.4  
 Limitations ..... 5.7.3.5.3, A.5.7.3.5.3  
 Minimum Application Rates and Discharge Times  
 for Fixed Discharge Outlets on Diked Areas  
 Involving Liquid Hydrocarbons ..... 5.7.3.2  
 Indoor Hazards ..... 5.5  
 Design Criteria for Indoor Storage Tanks Containing  
 Flammable or Combustible Liquids Requiring  
 Alcohol-Resistant Foams ..... 5.5.4  
 Discharge Outlets ..... 5.5.2  
 Minimum Discharge Time and Application Rate ..... 5.5.3  
 Loading Racks ..... 5.6, A.5.6  
 Design Criteria for Foam Monitor Protection Systems ..... 5.6.5  
 Areas to Be Protected by Monitor  
 Nozzles ..... 5.6.5.1, A.5.6.5.1  
 Minimum Application Rates and Discharge Times ..... 5.6.5.3  
 Design Criteria for Foam-Water Sprinkler Systems ..... 5.6.4  
 Methods of Protection ..... 5.6.3  
 Nondiked Spill Areas ..... 5.8, A.5.8  
 Design Criteria for Protection of Spill Fires Involving  
 Hydrocarbons or Flammable and Combustible  
 Liquids Requiring Alcohol-Resistant Foams ..... 5.8.1  
 Outdoor Covered (Internal) Floating Roof Tanks ..... 5.4, A.5.4  
 Outdoor Fixed Roof (Cone) Tanks ..... 5.2  
 Basis of Design ..... 5.2.2  
 Design Criteria for Foam Monitors and Handlines ..... 5.2.4

Design Parameters .....	5.2.4.4	Quantity .....	6.14.3
Foam Application Rates .....	5.2.4.2	Foam System Arrangement .....	6.14.3.3, A.6.14.3.3
Limitations .....	5.2.4.1	System Design Considerations .....	6.14.1, A.6.14.1
Tanks Containing Flammable and Combustible Liquids		Foam Concentrate .....	6.8
Requiring Alcohol-Resistant Foams .....	5.2.4.3, A.5.2.4.3	Quality .....	6.8.1
Design Criteria for Subsurface Application .....	5.2.6	Foam-Generating Apparatus Location .....	6.10
Foam Discharge Outlet Elevation .....	5.2.6.3, A.5.2.6.3	Accessibility for Inspection and Maintenance .....	6.10.1
Foam Discharge Outlets .....	5.2.6.2, A.5.2.6.2	Protection Against Exposure .....	6.10.2, A.6.10.2
Minimum Discharge Times and Application Rates .....	5.2.6.5	General Information and Requirements .....	6.1, A.6.1
Subsurface Injection Back-Pressure		Hazards Protected .....	6.3, A.6.3
Limitations .....	5.2.6.4, A.5.2.6.4	Local Application Systems .....	6.13
Design Criteria for Surface Application with Fixed		General Information .....	6.13.1
Foam Discharge Outlets .....	5.2.5	Description .....	6.13.1.1
Design Criteria for Tanks Containing Flammable		Uses .....	6.13.1.2, A.6.13.1.2
and Combustible Liquids Requiring		General Requirements .....	6.13.2
Alcohol-Resistant Foams .....	5.2.5.3, A.5.2.5.3	Hazard Specifications .....	6.13.3
Minimum Discharge Times and Application		Extent of Hazard .....	6.13.3.1
Rates .....	5.2.5.3.4	Foam Requirements for Flammable and Combustible	
Design Criteria for Tanks Containing		Liquids and Solids .....	6.13.3.3
Hydrocarbons .....	5.2.5.2	Arrangement .....	6.13.3.3.3
Minimum Discharge Times and		General .....	6.13.3.3.1
Application Rates .....	5.2.5.2.2, A.5.2.5.2.2	Quantity .....	6.13.3.3.2
Fixed Foam Discharge Outlets .....	5.2.5.1, A.5.2.5.1	Location of Hazard .....	6.13.3.2, A.6.13.3.2
Limitations .....	5.2.3, A.5.2.3	Operation and Control of Systems .....	6.7
Semisubsurface Systems .....	5.2.7, A.5.2.7	Alarms .....	6.7.3
Supplementary Protection .....	5.2.1	Detection of Fires .....	6.7.1, A.6.7.1
Outdoor Open-Top Floating Roof Tanks .....	5.3, A.5.3	Operating Devices .....	6.7.4, A.6.7.4
Fixed Discharge Outlets Design Criteria for Seal Area		Supervision .....	6.7.2
Protection .....	5.3.5	Personnel Safety .....	6.6, A.6.6
Foam Dam Design Criteria .....	5.3.5.4	Electrical Clearances .....	6.6.2, A.6.6.2
Top-of-Seal Method with Foam Dam .....	5.3.5.2, A.5.3.5.2	Portable Foam-Generating Devices .....	6.15
Top-of-Seal System Design .....	5.3.5.3	Equipment Specifications .....	6.15.5
Below Primary Seal or Weather Shield Method .....	5.3.5.3.5	Electric Power Supply and Connections .....	6.15.5.2
Below-the-Seal or Weather Shield System .....	5.3.5.3.6	Hose .....	6.15.5.1
Foam Handline Design Criteria for Seal		Foam Requirements .....	6.15.4
Area Protection .....	5.3.6, A.5.3.6	Rate and Duration of Discharge .....	6.15.4.1
Foam Monitor Design Criteria for Seal Area		Simultaneous Use of Portable Foam-Generating	
Protection .....	5.3.7	Devices .....	6.15.4.1.3
Methods of Seal Fire Protection .....	5.3.4	General Information .....	6.15.1
Basis of Design .....	5.3.4.3, A.5.3.4.3	Description .....	6.15.1.1
Supplementary Protection .....	5.3.4.2	General Requirements .....	6.15.1.2
Types of Fires Anticipated .....	5.3.3, A.5.3.3	Hazard Specifications .....	6.15.2
Seal Area Protection .....	5.3.3.2	Location and Spacing .....	6.15.3
Subsurface and Semisubsurface Injection .....	5.3.3.1	Training .....	6.15.6, A.6.15.6
Supplementary Protection .....	5.9, A.5.9	Systems Protecting One or More Hazards .....	6.5
Additional Protection .....	5.9.1	Total Flooding Systems General Information .....	6.12
Supplemental Foam Hose Stream Requirements .....	5.9.2	Applications .....	6.12.2, A.6.12.2
Types of Hazards .....	5.1, A.5.1	Description .....	6.12.1
		Foam Requirements .....	6.12.5
		Foam Depth .....	6.12.5.2
		High-Expansion Foam .....	6.12.5.2.1
		Medium-Expansion Foam .....	6.12.5.2.2
		General .....	6.12.5.1
		General Requirements .....	6.12.3
		Maintenance of Submergence Volume for	
		High-Expansion Foam .....	6.12.10, A.6.12.10
		Distribution .....	6.12.10.5
		Method .....	6.12.10.3
		Overhaul .....	6.12.10.4, A.6.12.10.4
		Quantity .....	6.12.9
		Rate of Discharge .....	6.12.8, A.6.12.8
		High-Expansion Foam .....	6.12.8.2
		Calculation .....	6.12.8.2.3
		Medium-Expansion Foam .....	6.12.8.1
		Submergence Time for High-Expansion Foams .....	6.12.7
		Submergence Volume for High-Expansion Foams .....	6.12.6
		Total Flooding Enclosure Specifications .....	6.12.4
		Leakage .....	6.12.4.1, A.6.12.4.1
		Openings .....	6.12.4.1.1
		Ventilation .....	6.12.4.1.2
		Types of Systems .....	6.4
		Use and Limitations .....	6.2
<b>-M-</b>			
<b>Maintenance</b> .....	Chap. 12		
Detection and Actuation Equipment .....	12.5		
Foam Concentrate Inspection .....	12.6		
Foam-Producing Equipment .....	12.2, A.12.2		
Compressed Air Foam-Producing Equipment .....	12.2.3		
High-Pressure Cylinders .....	12.7		
Inspection, Testing, and Maintenance .....	12.1, A.12.1		
Operating Instructions and Training .....	12.8		
Piping .....	12.3		
Strainers .....	12.4		
<b>Medium- and High-Expansion Foam</b> .....	Annex C		
<b>Medium- and High-Expansion Systems</b> .....	Chap. 6		
Air Supply .....	6.9		
Distribution Systems .....	6.11		
Arrangement and Installation of Piping and			
Fittings .....	6.11.2		
Ducts .....	6.11.3		
Piping and Fittings .....	6.11.1		
Foam Applications for Liquefied Natural			
Gas (LNG) .....	6.14, A.6.14		
Foam Discharge Rate per Unit Area .....	6.14.2, A.6.14.2		



## ***Sequence of Events for the Standards Development Process***

*As soon as the current edition is published, a Standard is open for Public Input*

### **Step 1: Input Stage**

- Input accepted from the public or other committees for consideration to develop the First Draft
- Committee holds First Draft Meeting to revise Standard (23 weeks)
  - Committee(s) with Correlating Committee (10 weeks)
- Committee ballots on First Draft (12 weeks)
  - Committee(s) with Correlating Committee (11 weeks)
- Correlating Committee First Draft Meeting (9 weeks)
- Correlating Committee ballots on First Draft (5 weeks)
- First Draft Report posted

### **Step 2: Comment Stage**

- Public Comments accepted on First Draft (10 weeks)
- If Standard does not receive Public Comments and the Committee does not wish to further revise the Standard, the Standard becomes a Consent Standard and is sent directly to the Standards Council for issuance
- Committee holds Second Draft Meeting (21 weeks)
  - Committee(s) with Correlating Committee (7 weeks)
- Committee ballots on Second Draft (11 weeks)
  - Committee(s) with Correlating Committee (10 weeks)
- Correlating Committee First Draft Meeting (9 weeks)
- Correlating Committee ballots on First Draft (8 weeks)
- Second Draft Report posted

### **Step 3: Association Technical Meeting**

- Notice of Intent to Make a Motion (NITMAM) accepted (5 weeks)
- NITMAMs are reviewed and valid motions are certified for presentation at the Association Technical Meeting
- Consent Standard bypasses Association Technical Meeting and proceeds directly to the Standards Council for issuance
- NFPA membership meets each June at the Association Technical Meeting and acts on Standards with “Certified Amending Motions” (certified NITMAMs)
- Committee(s) and Panel(s) vote on any successful amendments to the Technical Committee Reports made by the NFPA membership at the Association Technical Meeting

### **Step 4: Council Appeals and Issuance of Standard**

- Notification of intent to file an appeal to the Standards Council on Association action must be filed within 20 days of the Association Technical Meeting
- Standards Council decides, based on all evidence, whether or not to issue the Standards or to take other action

## ***Committee Membership Classifications***<sup>1,2,3,4</sup>

The following classifications apply to Committee members and represent their principal interest in the activity of the Committee.

1. M *Manufacturer*: A representative of a maker or marketer of a product, assembly, or system, or portion thereof, that is affected by the standard.
2. U *User*: A representative of an entity that is subject to the provisions of the standard or that voluntarily uses the standard.
3. IM *Installer/Maintainer*: A representative of an entity that is in the business of installing or maintaining a product, assembly, or system affected by the standard.
4. L *Labor*: A labor representative or employee concerned with safety in the workplace.
5. RT *Applied Research/Testing Laboratory*: A representative of an independent testing laboratory or independent applied research organization that promulgates and/or enforces standards.
6. E *Enforcing Authority*: A representative of an agency or an organization that promulgates and/or enforces standards.
7. I *Insurance*: A representative of an insurance company, broker, agent, bureau, or inspection agency.
8. C *Consumer*: A person who is or represents the ultimate purchaser of a product, system, or service affected by the standard, but who is not included in (2).
9. SE *Special Expert*: A person not representing (1) through (8) and who has special expertise in the scope of the standard or portion thereof.

NOTE 1: “Standard” connotes code, standard, recommended practice, or guide.

NOTE 2: A representative includes an employee.

NOTE 3: While these classifications will be used by the Standards Council to achieve a balance for Technical Committees, the Standards Council may determine that new classifications of member or unique interests need representation in order to foster the best possible Committee deliberations on any project. In this connection, the Standards Council may make such appointments as it deems appropriate in the public interest, such as the classification of “Utilities” in the National Electrical Code Committee.

NOTE 4: Representatives of subsidiaries of any group are generally considered to have the same classification as the parent organization.



## **Submitting Public Input / Public Comment through the Electronic Submission System (e-Submission):**

As soon as the current edition is published, a Standard is open for Public Input.

Before accessing the e-Submission System, you must first sign-in at [www.NFPA.org](http://www.NFPA.org). *Note: You will be asked to sign-in or create a free online account with NFPA before using this system:*

- a. Click in the gray Sign In box on the upper left side of the page. Once signed-in, you will see a red “Welcome” message in the top right corner.
- b. Under the Codes and Standards heading, Click on the Document Information pages (List of Codes & Standards), and then select your document from the list or use one of the search features in the upper right gray box.

*OR*

- a. Go directly to your specific document page by typing the convenient short link of [www.nfpa.org/document#](http://www.nfpa.org/document#), (Example: NFPA 921 would be [www.nfpa.org/921](http://www.nfpa.org/921)) Click in the gray Sign In box on the upper left side of the page. Once signed in, you will see a red “Welcome” message in the top right corner.

To begin your Public Input, select the link The next edition of this standard is now open for Public Input (formally “proposals”) located on the Document Information tab, the Next Edition tab, or the right-hand Navigation bar. Alternatively, the Next Edition tab includes a link to Submit Public Input online

At this point, the NFPA Standards Development Site will open showing details for the document you have selected. This “Document Home” page site includes an explanatory introduction, information on the current document phase and closing date, a left-hand navigation panel that includes useful links, a document Table of Contents, and icons at the top you can click for Help when using the site. The Help icons and navigation panel will be visible except when you are actually in the process of creating a Public Input.

Once the First Draft Report becomes available there is a Public comment period during which anyone may submit a Public Comment on the First Draft. Any objections or further related changes to the content of the First Draft must be submitted at the Comment stage.

To submit a Public Comment you may access the e-Submission System utilizing the same steps as previous explained for the submission of Public Input.

For further information on submitting public input and public comments, go to: <http://www.nfpa.org/publicinput>

### **Other Resources available on the Doc Info Pages**

**Document information tab:** Research current and previous edition information on a Standard

**Next edition tab:** Follow the committee’s progress in the processing of a Standard in its next revision cycle.

**Technical committee tab:** View current committee member rosters or apply to a committee

**Technical questions tab:** For members and Public Sector Officials/AHJs to submit questions about codes and standards to NFPA staff. Our Technical Questions Service provides a convenient way to receive timely and consistent technical assistance when you need to know more about NFPA codes and standards relevant to your work. Responses are provided by NFPA staff on an informal basis.

**Products/training tab:** List of NFPA’s publications and training available for purchase.

**Community tab:** Information and discussions about a Standard

## Information on the NFPA Standards Development Process

**I. Applicable Regulations.** The primary rules governing the processing of NFPA standards (codes, standards, recommended practices, and guides) are the NFPA *Regulations Governing the Development of NFPA Standards (Regs)*. Other applicable rules include NFPA *Bylaws*, NFPA *Technical Meeting Convention Rules*, NFPA *Guide for the Conduct of Participants in the NFPA Standards Development Process*, and the NFPA *Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council*. Most of these rules and regulations are contained in the *NFPA Standards Directory*. For copies of the *Directory*, contact Codes and Standards Administration at NFPA Headquarters; all these documents are also available on the NFPA website at “[www.nfpa.org](http://www.nfpa.org).”

The following is general information on the NFPA process. All participants, however, should refer to the actual rules and regulations for a full understanding of this process and for the criteria that govern participation.

**II. Technical Committee Report.** The Technical Committee Report is defined as “the Report of the responsible Committee(s), in accordance with the Regulations, in preparation of a new or revised NFPA Standard.” The Technical Committee Report is in two parts and consists of the First Draft Report and the Second Draft Report. (See *Regs* at 1.4)

**III. Step 1: First Draft Report.** The First Draft Report is defined as “Part one of the Technical Committee Report, which documents the Input Stage.” The First Draft Report consists of the First Draft, Public Input, Committee Input, Committee and Correlating Committee Statements, Correlating Input, Correlating Notes, and Ballot Statements. (See *Regs* at 4.2.5.2 and Section 4.3) Any objection to an action in the First Draft Report must be raised through the filing of an appropriate Comment for consideration in the Second Draft Report or the objection will be considered resolved. [See *Regs* at 4.3.1(b)]

**IV. Step 2: Second Draft Report.** The Second Draft Report is defined as “Part two of the Technical Committee Report, which documents the Comment Stage.” The Second Draft Report consists of the Second Draft, Public Comments with corresponding Committee Actions and Committee Statements, Correlating Notes and their respective Committee Statements, Committee Comments, Correlating Revisions, and Ballot Statements. (See *Regs* at Section 4.2.5.2 and 4.4) The First Draft Report and the Second Draft Report together constitute the Technical Committee Report. Any outstanding objection following the Second Draft Report must be raised through an appropriate Amending Motion at the Association Technical Meeting or the objection will be considered resolved. [See *Regs* at 4.4.1(b)]

**V. Step 3a: Action at Association Technical Meeting.** Following the publication of the Second Draft Report, there is a period during which those wishing to make proper Amending Motions on the Technical Committee Reports must signal their intention by submitting a Notice of Intent to Make a Motion. (See *Regs* at 4.5.2) Standards that receive notice of proper Amending Motions (Certified Amending Motions) will be presented for action at the annual June Association Technical Meeting. At the meeting, the NFPA membership can consider and act on these Certified Amending Motions as well as Follow-up Amending Motions, that is, motions that become necessary as a result of a previous successful Amending Motion. (See 4.5.3.2 through 4.5.3.6 and Table1, Columns 1-3 of *Regs* for a summary of the available Amending Motions and who may make them.) Any outstanding objection following action at an Association Technical Meeting (and any further Technical Committee consideration following successful Amending Motions, see *Regs* at 4.5.3.7 through 4.6.5.3) must be raised through an appeal to the Standards Council or it will be considered to be resolved.

**VI. Step 3b: Documents Forwarded Directly to the Council.** Where no Notice of Intent to Make a Motion (NITMAM) is received and certified in accordance with the Technical Meeting Convention Rules, the standard is forwarded directly to the Standards Council for action on issuance. Objections are deemed to be resolved for these documents. (See *Regs* at 4.5.2.5)

**VII. Step 4a: Council Appeals.** Anyone can appeal to the Standards Council concerning procedural or substantive matters related to the development, content, or issuance of any document of the Association or on matters within the purview of the authority of the Council, as established by the *Bylaws* and as determined by the Board of Directors. Such appeals must be in written form and filed with the Secretary of the Standards Council (See *Regs* at 1.6). Time constraints for filing an appeal must be in accordance with 1.6.2 of the *Regs*. Objections are deemed to be resolved if not pursued at this level.

**VIII. Step 4b: Document Issuance.** The Standards Council is the issuer of all documents (see Article 8 of *Bylaws*). The Council acts on the issuance of a document presented for action at an Association Technical Meeting within 75 days from the date of the recommendation from the Association Technical Meeting, unless this period is extended by the Council (See *Regs* at 4.7.2). For documents forwarded directly to the Standards Council, the Council acts on the issuance of the document at its next scheduled meeting, or at such other meeting as the Council may determine (See *Regs* at 4.5.2.5 and 4.7.4).

**IX. Petitions to the Board of Directors.** The Standards Council has been delegated the responsibility for the administration of the codes and standards development process and the issuance of documents. However, where extraordinary circumstances requiring the intervention of the Board of Directors exist, the Board of Directors may take any action necessary to fulfill its obligations to preserve the integrity of the codes and standards development process and to protect the interests of the Association. The rules for petitioning the Board of Directors can be found in the *Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council* and in 1.7 of the *Regs*.

**X. For More Information.** The program for the Association Technical Meeting (as well as the NFPA website as information becomes available) should be consulted for the date on which each report scheduled for consideration at the meeting will be presented. For copies of the First Draft Report and Second Draft Report as well as more information on NFPA rules and for up-to-date information on schedules and deadlines for processing NFPA documents, check the NFPA website ([www.nfpa.org/aboutthecodes](http://www.nfpa.org/aboutthecodes)) or contact NFPA Codes & Standards Administration at (617) 984-7246.



# STAY UP-TO-DATE. JOIN NFPA® TODAY!

**YES** Please enroll me as a member of NFPA for the term checked below. Activate all benefits, and ship my *Member Kit* including the *Benefits Guide* and other resources to help me make the most of my NFPA membership. Please allow three to four weeks for the kit to arrive.

## BILLING INFORMATION:

Name \_\_\_\_\_ Title \_\_\_\_\_  
Organization \_\_\_\_\_  
Address \_\_\_\_\_  
City \_\_\_\_\_ State \_\_\_\_\_ Zip/Postal Code \_\_\_\_\_  
Country \_\_\_\_\_  
Phone \_\_\_\_\_ E-mail \_\_\_\_\_

Priority Code: 8J-MIS-1Z

## PLEASE ANSWER THE FOLLOWING QUESTIONS:

### Job Title *(check one)*

- Architect, Engineer, Consultant, Contractor (C17)
- Facilities Safety Officer (F14)
- Fire Chief, Other Fire Service (A11)
- Loss Control, Risk Manager (L11)
- Inspector, Building Official, Fire Marshal (F03)
- Owner, President, Manager, Administrator (C10)
- Other (please specify): (G11) \_\_\_\_\_

### Type of Organization *(check one)*

- Architecture, Engineering, Contracting (A14)
- Commercial Firm (Office, Retail, Lodging, Restaurant) (G13)
- Electrical Services, Installation (J11)
- Fire Service, Public and Private (AA1)
- Government (C12)
- Industrial Firm (Factory, Warehouse) (C11)
- Institutional (Health Care, Education, Detention, Museums) (B11)
- Insurance, Risk Management (B12)
- Utilities (G12)
- Other (please specify): (G11) \_\_\_\_\_

## TERMS AND PAYMENT:

- 1 year (\$165)
- 2 years (\$300) **SAVE \$30**
- 3 years (\$430) **SAVE \$65**

Annual membership dues include a \$45 subscription to *NFPA Journal*®. Regular membership in NFPA is individual and non-transferable. NFPA Journal is a registered trademark of the National Fire Protection Association, Quincy, MA 02169. Voting privileges begin after 180 days of individual membership. Prices subject to change.

## PAYMENT METHOD:

Check One:

- Payment Enclosed *(Make check payable to NFPA.)*
- Purchase Order *(Please attach this form to your P.O.)*
- Bill Me Later *(Not available on International memberships.)*

Charge My:  VISA  MasterCard  AmEx  Discover

Card # \_\_\_\_\_

Expiration Date \_\_\_\_\_

Name on Card \_\_\_\_\_

Signature \_\_\_\_\_

International members: Please note prepayment is required on all International orders. Be sure to enclose a check or select your preferred credit card option.

## 4 EASY WAYS TO JOIN

**Fax:** 1-800-593-6372, Outside the U.S. +1-508-895-8301

**Mail:** NFPA Membership Services Center,  
11 Tracy Drive, Avon, MA 02322-9908

**Online:** nfpa.org

**Call:** 1-800-344-3555  
Outside the U.S. call +1-617-770-3000

12/14-D

### 100% MONEY-BACK GUARANTEE

If anytime during your first year you decide membership is not for you, let us know and you'll receive a 100% refund of your dues.



# “Member-Only” Benefits Keeps You Up-To-Date!

**FREE! Technical Support** — Technical Support by Phone/Email. Get fast, reliable answers to all code-related questions—from electrical safety for employee workplaces to carbon dioxide extinguishing systems—from NFPA’s team of fire protection specialists.

**NFPA Journal®** — THE journal of record for fire protection, this bi-monthly publication will keep you abreast of the latest fire prevention and safety practices, as well as new technologies and strategies for protecting life and property from fire.

**NFPA Update** — This easy-to-read monthly e-newsletter will keep you up-to-date on important association programs such as the annual meeting; bring you times of interest from NFPA’s regional offices; and alert you to nationwide events and opportunities you won’t want to miss.

**NFPA News** — From new standards for dry cleaning plants to warning equipment for household carbon monoxide, this monthly online update keeps you abreast of additions of changes that could impact how you do you work.

**NFPA Standards Directory** — The NFPA Standards Directory is your complete guide to NFPA’s code-making process. Simply access your online NFPA member profile for document revision guidelines, the revision cycle schedule, and forms for submitting Proposals and Comments. Your online NFPA member profile and access to the NFPA Standards Directory is automatically generated once you join NFPA.

**FREE! Section Membership** — Share YOUR expertise with others in any of 16 industry-specific sections covering your own field of interest.

**Member Kit** — Includes Membership Certificate, Pin, Decals, ID Card, and Camera-ready Logo Art. Display the NFPA member logo proudly on your business correspondence, literature, website, and vehicles.

**10% Discounts** — Save hundreds of dollars each year on the many products and services listed in the NFPA Catalog, including codes and standards publications, handbooks, training videos, and other education materials to increase your knowledge and skills.

Voting Rights — Your chance to help shape the future direction of fire prevention codes and standards. Voting rights go into effect 180 days from the start of individual membership.

**Conference Invitation**— Invitation to the NFPA Conference and Expo. Attend this important meeting at discounted rates as a member of NFPA.

**Join NFPA today!**  
**[www.nfpa.org](http://www.nfpa.org)**

NFPA® and NFPA Journal® are registered trademarks of the National Fire Protection Association, Quincy, MA 02169-7471