

NFPA[®]

120

Standard for
Fire Prevention and
Control in Coal Mines

2020



IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA® STANDARDS

NFPA® codes, standards, recommended practices, and guides (“NFPA Standards”), of which the document contained herein is one, are developed through a consensus standards development process approved by the American National Standards Institute. This process brings together volunteers representing varied viewpoints and interests to achieve consensus on fire and other safety issues. While the NFPA administers the process and establishes rules to promote fairness in the development of consensus, it does not independently test, evaluate, or verify the accuracy of any information or the soundness of any judgments contained in NFPA Standards.

The NFPA disclaims liability for any personal injury, property, or other damages of any nature whatsoever, whether special, indirect, consequential or compensatory, directly or indirectly resulting from the publication, use of, or reliance on NFPA Standards. The NFPA also makes no guaranty or warranty as to the accuracy or completeness of any information published herein.

In issuing and making NFPA Standards available, the NFPA is not undertaking to render professional or other services for or on behalf of any person or entity. Nor is the NFPA undertaking to perform any duty owed by any person or entity to someone else. Anyone using this document should rely on his or her own independent judgment or, as appropriate, seek the advice of a competent professional in determining the exercise of reasonable care in any given circumstances.

The NFPA has no power, nor does it undertake, to police or enforce compliance with the contents of NFPA Standards. Nor does the NFPA list, certify, test, or inspect products, designs, or installations for compliance with this document. Any certification or other statement of compliance with the requirements of this document shall not be attributable to the NFPA and is solely the responsibility of the certifier or maker of the statement.

REVISION SYMBOLS IDENTIFYING CHANGES FROM THE PREVIOUS EDITION

Text revisions are shaded. A **Δ** before a section number indicates that words within that section were deleted and a **Δ** to the left of a table or figure number indicates a revision to an existing table or figure. When a chapter was heavily revised, the entire chapter is marked throughout with the **Δ** symbol. Where one or more sections were deleted, a **•** is placed between the remaining sections. Chapters, annexes, sections, figures, and tables that are new are indicated with an **N**.

Note that these indicators are a guide. Rearrangement of sections may not be captured in the markup, but users can view complete revision details in the First and Second Draft Reports located in the archived revision information section of each code at www.nfpa.org/docinfo. Any subsequent changes from the NFPA Technical Meeting, Tentative Interim Amendments, and Errata are also located there.

REMINDER: UPDATING OF NFPA STANDARDS

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

ADDITIONAL IMPORTANT NOTICES AND DISCLAIMERS CONCERNING NFPA[®] STANDARDS

Updating of NFPA Standards

Users of NFPA codes, standards, recommended practices, and guides (“NFPA Standards”) should be aware that these documents may be superseded at any time by the issuance of a new edition, may be amended with the issuance of Tentative Interim Amendments (TIAs), or be corrected by Errata. It is intended that through regular revisions and amendments, participants in the NFPA standards development process consider the then-current and available information on incidents, materials, technologies, innovations, and methods as these develop over time and that NFPA Standards reflect this consideration. Therefore, any previous edition of this document no longer represents the current NFPA Standard on the subject matter addressed. NFPA encourages the use of the most current edition of any NFPA Standard [as it may be amended by TIA(s) or Errata] to take advantage of current experience and understanding. An official NFPA Standard at any point in time consists of the current edition of the document, including any issued TIAs and Errata then in effect.

To determine whether an NFPA Standard has been amended through the issuance of TIAs or corrected by Errata, visit the “Codes & Standards” section at www.nfpa.org.

Interpretations of NFPA Standards

A statement, written or oral, that is not processed in accordance with Section 6 of the Regulations Governing the Development of NFPA Standards shall not be considered the official position of NFPA or any of its Committees and shall not be considered to be, nor be relied upon as, a Formal Interpretation.

Patents

The NFPA does not take any position with respect to the validity of any patent rights referenced in, related to, or asserted in connection with an NFPA Standard. The users of NFPA Standards bear the sole responsibility for determining the validity of any such patent rights, as well as the risk of infringement of such rights, and the NFPA disclaims liability for the infringement of any patent resulting from the use of or reliance on NFPA Standards.

NFPA adheres to the policy of the American National Standards Institute (ANSI) regarding the inclusion of patents in American National Standards (“the ANSI Patent Policy”), and hereby gives the following notice pursuant to that policy:

NOTICE: The user’s attention is called to the possibility that compliance with an NFPA Standard may require use of an invention covered by patent rights. NFPA takes no position as to the validity of any such patent rights or as to whether such patent rights constitute or include essential patent claims under the ANSI Patent Policy. If, in connection with the ANSI Patent Policy, a patent holder has filed a statement of willingness to grant licenses under these rights on reasonable and nondiscriminatory terms and conditions to applicants desiring to obtain such a license, copies of such filed statements can be obtained, on request, from NFPA. For further information, contact the NFPA at the address listed below.

Law and Regulations

Users of NFPA Standards should consult applicable federal, state, and local laws and regulations. NFPA does not, by the publication of its codes, standards, recommended practices, and guides, intend to urge action that is not in compliance with applicable laws, and these documents may not be construed as doing so.

Copyrights

NFPA Standards are copyrighted. They are made available for a wide variety of both public and private uses. These include both use, by reference, in laws and regulations, and use in private self-regulation, standardization, and the promotion of safe practices and methods. By making these documents available for use and adoption by public authorities and private users, the NFPA does not waive any rights in copyright to these documents.

Use of NFPA Standards for regulatory purposes should be accomplished through adoption by reference. The term “adoption by reference” means the citing of title, edition, and publishing information only. Any deletions, additions, and changes desired by the adopting authority should be noted separately in the adopting instrument. In order to assist NFPA in following the uses made of its documents, adopting authorities are requested to notify the NFPA (Attention: Secretary, Standards Council) in writing of such use. For technical assistance and questions concerning adoption of NFPA Standards, contact NFPA at the address below.

For Further Information

All questions or other communications relating to NFPA Standards and all requests for information on NFPA procedures governing its codes and standards development process, including information on the procedures for requesting Formal Interpretations, for proposing Tentative Interim Amendments, and for proposing revisions to NFPA standards during regular revision cycles, should be sent to NFPA headquarters, addressed to the attention of the Secretary, Standards Council, NFPA, 1 Batterymarch Park, P.O. Box 9101, Quincy, MA 02269-9101; email: stds_admin@nfpa.org.

For more information about NFPA, visit the NFPA website at www.nfpa.org. All NFPA codes and standards can be viewed at no cost at www.nfpa.org/docinfo.

Copyright © 2019 National Fire Protection Association®. All Rights Reserved.

NFPA® 120

Standard for

Fire Prevention and Control in Coal Mines

2020 Edition

This edition of NFPA 120, *Standard for Fire Prevention and Control in Coal Mines*, was prepared by the Technical Committee on Mining Facilities. It was issued by the Standards Council on November 4, 2019, with an effective date of November 24, 2019, and supersedes all previous editions.

This edition of NFPA 120 was approved as an American National Standard on November 24, 2019.

Origin and Development of NFPA 120

In 1977, with the formation of the Mining Committee, this standard, NFPA 120, formerly NFPA 653, was reassigned to the Committee on Mining Facilities. The change in numerical identity of the standard was in keeping with the numbering sequence assigned to the Mining Committee for other documents now under development. NFPA 120 represents a complete revision of former NFPA 653 and also includes changes in style in accordance with the NFPA *Manual of Style*.

The 1971 edition of NFPA 653, *Coal Preparation Plants*, was the same as the 1959 edition and was adopted at the NFPA 1971 Annual Meeting. The 1959 edition of NFPA 653 was prepared by the NFPA Committee on Dust Explosion Hazards and was adopted at the 1958 Annual Meeting with an amendment adopted in 1959.

The 1994 edition of NFPA 120 included a variety of technical and editorial updates. Previous editions not already mentioned include versions issued in 1984 and 1988.

The 1999 edition addressed the need for emergency lighting, expanded the types of portable fire extinguishers used, and expanded and clarified the types of fire suppression equipment used. The water supply requirements also were clarified.

The 2004 edition applied the NFPA *Manual of Style* to the document. It also incorporated all the appropriate sections of NFPA 121 and NFPA 123, which was done in an effort to consolidate common requirements.

The Coal Mining Task Group for the 2004 edition consisted of the following members: Matt Bujewski, Chair, Marsh Inc.; Tim Gierer, Alltype Fire Protection; Dennis Brohmer, Ansul Inc.; Jay Senn, Peabody Energy Group; Charlie Russell, Arch Coal Inc.; Brent Sullivan, Coteau Properties; Carol Boring, Mine Safety and Health Administration; Alex Smith, NIOSH; Mario Orozco, Zurich Services Corp.; Mike Wegleitner, Falkirk Mining Co. (alternate for Brent Sullivan); and Bill Wilson, U.S. Department of Labor (alternate for Carol Boring).

For the 2010 edition, the technical committee revised the fire prevention and fire protection provisions for coal mines by requiring the use of means to manage the spontaneous combustion potential of the coal being mined, including adding an inspection plan for carbon monoxide detection systems. The fire prevention practices for coal mines were improved by referencing the inspection and maintenance practices of fire suppression systems in the corresponding NFPA fire suppression standard. The committee provided improved fire protection for transformers by referencing NFPA 70®, *National Electrical Code*®, and adding NFPA 850, *Recommended Practice for Fire Protection for Electric Generating Plants and High Voltage Direct Current Converter Stations*, as an annex reference. Similarly, the standard was revised to make it consistent with fire protection industry practices and the updated provisions in NFPA 122, *Standard for Fire Prevention and Control in Metal/Nonmetal Mining and Metal Mineral Processing Facilities*.

For the 2014 edition, the technical committee rewrote the sprinkler requirements in a more coherent manner and provided additional guidance for underground sprinkler systems. The committee established a common definition and a protection scheme for self-propelled, mobile, and portable equipment.

In the 2020 edition, the technical committee has added new fire safety material to Chapter 6 related to the use of spiral concentrators in coal processing facilities. Direction has been provided to the stakeholder regarding best practices during welding and cutting operations within the vicinity of spiral concentrators, including associated Annex A material for further guidance.

Technical Committee on Mining Facilities

Mario G. Orozco, *Chair*
Zurich Insurance, IL [I]

David G. Aden, State of Alaska Department of Public Safety, AK [E]

Steven M. Behrens, AXA XL Risk Consulting/ Global Asset Protection Services, LLC, CT [I]

Michael Breneman, Peabody Energy, MO [U]

Matthew J. Bujewski, MJB Risk Consulting, MO [SE]

John D. Campbell, Global Fire Protection Group, LLC, MO [M]
Rep. Hidrosistemas Baja

Joseph J. Chrobak, Sr., William Penn Fire Company, PA [E]

Jack Douglas Conaway, Arch Coal, Inc., MO [U]

Brian Corcoran, Wolverine Fire Protection, NV [IM]

Paolo De Rosa, Marsh Canada, Canada [I]

Rickard P. Hansen, Malmfaltens Brandkonsult, Sweden [SE]

Jason Wallace Jeffe, Murray Energy Corporation, PA [U]

L. Harvey Kirk, III, US Department of Labor, VA [E]

James M. Kohl, Cintas Fire Protection, IL [IM]
Rep. National Association of Fire Equipment Distributors

Scott Matthews, AFEX Fire Suppression Systems, NC [M]

Erick Mondragon, Swiss Reinsurance Company (Swiss Re), FL [I]

Matthew Paine, FM Global, MA [I]

Rob Rosovich, FireIce Inc., FL [M]

Chad L Ryczek, Johnson Controls, WI [M]

Michael Schmeida, Gypsum Association, OH [U]

Steven A. Sheldon, Fisher Engineering, Inc., AZ [SE]

Robert D. Taylor, PRB Coal Users Group, IN [U]

Spencer Thompson, North American Coal, FL [U]

William B. Till, Jr., Bernie Till & Associates LLC, SC [SE]

Pierre M. Tousignant, Sherritt Metals, Canada [U]

Daniel P. Wake, Victaulic Company of America, PA [M]

Rep. National Fire Sprinkler Association

Chris Yoder, Pillar Innovations, MD [M]

Liming Yuan, National Institute for Occupational Safety & Health, PA [RT]

Rep. National Institute for Occupational Safety & Health

Alternates

Charles Barton, US Department of Labor, VA [E]
(Alt. to L. Harvey Kirk, III)

Tracy Bollig, American Fire Sprinkler Corporation, KS [M]
(Alt. to Daniel P. Wake)

Timothy Earl, GBH International, MI [U]
(Alt. to Michael Schmeida)

Eric Metheny, Arch Coal, WV [U]
(Alt. to Jack Douglas Conaway)

Debra M. Gursha, NFPA Staff Liaison

David Mills, Marsh Property Risk Consulting, PA [I]
(Alt. to Paolo De Rosa)

Larry J. Moore, FM Global, CO [I]
(Alt. to Matthew Paine)

Kendall A. Pate, Amerex Corporation, AL [M]
(Voting Alt.)

Dennis M. Phillips, Johnson Controls, TN [M]
(Alt. to Chad L Ryczek)

This list represents the membership at the time the Committee was balloted on the final text of this edition. Since that time, changes in the membership may have occurred. A key to classifications is found at the back of the document.

NOTE: Membership on a committee shall not in and of itself constitute an endorsement of the Association or any document developed by the committee on which the member serves.

Committee Scope: This Committee shall have primary responsibility for documents on safeguarding life and property against fire, explosion, and related hazards associated with underground and surface coal and metal and nonmetal mining facilities and equipment.

Contents

| | | | |
|----------------------------------------------------------------------------------------------------------|---------|---------------------------------------------------------------------------------------------|---------|
| Chapter 1 Administration | 120- 5 | | |
| 1.1 Scope. | 120- 5 | 7.4 Flammable and Combustible Liquid Storage on Surface Equipment and in Buildings. | 120- 26 |
| 1.2 Purpose. | 120- 5 | 7.5 Flammable Liquids Stored and Used Underground. | 120- 26 |
| 1.3 Application. | 120- 5 | 7.6 Combustible Liquids Stored and Used Underground. | 120- 27 |
| 1.4 Retroactivity. | 120- 5 | | |
| 1.5 Equivalency. | 120- 5 | | |
| Chapter 2 Referenced Publications | 120- 6 | Chapter 8 Mine Surface Buildings | 120- 30 |
| 2.1 General. | 120- 6 | 8.1 Construction. | 120- 30 |
| 2.2 NFPA Publications. | 120- 6 | 8.2 Fire Prevention. | 120- 30 |
| 2.3 Other Publications. | 120- 6 | 8.3 Life Safety. | 120- 30 |
| 2.4 References for Extracts in Mandatory Sections. | 120- 6 | 8.4 Flammable and Combustible Liquids. | 120- 30 |
| Chapter 3 Definitions | 120- 6 | 8.5 Compressed Gas Storage and Usage. | 120- 30 |
| 3.1 General. | 120- 6 | 8.6 Fire Detection and Protection. | 120- 30 |
| 3.2 NFPA Official Definitions. | 120- 7 | 8.7 Water Supplies. | 120- 30 |
| 3.3 General Definitions. | 120- 7 | Chapter 9 Coal Conveyance and Storage | 120- 30 |
| Chapter 4 Underground Mining Operations | 120- 9 | 9.1 Conveyors — General. | 120- 30 |
| 4.1 General. | 120- 9 | 9.2 Overland Conveyors. | 120- 31 |
| 4.2 Fire Prevention. | 120- 9 | 9.3 Below-Grade Reclaim Conveyors. | 120- 31 |
| 4.3 Fire Protection. | 120- 10 | 9.4 Underground Conveyors. | 120- 31 |
| Chapter 5 Surface Mining Operations | 120- 16 | 9.5 Coal Storage — General. | 120- 33 |
| 5.1 General. | 120- 16 | Chapter 10 Truck, Rail, and Barge Loadouts | 120- 33 |
| 5.2 Fire Prevention. | 120- 16 | 10.1 Construction. | 120- 33 |
| 5.3 Fire Protection. | 120- 16 | 10.2 Fire Prevention. | 120- 33 |
| Chapter 6 Coal Processing | 120- 19 | 10.3 Life Safety. | 120- 34 |
| 6.1 General. | 120- 19 | 10.4 Fire Detection and Protection. | 120- 34 |
| 6.2 Fire and Explosion Prevention. | 120- 19 | 10.5 Manual Fire Fighting. | 120- 34 |
| 6.3 Preparation Plants and Crusher Buildings. | 120- 21 | Chapter 11 Emergency Response, Manual Fire Fighting, and Training | 120- 34 |
| 6.4 Dryers. | 120- 22 | 11.1 Emergency Procedures. | 120- 34 |
| 6.5 Conveyors. | 120- 23 | 11.2 Underground Operations. | 120- 34 |
| 6.6 Mobile Equipment. | 120- 23 | 11.3 Surface Operations. | 120- 35 |
| 6.7 Spiral Concentrators. | 120- 23 | Annex A Explanatory Material | 120- 35 |
| Chapter 7 Storage and Use of Compressed Gases and Flammable and Combustible Liquids | 120- 24 | Annex B Informational References | 120- 47 |
| 7.1 Compressed Gas Storage and Usage — Cutting and Welding. | 120- 24 | Index | 120- 51 |
| 7.2 Liquid Propane Storage and Use. | 120- 25 | | |
| 7.3 Flammable and Combustible Liquid Storage Tanks on the Surface. | 120- 25 | | |

NFPA 120

Standard for

Fire Prevention and Control in Coal Mines

2020 Edition

IMPORTANT NOTE: This NFPA document is made available for use subject to important notices and legal disclaimers. These notices and disclaimers appear in all publications containing this document and may be found under the heading “Important Notices and Disclaimers Concerning NFPA Standards.” They can also be viewed at www.nfpa.org/disclaimers or obtained on request from NFPA.

UPDATES, ALERTS, AND FUTURE EDITIONS: New editions of NFPA codes, standards, recommended practices, and guides (i.e., NFPA Standards) are released on scheduled revision cycles. This edition may be superseded by a later one, or it may be amended outside of its scheduled revision cycle through the issuance of Tentative Interim Amendments (TIAs). An official NFPA Standard at any point in time consists of the current edition of the document, together with all TIAs and Errata in effect. To verify that this document is the current edition or to determine if it has been amended by TIAs or Errata, please consult the National Fire Codes® Subscription Service or the “List of NFPA Codes & Standards” at www.nfpa.org/docinfo. In addition to TIAs and Errata, the document information pages also include the option to sign up for alerts for individual documents and to be involved in the development of the next edition.

NOTICE: An asterisk (*) following the number or letter designating a paragraph indicates that explanatory material on the paragraph can be found in Annex A.

A reference in brackets [] following a section or paragraph indicates material that has been extracted from another NFPA document. Extracted text may be edited for consistency and style and may include the revision of internal paragraph references and other references as appropriate. Requests for interpretations or revisions of extracted text shall be sent to the technical committee responsible for the source document.

Information on referenced and extracted publications can be found in Chapter 2 and Annex B.

Chapter 1 Administration

1.1 Scope.

1.1.1* This standard shall cover minimum requirements for reducing loss of life and property from fire and explosion in the following:

- (1) Underground bituminous coal mines
- (2) Coal preparation plants designed to prepare coal for shipment
- (3) Surface building and facilities associated with coal mining and preparation
- (4) Surface coal and lignite mines

1.1.2 This standard shall not apply to the following:

- (1) Flammable and combustible liquids produced in underground coal mines
- (2) Other equipment and processes, such as coal pulverizers, used to condition coal for firing in boilers at power-generating plants or gasification plants or for utilization in certain special processes

1.2 Purpose. This standard shall be intended for the use and guidance of those charged with designing, constructing, purchasing, testing, installing, examining, approving, operating, or maintaining fire prevention, fire protection, or fire-fighting equipment in underground bituminous coal mines, coal preparation plants, and surface mining equipment and processes.

1.3* Application.

1.3.1 This standard shall be based on the current state of the art, and application to existing installations shall not be mandatory. Nevertheless, operating mines are urged to adopt those features of this standard that are considered applicable and reasonable for existing installations.

1.3.2 At times it will be necessary for those responsible for the storage of flammable and combustible liquids and the use of diesel-powered equipment within underground bituminous coal mines to consult an experienced fire protection specialist, and it shall be permitted.

1.3.3 Only those skilled in fire protection shall be considered competent to design and supervise the installation of mine fire protection systems.

1.3.4 Coal preparation plants shall be designed by experienced persons familiar with fire and explosion hazards in coal-processing plants.

1.3.5 At times it will be necessary for those charged with purchasing, testing, approving, and maintaining fire protection equipment for self-propelled and surface mining equipment to consult an experienced fire protection specialist.

1.4 Retroactivity. The provisions of this standard reflect a consensus of what is necessary to provide an acceptable degree of protection from the hazards addressed in this standard at the time the standard was issued.

1.4.1 Unless otherwise specified, the provisions of this standard shall not apply to facilities, equipment, structures, or installations that existed or were approved for construction or installation prior to the effective date of the standard. Where specified, the provisions of this standard shall be retroactive.

1.4.2 In those cases where the authority having jurisdiction determines that the existing situation presents an unacceptable degree of risk, the authority having jurisdiction shall be permitted to apply retroactively any portions of this standard deemed appropriate.

1.4.3 The retroactive requirements of this standard shall be permitted to be modified if their application clearly would be impractical in the judgment of the authority having jurisdiction, and only where it is clearly evident that a reasonable degree of safety is provided.

1.4.4 Operators are urged to avail themselves of any information that will prevent dust dispersions, eliminate sources of ignition, or otherwise reduce fire and explosion hazards by improving conditions in their plants.

1.5 Equivalency. Nothing in this standard is intended to prevent the use of systems, methods, or devices of equivalent or superior quality, strength, fire resistance, effectiveness, durability, and safety over those prescribed by this standard.

1.5.1 Technical documentation shall be submitted to the authority having jurisdiction to demonstrate equivalency.

1.5.2 The system, method, or device shall be approved for the intended purpose by the authority having jurisdiction.

Chapter 2 Referenced Publications

2.1 General. The documents or portions thereof listed in this chapter are referenced within this standard and shall be considered part of the requirements of this document.

▲ 2.2 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 10, *Standard for Portable Fire Extinguishers*, 2018 edition.

NFPA 11, *Standard for Low-, Medium-, and High-Expansion Foam*, 2016 edition.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 2019 edition.

NFPA 14, *Standard for the Installation of Standpipe and Hose Systems*, 2019 edition.

NFPA 17, *Standard for Dry Chemical Extinguishing Systems*, 2017 edition.

NFPA 24, *Standard for the Installation of Private Fire Service Mains and Their Appurtenances*, 2019 edition.

NFPA 25, *Standard for the Inspection, Testing, and Maintenance of Water-Based Fire Protection Systems*, 2020 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 2018 edition.

NFPA 51B, *Standard for Fire Prevention During Welding, Cutting, and Other Hot Work*, 2019 edition.

NFPA 55, *Compressed Gases and Cryogenic Fluids Code*, 2020 edition.

NFPA 58, *Liquefied Petroleum Gas Code*, 2020 edition.

NFPA 68, *Standard on Explosion Protection by Deflagration Venting*, 2018 edition.

NFPA 69, *Standard on Explosion Prevention Systems*, 2019 edition.

NFPA 70[®], *National Electrical Code*[®], 2020 edition.

NFPA 72[®], *National Fire Alarm and Signaling Code*[®], 2019 edition.

NFPA 85, *Boiler and Combustion Systems Hazards Code*, 2019 edition.

NFPA 91, *Standard for Exhaust Systems for Air Conveying of Vapors, Gases, Mists, and Particulate Solids*, 2020 edition.

NFPA 101[®], *Life Safety Code*[®], 2018 edition.

NFPA 704, *Standard System for the Identification of the Hazards of Materials for Emergency Response*, 2017 edition.

NFPA 780, *Standard for the Installation of Lightning Protection Systems*, 2020 edition.

NFPA 1142, *Standard on Water Supplies for Suburban and Rural Fire Fighting*, 2017 edition.

NFPA 1961, *Standard on Fire Hose*, 2020 edition.

NFPA 1962, *Standard for the Care, Use, Inspection, Service Testing, and Replacement of Fire Hose, Couplings, Nozzles, and Fire Hose Appliances*, 2018 edition.

NFPA 2001, *Standard on Clean Agent Fire Extinguishing Systems*, 2018 edition.

2.3 Other Publications.

2.3.1 API Publications. American Petroleum Institute, 200 Massachusetts Avenue NW, Suite 1100, Washington, DC 20001.

API STD 2000, *Standard for Venting Atmospheric and Low-Pressure Storage Tanks*, 2014 edition.

2.3.2 ASME Publications. American Society of Mechanical Engineers, Two Park Avenue, New York, NY 10016-5990.

Boiler and Pressure Vessel Code, 2017.

2.3.3 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM D5/D5M, *Standard Test Method for Penetration of Bituminous Materials*, 2013.

ASTM D323, *Standard Test Method for Vapor Pressure of Petroleum Products (Reid Method)*, 2015a.

ASTM D4359, *Standard Test Method for Determining Whether a Material is a Liquid or a Solid*, 1990, reapproved 2012.

• **2.3.4 NETA Publications.** InterNational Electrical Testing Association, 3050 Old Centre Avenue, Suite 101, Portage, MI 49024.

ANSI/NETA MTS, *Standard for Maintenance Testing Specifications for Electrical Power Distribution Equipment and Systems*, 2015.

2.3.5 U.S. Bureau of Mines Publications. National Technical Information Service (NTIS), 5301 Shawnee Road, Alexandria, VA 22312.

Schedule 2G, March 1968.

▲ **2.3.6 USDA Forest Service Publications.** U.S. Department of Agriculture Forest Service, 1400 Independence Avenue, SW, Washington, DC 20250-1111.

Specification 5100-186(d), *Fire Hose, Cotton-Synthetic, Lined, Woven Jacket, 1-inch and 1½-inch Hose*, 2006.

2.3.7 Other Publications.

Merriam-Webster's Collegiate Dictionary, 11th edition, Merriam-Webster, Inc., Springfield, MA, 2003.

2.4 References for Extracts in Mandatory Sections.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 2019 edition.

NFPA 17, *Standard for Dry Chemical Extinguishing Systems*, 2017 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 2018 edition.

NFPA 52, *Vehicular Gaseous Fuel Systems Code*, 2019 edition.

NFPA 80, *Standard for Fire Doors and Other Opening Protectives*, 2019 edition.

NFPA 99, *Health Care Facilities Code*, 2018 edition.

NFPA 122, *Standard for Fire Prevention and Control in Metal/Nonmetal Mining and Metal Mineral Processing Facilities*, 2020 edition.

NFPA 5000[®], *Building Construction and Safety Code*[®], 2018 edition.

Chapter 3 Definitions

3.1 General. The definitions contained in this chapter shall apply to the terms used in this standard. Where terms are not defined in this chapter or within another chapter, they shall be defined using their ordinarily accepted meanings within the context in which they are used. *Merriam-Webster's Collegiate*

Dictionary, 11th edition, shall be the source for the ordinarily accepted meaning.

3.2 NFPA Official Definitions.

3.2.1* Approved. Acceptable to the authority having jurisdiction.

3.2.2* Authority Having Jurisdiction (AHJ). An organization, office, or individual responsible for enforcing the requirements of a code or standard, or for approving equipment, materials, an installation, or a procedure.

3.2.3 Labeled. Equipment or materials to which has been attached a label, symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction and concerned with product evaluation, that maintains periodic inspection of production of labeled equipment or materials, and by whose labeling the manufacturer indicates compliance with appropriate standards or performance in a specified manner.

3.2.4* Listed. Equipment, materials, or services included in a list published by an organization that is acceptable to the authority having jurisdiction and concerned with evaluation of products or services, that maintains periodic inspection of production of listed equipment or materials or periodic evaluation of services, and whose listing states that either the equipment, material, or service meets appropriate designated standards or has been tested and found suitable for a specified purpose.

3.2.5 Shall. Indicates a mandatory requirement.

3.2.6 Should. Indicates a recommendation or that which is advised but not required.

3.2.7 Standard. An NFPA Standard, the main text of which contains only mandatory provisions using the word “shall” to indicate requirements and that is in a form generally suitable for mandatory reference by another standard or code or for adoption into law. Nonmandatory provisions are not to be considered a part of the requirements of a standard and shall be located in an appendix, annex, footnote, informational note, or other means as permitted in the NFPA Manuals of Style. When used in a generic sense, such as in the phrase “standards development process” or “standards development activities,” the term “standards” includes all NFPA Standards, including Codes, Standards, Recommended Practices, and Guides.

3.3 General Definitions.

3.3.1 Adequate Ventilation. Air volume and velocity that is sufficient to dilute, render harmless, and carry away flammable or explosive concentrations of dusts and vapors.

3.3.2 Atmospheric Tank. A storage tank that has been designed to operate at pressures from 760 mm Hg through 812 mm Hg (atmospheric through 1.0 psig) measured at the top of the tank.

3.3.3 Boiling Point. The temperature at which the vapor pressure of a liquid equals the surrounding atmospheric pressure. [30, 2018]

3.3.4 Closed Container. A container as herein defined, so sealed by means of a lid or other device that neither liquid nor vapor will escape from it at ordinary temperatures. [30, 2018]

3.3.5 Coal Preparation. The separation, crushing, screening, washing, drying, storage, and loadout of coal to make ready for market.

3.3.6 Combustible. Capable of undergoing combustion.

3.3.7 Combustible Liquid. Any liquid that has a closed-cup flash point at or above 37.8°C (100°F), as determined by the test procedures and apparatus set forth in Section 4.4 of NFPA 30. Combustible liquids are classified according to Section 4.3 of NFPA 30. [30, 2018]

3.3.8 Combustible Liquid Storage Area — Fixed. An area used for storage of Class II and Class III combustible liquids that is infrequently moved, and where the aggregate quantity present shall not exceed 18,925 L (5000 gal). Handling of liquids incidental to transfer can take place within a storage area.

3.3.9 Combustible Liquid Storage Area — Mobile. Self-propelled or mobile equipment fitted with suitable containers or tanks and other related fixtures used for the storage, transport, and dispensing of Class II and Class III combustible liquids. The aggregate quantity of combustible liquid carried on such equipment does not exceed 3785 L (1000 gal).

3.3.10 Combustible Liquid Storage Area — Portable. An area used for storage of Class II and Class III combustible liquids that is periodically moved, and where the aggregate quantity present does not exceed 3785 L (1000 gal). Handling of liquids incidental to transfer can take place within a storage area.

3.3.11 Combustion. A chemical process of oxidation that occurs at a rate fast enough to produce heat and usually light in the form of either a glow or flame. [5000, 2018]

3.3.12 Container. Any vessel of 450 L (119 gal) or less capacity used for transporting or storing liquids. [30, 2018]

3.3.13 Diesel-Powered Equipment. Any device powered by a diesel engine. [122, 2020]

3.3.14 Dry Pipe Sprinkler System. A sprinkler system employing automatic sprinklers that are attached to a piping system containing air or nitrogen under pressure, the release of which (as from the opening of a sprinkler) permits the water pressure to open a valve known as a dry pipe valve, and the water then flows into the piping system and out the opened sprinklers. [13, 2019]

3.3.15 Emergency Egress. An egress from a compartment or work station in emergencies when the normal egress is unusable.

3.3.16 Equipment Operator. The authorized person who starts, controls, or stops mining equipment.

3.3.17 Fire Detector. An automatic device designed to detect the presence of fire and initiate action. [122, 2020]

3.3.18 Fire-Resistant Construction. Masonry walls or equivalent having at least a 1-hour fire rating, including compressible materials having an equivalent fire resistance capability.

3.3.19 Fire-Resistant Enclosure. An enclosure that is constructed of fire-resistant construction.

3.3.20 Fire Risk Assessment. The evaluation of the relative danger of the start and spread of fire; the generation of smoke, gases, or toxic fumes; and the possibility of explosion or other

occurrence endangering the lives and safety of personnel or causing significant damage to property. [122, 2020]

3.3.21 Fixed Fire-Suppression System. An engineered or pre-engineered total flooding or local application system consisting of a fixed supply of extinguishing agent permanently connected for fixed agent distribution to fixed nozzles that are arranged to discharge an extinguishing agent into an enclosure (total flooding), directly onto a hazard (local application), or a combination of both; or an automatic sprinkler system. [122, 2020]

3.3.21.1 Engineered Systems. Engineered systems are those systems requiring individual calculation and design to determine the flow rates, nozzle pressures, pipe size, area, or volume protected by each nozzle, quantity of suppression agent, number and types of nozzles and their placement in a specific system.

3.3.21.2 Pre-Engineered Systems. Those systems having predetermined flow rates, nozzle pressures, and quantities of extinguishing agent and having specific pipe size, maximum and minimum pipe lengths, flexible-hose specifications, number of fittings, and number and types of nozzles. [17, 2017]

△ **3.3.22 Flammable Liquid.** Any liquid that has a closed-cup flash point below 37.8°C (100°F), as determined by the test procedures and apparatus set forth in Section 4.4 of NFPA 30, and a Reid vapor pressure that does not exceed an absolute pressure of 276 kPa (40 psi) at 37.8°C (100°F), as determined by ASTM D323, *Standard Test Method for Vapor Pressure of Petroleum Products (Reid Method)*. Flammable liquids are classified according to Section 4.3 of NFPA 30. [30, 2018]

3.3.23 Flammable Liquid Storage Area. Area used for storage of Class I liquids.

3.3.24 Flash Point. The minimum temperature of a liquid at which sufficient vapor is given off to form an ignitable mixture with the air, near the surface of the liquid or within the vessel used, as determined by the appropriate test procedure and apparatus specified in Section 4.4 of NFPA 30. [30, 2018]

3.3.25 Hand Hose Line System. A hose and nozzle assembly connected by fixed piping or connected directly to a supply of extinguishing agent. [122, 2020]

3.3.26 Hydrant. A valved hose connection.

3.3.27 Important Structures. A structure that is considered not expendable in an exposure fire.

3.3.28 Inby. A mining term that means in the direction of the face of the mine or further into the mine.

3.3.29 Intrinsically Safe. As applied to equipment and wiring, equipment and wiring that are incapable of releasing sufficient electrical energy under normal or abnormal conditions to cause ignition of a specific hazardous atmospheric mixture. [99, 2018]

3.3.30 Liquid. Any material that (1) has a fluidity greater than that of 300 penetration asphalt when tested in accordance with ASTM D5/D5M, *Standard Test Method for Penetration of Bituminous Materials*, or (2) is a viscous substance for which a specific melting point cannot be determined but that is determined to be a liquid in accordance ASTM D4359, *Standard Test Method for Determining Whether a Material is a Liquid or a Solid*. [30, 2018]

3.3.31 Low Pressure Tank. A storage tank designed to withstand an internal pressure above 3.5 kPa (0.5 psig) but not more than 102.4 kPa (15 psig).

3.3.32 Mine Operator. Any owner, lessee, or other person who operates, controls, or supervises a mine. [122, 2020]

3.3.33* Mobile Equipment. Wheeled, skid-mounted, track-mounted, or rail-mounted equipment capable of moving or being moved.

3.3.34* Noncombustible Material. A material that, in the form in which it is used and under the conditions anticipated, will not ignite, burn, support combustion, or release flammable vapors when subjected to fire or heat.

3.3.35 Normal Operation. The regular performance of those functions for which a machine or accessory is designed.

3.3.36 Operating Area. An area where mining of coal is taking place or area where construction is underway.

3.3.37 Outby. A mining term that means in the direction away from the face of the mine or toward the outside of the mine; opposite of inby.

3.3.38 Permissible Equipment. A completely assembled machine or accessory for which formal approval has been issued, allowing operation in a potentially explosive methane and air-mixture environment.

3.3.39 Pipeline System. An arrangement of piping, valves, connections, and allied equipment installed in a mine for the purpose of transporting, transferring, or dispensing flammable or combustible liquids. [122, 2020]

3.3.40 Portable Extinguisher. An extinguisher of the hand-held or wheeled type that is capable of being carried or moved about, or a transportable system consisting of a hose reel or rack, hose, and discharge nozzle assembly connected to a supply of suppressant.

3.3.41 Portable Tank. Any vessel having a liquid capacity over 230 L (60 gal) intended for storing liquids and not intended for fixed installation. [30, 2018]

△ **3.3.42 Pressure Vessel.** A container or other component designed in accordance with the ASME *Boiler and Pressure Vessel Code*. [52, 2019]

3.3.43 Rock Dust. Crushed limestone applied on surfaces in mines to make coal dust incombustible in the event of a gas explosion.

△ **3.3.44 Safety Can.** A listed container of not more than 20 L (5.3 gal) capacity having a screen or strainer in each fill and pour opening and having a spring-closing lid and spout cover designed to safely relieve internal pressure when exposed to fire. [30, 2018]

3.3.45 Self-Closing Doors. Doors that, when opened and released, return to the closed position. [80, 2019]

3.3.46 Self-Propelled Equipment. Any unit that contains a motive power train as an integral part of the unit.

3.3.47 Suitable. That which is appropriate and has the qualities or qualifications to meet a given purpose, occasion, condition, function, or circumstance. [122, 2020]

3.3.48 Tank. A closed vessel having a liquid capacity in excess of 227 L (60 gal). [122, 2020]

3.3.49 Task Trained. Instructed in the safety and health aspects and safe work procedures of the task prior to performing such tasks.

3.3.50 Unattended. Any machine or device that is not regularly operated by a miner or not in direct line of sight of a miner that is assigned within 152.4 m (500 ft) of the equipment during each production shift.

Chapter 4 Underground Mining Operations

4.1 General. This chapter shall cover minimum requirements for reducing loss of life and property from fire in underground coal mines.

4.2* Fire Prevention. Precautions shall be taken to prevent the ignition of flammable vapors and combustible materials.

4.2.1 Smoking materials, matches, and lighters shall not be allowed underground.

4.2.2 Rock Dusting. Rock dust shall be provided on the ribs, ceiling, and floor of the mine from the mine entry to the working face in all areas of the mine that are active (not sealed).

4.2.2.1 Rock dust shall be maintained at a concentration of 80 percent.

4.2.3 Cutting and Welding. Cutting and welding and compressed gas usage shall be in accordance with Section 7.1.

4.2.4 Housekeeping.

4.2.4.1 Maintenance and operating practices shall prevent the accidental release of flammable or combustible liquids.

4.2.4.2 A cleanup plan shall be established, implemented, and monitored to prevent the accumulation of loose coal and other combustible materials.

4.2.4.3 Where flammable or combustible liquids are used or handled, means shall be provided to dispose of leakage or spills.

4.2.4.4 Waste receptacles shall be provided for combustible refuse.

4.2.4.5 Routes designated for access to fire protection equipment shall be kept clear of obstructions.

4.2.5 Underground Maintenance Shops.

4.2.5.1* Underground maintenance shops that are intended for use longer than 6 months shall be enclosed structures of fire-resistant construction, including floor, roof, roof supports, doors, and door frames, or shall be protected with an automatic sprinkler fire suppression system in accordance with 4.3.3.3.

4.2.5.2 The shop area shall be ventilated directly to a return airway.

4.2.6* Belt Conveyors. Belt conveyors installed in underground coal mines shall, as a minimum, meet all the requirements of Section 9.4 of this standard.

4.2.7 Hydraulic Fluids.

4.2.7.1 Fire-resistant hydraulic fluid shall be approved by the authority having jurisdiction.

4.2.7.2 Unattended hydraulic equipment shall employ fire-resistant hydraulic fluid and be protected by an automatic fire suppression system.

4.2.7.3 Where fire-resistant fluids are required, samples of in-use fire-resistant fluids of the invert emulsion type shall be collected quarterly.

4.2.7.3.1 Samples of the in-use fire-resistant fluids shall be tested individually to determine if the water content will make the fluid fire resistant.

4.2.7.3.2 When a sample of the in-use fire-resistant fluids indicates that the water content is insufficient for the fluid to be fire resistant, the fluid shall be replaced or water shall be added to restore the fire resistance of the fluid.

4.2.7.3.3 When water is added to the hydraulic system of any machine, a sample shall be taken and analyzed within 24 hours.

4.2.8 Flammable Liquids Storage and Use. The storage and use of flammable liquids underground shall conform to Section 7.5.

4.2.9 Combustible Liquids Storage and Use. The storage and use of combustible liquids underground shall conform to Section 7.6.

4.2.10 Methane Control. Methane within the coal mine shall be reduced to not more than 1 percent on the intake air and 2 percent on the return air.

4.2.10.1 Methane monitors shall be provided on equipment used to cut coal from the face.

4.2.10.1.1 The methane monitors shall alarm at 1 percent concentration and be interlocked to shut down the machine at a 2 percent concentration of methane.

4.2.11* Spontaneous Combustion.

4.2.11.1 Mine operators shall determine the spontaneous combustion potential of the coal being mined.

4.2.11.2* Mines with a high spontaneous combustion potential shall take means to minimize the spontaneous combustion risk.

N 4.2.12 Liquid-Filled Transformers.

N 4.2.12.1* Transformers with mineral oil or other combustible coolants shall not be installed underground.

N 4.2.12.2 An oil analysis, including dissolved gas, shall be conducted on combustible oil-filled transformers that are located on the surface based on the manufacturer's recommendations or on ANSI/NETA MTS, *Standard for Maintenance Testing Specifications for Electrical Power Distribution Equipment and Systems*, whichever is more stringent.

N 4.2.13* Thermographic Scanning. Thermographic scanning shall be performed on surface switchgear and motor starters supplying the underground electrical system on an annual basis.

4.3* Fire Protection.

4.3.1 Water Supply for Mine Fire Protection.

4.3.1.1 General Requirements.

4.3.1.1.1* Water distribution lines shall extend from the surface to each operating area.

4.3.1.1.2 Water distribution lines from a suitable underground supply of water shall be permitted to replace the surface distribution lines if sufficient quantity is available and power for the pump(s) will not be affected or interrupted during a fire.

4.3.1.1.3 The operator shall choose the entry in which the water line is located, and it shall be protected by the choice of location.

4.3.1.1.4 Water flow and ventilation airflow shall be in the same direction unless provision is made to ensure the availability of fire-fighting water on the upwind side of a fire in the entry containing the water line.

4.3.1.1.5 Where applicable, water lines shall be protected against freezing.

4.3.1.1.6 Water lines that are 50 mm (2 in.) or larger in diameter shall be joined with flanges, mechanical grooved fittings, threaded fittings, or other fittings.

4.3.1.1.7 At least every third joint shall be capable of allowing limited motion and emergency rearrangement.

4.3.1.1.8 Pipe and fittings shall be of metal construction and designed to withstand the anticipated water pressure.

4.3.1.1.9* Water lines shall be equipped with shutoff valves at intervals not exceeding 1524 m (5000 ft).

4.3.1.1.10 A shutoff valve shall be provided in each branch line at the point where it is coupled to the main water line.

4.3.1.1.10.1 Shutoff valves for fire protection shall be sealed, locked, or supervised in the open position.

4.3.1.2 Water Demand.

4.3.1.2.1* All coal mine water systems shall be capable of simultaneously supplying three hose streams, each with a flow rate of at least 190 L/min (50 gpm), and a nozzle pressure of at least a gauge pressure of 345 kPa (50 psi) for a total of 570 L/min (150 gpm), applied through the maximum expected lay of hose.

4.3.1.2.2* The mine water system shall be capable of supplying the required hose stream water demand continuously for 24 hours or the sprinkler water demand continuously for 2 hours, whichever is the greater supply.

4.3.1.3 Hydrants.

4.3.1.3.1* The mine operator shall choose the entry in which hydrants are to be located, except for belt conveyor entries where hydrants shall be located in the same entry as the belt, locate personnel doors, and provide fire hose that reaches parallel entries where risk of fires exists.

4.3.1.3.2* Hydrants that supply water to a fire hose shall be provided on the water line at intervals not exceeding 91.4 m (300 ft) for belt conveyors and 152.4 m (500 ft) for haulage tracks.

4.3.1.3.3 Hydrants shall be located in the belt entry and accessible.

4.3.1.3.3.1 If staggered crosscuts are used, hydrant locations and crosscuts with personnel doors shall be located to provide a route for laying a fire hose to parallel entries.

4.3.1.3.3.2 At least one hydrant shall be located upwind of the area protected by an automatic sprinkler system.

4.3.1.4 Maintenance. The water supply system shall be maintained operable.

4.3.2* Protective Signaling Fire Detection Systems.

4.3.2.1 General Requirements.

4.3.2.1.1* The design and installation of all fire detection systems shall be approved for the intended use.

4.3.2.1.2 Fire detectors and related signaling system components used to initiate an audible or visual alarm, automatic activation of a fire suppression system, or equipment shutdown shall be listed or approved for the intended use.

4.3.2.1.3* Signaling system input, alarm, and releasing circuits shall be supervised.

4.3.2.1.3.1 The presence of a fault, alarm, or release shall initiate a signal in the protected area and remotely in a constantly attended location.

4.3.2.1.3.2 The signal specified in 4.3.2.1.3.1 shall indicate which condition has occurred.

4.3.2.1.3.3 A trouble signal shall not be required when the main power supply is intentionally shut off during periods of mine inactivity.

4.3.2.1.4* All components of protective signaling systems used in by the last open crosscut or in return air shall be classified as permissible or intrinsically safe.

4.3.2.2 Selection and Application.

4.3.2.2.1* Carbon monoxide (CO) detectors or the equivalent shall be installed along all belt conveyors and at all unattended automatic belt heads (where mine cars are loaded automatically).

4.3.2.2.2* Compartment sizes and contours, airflow patterns, obstructions, and other characteristics of the protected area shall determine the placement, type, sensitivity, and, where applicable, number of detectors.

4.3.2.2.3 The fire alarm shall identify a fire within each belt flight (segment).

4.3.2.2.4 Fire detection systems shall be installed so as to minimize the possibility of damage from roof falls and from the moving belt and its load.

4.3.2.2.5 The voltage of automatic fire alarm systems shall not exceed 120 volts.

4.3.2.2.6 The system shall be designed to provide an alarm up to 4 hours after the source of power to the belt is shut off.

4.3.2.2.7 An audible and visual alarm shall be provided either at the location of the belt or at a constantly attended location that has a telephone or equivalent communication with those miners who might be endangered.

4.3.2.2.8 The alarm system shall be equipped with a “trouble” signal to indicate open circuits, shorts, ground faults, or any other defects.

4.3.2.2.9 The alarm system shall include a manual reset feature.

N 4.3.2.2.10* Electrical equipment buildings and rooms on the surface that are critical to underground operations shall be provided with a smoke detection system.

N 4.3.2.2.10.1 The smoke detection system shall report to a constantly attended location.

N 4.3.2.2.10.2 Fire alarm systems shall be installed in accordance with *NFPA 72*.

4.3.2.3 Inspection, Maintenance, and Testing.

4.3.2.3.1 Fire detection systems and associated equipment shall be tested after installation according to the manufacturer’s or designer’s instruction manual.

4.3.2.3.2 The detection system shall be inspected visually weekly.

4.3.2.3.3 Carbon monoxide detection systems shall be visually inspected daily, functionally tested weekly, and calibrated monthly, not to exceed 31 days between calibrations.

N 4.3.2.3.4 Fire detection systems installed in surface structures shall be inspected in accordance with *NFPA 72*.

4.3.3 Fire Protection Systems.

4.3.3.1 General Requirements.

4.3.3.1.1 Mining equipment requiring a fixed fire protection system shall be protected by a system with the capacity to suppress the largest anticipated fires in the protected areas and shall meet the following criteria:

- (1) They shall be listed or approved for the purpose.
- (2) They shall be located or guarded so as to be protected against physical damage.
- (3)* They shall be actuated either automatically, manually, or both.
- (4)* They shall be provided with an agent distribution hose or pipe secured and protected against damage, including abrasion and corrosion, and shall be flame resistant.
- (5) They shall be provided with discharge nozzle blowoff caps or other devices or materials to prevent the entrance of moisture, dirt, or other material into the piping. The discharge nozzle protective device shall blow off, blow out, or open upon agent discharge.
- (6)* Water-based systems shall not be required to have nozzle blowoff caps as long as the nozzles are kept free of blockage at all times.
- (7) The fire protection system shall be installed so that system actuation causes shutdown of the protected equipment.
- (8) Discharge nozzles or sprinklers shall not be covered with any material that will reduce the effectiveness of the system.

4.3.3.1.2 Automatically actuated systems other than water-based sprinkler systems shall have a manual actuator capable of being activated from the operator’s compartment or other accessible location.

4.3.3.1.3 Unless otherwise noted in this standard, fire protection systems shall be installed and operate in accordance with the applicable NFPA standard.

4.3.3.1.3.1 Pre-engineered systems shall be designed, installed, and tested in accordance with the fire suppression system manufacturer’s listed installation and maintenance manual.

4.3.3.1.4* Where the nature of a coal mine does not allow the NFPA standards to be followed, systems that provide equivalent protection shall be approved by the authority having jurisdiction.

Δ 4.3.3.2 Applications.

Δ 4.3.3.2.1* Equipment and Facilities.

Δ 4.3.3.2.1.1 Equipment and facilities shall be protected in accordance with the following requirements:

- (1)* Drive areas of belt conveyors shall be protected in accordance with 9.4.6.
- (2) Flammable and combustible liquid storage areas shall be protected in either of the following fashions:
 - (a) Automatic water-based fixed fire protection systems installed for the protection of Class I or Class II liquid storage areas shall be of the Class B foam-water type.
 - (b) Fixed diesel or other Class II combustible liquid storage areas shall be protected with a dry chemical system or a system that provides equivalent protection according to the authority having jurisdiction.
- (3) Unattended hydraulic equipment shall use fire-resistant hydraulic fluid.
- (4) Unattended electrical equipment such as enclosed electric motors, controls, transformers, rectifiers, battery chargers, and other equipment that does not have a hydraulic system shall be protected by an approved automatic fire protection system.

N (A) Unattended electrical equipment located on noncombustible material and spaced at least 0.61 m (2 ft) from coal or other combustible material shall not be required to be protected with an automatic fire suppression system.

N (B) Unattended electrical equipment located on noncombustible material and separated from coal or other combustible material by a fire-resistive layer or wall shall not be required to be protected with an automatic fire suppression system.

N 4.3.3.2.1.2 Sprinkler systems used to protect the equipment and facilities listed in 4.3.3.2.1.1 shall satisfy the requirements of 4.3.3.3 through 4.3.3.5.4.

N 4.3.3.2.1.3 Dry or wet chemical systems used to protect the equipment and facilities listed in 4.3.3.2.1.1 shall satisfy the requirements for self-propelled equipment in 4.3.3.6.1.

4.3.3.2.2* Air Compressors. Air compressors with motors that exceed 5 horsepower shall be protected by an approved automatic fire protection system interlocked to shut down the power to the compressor and by one of the following:

- (1) A person in constant attendance, within the line of sight of the compressor, and equipped with a portable fire extinguisher
- (2) Containment within an enclosure that is constructed of noncombustible materials, ventilated to prevent overheat-

ing of the compressor, and designed to provide containment of any possible fire involving the compressor

4.3.3.3 Sprinkler System Requirements.

4.3.3.3.1* Water Supply. The water supply shall have enough pressure and flow to provide sprinkler coverage as the sprinkler design is intended.

4.3.3.3.1.1 An approved strainer with a flush-out connection and a manual shutoff valve shall be provided at the point of the sprinkler system connection to the main water line.

4.3.3.3.1.2 An indicating, full-flow, slow-opening water control valve shall be located at the tap of the water line supplying the sprinkler system.

4.3.3.3.1.3 When the sprinkler system is put into operation, the slow-opening valve specified in 4.3.3.3.1.2 shall be sealed or locked in the open position, or be provided with a supervisory alarm.

4.3.3.3.1.4 A pressure gauge shall be provided at the point of connection.

4.3.3.3.1.5 The water line from the water main to the sprinkler system shall be metallic.

4.3.3.3.1.6 The water line from the water main to the sprinkler system of a belt drive shall be flexible metal or reinforced nonmetal if excessive vibration could reduce the reliability of the sprinkler system.

4.3.3.3.1.7 Fittings and piping shall have a rated pressure higher than the anticipated maximum pressure on the system.

4.3.3.3.2 General Installation Requirements.

4.3.3.3.2.1* Piping in sprinkler systems shall comply with NFPA 13.

4.3.3.3.2.2 Nonmetallic pipe shall not be used downstream of the sprinkler control valve unless investigated and approved for this purpose.

4.3.3.3.2.3 Hangers supporting sprinkler piping shall be metallic.

4.3.3.3.2.4 At least one hanger shall be attached to each length of pipe.

4.3.3.3.2.5* Sprinklers shall be standard orifice pendent, upright, or sidewall-type automatic sprinklers.

4.3.3.3.2.6* For sprinkler systems installed to protect the equipment and facilities indicated in 4.3.3.2.1.1(2) through 4.3.3.2.1.1(4), 4.3.3.2.1.1(A), and 4.3.3.2.1.1(B), sprinklers shall be spaced no more than 3.66 m (12 ft) apart, and the protection of any one sprinkler shall not exceed 9.3 m² (100 ft²).

4.3.3.3.2.7* Sprinklers shall be located so that the discharge will not be obstructed.

4.3.3.3.2.8 Sprinkler deflectors shall be located at a distance below the roof of not less than 25.4 mm (1 in.) nor greater than 508 mm (20 in.).

4.3.3.3.2.9 Roof cavities containing combustible material such as wood or coal in the area to be protected shall be protected by installation of upright sprinklers within the cavity at the top

of riser pipes so that the deflectors are within 508 mm (20 in.) of the roof.

4.3.3.3.2.10 Wet-pipe sprinkler systems shall not be used where chance of freezing exists.

4.3.3.3.2.11 Provisions shall be made to drain all parts of the system.

4.3.3.3.2.12 Drain connections shall be sized as shown in Table 4.3.3.3.2.12.

4.3.3.3.2.13 Trapped piping sections shall be equipped with auxiliary drains or otherwise arranged to facilitate draining.

4.3.3.3.3 General Alarm Requirements for Sprinkler Systems.

4.3.3.3.3.1 A waterflow switch or alarm valve capable of detecting the flow through one opened sprinkler shall be installed in the piping feeding the sprinklers.

(A) An inspector's test connection shall be provided at the end of the most remote line of the sprinkler system.

(B) The inspector's test connection shall simulate the operation of a single sprinkler for sprinkler systems other than belt drive systems.

(C) In addition to 4.3.3.3.3.1(B), the inspector's test connection for belt drive systems shall simulate a minimum of eight sprinklers activating at the same time.

4.3.3.3.3.2 The alarm device shall be connected to an alarm system that will alarm at a constantly attended location. The alarm device shall provide a local audible and visual alarm.

4.3.3.3.3.3 The alarm system shall identify the sprinkler system involved.

4.3.3.3.3.4 In dry-pipe automatic sprinkler systems, the alarm system shall be actuated by a pressure switch associated with the trim on the dry-pipe device.

4.3.3.3.3.5 A paddle-type water flow switch shall be installed in wet systems only.

4.3.3.3.4 Antifreeze System. Where danger of freezing exists, sprinkler systems filled with antifreeze solution shall be permitted and shall meet the requirements of 7.6.2 and 7.6.3 of NFPA 13.

4.3.3.3.5* Dry-Pipe System. Where danger of freezing exists, a dry-pipe sprinkler system shall be permitted and shall meet the requirements of 4.3.3.3.5.1 through 4.3.3.3.5.7.

4.3.3.3.5.1 The dry-pipe valve and its accessories shall be installed in a separate area and shall be protected against freezing and mechanical injury.

4.3.3.3.5.2 If the separate area described in 4.3.3.3.5.1 is ventilated with return air, all electrical components shall be permissible or intrinsically safe.

Table 4.3.3.3.2.12 Sizes of Drain Connections

| Riser or Main Size | Size of Drain Connection |
|--------------------|--------------------------|
| Up to 2 in. | ¾ in. or larger |
| 2½ in. to 3½ in. | 1¼ in. or larger |
| 4 in. and larger | 2 in. only |

For SI units, 1 in. = 25.4 mm.

4.3.3.3.5.3 Water pressure shall be regulated not to exceed the maximum pressure specified by the manufacturer of the dry-pipe valve.

4.3.3.3.5.4 The dry-pipe valve shall be installed in accordance with the manufacturer's instructions.

4.3.3.3.5.5 Mechanical grooved couplings, including gaskets used on dry-pipe systems, shall be listed for dry-pipe service.

4.3.3.3.5.6 Operation of the dry-pipe system and supervision of the system, including pressure of the air supply, shall be signaled to an attended location. Signaling to an attended location shall be permitted to utilize alarm systems serving fire detection equipment.

4.3.3.3.5.7 The system air supply shall be provided from a reliable source such as a dedicated compressor and shall be equipped with an air maintenance device.

4.3.3.3.5.8 Sprinklers shall be installed in the upright position on a dry-pipe system or be listed dry type or horizontal sidewall sprinklers installed according to the listing for dry-pipe systems.

4.3.3.3.6 Protection of Specific Hazards.

4.3.3.3.6.1* Automatic water-based fixed fire protection systems installed for the protection of Class I or Class II liquid storage areas shall be of the foam-water type.

4.3.3.3.6.2* Where the requirements of 9.4.6 dealing with underground belt drives are satisfied by installing automatic sprinkler systems, such systems shall comply with the requirements of 4.3.3.3.1.2 and 4.3.3.3.1.3.

4.3.3.4 Automatic Sprinkler System Acceptance Testing.

4.3.3.4.1 Flushing of Water-Line Connections.

4.3.3.4.1.1 Water-line connections and lead-in connections shall be flushed at the maximum flow rate available before connection is made to the sprinkler piping in order to remove foreign material.

4.3.3.4.1.2 Flushing shall be continued until the water is clear.

4.3.3.4.2 Flow Testing of Sprinkler Systems.

Δ 4.3.3.4.2.1 Wet-pipe closed automatic sprinkler systems shall be flow-tested by operating flow through at least one sprinkler for non-belt drive areas and at least eight **sprinklers** for belt drive areas.

4.3.3.4.2.2 If the system contains fewer than eight sprinklers, all sprinklers or an inspector's test simulating all sprinklers shall be flow-tested as specified in 4.3.3.4.2.1.

4.3.3.4.2.3 With a water flow and pressure that is present under normal mine operating conditions, if the residual pressure measured downstream of the opened sprinklers is 70 kPa (10 psi) or greater for belt drive systems and 140 kPa (20 psi) for all other systems, the system shall be considered acceptable.

4.3.3.4.2.4 Closed sprinkler systems installed to protect areas where the water discharge could damage the area or its contents shall not be required to be tested by operating flow through opened sprinklers.

4.3.3.4.2.5 Where the condition(s) in 4.3.3.4.2.4 exist, the alternative test of operating flow through a 51 mm (2 in.) valve test connection shall be permitted to be used.

4.3.3.4.2.6 Portable sprinkler systems that are dismantled and reinstalled in new areas shall be flow-tested following the initial installation.

4.3.3.4.3 Tests of Dry-Pipe Sprinkler Systems.

4.3.3.4.3.1 Where there is no risk of freezing, new dry-pipe systems shall be flow-tested and hydrostatically tested in accordance with NFPA 13.

4.3.3.4.3.2 A dry-pipe valve shall be tested according to the manufacturer's recommendations.

4.3.3.4.3.3* Where there is risk of freezing in dry-pipe systems, an air pressure of 276 kPa (40 psi) shall be pumped up and allowed to stand 24 hours, and all leaks that allow a loss of pressure over 10.3 kPa (1½ psi) during the 24 hours shall be stopped.

4.3.3.5 Inspection, Maintenance, and Testing.

4.3.3.5.1 All fire suppression systems shall be tested after installation in accordance with the appropriate NFPA standard.

4.3.3.5.2 If an applicable NFPA standard does not exist, then a fire suppression system shall be tested in accordance with the manufacturer's or designer's instruction manual.

4.3.3.5.3 Testing shall not require the discharge of suppressant unless there is no other satisfactory manner in which the reliability and integrity of the system can be verified.

4.3.3.5.4* All persons who inspect, test, operate, or maintain fire suppression systems shall be trained.

4.3.3.5.5 Sprinkler System Maintenance.

4.3.3.5.5.1 All sprinkler systems shall be maintained in accordance with the manufacturer's requirements or in accordance with NFPA 25.

4.3.3.5.5.2* As a minimum, all closed-head sprinkler systems, except antifreeze systems, shall be flushed annually by operating flow through the end of the line drain(s) for the system to remove any silt buildup.

(A) If pendent sprinklers are used on wet-type sprinkler systems, the end sprinkler on each line shall be removed and examined annually to check for silt buildup.

(B) If silt buildup is found, all sprinklers on the line shall be removed, the line flushed, and new sprinklers installed.

4.3.3.5.5.3* As a minimum, deluge sprinklers and deluge water-spray systems shall be flow-tested on a monthly basis.

4.3.3.5.5.4 The strainer shall be flushed on a weekly basis, at a minimum.

4.3.3.5.6 Antifreeze Systems.

(A) Each year at the onset of freezing weather, a small amount of antifreeze shall be drawn from the drain valve and the test valve(s) and tested with a hydrometer to ensure that the solution is suitable for the lowest temperature expected.

(B) If the test described in 4.3.3.5.6(A) shows that the solution is not suitable, the solution shall be replaced.

4.3.3.6 Fire Suppression for Self-Propelled Equipment.

4.3.3.6.1* Fire suppression systems consisting of an agent container and a network of agent distribution hose or pipe with

discharge nozzles attached shall be used to protect self-propelled equipment and shall comply with the following:

- (1) The system shall suppress any potential fire on the equipment it is intended to protect.
- (2) The fire suppression system shall be approved for the purpose, and the components shall be located or guarded to protect against damage.
- (3) Fire suppression systems shall be actuated automatically, manually, or both.
- (4) Automatically actuated systems designed to incorporate manual actuation shall be equipped with one or more such devices accessible for actuation and shall be maintained in operable condition.
- (5) Discharge nozzles shall be provided with blow-off caps or other devices to prevent the entrance of moisture or other environmental materials into the piping.
- (6) The protective device shall blow off, blow out, or open upon agent discharge.
- (7) The electrical components of systems installed on equipment that might be operated in the last open crosscut or in return air shall be permissible.
- (8) A standby source of power shall be provided if electrical power is the only means of actuation.
- (9) All fire suppression equipment and systems shall be tested after installation in accordance with the manufacturer's or designer's recommendations.
- (10) Testing shall not require the discharge of agent unless there is no other feasible way to evaluate the system.
- (11)* An owner's or operations manual shall be provided for all fire suppression systems.
- (12)* Fire suppression systems shall be inspected and maintained in accordance with the appropriate NFPA standard.

4.3.3.6.2* Fire suppression systems shall be provided for protection of attended, electrically powered, self-propelled equipment such as cutting machines, continuous miners, shearers, roof and coal drills, loaders, shuttle cars, scoops, and locomotives that use hydraulic fluid, unless fire-resistant hydraulic fluid is used.

4.3.3.6.3 Cutting machines, continuous miners, shearers, and other machines that supply water through a hose for dust control during mining shall be permitted to use this water source for fire protection, provided a diversion valve is at or outby the operator's station to permit quick and convenient diversion of water to the fire suppression nozzles.

4.3.4 Manual Fire Fighting.

4.3.4.1 Portable Fire Extinguishers.

4.3.4.1.1 General Requirements.

4.3.4.1.1.1* Portable fire extinguishers used in underground coal mines shall be listed, multipurpose (ABC) dry chemical types having a minimum nominal capacity of 4.6 kg (10 lb) of extinguishing agent, and shall meet the requirements of NFPA 10.

4.3.4.1.1.2 Portable extinguishers shall be kept in their designated places.

4.3.4.1.1.3 Extinguishers shall be located where they will be accessible in the event of fire.

4.3.4.1.1.4 In areas where visual obstruction cannot be completely avoided, visible markings shall be provided to indicate the location.

4.3.4.1.1.5 Extinguishers subject to dislodgment shall be installed in brackets specifically designed for this problem.

4.3.4.1.1.6 Extinguishers shall be protected from physical damage.

4.3.4.1.1.7 Damaged extinguishers shall be repaired, replaced, or removed from service.

4.3.4.1.1.8 At least one hand-portable fire extinguisher having a nominal capacity of 9.1 kg (20 lb) with a minimum rating of 10-A:60-B:C shall be located outside of, but not more than 3.0 m (10 ft) from, the opening into each flammable and combustible storage area and maintenance shop.

4.3.4.1.1.9 The installation of manual or automatic fire suppression systems shall not waive the requirement of 4.3.4.1.1.8.

4.3.4.1.1.10 Where portable fire extinguishers are provided within flammable and combustible storage areas, travel distance to a portable extinguisher shall not exceed 12.2 m (40 ft).

4.3.4.1.2 Selection and Application.

4.3.4.1.2.1 Multipurpose (ABC) dry chemical extinguishers shall be provided for protection of the following:

- (1) Ventilation doors on trolley wire-supplied track haulage-ways
- (2) Pumps and pump rooms
- (3) Conveyor belt drives
- (4) Belt head loading equipment
- (5) Air compressors
- (6) Electrical equipment such as transformers, load centers, rectifiers, circuit breakers, generators, and starters
- (7) Rotary dump areas
- (8) Battery-charging areas
- (9) Intervals of 23 m (75 ft) along a longwall face unless washdown hose is present
- (10) Flammable and combustible liquid storage areas
- (11) Mobile equipment used for the storage, transport, and dispensing of combustible liquids
- (12) Electric- or diesel-powered mobile equipment
- (13) Self-propelled equipment

4.3.4.1.2.2 The installation of an automatic or manually operated fire suppression system shall not eliminate the requirement for a portable fire extinguisher.

4.3.4.1.2.3* At least one multipurpose (ABC) dry chemical extinguisher having a nominal capacity of 13.6 kg (30 lb) or greater of agent or two multipurpose (ABC) dry chemical extinguishers having a nominal capacity of 9.1 kg (20 lb) or greater of agent each shall be provided in each working section of a mine, including the headgate of a longwall face.

4.3.4.1.3 Inspection and Maintenance.

4.3.4.1.3.1 Portable fire extinguishers shall be inspected, maintained, and recharged as specified in Chapter 7 of NFPA 10 and shall include the requirements of 4.3.4.1.3.2 through 4.3.4.1.3.9.

4.3.4.1.3.2* Visual Inspection.

(A) Portable fire extinguishers shall be inspected visually at least monthly.

(B) The visual inspection shall confirm the following:

- (1) The extinguisher is in its designated place.
- (2) The tamper seals are intact.
- (3) The extinguisher gauge is in the operable range (if extinguisher is stored pressure type).
- (4) There is no obvious physical damage or condition to prevent operation.

4.3.4.1.3.3 Extinguishers shall be subjected to a thorough maintenance examination at least once every 12 months.

4.3.4.1.3.4 Maintenance procedures shall include a thorough examination of the extinguisher, including mechanical parts, extinguishing agent, and the means of expulsion.

4.3.4.1.3.5 Any detected troubles or impairments shall be corrected or replaced immediately by competent personnel.

4.3.4.1.3.6 Each extinguisher shall have a durable tag or label securely attached on which the date of the maintenance services shall be recorded.

4.3.4.1.3.7 All extinguishers shall be recharged after any discharge.

4.3.4.1.3.8 All extinguishers shall be recharged as deemed necessary through inspection and maintenance.

4.3.4.1.3.9 Portable extinguishers shall be hydrostatically tested at intervals not exceeding those specified in **Chapter 8 of NFPA 10**.

4.3.4.2 Hand Hose Line Systems.**4.3.4.2.1 Selection and Application.**

4.3.4.2.1.1* Fire hose for use in underground coal mines shall be a minimum of 38 mm (1½ in.) in diameter, single or multi-jacket, and of a type suitable for coal mine use.

4.3.4.2.1.2 The hose shall meet the minimum applicable standards of NFPA 1961.

4.3.4.2.1.3 Hose lines employing natural fibers shall not be used in underground coal mines.

4.3.4.2.1.4* Fire hose, including couplings, shall be rated for the maximum line pressure that can exist on the mine water system, or there shall be provision for limiting the line pressure to the working pressure of the hose.

4.3.4.2.1.5 Nozzle flow pressure shall be adjusted to provide hose control.

4.3.4.2.1.6* Couplings for fire hose used in underground coal mines shall have straight, iron pipe threads or National Standard Thread.

4.3.4.2.1.7 Where hose or hose-connected equipment is brought in from outside the mine, compatible adapters shall be available.

4.3.4.2.1.8 Hose nozzles shall be capable of delivering a straight stream and a spray discharge.

4.3.4.2.1.9* Fire hose shall be stored in caches, and caches shall contain hose to reach all areas covered by the hydrants that the cache will serve.

4.3.4.2.1.10 Each cache shall contain at least one hose nozzle and one hose wrench.

4.3.4.2.1.11* Caches of fire hose shall be provided at strategic underground locations as follows:

- (1) At each intersection with an active submain
- (2) At the mouth of each panel
- (3) At and on the intake side of each conveyor belt drive
- (4) At the entrance to each shop and storage area as defined in 4.2.5, 4.2.8, and 4.2.9
- (5) In each operating area
- (6) At intervals not to exceed 1524 m (5000 ft) along the main haul route or travelway

4.3.4.2.1.12 Hand hose line systems, if used, shall be installed in accordance with NFPA 14 and shall be a minimum of either 38 mm (1½ in.) lined or 25.4 mm (1 in.) hard rubber.

4.3.4.2.1.13 Hand hose lines that are designated for fire fighting and that have the capability to be used in Class I or Class II liquid storage areas shall be equipped to discharge a foam-water solution and shall be in accordance with the applicable sections of NFPA 11.

4.3.4.2.2* Maintenance. Caches of fire hose shall be checked at least every 6 months to ensure that the inventory of hose, nozzles, wrenches, and adapters is complete, and the following requirements shall apply:

- (1) At least one length of hose from each cache shall be pressure-tested annually in accordance with NFPA 1962.
- (2) The tested hose shall be tagged and dated so that a different length of hose is tested each year.
- (3) If any length of hose fails the pressure test, all lengths of hose in the cache shall be tested.
- (4) Hose lines that fail the test shall be replaced.

4.3.4.3 Portable Foam-Generating Devices.**4.3.4.3.1 General Requirements.**

4.3.4.3.1.1 Portable foam generators, fire hose, foam concentrate, and emergency fire-fighting materials in accordance with 4.3.4.5 shall be accessible within 60 minutes of fire notification.

4.3.4.3.1.2 Portable foam-generating devices and associated equipment shall be listed or approved for that purpose.

4.3.4.3.2 High-Expansion Foam.

4.3.4.3.2.1 Where high-expansion foam is used, provision shall be made to supply uncontaminated air for foam making.

4.3.4.3.2.2 The foam system shall be tested with the water supply to determine the quality of the foam-making capabilities.

4.3.4.3.3 Maintenance.

4.3.4.3.3.1 At least annually, a thorough maintenance examination of the foam-generating devices and associated equipment, including foam concentrate, shall be made by the mine operator.

4.3.4.3.3.2 Operation of foam-generating equipment during training sessions conducted at least annually shall satisfy the maintenance examination requirement.

4.3.4.4 Rock Dust.

4.3.4.4.1 At least 109 kg (240 lb) of bagged, dry rock dust shall be stored upwind and kept available for fire fighting at or near the following areas:

- (1) Maintenance and shop areas
- (2) Combustible liquid storage area
- (3) Working section
- (4) Belt drive area
- (5) Belt-head loading area
- (6) Ventilation doors on trolley wire-supplied track haulage-ways

4.3.4.4.2 Where it is impractical to store for fire extinguishment purposes, rock dust shall be permitted to be replaced with an additional portable extinguisher having a nominal capacity of 4.5 kg (10 lb) of multipurpose (ABC) dry chemical extinguishing agent.

4.3.4.5 Emergency Materials.

4.3.4.5.1 Emergency materials for fighting mine fires shall be near the shaft bottom or other entrance to the mine.

4.3.4.5.2 If the shaft bottom or other entrance to the mine is more than 3.2 km (2 mi) from a working section, additional caches of emergency materials shall be located within 3.2 km (2 mi) of the working section.

4.3.4.5.3 Emergency materials shall include fire hose and necessary adapters, multiple hydrants, wrenches and nozzles, brattice boards and cloth, wood posts, cap pieces, wood wedges, spad guns and spads, or other specialized equipment for installing line brattice, nails, bags of sealant or cement, saws, hammers, axes, shovels, and picks.

4.3.4.5.4 Caches of emergency materials shall be checked at least every 6 months to ensure that the inventory of materials is complete.

4.3.4.6* Training.

4.3.4.6.1 All miners shall be instructed annually in fire prevention and fire-fighting techniques.

4.3.4.6.2 All employees shall be instructed in emergency evacuation procedures.

4.3.4.6.3 All persons who inspect, test, operate, or maintain fire suppression systems shall be trained in the functions they are to perform.

Chapter 5 Surface Mining Operations

5.1 General. This chapter shall cover surface bituminous and subbituminous coal and lignite mining operations.

5.2* Fire Prevention. Risk reduction practices shall follow the principles of minimizing ignition sources and reducing exposure of combustible materials to ignition sources.

5.2.1 Housekeeping.

5.2.1.1 Spills, leaks, excess lubricants, and combustible materials such as oil-soaked wastes, rubbish, and accumulations of environmental debris shall not be allowed to accumulate in quantities that could create a fire hazard.

5.2.1.2 Approved metal receptacles shall be provided where oil-soaked wastes or rubbish are not immediately removed to a safe place for disposal.

5.2.1.3 The storage and handling of flammable or combustible liquids on or within equipment shall be in accordance with NFPA 30.

5.2.1.4 Access to fire protection equipment on mining equipment shall be kept clear of obstructions.

5.2.2 Inspection and Maintenance of Equipment. Hydraulic, coolant, lubrication and fuel lines, and electrical wiring shall be inspected and maintained in accordance with the manufacturers' recommendations.

5.2.3 Flammable and Combustible Liquid Storage on Equipment and in Buildings. Flammable and combustible liquid storage and usage shall be in accordance with Sections 7.3 and 7.4.

5.2.4 Compressed Gas Storage and Usage. Compressed gas storage and usage shall be in accordance with Section 7.1.

5.3 Fire Protection.

5.3.1 Fire protection for the purposes of this standard shall be defined in the broad sense to include fire detection and fire suppression.

5.3.2* Fire suppression system types shall include dry chemical, wet chemical, gaseous, water mist, foam, and sprinkler.

5.3.3 Fire suppression systems and fire alarm systems shall be installed in accordance with applicable NFPA standards.

5.3.3.1 Fire suppression systems shall be tested and maintained in accordance with the appropriate NFPA standard.

5.3.3.2 **Water Supplies.** Fire suppression water supply shall be of sufficient quantity to extinguish the largest anticipated fire. This shall be accomplished with water trucks in pit areas or fire hydrants in coal processing areas.

5.3.4 Fire Extinguishers for Equipment.

5.3.4.1* A 9.1 kg (20 lb) ABC-type fire extinguisher shall be provided at intervals not to exceed 15.2 m (50 ft) travel distance, including the lower frame areas of draglines.

5.3.4.2 The fire-extinguishing agent applied by hand-portable extinguishers to hazards involving energized electrical equipment shall be nonconductive.

5.3.4.3 Portable extinguishers shall be maintained in accordance with NFPA 10 and kept in their designated places at all times.

5.3.4.4 Extinguishers shall be located on each vehicle and shall be accessible.

5.3.4.5 In areas where obstruction to visual observation cannot be completely avoided, visible markings shall be provided to indicate the location of the fire extinguishers.

5.3.4.6 Extinguishers installed under conditions where they can be subject to physical damage shall be guarded to protect against damage.

5.3.4.7 The installation of an automatic or manually operated fire suppression system shall not eliminate the portable fire extinguisher requirement.

5.3.4.8 Portable fire extinguishers shall be inspected, maintained, and recharged as specified in Chapter 7 of NFPA 10 and the following:

- (1) Portable fire extinguishers shall be inspected visually at least monthly.
- (2) The visual inspection shall ensure the following:
 - (a) The extinguisher is in its designated place.
 - (b) The tamper seals are intact.
 - (c) The extinguisher gauge is in the operable range (if the extinguisher is the stored-pressure type).
 - (d) There is no obvious physical damage or condition that will prevent proper operation.
- (3) Extinguishers found to be defective or deficient by visual inspection shall be replaced.
- (4) Extinguishers shall be subjected to a maintenance examination at least once every year.
- (5) Maintenance procedures shall include a thorough examination of the extinguishers, including mechanical parts, extinguishing agent, and expellant.
- (6) Any troubles or impairments shall be corrected.
- (7) All extinguishers shall be recharged after use in accordance with the manufacturer's recommendations.
- (8)* Each extinguisher shall have a permanent tag attached on which the inspection date shall be recorded.

5.3.4.9 Portable extinguishers shall be tested hydrostatically at intervals not exceeding those specified in Chapter 8 of NFPA 10.

5.3.5 Draglines, Electric Shovels, Highwall Miners, and Hydraulic/Electric Excavators.

5.3.5.1 Center Pin/Collector Ring Area.

5.3.5.1.1 An automatic fire suppression system shall be installed in the center pin/collector ring area of the dragline. If an electrical spark cannot communicate from the collector ring (e.g., a sealed ring) to the grease around the center pin, a fire suppression system is not required.

5.3.5.1.2 An automatic fire suppression system shall be installed in the ring gear area of shovels.

5.3.5.1.3 Suppression system alarms shall be transmitted to the operator's cab. An audible and visual alarm shall be provided.

5.3.5.1.4 A manual actuator shall be provided just outside the center pin/collector ring area.

5.3.5.2 Hydraulics.

5.3.5.2.1 An automatic fire suppression system shall be installed to protect the hydraulic pump(s), hydraulic control valves, associated lines and equipment in the hydraulic pump area, and other areas to which fires can propagate.

5.3.5.2.2* The system shall send audible and visual alarms to the operator's cab.

5.3.5.2.3 A manual actuator shall be located just outside the hydraulic compartment area.

5.3.5.3 Lube Oil Pumping and Storage.

5.3.5.3.1* Automatic lube oil systems that are located in a segregated room shall be provided with an automatic fire suppression system.

5.3.5.3.2 The system shall send an audible and visual alarm to the operator's cab.

5.3.5.3.3 A manual actuator shall be located just outside the lube oil room.

5.3.5.3.4 Lube oil rooms shall have automatic door closers or shall have the door interlocked to shut upon actuation of the fire suppression system.

5.3.5.4 Transformers.

5.3.5.4.1 Oil-filled transformers located in the tail section, enclosed rooms, or other inaccessible locations shall be provided with an automatic fire suppression system.

5.3.5.4.1.1 The system shall transmit an audible and visual alarm to the operator's cab.

5.3.5.4.1.2 A manual actuator shall be located just outside the transformer area.

5.3.5.4.2* Transformers located in areas other than those listed in 5.3.5.4.1 shall be protected with a Class BC, minimum 45.4 kg (100 lb), fire extinguisher.

5.3.5.4.3 Oil analysis, including dissolved gas, shall be conducted on combustible oil-filled transformers based upon manufacturer's recommendations or ANSI/NETA MTS, *Standard for Maintenance Testing Specifications for Electrical Power Distribution Equipment and Systems*, whichever is more stringent.

5.3.5.4.4 Thermographic scanning shall be performed on transformers at least annually.

5.3.5.5 Electrical Room or Cabinet.

5.3.5.5.1 Enclosed electrical rooms shall be protected with a total flooding gaseous extinguishing agent or equivalent fire suppression system.

5.3.5.5.1.1 The system shall be installed in accordance with NFPA 2001 or other applicable NFPA standards.

5.3.5.5.1.2 The system shall be actuated by a smoke, ultraviolet/infrared (UV/IR), or heat detector system and send an audible and visual alarm to the operator's cab.

5.3.5.5.1.3 The ventilation system shall be interlocked to the gaseous extinguishing system to shut down upon first detection.

5.3.5.5.1.4 The room shall be sealed to maintain the design gaseous extinguishing concentration.

5.3.5.5.1.5 Pre-discharge alarms shall be provided in rooms provided with automatic suppression systems.

5.3.5.5.2 Electrical rooms shall be maintained at a positive pressure to reduce the chances of dust entering the room.

5.3.5.5.3 Electrical cabinets shall be protected with a gaseous fire suppression system or equivalent fire protection system.

5.3.5.5.3.1 The system shall be installed in accordance with NFPA 2001 or other applicable NFPA standards.

5.3.5.5.3.2 The system shall be actuated by a smoke, UV/IR, or heat detector system and send an audible and visual alarm to the operator's cab.

5.3.5.5.4* Thermographic scanning shall be performed on the electrical switchgear and motor starters at least annually.

N 5.3.5.5.5 Diesel generators for highwall miners shall be provided with an automatic fire suppression system that includes an audible and visual alarm on the exterior of the generator enclosure.

5.3.5.6 Manual Extinguishing Equipment.

5.3.5.6.1 Minimum 45.4 kg (100 lb) A:B:C-type extinguishers shall be accessible to persons on the main deck of the dragline.

5.3.5.6.2 The location and number of extinguishers shall be determined by what is practical for the machine.

5.3.6 Hydraulic/Diesel Excavators.

5.3.6.1 An automatic fire suppression system shall be provided to protect the engine compartment, hydraulic pumps, and associated equipment.

5.3.6.1.1 For hydraulic systems above 567.8 L (150 gal) in the lines, a dual agent system shall be provided.

5.3.6.1.2 A manual actuator shall be located in the operator's cab and at the means of egress from the machine.

5.3.6.2 The machine shall be interlocked to shut down upon discharge of the extinguishing system.

5.3.6.3 A means shall be provided to automatically relieve the hydraulic pressure upon discharge of the extinguishing system.

5.3.6.4 Adequate fire resistance shielding shall be provided between the hydraulic hoses and the turbocharger and engine manifold to prevent hydraulic fluid from being sprayed on hot mechanical parts.

5.3.6.5 The fire detection electrical wiring within fire hazard areas, such as battery compartments, engine compartments, and so forth, shall be outfitted with a fire-resistant sleeve.

5.3.6.6* Fire-suppression system manual actuation lines shall not be routed near high heated surfaces and shall not be routed within fire hazard areas unless fitted with fire-resistant sleeves.

5.3.7 Mobile Equipment.

5.3.7.1 Fire Protection. Portable extinguishers installed on mobile mining equipment, including but not limited to mobile generators and compressors, shall have a minimum rating of 2-A:10-B:C and a nominal capacity of 2.3 kg (5 lb) of extinguishing agent.

5.3.8 Self-Propelled Equipment.

5.3.8.1 Portable Fire Extinguishers.

5.3.8.1.1* All self-propelled surface mining equipment, including but not limited to bulldozers, front-end loaders, haulage trucks, cranes, graders, scrapers, draglines, drills, shovels, and diesel and electrical equipment, shall be equipped with at least one listed portable, multipurpose (ABC), dry chemical extinguisher having a nominal capacity of 4.5 kg (10 lb) of agent or greater.

5.3.8.1.2 Portable extinguishers installed on small units of self-propelled mining equipment, including but not limited to miniature loaders and individual personnel transports, shall have a minimum rating of 2-A:10-B:C and a nominal capacity of 2.3 kg (5 lb) of extinguishing agent.

5.3.8.2 Fire Detection.

5.3.8.2.1 Fire detectors shall be permitted to be used to initiate audible or visual warning, automatic actuation of a fire suppression system, or equipment shutdown.

5.3.8.2.2 Fire detectors shall be tested and listed for the application.

5.3.8.2.2.1 If fire detectors are used with a pre-engineered fire suppression system then they shall be included in the fire suppression system listing.

5.3.8.2.3 Compartment sizes and contours, airflow patterns, obstructions, and other characteristics of the protected area shall determine the placement, type, sensitivity, durability, and, where applicable, number of detectors.

5.3.8.2.4 All fire detection systems and applicable equipment shall be tested after installation in accordance with *NFPA 72* and fire suppression systems standards.

5.3.8.2.4.1 It shall not be necessary for testing to require the discharge of any associated fire suppression system.

5.3.8.2.5* At least every 6 months, all fire detection systems, including alarms, shutdowns, and other associated equipment, shall be thoroughly examined and checked for proper operation in accordance with the manufacturer's recommendations.

5.3.8.2.5.1 Any equipment found deficient shall be repaired or replaced, and the system retested for operation in accordance with the manufacturer's instructions.

5.3.8.2.6 Between the maintenance examinations or tests, the detection system shall be inspected visually, in accordance with an approved schedule necessitated by conditions as determined by the mine operator.

5.3.8.3 Fixed Suppression Systems.

5.3.8.3.1 Haul trucks with a capacity of over 77 metric tons (85 tons) shall have a fixed fire suppression system protecting the engine compartment and hydraulic pump and other hazard areas.

5.3.8.3.2* Other large mining equipment such as but not limited to dozers, endloaders, drills, graders, and scrapers shall have a fixed fire suppression system protecting the engine compartment and hydraulic pump and other hazard areas.

N 5.3.8.3.3 Self-propelled equipment with a hydraulic system that exceeds 568 L (150 gal) in the lines shall be provided with a dual-agent fire suppression system.

5.3.8.3.4 Mining equipment requiring a fire suppression system shall be protected by a system to suppress potential fires in the protected areas and shall comply with the following:

- (1) The fire suppression system shall be listed or approved for the purpose.
- (2) Where installed, the equipment shall be located or guarded so as to be protected against physical damage.
- (3) Fire suppression systems shall be automatically actuated.
- (4)* Automatically actuated systems shall also have a manual actuator capable of being activated from the operator's compartment or other location.
- (5) Agent distribution hose or pipe shall be secured and protected against damage, including abrasion and corrosion.

- (6) Except for automatic sprinkler systems, discharge nozzles shall be protected against entrance of environmental debris, including moisture, dust, dirt, or insects, by blow-off caps or other similar devices or materials.
- (7) Except for automatic sprinkler systems, the nozzle cover shall open or blow off upon discharge of the system.
- (8) The automatic fire suppression system shall be installed so that system actuation causes shutdown of the protected equipment.
- (9) Up to a 30-second delay shall be included in the design of the interlock system for the operator to maintain control of the equipment.

5.3.8.3.5 A standby source of power shall be provided where electrical power is the only means of fire suppression system actuation.

5.3.8.3.6 All fire suppression equipment and systems shall be tested after installation in accordance with the manufacturer's or designer's recommendations.

5.3.8.3.6.1 Testing shall not require the discharge of suppressant unless there is no other manner in which the reliability and integrity of the system can be verified.

5.3.8.3.7 An installation-and-maintenance or owner's manual that describes system operation and maintenance requirements shall be provided for all fire suppression equipment.

5.3.8.3.8* In accordance with the manufacturers' or designers' recommended inspection and maintenance procedures and schedules, but not to exceed every 6 months, all fire suppression systems, including alarms, shutdowns, and other associated equipment, shall be thoroughly examined and checked for proper operation by trained and competent personnel.

5.3.8.3.8.1 Any equipment found deficient shall be repaired or replaced, and the system retested for proper operation.

5.3.8.3.8.2 Between regular maintenance examinations or tests, the system shall be inspected visually, in accordance with the manufacturer's or designer's recommended schedule.

5.3.8.3.8.3 Testing shall be in accordance with the applicable NFPA standards.

5.3.8.3.9 Fire suppression systems shall be maintained in operating condition at all times.

5.3.8.3.10 Use, impairment, and restoration of the system shall be reported to the mine operator.

5.3.8.3.11 All persons who can be expected to inspect, test, maintain, or operate a fire suppression system shall be trained to perform their intended tasks.

5.3.8.3.12 Where inadvertent discharge of the fire suppression system during servicing could result in injury to personnel, provisions shall be made to safeguard against accidental actuation of the system.

5.3.8.3.13 All operators, supervisors, and maintenance personnel of self-propelled and mobile equipment shall be trained in the use of fire suppression equipment.

Chapter 6 Coal Processing

6.1 General. This chapter covers coal preparation, crushing, screening, and drying.

6.1.1 Materials and Construction.

6.1.1.1 Coal mine surface buildings and structures, housing, and supporting coal-processing and coal-handling equipment shall be of noncombustible construction.

6.1.1.2 Dry coal screening, crushing, dry cleaning, and other operations producing coal dust shall be conducted in open structures to prevent the accumulation of dust concentration levels that can create explosion hazards.

6.1.1.2.1 Where open structures are impractical, enclosed buildings shall be provided with explosion venting in accordance with 6.2.3 and shall be located so as to minimize fire and explosion exposure to major buildings and equipment.

6.1.1.2.2 Location of the processes described in 6.1.1.2 in the main plant building shall be permitted, provided the dust-producing area is equipped with explosion venting in accordance with 6.2.3 and is separated from the remainder of the building by construction designed to withstand the pressure buildup from an explosion prior to pressure relief by means of explosion vents.

6.1.2 Coal Dust Control.

6.1.2.1 Dedusters.

6.1.2.1.1 All dedusting equipment shall be connected directly to a suction system capable of moving enough air to prevent the leakage of dust from the system.

6.1.2.1.2 The suction system shall discharge the dust-laden air by the shortest possible route to collectors outside the building.

6.1.2.2* Pneumatic Cleaners.

6.1.2.2.1 Dust-collecting systems with suction hoods at the cleaners, suction ducting that maintains at least a 20 m/sec (4000 ft/min) air velocity, and dust collectors having pressure release venting shall be installed.

6.1.2.2.2 Belt conveyor-type transfers and loading points associated with the cleaners shall be hooded similarly and connected to dust collectors.

6.1.3 Coal Storage. Coal storage facilities shall be in accordance with 9.5.2.

6.2 Fire and Explosion Prevention.

6.2.1 Electrical Classification of Hazard.

6.2.1.1 Plant areas of open construction where coal dust or any combustible gases liberated from the coal are dispersed to the open atmosphere shall be classified nonhazardous.

6.2.1.2 Plant areas isolated from the coal process, such as control rooms, electrical equipment rooms, or substations, that are provided with ventilation to prevent the accumulation of combustible gases or coal dust shall be classified nonhazardous.

6.2.1.3 Enclosed areas of processing plants where coal is wet to prevent particles from becoming airborne or where dry coal dust does not accumulate shall be classified nonhazardous.

6.2.1.4* Enclosed areas where the failure or malfunction of the ventilation would result in the accumulation of explosive concentrations of methane gas shall be designated as Class I, Division 2 locations in accordance with Article 500 of *NFPA 70*.

6.2.1.4.1* Electrical equipment approved as “permissible” by the Mine Safety and Health Administration (MSHA) shall be acceptable in locations classified Class I, Division 1.

6.2.1.5 Areas of a processing plant normally designated as Class I shall be permitted to be considered nonhazardous, provided the following conditions are met:

- (1) Ventilation to prevent an accumulation of an explosive or ignitable mixture of gases
- (2) Failsafe continuous methane monitoring designed to sound an alarm when the methane–air mixture reaches 20 percent of the lower explosive level (LEL) or 1 percent methane by volume
- (3) An interlock to stop the process equipment automatically when the methane–air mixture reaches 40 percent of the LEL or 2 percent methane by volume
- (4) An electrical system arranged so that when methane concentrations reach 40 percent of the LEL, all electrical circuits including control circuit conductors are de-energized
- (5) Any equipment that is needed to restore the plant to a methane–air mixture of less than 20 percent of the LEL or 1 percent methane by volume, such as lighting, ventilation, or sump pumps, installed in accordance with Class I, Division 1 requirements

6.2.1.6* Enclosed areas in which coal dust is not in suspension in explosive or ignitable quantities or in which coal dust might be present in explosive or ignitable quantities or might be in suspension in the air due to a malfunction shall be designated as Class II, Division 2 in accordance with Article 500 of *NFPA 70*.

6.2.1.7* The structure of a preparation plant shall be connected to a common electrical ground.

6.2.1.7.1 Any electrical equipment that is mounted on a concrete pad shall be grounded to the metal structure with a shunt.

6.2.1.7.2 Where the structure is nonmetallic, a separate grounding grid for equipment shall be provided.

6.2.1.8 Positive pressure shall be maintained in process control rooms to prevent the entry of fugitive dust.

6.2.1.9 Electrical Equipment Rooms. Positive pressure shall be maintained in electrical equipment rooms, such as switchgear rooms, motor control centers, and cable-spreading rooms, that have a potential for fugitive dust entry.

6.2.1.9.1 Thermographic scanning shall be performed on switchgear and motor starters on an annual basis.

6.2.1.10 Tools that are actuated by electrical power shall not be used in areas with explosive gases or dusts.

6.2.1.11 Transformers. Oil analysis, including dissolved gas, shall be conducted on combustible oil-filled transformers based upon manufacturer’s recommendations or ANSI/NETA MTS, *Standard for Maintenance Testing Specifications for Electrical Power Distribution Equipment and Systems*, whichever is more stringent.

6.2.1.12 A smoke detector system shall be provided in MCC rooms or other critical electrical rooms. The system shall be installed in accordance with *NFPA 72* and send an alarm to a constantly attended location.

6.2.2 Dust Collectors and Dust Removal Equipment.

6.2.2.1 Dust collectors or dust suppression systems using water-based sprays shall be used to reduce dust in suspension at coal transfer points.

6.2.2.2 Those areas in which combustible dust is or might be in suspension in the air continuously, intermittently, or periodically under normal operating conditions shall be provided with a dust-collecting system or systems to collect such dust and prevent its discharge to the atmosphere.

6.2.2.2.1 All coal-handling equipment or machinery that produces dust shall be connected to a dust collector with ducts and hoods that are designed to provide suction volume and velocity to collect and transport all the dust produced.

6.2.2.2.2 Hoods, enclosures, and ducts shall be of noncombustible construction, designed and maintained in accordance with *NFPA 91*.

6.2.2.2.3 All dust collectors, other than those that are an integral part of dust-producing equipment, shall be located outside the working areas, preferably outside the building or in separate rooms that are vented to the outside.

6.2.2.3 When a plant or handling facility is planned, special consideration shall be given to the location of the dust-producing equipment with respect to the location of the dust collection devices to ensure that the connecting ducts will be as straight and as short as possible.

6.2.2.3.1* All dry dust collectors shall be of noncombustible construction, equipped with explosion doors or vents.

6.2.2.3.2 The entire dust-collecting system shall conform to *NFPA 91*.

6.2.2.4 In no case shall the design of the dust removal system be such that the dust is drawn through the fan before entering the collector. Fans shall be of noncombustible construction.

6.2.2.5* Ducts shall be designed to maintain a velocity of not less than 22.9 m/sec (4500 ft/min) to ensure the transport of both coarse and fine particles and to ensure re-entrainment if for any reason the particles should fall out before delivery to the dust collector (e.g., in the event of a power failure).

6.2.2.5.1 In bag-type dust collectors, the bags shall be constructed of antistatic, fire-resistant material and shall be provided with an electrical ground.

6.2.2.5.2 Dust collector hoppers shall be sloped at approximately 60 degrees to ensure material flow.

6.2.2.5.2.1 Zero-speed switches and high-level alarms shall be used to identify conditions that can lead to spontaneous combustion.

6.2.2.5.2.2 Hopper discharge valves or screw conveyors shall be provided to discharge the dust continually.

6.2.2.5.2.3 Hoppers shall not be used as storage bins.

6.2.2.5.3 Hood takeoffs shall have a minimum area of four times the area of the duct.

6.2.2.5.3.1 Ductwork also shall be supplied with blast gates and dampers for individual pickup volume adjustment.

6.2.3 Explosion Venting.

6.2.3.1* Explosion venting shall be provided in areas where coal dust might be present in explosive or ignitable quantities, such as in coal preparation plant buildings, and in sections of buildings housing screens, pneumatic coal-cleaning equipment, dryers, and other dust-producing machinery.

6.2.3.2 Ventilating hoods and exhaust ducts shall not be acceptable as explosion-venting devices unless they are designed for a dual purpose and function to provide direct release of excess pressure to the outside.

6.2.3.3 Equipment vents or ducts used to direct the energy of an explosion in equipment to the outside of the building or a safe location shall be as short as possible and shall be designed to withstand the explosion pressure.

6.2.3.3.1 Vent closures, which might be necessary to permit proper functioning of equipment and to prevent the escape of dust during normal operation, shall be designed to open at the lowest possible increase in pressure or shall be of flexible or frangible materials that blow out or rupture to permit the release of explosion pressure.

6.2.4* Flammable and Combustible Liquids and Liquefied Petroleum Gas. Flammable and combustible liquids and compressed gases shall be stored and used in accordance with Chapter 7.

6.2.5 Maintenance. The user shall have responsibility for establishing a maintenance program that ensures that equipment is in working order.

6.2.5.1 All coal-handling equipment and machinery shall be maintained in accordance with the manufacturers' recommendations.

6.2.6 Housekeeping. Provision shall be made for cleaning to prevent the accumulation of coal dust.

6.2.6.1 Combustible waste materials shall not be permitted to accumulate in locations where a fire or an explosion hazard can be created.

6.3* Preparation Plants and Crusher Buildings. This section shall apply to preparation plants, tipples, crushers inside buildings, and crushers in belowgrade areas. Open air crushers do not pose a significant hazard and shall be excluded from the requirements of this section.

6.3.1 Building Construction.

6.3.1.1 Buildings and equipment shall be shaped, installed, or protected so as to minimize the surface area on which coal dust can accumulate.

6.3.1.2 Access for cleaning or washing down shall be provided.

6.3.1.3 Access platforms or walkways installed between floors shall be permitted to be open-grid construction to facilitate cleaning.

6.3.1.4 Walls or partitions isolating sections of the plant that contain dust-producing operations shall be constructed and installed to minimize the transmission of dust to adjacent areas.

6.3.1.5 To prevent the accumulation of dust on exposed wall or partition framing, metal siding or other equivalent material shall be installed on the side facing the dust-producing section.

6.3.1.6 Doors in the walls or partitions required by 6.3.1.4 shall be self-closing.

6.3.1.7 Drain systems shall be provided in areas where cleaning is accomplished by washing down.

6.3.1.8 Two remote means of egress shall be provided on each floor of the plant.

6.3.1.9 Emergency lighting shall be provided at the means of egress stairways in accordance with **Section 7.9 of NFPA 101**.

6.3.1.10* Emergency exit signs shall be provided at the means of egress stairways in accordance with **Section 7.10 of NFPA 101**.

6.3.1.11 If lightning protection is required, it shall be in accordance with NFPA 780.

6.3.1.12 Electrical Equipment. Transformers, switchgear, motor starters, and other electrical equipment shall be installed in accordance with *NFPA 70*.

6.3.1.12.1* Transformers located outside of the preparation plant shall be far enough away or provided with a fire barrier wall and containment or drainage to limit damage to the building if the transformer were on fire.

6.3.1.12.2* Combustible oil-filled transformers located inside the preparation plant shall be enclosed in a transformer vault constructed in accordance with *NFPA 70*.

6.3.1.12.3* Oil-filled transformers shall not be allowed on the roof of a preparation plant.

6.3.2 Fire Protection.

6.3.2.1 Portable Extinguishers.

6.3.2.1.1 Every building or room of a plant where combustible material is present or dry coal is processed or handled shall be provided with approved portable multipurpose fire extinguishers.

6.3.2.1.2 The number of approved portable extinguishers, their type, and their distribution shall be in accordance with NFPA 10 except that the smallest extinguisher shall have a nominal capacity of 9.1 kg (20 lb) of agent and a minimum rating of 10-A:60-B:C.

6.3.2.1.3 Extinguishers employing agents having a B:C rating shall be permitted to be used if the hazard is confined solely to electrical equipment.

6.3.2.2 Fixed Fire Protection Systems.

6.3.2.2.1* Where required by the authority having jurisdiction, fixed fire protection systems shall be provided and shall be designed in accordance with the appropriate NFPA standards, depending on the agent utilized.

6.3.2.2.1.1 Where a pre-engineered fire suppression system is used, it shall be designed and installed in accordance with the fire suppression system manufacturer's listed installation and maintenance manual.

6.3.2.2.2 Working plans for the fixed fire protection system shall be submitted for approval to the authority having jurisdiction.

6.3.2.2.3 Combustible hydraulic and lube oil systems that exceed 94.6 L (25 gal) and are located in below-grade areas shall be protected by an automatic fire suppression system.

6.3.2.3 Standpipe and Hose Systems.

6.3.2.3.1* Class III standpipe systems shall be provided in all coal preparation plants and crusher buildings in accordance with NFPA 14.

6.3.2.3.2 When automatic sprinkler systems are to be supplied through the standpipe system, hydraulic calculations shall be used to ensure that the piping and the water supply meet the hose and automatic sprinkler demands simultaneously.

6.3.2.3.3 Hose stations on or in conveyor galleries shall be provided with hoses that are of length equal to the distance between water supply connections.

6.3.2.3.4 Fire hose shall be provided in an accessible area in order to fight a fire involving spirals.

6.3.2.4 Water Supply.

6.3.2.4.1* Availability. An available supply of water shall be provided for fire protection systems and manual fire-fighting purposes.

6.3.2.4.2 Fire Mains. Where fire mains and hydrants are provided, the water supply system shall be installed and maintained in accordance with NFPA 24.

6.3.2.4.3 Other Water Supplies. Where public or private fire mains are not provided, alternative water supplies complying with NFPA 1142 shall be provided.

6.3.2.4.4* Capacity.

6.3.2.4.4.1 The water supply capacity shall be capable of providing the estimated water needed for fire-fighting purposes for a minimum duration of 2 hours.

6.3.2.4.4.2 Water pumps installed as part of a process water system and designed for the calculated flows and pressures required for fire fighting shall be permitted to be used to supply fire mains.

6.3.2.5 Inspection and Maintenance of Fire Protection Equipment.

6.3.2.5.1 Portable extinguishers shall be maintained in accordance with NFPA 10.

6.3.2.5.1.1 Fire extinguishers shall be inspected on a 6-month basis.

6.3.2.5.2 Water-based fire protection systems shall be maintained in accordance with NFPA 25.

6.3.2.5.3 Any fire protection system, including sprinklers, installed in accordance with the requirements of this standard shall be maintained to provide assurance that the system will operate.

6.3.2.5.4 All persons who inspect, test, or maintain fixed fire protection systems shall be trained in accordance with the appropriate NFPA standards and the manufacturers' specifications.

6.3.2.6 Surveillance.

6.3.2.6.1 Periodic surveillance for fire hazards shall be conducted when the plant, or any part thereof, is not in operation or not constantly attended.

6.3.2.6.2 Frequency of surveillance shall be dependent on the type of coal product involved and its susceptibility to self-heating and other site conditions.

6.3.2.6.3* Smoke detectors shall be provided in electrical equipment rooms.

6.3.2.6.3.1 Fire alarm systems shall be installed in accordance with NFPA 72.

6.3.2.6.3.2 Audio and visual notification alarms shall be provided in the area, and the signal shall be transmitted to a constantly attended location.

6.4 Dryers.

6.4.1* General.

6.4.1.1 Thermal coal-drying systems shall be located at least 30.5 m (100 ft) from any underground coal mine opening.

6.4.1.2 Dryers that have been idle for more than 30 days or shut down because of a fire or any other emergency condition during normal operation shall be checked to ensure that there is no burning material within the system before being placed back in service.

6.4.2 Loss Prevention Design Features. Dryer heating units that are fired by pulverized coal shall be installed, operated, and maintained in accordance with NFPA 85.

6.4.2.1 Dryers of the direct-fired type shall be designed and operated so that combustion is complete as possible within the furnace/air heater before the gases of combustion come in direct contact with the coal drying in the drying chamber.

6.4.2.2 Dryers shall be designed and constructed to be dust-tight, with smooth surfaces to prevent the accumulation of coal.

6.4.2.3 Where coal can be exposed to excessive heat on normal or emergency shutdown, a bypass stack with an automatically controlled damper shall be installed to direct the products of combustion away from the coal.

6.4.2.4 Thermal dryer systems that have a hot gas inlet or plenum chambers where fly ash or coal siftings might accumulate shall be equipped with drop-out doors or ports to facilitate removal of these solids.

6.4.2.4.1 Where continuous means of removing drop-out solids are not provided, checking and manual clean-out shall be provided as conditions warrant.

6.4.2.5* All internal areas of thermal coal dryers where coal solids could possibly hang up or accumulate under any abnormal operating condition, such as in the drying chamber or dry cyclone collector, shall be equipped with explosion relief vents that open directly to the outside atmosphere.

6.4.2.5.1 These explosion relief vents shall be of the quantity, size, and location to operate in excess of the design normal pressure.

6.4.2.5.2 Explosion vents shall be checked or tested at least once each month, and records kept to verify these checks.

6.4.2.5.3 Explosion vents shall be directed away from personnel work areas and walkways.

6.4.2.6 During system operation, visual checks shall be made of all the mechanical components and equipment associated with the drying system as conditions warrant.

6.4.2.7* Indirect heat exchange-type dryers, such as thermal disk processors, shall be given special consideration in the design of fire protection for the dryer and dryer building.

6.4.3 Instrumentation and Control.

6.4.3.1 Instrumentation and control panels on thermal dryers shall be located in an area relatively free of moisture, vibration, dust, and noise.

6.4.3.2 The panel shall be located within the range and view of the supervising operator.

6.4.3.3 The operator control room shall be provided with windows or other means, such as video cameras, that give visual contact with the thermal drying system.

6.4.3.4 The panel shall include recording-type control instruments, monitoring indicators, alarms, and temperature limits set to maintain normal operation.

6.4.3.5 Audible and visual alarms shall be interlocked electrically to provide shutdown of the drier when temperatures are exceeded or other emergency malfunctions occur.

6.4.3.6 Control instruments shall be checked and serviced by a technician at least every 3 months.

6.4.3.7 Where pneumatic controls are used, instrument quality air shall be provided.

6.4.3.8 A schematic diagram showing the locations of thermocouples, pressure taps, and other controls shall be posted at the control panel.

6.4.3.9 Written procedures, including start-up, normal shutdown, and emergency shutdown procedures, shall be provided and posted at the control panel.

6.4.3.10 All main fans shall be inspected and shall have bearing temperature and vibration detectors.

6.4.3.11 Coal feed bins shall have low-level alarms.

6.4.4 Fire Protection for Drying Chambers. Drying chambers shall be protected by an automatic water spray system.

6.4.4.1 The automatic spray system shall include a manual control.

6.4.4.2 The source for the fire protection water shall be such that the required volume flow rate and pressure of clean (solid-free) water are available at all times and that the exposed piping is protected against freezing.

6.4.5* Explosion Venting.

6.4.5.1 Buildings shall be provided with explosion venting in accordance with NFPA 69 and shall be located to minimize fire and explosion exposure to other buildings and equipment.

6.4.5.2 Cyclone collectors used with dryers shall be equipped with explosion vents equal in size to the cross-sectional area of

the exhaust sleeve to supplement the venting area provided at the exhaust opening.

6.4.5.3 Dryers shall be designed and installed, if possible, with their explosion vents opening directly to the outside.

6.4.5.3.1 This venting shall be permitted to be accomplished by installation of the dryer along an outside wall of the building, directly under the roof, or by a portion of the dryer being extended through the roof.

6.4.5.3.2 If such locations are not practicable, ducts to the outside of the building shall be as short as possible and designed to withstand explosion pressure.

6.4.5.3.3 Access floors, platforms, walkways, and stairs on the thermal dryer structure shall be located so that personnel are not in the line of an explosion vent.

6.5 Conveyors. Conveyors shall be in accordance with Section 9.1.

6.6 Mobile Equipment. Mobile equipment used in coal processing areas shall conform to 5.3.8.

N 6.7 Spiral Concentrators.

N 6.7.1* In addition to the requirements of NFPA 51B, when welding or cutting operations are to occur directly above or within 10.5 m (35 ft) of a coal washing spiral concentrator, the following fire prevention measures shall be taken:

- (1) A hot work permit shall be created and approved by an individual designated by management to authorize cutting and welding operations before commencing welding or cutting work as described in 6.7.1.
- (2) The hot work permit shall, at a minimum, include the requirements for performing a risk assessment before work commences as well as the provisions contained in 7.1.2.5(1) through 7.1.2.5(5) of this standard.
- (3) The spirals and the surrounding area shall be washed down with water to remove the accumulation of as many coal fines as practical and to thoroughly wet residual coal fines remaining in the spirals and surrounding area within 10.5 m (35 ft).
- (4) Periodic wetting of spirals and the surrounding area shall continue as required by the authority having jurisdiction for the duration of welding and cutting activities.
- (5) A trained fire watch shall be posted within the visual vicinity of the spirals when hot work is in process.
- (6) A fire watch shall be maintained for a minimum of 1 hour following completion of all hot work.
- (7) The fire watch shall be guided by the provisions contained in 7.1.2.12 of this standard.
- (8) Fire extinguishers and fire hoses shall be available during hot work as prescribed in 7.1.2.5(3) and 7.1.2.5(4) of this standard.
- (9) Fire-resistant barriers shall be used where practical to isolate the spirals from hot material or debris.

N 6.7.2 Signage shall be permanently posted around spirals, prohibiting smoking or open flame and requiring approved hot work permits before commencing any welding or cutting tasks as described in 6.7.1.

Chapter 7 Storage and Use of Compressed Gases and Flammable and Combustible Liquids

7.1* Compressed Gas Storage and Usage — Cutting and Welding.

7.1.1 Procedures and Maintenance of Equipment.

7.1.1.1 Cutting and welding shall be performed only by persons who have been task trained.

7.1.1.2 Personal protective equipment shall be worn by personnel during welding or flame cutting operations.

7.1.1.3 Before any cutting or welding is performed, prior approval shall be granted by management or its designated agent.

7.1.1.4 Compressed gas shall be used only for its intended purpose.

7.1.1.5 Compressed oxygen shall not be used to blow coal dust from clothing or machinery.

7.1.1.6 Manifolding of cylinders containing gases used for cutting and welding shall be permitted only in shops ventilated with sufficient quantity and velocity to dilute, render harmless, and clear away flammable or explosive concentrations of vapors.

7.1.1.7 When not in use, the compressed gas cylinder valve shall be closed.

7.1.1.8 Cutting and welding equipment shall be maintained in operating condition with all safeguards in place and functioning.

7.1.1.9 Flashback and backflow preventers shall be installed at the outlets of all pressure regulators and on the hose connections used in cutting, welding, brazing, and soldering torches.

7.1.2 Fire Prevention and Control.

7.1.2.1* Cutting or welding shall not be performed on or within containers or tanks that have stored combustible or flammable materials until such containers or tanks have been purged and cleaned or have been inerted.

7.1.2.2 Cutting or welding shall not be performed within 15.2 m (50 ft), measured horizontally, of explosives, blasting agents, or flammable or combustible liquid storage areas unless separated by a noncombustible barrier.

7.1.2.3 Electrical cutting and welding equipment shall be electrically grounded.

7.1.2.4 All machinery and operations producing combustible dust within range of welding sparks shall be shut down prior to the start of the welding or cutting operation and shall remain inoperative until a final inspection is completed.

7.1.2.5* Before cutting and welding operations are undertaken, the following precautions shall be observed:

- (1) The immediate area shall be cleaned and cleared of combustible material and, if underground, wetted down with water or coated with rock dust.
- (2) Open gear cases and combustible machine components located within 7.6 m (25 ft) of cutting or welding operations shall be covered with noncombustible material.
- (3) Fire-extinguishing equipment, including fully charged and operable multipurpose (ABC) dry chemical extinguishers, rock dust, or water hose, shall be within 7.6 m (25 ft) of the cutting or welding operation.

- (4) In the case of a portable fire extinguisher, a single unit having a nominal capacity of 9.1 kg (20 lb) with a minimum rating of 4-A:40-B:C shall be within 7.6 m (25 ft) of the cutting or welding operation.
- (5) Tests for methane gas (CH_4) shall be made before cutting or welding in any area where methane gas is likely to be present, and the following shall apply:
 - (a) Cutting or welding shall not be permitted to begin or continue unless the concentration of methane gas is less than 1 percent by volume.
 - (b) Methane concentration shall be continuously monitored during the cutting and welding operation.
- (6) Where cutting or welding is necessary in by the last open crosscut, a continuous fire watch shall be maintained.
- (7) Where in by equipment to be modified or repaired can be moved, it shall be moved out by the last open crosscut before cutting or welding.
- (8) Ventilation shall be established prior to and maintained during cutting or welding.
- (9) Flammable and combustible liquids shall not be dispensed within 15.2 m (50 ft) of cutting or welding operations.
- (10) Freshly painted surfaces shall be permitted to dry so that ignitable vapor is not present before cutting or welding.
- (11) When conducting cutting and welding operations inside buildings, in draglines, or underground, a permit shall be prepared and signed by the person performing the work and by an individual designated by management to authorize cutting and welding operations.

7.1.2.6 Combustibles posing a fire hazard shall be relocated or protected with a fire-retardant cover or fire-retardant barrier.

7.1.2.7 Where welding or cutting with an arc or a flame is performed where combustible materials are present and cannot be removed or protected from ignition sources, a fire watch shall be provided.

7.1.2.7.1 Where a fire watch is required, it shall be maintained for a minimum of 30 minutes after completion of cutting or welding operations to detect and extinguish smoldering combustibles.

7.1.2.7.2 The fire watch shall have fire-extinguishing equipment available and be trained in its use.

7.1.2.7.3 Fire watchers shall be familiar with the facilities and the procedures for sounding an alarm in the event of a fire.

7.1.2.8 Openings or cracks in walls, partitions, floor decks, or ducts shall be covered tightly with a noncombustible material to prevent the passage of sparks to adjacent areas.

7.1.2.9 Where welding is being performed on a metal wall, partition, ceiling, or roof, precautions shall be taken to prevent ignition of combustibles on the other side due to conduction or radiation.

7.1.2.10 In confined spaces, positive ventilation shall be established prior to start-up of cutting or welding operations.

7.1.2.11 Noncombustible barriers shall be installed below welding or cutting operations that are being performed in or over shafts, silos, and similar openings.

7.1.2.12 Inspection.

7.1.2.12.1 Inspection for sparks, smoldering material, and fire shall be made during cutting or welding.

7.1.2.12.2 After completion of the work, a search of the area, including the floors above and below, shall be made for fires and for development of smoldering fires.

7.1.3 Underground Transport. Compressed gas cylinders for cutting or welding shall be transported as follows:

- (1) The cylinders shall be disconnected from regulators.
- (2) The cylinders shall be protected with a metal cap or headband (fence-type metal protector around the valve stem).
- (3) The cylinders shall be secured by devices that will hold them in place during transit.
- (4) The cylinders shall be placed in electrically insulated, substantial containers designed to hold the cylinders during transit on a trolley wire haulage system.
- (5) The cylinders shall be labeled "empty" or "MT" if the gas has been expended.

7.1.4 Underground Storage. Compressed gas cylinders stored underground shall meet all the requirements of Section 7.1.

7.1.4.1* Compressed gas cylinders shall be clearly marked using the designations of the U.S. Department of Transportation (DOT).

7.1.4.2 Compressed gas cylinders shall be placed in storage areas that shall be designated for the purpose, constructed of noncombustible material or rock-dusted, and free of trash and combustible or flammable liquids.

7.1.4.3 Compressed gas cylinders shall be stored and secured in an upright position or angled with the valve end elevated.

7.1.4.4 Compressed gas cylinders shall be protected against damage from the following:

- (1) Falling material
- (2) Contact with power lines and energized electrical machinery
- (3) Heat from cutting or welding operations

7.1.4.5 The valves of the compressed gas cylinder shall be closed and protected from physical damage when not in use.

7.1.4.5.1 Hoses from compressed gas shall have flash arresters on the regulator side and shall be drained after use.

7.1.4.6 Compressed gas cylinders shall not be stored or left unattended in by the last open crosscut.

7.1.4.7 Where located in other than underground shops, compressed gas cylinders not in use shall have the regulators removed, and the valves shall be protected by being covered with protective metal caps, by tank design, or by other approved equivalent protection.

7.1.4.8 Flammable compressed gas shall be segregated from oxygen by a fire-resistive barrier (e.g., steel plating or concrete blocks) or by a distance of 6.1 m (20 ft).

7.1.5 Surface Storage.

7.1.5.1 Storage of compressed gases on an excavating machine shall be limited to that used on a daily basis.

7.1.5.2 Acetylene, oxygen, and other compressed gas cylinders shall be kept in the upright position and secured against falling over.

7.1.5.3 A metal or caged barrier shall be provided above cylinders in storage if there is the potential for falling objects.

7.1.5.4 Flammable compressed gas shall be segregated from oxygen by a fire-resistive barrier (e.g., steel plating or concrete blocks) or by a distance of 6.1 m (20 ft).

7.1.5.5 Storage of flammable gases and oxygen shall be located outside buildings or in a room designed in accordance with NFPA 55.

7.1.5.6 All electrical equipment within an enclosed storage room containing flammable gases shall be Class I, Division 2, Group A, B, C, or D.

7.1.5.7 Outside storage areas shall be kept clear of dry vegetation and combustible materials for a minimum distance of 7.6 m (25 ft).

7.1.5.8 Storage areas shall be provided with physical protection from vehicle damage.

7.1.5.9* Compressed gas cylinders shall be clearly marked using the designations of the DOT.

7.1.5.10 Empty cylinders shall be clearly marked "Empty" or "MT" or stored in a separate area.

7.2 Liquid Propane Storage and Use. The storage, use, and handling of liquefied petroleum gases (LP-Gases), such as propane or butane, shall be in accordance with NFPA 58.

7.3 Flammable and Combustible Liquid Storage Tanks on the Surface.**7.3.1* Design and Location of Storage Tanks.**

7.3.1.1 Storage tanks shall be built, installed, and used in accordance with NFPA 30.

7.3.1.2* The tank shall be listed for its use.

7.3.1.3 Aboveground flammable liquids storage tanks shall be located a minimum of 15.2 m (50 ft) from important structures.

7.3.1.4 Aboveground combustible liquid storage tanks shall not be stored closer than 1.5 m (5 ft) from important structures.

7.3.1.5 Aboveground tanks shall not be located within 30.5 m (100 ft) of mine openings, fan installations, hoist houses, or any buildings connected to these operations.

7.3.1.6 The contents of the storage tank shall be identified by the designations given in NFPA 704.

7.3.2* Control of Spillage from Aboveground Tanks. Facilities shall be provided so that any accidental discharge will be prevented from endangering important facilities or adjoining property or from reaching waterways.

7.3.3 Normal and Emergency Venting.

7.3.3.1 Atmospheric storage tanks shall be vented in accordance with API **STD** 2000, *Standard for Venting Atmospheric and Low-Pressure Storage Tanks*.

7.3.3.2 As an alternative to 7.3.3.1, the normal vent shall be at least as large as the largest filling or withdrawal connection, but in no case shall it be less than 31.7 mm (1¼ in.) nominal diameter.

7.3.3.3 Aboveground tanks storing flammable liquids shall have the vent normally closed and be equipped with a flame arrester.

7.3.3.4* Emergency Relief.

7.3.3.4.1 Emergency relief shall be provided for all aboveground tanks storing material with a flash point less than 93.3°C (200°F).

7.3.3.4.2 The relief shall be in the form of a relief valve or a weak roof-to-shell seam.

7.3.3.5 Tanks containing material with a flash point greater than 93.3°C (200°F) that are located in the same diked area as liquids with lower flash points shall also conform to 7.3.3.4.

7.3.3.6* Vent piping shall be located so that the discharge is above the fill pipe opening and at least 3.7 m (12 ft) above the adjacent ground level.

7.3.4 Fuel Lines.

7.3.4.1 Fuel lines shall be equipped with valves to cut off fuel at the source.

7.3.4.2 Fuel lines with flexible piping shall be equipped with a fusible link activated automatic shutoff valve located at the point where the fuel line exits the storage tank.

7.3.5 Leakage and Overfill of Buried Tanks.

7.3.5.1 Buried tanks with flammable liquids shall have a leak detection program in effect.

7.3.5.2 Accurate inventory records of buried tanks with flammable liquids shall be maintained.

7.3.5.3 Buried tanks shall be equipped with an overfill alarm interlocked to shut off the feed when the tank is 95 percent full and to alarm at 90 percent.

7.3.6 Vehicle Barriers. Vehicle barriers shall be provided around aboveground stationary storage tanks or fuel pumps that are located in an area subject to vehicular traffic.

7.3.7 Control of Ignition Sources.

7.3.7.1 Signs warning against smoking or open flames shall be posted so they can be readily seen.

7.3.7.2 Storage tanks containing flammable liquids shall be grounded.

7.3.7.3 Tank trucks with flammable liquids shall be grounded by being electrically bonded to the fill pipe when storage tank filling operations are taking place.

7.3.7.4 Areas surrounding storage tanks shall be kept free of grass, weeds, underbrush, or other combustible material such as trash or leaves for at least 7.6 m (25 ft) in all directions.

7.3.8 Fire Extinguishers. Two fully charged and operable 9.1 kg (20 lb) extinguishers with minimum ratings of 4-A:40-B:C shall be provided within 9.1 m (30 ft) of the tank or pump.

7.4 Flammable and Combustible Liquid Storage on Surface Equipment and in Buildings.

7.4.1 The storage, use, and handling of flammable and combustible liquids in surface buildings shall conform to NFPA 30 except Chapters 1, 2, 3, 4, and 15, and Section 18.5.

7.4.2 Flammable and combustible liquids on equipment, except in fuel tanks on vehicles, shall be stored and handled in accordance with NFPA 30.

7.4.3 Flammable liquids of a quantity greater than 94.6 L (25 gal) shall be stored in a flammable liquids cabinet.

7.4.4 All flammable aerosols shall be stored in a flammable liquids cabinet.

7.4.5* On equipment, combustible liquid storage in drums or totes shall not exceed a 1-day supply.

7.4.6 Upon request, the mine operator shall provide the authority having jurisdiction with information regarding the composition and flash point of the flammable and combustible materials.

7.4.7 Smoking and Open Flames.

7.4.7.1 Smoking and open flames shall be prohibited in areas or locations where fire or explosion hazards exist.

7.4.7.2 Signs warning against smoking and open flames shall be posted.

7.4.8 Vehicle Refueling.

7.4.8.1 Vehicles using liquid fuels shall be refueled only at locations designated for that purpose and from approved dispensing pumps and nozzles.

7.4.8.2 Engines, except diesel engines, shall be shut off during refueling.

7.5 Flammable Liquids Stored and Used Underground.

7.5.1 General.

7.5.1.1* Electrical equipment in flammable liquid storage areas shall be classified as one of the following:

- (1) Class I, Division 1 as specified in *NFPA 70*
- (2) "Permissible" electrical equipment

7.5.1.2 Flammable liquids in storage shall be kept in closed containers.

7.5.1.3 Flammable liquids shall be permitted to be used only where there are no open flames or other sources of ignition within the possible path of vapor travel in flammable concentrations.

7.5.1.4 Flammable liquid containers shall be returned to a flammable liquid storage area after use.

7.5.1.5 All aerosol cans shall be treated as containing flammable liquids unless otherwise specifically identified.

7.5.1.6 Individual aerosol cans that are used regularly in normal operations shall be permitted on mobile equipment or in tool cabinets and shall be protected from mechanical damage.

7.5.2 Flammable Liquid Containers.

7.5.2.1 Flammable paints shall be stored only in original containers or cans of not over 19 L (5 gal) capacity.

7.5.2.2 All other flammable liquids shall be transferred to a listed safety can prior to being transported underground.

7.5.2.3 Safety cans containing Class IA flammable liquids shall not exceed 7.6 L (2 gal) capacity.

7.5.2.4 All flammable liquid containers shall be labeled with the word “Flammable.”

7.5.2.5 Flammable liquid containers shall be stored in a stable manner.

7.5.3 Flammable Liquid Storage Areas.

7.5.3.1 Flammable liquids shall be stored in one of the following:

- (1) Listed or approved noncombustible storage cabinets
- (2) Cabinets meeting the requirements specified in Section 9.5 of NFPA 30
- (3) An enclosure of fire-resistive construction

7.5.3.2 In operating areas, containers of flammable liquids and aerosol cans shall be stored at least 7.6 m (25 ft) away from potential ignition sources such as energized trolley wire, energized electrical equipment, and other operating equipment.

7.5.3.3 The aggregate quantity of flammable liquids, including aerosol cans, in a flammable liquid storage area shall not exceed 227 L (60 gal).

7.5.4 Dispensing Flammable Liquids.

7.5.4.1 Flammable liquids shall be drawn from or transferred into containers using only the following methods:

- (1) From safety cans
- (2) From a container by means of a device that draws through an opening in the top of the container
- (3) By gravity through a listed or approved self-closing valve or self-closing faucet

7.5.4.2 Transferring flammable liquids by means of an electric pump or pressurizing a container with air shall be prohibited.

7.5.4.3 Transferring flammable liquids by pressure of inert gas shall be permitted only if controls, including pressure relief devices, are provided to limit the pressure so it cannot exceed the design pressure of the container.

7.5.4.4 At least one portable fire extinguisher having a nominal capacity of 9.1 kg (20 lb) with a minimum rating of 4-A:60-B:C shall be located not more than 9.1 m (30 ft) from any area where flammable liquid is dispensed.

7.6 Combustible Liquids Stored and Used Underground.**7.6.1 General.**

7.6.1.1 This chapter shall not apply to combustible liquids in use, such as the following:

- (1) Diesel fuel in the fuel tanks of diesel-powered vehicles
- (2) Hydraulic fluid in the reservoirs of hydraulic equipment
- (3) Lubricating oil in the lubrication reservoirs of operating equipment

7.6.1.2 Combustible liquids in approved tanks or containers meeting the following requirements shall be exempt from the requirements for storage areas:

- (1) Class II combustible liquids stored in containers meeting the requirements of this chapter and not exceeding 227 L (60 gal)
- (2) Class III combustible liquids stored in containers or approved tanks as specified in this chapter and not exceeding 2498 L (660 gal)

7.6.1.3 Combustible liquid containers shall be stored and shall be kept closed while stored in the following manner:

- (1) Drums holding 208 L (55 gal) and 114 L (30 gal) shall be set vertically, unless seam height will not allow, and not over one drum high.
- (2) Drums holding 60.6 L (16 gal) shall be set vertically and not over two drums high.
- (3) Pails holding 19 L (5 gal) shall be set vertically and not over four pails high.
- (4) Cartons holding grease cartridges shall not be stacked over three cartons high.

7.6.1.4 Ventilation shall be provided wherever combustible liquids are stored to prevent the accumulation of ignitable vapors.

7.6.2 Combustible Liquid Containers and Tanks.

7.6.2.1 Tanks for handling combustible liquids shall be substantially constructed and fitted with filler caps, vents, and discharge valves that are protected in the event of derailment or ribbing of the vehicle carrying the tanks.

7.6.2.2* Containers shall be acceptable to the authority having jurisdiction.

7.6.2.3 Containers larger than 19 L (5 gal) shall be provided with vacuum and pressure relief.

7.6.2.4 The capacity limitations for combustible liquids in containers and portable tanks shall be in accordance with the definitions for *container* and *portable tank* in Chapter 3.

7.6.2.5 Combustible liquid storage tanks intended for fixed installation and portable installations in accordance with NFPA 30 shall be of materials compatible with the liquid stored.

7.6.2.6 Atmospheric tanks shall be built in accordance with NFPA 30.

7.6.2.7 The operating pressure of storage tanks shall not exceed their design working pressure.

7.6.2.8 Low-pressure tanks shall be built in accordance with NFPA 30.

7.6.2.9 The operating pressure of the vessel shall not exceed the design working pressure.

7.6.2.10* Pressure vessels shall be built in accordance with NFPA 30.

7.6.2.11 Storage tanks shall be vented to prevent the development of vacuum or pressure from distorting the shell or roof of the tank as a result of filling or emptying and atmospheric temperature changes.

7.6.2.12 Protection shall also be provided to prevent overpressure from any filling source exceeding the design pressure of the tank.

7.6.2.13* Storage tank vents shall be at least as large as the filling or withdrawing lines but no less than 31.7 mm (1¼ in.) nominal inside diameter.

7.6.2.14 If more than one fill or withdraw line can be used simultaneously, the vent capacity shall be based on the maximum anticipated simultaneous flow.

7.6.2.15 Vent pipes shall be constructed to drain toward the tank without sags or traps to collect liquid.

7.6.2.16 Connections for all tank openings shall be liquid-tight.

7.6.2.17 Each connection to a tank through which liquid normally can flow shall be provided with an external valve located at the shell of the tank.

7.6.2.18 Tanks containing combustible liquids shall be provided with a means for quick cutoff of flow in the event of fire in the vicinity of the tank.

7.6.2.19 Openings for manual gauging, if independent of the fill pipe, shall be kept closed when not gauging.

7.6.2.19.1 Each opening for any liquid shall be protected against liquid overflow and possible vapor release by means of a spring-loaded cap or other device.

7.6.2.19.2 Substitutes for manual gauging shall be permitted.

7.6.3* Transfer and Transport of Combustible Liquids.

7.6.3.1 Combustible liquid shall be permitted to be transferred into the mine by pipeline, portable tank, closed container, or safety can.

7.6.3.2 When combustible liquid is transferred into the mine, it shall be transported or transferred directly to the storage area or location where it will be used.

7.6.3.3 Combustible liquid shall not be transported in the same conveyance with personnel unless the items are secured or are small enough to be carried by hand without increasing the risk of an accident.

7.6.3.4 Combustible liquid containers or tanks loaded on rail or trackless vehicles shall be secured against shifting and damage during transit.

7.6.3.5 Rail or trackless vehicles that carry supplies for production areas in addition to combustible liquids shall have provisions for securing or separating those supplies from the lubricants and combustible liquids so that, in the event of derailment or ribbing, the supplies will not puncture containers or tanks.

7.6.3.6 Vehicles carrying combustible liquids shall be kept clean of accumulations of oil, grease, and other combustible material.

7.6.3.7 Spilled combustible liquids shall be cleaned up immediately.

7.6.3.8 Any remaining residue shall be covered with an oil absorbent or rock dust.

7.6.3.9 Combustible liquid containers or tanks shall be at least 305 mm (12 in.) below energized trolley wires or protected from contacting the wire by insulation while being transported by trolley wire-powered systems.

7.6.3.10* The quantity of combustible liquid in containers or tanks off-loaded from transport vehicles and stored in an operating area shall not exceed a 3-day supply for operations in that area.

7.6.3.11 A single tank or container with a capacity exceeding a 3-day supply shall be permitted.

7.6.3.12* Pipeline systems used for combustible liquid transfer shall be permitted to be either wet or dry pipe installations.

7.6.3.12.1 Piping, valves, and fittings used for combustible liquid transfer shall be designed for the expected working pressures and structural stresses as follows:

- (1) Piping, valve, and fitting burst strengths shall be at least four times the static pressure.
- (2) The pipeline shall be designed to withstand the mechanical and thermal stresses caused by exposure to fire.

7.6.3.12.2 A manual shutoff valve shall be installed in the pipeline at the surface storage tank and at the point of underground discharge.

7.6.3.12.3 An additional shutoff valve shall also be installed in each branch line where the branch line joins the main line.

7.6.3.12.4 The pipeline system shall be guarded and protected against physical damage.

7.6.3.12.5 Guarding by choice of location shall be considered an acceptable practice.

7.6.4 Temporary Areas for the Storage of Combustible Liquids in Portable Containers.

7.6.4.1 Portable combustible liquid storage areas shall meet one of the following criteria:

- (1) They shall be located a minimum of 30.5 m (100 ft) from explosives magazines, electrical substations, shops, working faces, or other combustible liquid storage areas.
- (2) They shall be separated from explosives magazines, electrical substations, shops, working faces, or other combustible liquid storage areas by unexcavated coal or rock or by a masonry bulkhead.

7.6.4.2 Unless equipped with an approved fire protection system, the storage area shall be a minimum of 30.5 m (100 ft) from any shaft station and 7.6 m (25 ft) from energized trolley wire.

7.6.4.3 A portable combustible liquid storage area shall be recessed or otherwise located and protected from accidental damage by mobile equipment or blasting.

7.6.4.4 The aggregate quantity of diesel fuel in a combustible liquid storage area for portable containers or tanks shall not exceed 1893 L (500 gal).

7.6.4.5 The aggregate quantity of Class II and Class III combustible liquids in a combustible liquid storage area for portable containers or tanks shall not exceed 3785 L (1000 gal).

7.6.5* Fixed Areas for Class II Liquid Storage.

7.6.5.1 Fixed combustible liquid storage areas shall be located as follows:

- (1) A minimum of 30.5 m (100 ft) from explosives magazines, electrical substations, shaft stations, slope bottoms, and shops
- (2) A minimum of 30.5 m (100 ft) from other flammable or combustible liquid storage areas or separated by one of the following:
 - (a) Unexcavated coal
 - (b) Rock
 - (c) Masonry bulkhead with a minimum thickness of 102 mm (4 in.) of blocks or 51 mm (2 in.) of reinforced gunite
- (3) A minimum of 30.5 m (100 ft) from any working face and out of the line of sight of blasting or a minimum of 152 m (500 ft) within line of sight from any working face to avoid damage from fly rock
- (4) A minimum of 7.6 m (25 ft) from normally energized trolley wire

7.6.5.2 All fixed combustible liquid storage areas shall be enclosed and protected by an approved, fixed automatic fire suppression system.

7.6.5.2.1 All fixed combustible liquid storage area enclosures shall be of noncombustible construction, including floor, roof, roof supports, doors, and door frames.

7.6.5.2.2 Exposed coal within all fixed combustible liquid storage areas shall be covered with noncombustible materials such as gunite, shotcrete, or preformed masonry.

7.6.5.2.3 Bulkheads, if used, shall be sealed and be built of or covered with noncombustible materials.

7.6.5.2.4 All fixed combustible liquid storage area enclosures shall be constructed to provide suitable spill containment or shall be provided with a suitable floor drain to direct spilled liquid to a containment sump or vessel.

7.6.5.2.5 All openings to the storage area enclosures shall be sealed with fire-resistive stoppings.

7.6.5.2.6 The access opening through which containers are moved shall be located on the intake side.

7.6.5.2.7* All doors shall be of the self-closing type and shall be listed or approved and constructed of noncombustible materials.

7.6.5.2.8 A personnel door shall be provided on the side where air enters the enclosure.

7.6.5.2.9 The storage area enclosure shall be vented directly to the return or the surface.

7.6.5.2.10* Tanks shall rest 305 mm (12 in.) above the ground or on foundations made of concrete, masonry, piling, or steel.

7.6.5.2.11 Tank foundations shall be designed to prevent accumulation of combustible liquid under the tank, to minimize the possibility of uneven settling of the tank, and to minimize corrosion in any part of the tank resting on the foundation.

7.6.5.2.12 All piping, valves, and fittings shall be suitable for the expected working pressures and structural stresses.

7.6.5.2.13 Ventilation shall be provided to prevent the accumulation of ignitable vapors.

7.6.5.2.14 Empty or idle combustible pallet storage within the combustible liquid storage area shall not be permitted.

7.6.5.2.15 The aggregate quantity of Class II and Class III combustible liquids in a fixed combustible liquid storage area shall not exceed 18,927 L (5000 gal), of which Class II shall not exceed 3785 L (1000 gal).

7.6.6 Fixed Storage Areas for Class III Combustible Liquids. Class III combustible liquids shall be stored in fire-resistive containers within an enclosure of fire-resistant construction.

7.6.7 Storage, Transport, and Dispensing of Combustible Liquids Using Mobile Equipment.

7.6.7.1 Where combustible liquids are stored on mobile equipment such as mobile service trucks, the equipment shall be parked at a fixed location or a location that meets the requirements of 7.6.4 when not in use.

7.6.7.2 The aggregate quantity of combustible liquids carried on mobile equipment shall not exceed 3785 L (1000 gal).

7.6.7.3 Diesel fuel tank trucks shall not exceed 1893 L (500 gal) storage capacity.

7.6.8* Dispensing Combustible Liquids.

7.6.8.1 Class III combustible liquids shall be permitted to be dispensed through the application of positive pressure to containers or tanks only where the containers or tanks are certified as pressure vessels.

7.6.8.2 Class II combustible liquids shall not be dispensed using compressed gas.

7.6.8.3 Where electrically powered pumps are used to dispense combustible liquids, a switch or circuit breaker shall be provided at a location away from dispensing devices, including remote pumping systems, to shut off the power to all dispensing devices in an emergency.

7.6.8.4 Dispensing nozzles for Class II combustibles shall be of the self-closing type without a latch-open device.

7.6.8.5 At least one portable fully charged and operable fire extinguisher having a nominal capacity of 9.1 kg (20 lb) with a minimum rating of 4-A:60-B:C shall be located not more than 9.1 m (30 ft) from any area where combustible liquid is dispensed.

7.6.8.6 Dispensing Class II combustible liquid from containers or tanks shall be accomplished by an approved transfer pump or by gravity flow.

7.6.8.6.1 Where needed, containers or tanks shall be equipped with an approved vent.

7.6.8.6.2 If a manual valve is used, it shall be of the self-closing type without a latch-open device.

7.6.8.7 Spillage shall be cleaned up.

7.6.8.8 Remaining residue shall be covered with an oil absorbent or rock dust.

Chapter 8 Mine Surface Buildings

8.1 Construction.

8.1.1 This chapter shall include mine offices, bathhouses, warehouses, vehicle storage, shops, and permanent miscellaneous buildings.

8.1.2 Offices over 1394 m² (15,000 ft²), warehouses over 929 m² (10,000 ft²), and shops over 465 m² (5000 ft²) shall be constructed of noncombustible materials or provided with an automatic sprinkler system installed in accordance with NFPA 13.

8.2 Fire Prevention.

8.2.1 No smoking shall be allowed in warehouses.

8.2.2 Combustible storage shall be maintained at least 0.9 m (3 ft) from electrical panels and electric resistance heaters.

8.2.3 Oily waste or rags that can create a fire hazard shall be placed in covered metal containers.

8.2.4 Battery rooms shall be in accordance with **Article 480 of NFPA 70**.

8.2.4.1 Battery-charging installations shall be located in a designated area that is protected against damage from mobile equipment.

8.2.4.2 Each battery-charging installation shall be equipped with the following:

- (1) Approved portable multipurpose fire extinguisher(s)
- (2) Ventilation for the removal of generated gases from charging batteries
- (3) A means for flushing spilled electrolyte

8.3 Life Safety.

8.3.1 Two means of egress shall be provided from multistory buildings.

8.3.2 For office, bathhouse, and warehouse areas, emergency lighting shall be provided in each stairwell or hallway that is the means of egress in accordance with NFPA 101.

8.3.3 For office, bathhouse, and warehouse areas, emergency exit signs shall be provided along the means of egress.

8.4 Flammable and Combustible Liquids.

8.4.1 All storage and handling of flammable and combustible liquids shall conform to the guidelines established in NFPA 30.

8.4.2 The quantity of flammable liquids and aerosols stored outside a flammable liquids storage cabinet shall not exceed 94.6 L (25 gal).

8.4.3 Other than in shops, the quantity of combustible liquids outside a flammable liquids storage cabinet or room constructed in accordance with NFPA 30 shall not exceed 454 L (120 gal).

8.4.4 Dispensing of flammable or combustible liquids in warehouses shall be prohibited.

8.4.5 Storage of acetylene, oxygen, or other welding gases inside warehouses shall be prohibited.

8.4.6 Drip pans shall be provided to catch leakage or spillage wherever flammable or combustible liquids are dispensed.

8.4.7 Fusible link-actuated automatic closers shall be provided on all parts cleaning tanks.

8.5* Compressed Gas Storage and Usage. Storage and use of compressed gases in and around mine buildings shall be in accordance with Section 7.1.

8.6 Fire Detection and Protection.

8.6.1 For multistory office buildings, a central station or proprietary alarm system shall be installed in accordance with NFPA 72.

8.6.1.1 Alarms shall include smoke detectors, duct detectors, and manual pull stations.

8.6.1.2 In addition, if sprinklers are installed, water flow, valve tamper, and low building temperature alarms shall be provided.

8.6.1.3 All equipment shall be listed or approved for its intended use.

8.6.2* If sprinkler systems are installed, they shall be in accordance with NFPA 13.

8.6.3* If fire hydrants are installed, they shall be in accordance with NFPA 24.

8.6.4 If a building is more than two stories high, a standpipe system shall be installed in accordance with NFPA 14.

8.6.5 If a gaseous fire suppression system is installed in a computer or telephone equipment room, it shall be in accordance with NFPA 2001.

8.6.6* Fire extinguishers shall be provided and maintained in accordance with NFPA 10.

8.6.6.1 Fire extinguishers shall be inspected at least every 6 months.

8.7 Water Supplies. If sprinklers or fire hydrants are installed, water supplies shall be capable of providing the required flow rate and pressure necessary for the fire protection features for at least one hour.

Chapter 9 Coal Conveyance and Storage

9.1* Conveyors — General.

9.1.1* Belt conveyors shall meet the following minimum requirements:

- (1) Belt alignment limit switches shall be provided on conveyors to shut down belts that are tracking improperly.
- (2) Slip switches shall be provided to detect a slipping or jammed belt and shall be interlocked to shut off driving power when the belt stops or slows down by more than 20 percent of its normal speed.
- (3) Slip switches shall be tested on an annual basis.
- (4) Shutoff power shall be provided on contributing conveyors to prevent any operating conveyor from discharging material to a stopped downstream conveyor.
- (5) Means shall be provided to remove tramp metal and other foreign objects as early in the handling process as possible.
- (6) Hydraulic systems for belt alignment, if provided, shall use only listed fire-retardant hydraulic fluids or shall be protected by an automatic fire protection system.

- (7) Alarms shall annunciate in the operator's control room.
- (8) Electrical equipment shall be classified as Class II, Division 2, Group F in all areas where required by *NFPA 70*.
- (9) Guarding for machinery in the drive area and at other points along the belt shall be made of noncombustible material.

9.1.2* Structures supporting belt conveyors shall be designed to prevent coal accumulations.

9.1.2.1 The design shall include any surface near the belting that can catch and retain fine coal liable to ignite spontaneously.

9.1.3 Consideration shall be given to the possibility of static electrical discharge at the conveyor head and tail pulleys located in dry climates where bituminous and lower ranking-type coals are handled.

9.1.3.1 Factors that shall be considered are belting materials, belt speed, and housekeeping of spilled coal dust.

9.1.3.2 Where such conditions as described in 9.1.3 exist, the use of static dissipators or eliminators shall be considered.

9.1.4 Attention shall be given to the prevention of and cleaning of accumulations of fine coal dust beneath and close to belt conveyors.

9.2 Overland Conveyors.

9.2.1 Chute plug alarms shall be provided for long runs of belt or critical conveyor systems.

9.2.2 The conveyor path shall be kept free of all grass, weeds, trash, or any other material that could create an exposure to the belt should it catch on fire.

9.2.3 Motor control center (MCC) buildings for conveyor systems shall be kept free of accumulations of coal dust.

9.3 Below-Grade Reclaim Conveyors.

9.3.1 Methane detection shall be provided in below-grade reclaim conveyor areas.

9.3.2 Equipment shall be interlocked to de-energize upon detection of a 2 percent concentration of methane.

9.3.3 Portable methane detectors are an acceptable alternative to fixed detectors, provided a reading is taken once per shift.

9.3.4 Hydraulic units more than 7.6 m (25 ft) inside the entrance and greater than 189 L (50 gal) total capacity shall have listed fire-resistant hydraulic fluid or shall be provided with an automatic fire suppression system. The fire suppression system shall be interlocked to shut down the hydraulic unit and send an alarm to a constantly attended location.

N 9.3.5 Belowgrade reclaim conveyors shall be provided with an automatic sprinkler system in accordance with 9.4.6.3.

N 9.3.5.1 Belowgrade reclaim conveyors less than 152.4 m (500 ft) in length shall not be required to be provided with an automatic sprinkler system.

N 9.3.5.2 Sprinkler protection shall not be required on the underside of belts less than 1.2 m (4 ft) in width.

N 9.3.6 Means of egress shall be provided in belowgrade reclaim conveyor tunnels.

N 9.3.6.1 Means of egress shall be provided every 91.4 m (300 ft) of travel distance in reclaim conveyor tunnels not provided with an automatic sprinkler system.

N 9.3.6.2 Means of egress shall be provided every 152.4 m (500 ft) of travel distance in reclaim conveyor tunnels provided with an automatic sprinkler system.

9.4 Underground Conveyors.

9.4.1 Underground conveyor belts shall be of a flame-resistant material and approved by the authority having jurisdiction.

9.4.2 Entries in which belt conveyors are installed shall be kept free of accumulations of coal and coal dust around the belt idlers, pulleys, and belt edges and shall be rock-dusted.

9.4.3* Fixed combustible material such as posts, cribbing, and roof supports shall be guarded from contact with the belt by the use of noncombustible material or by distance and shall be located at a distance of at least 152.4 mm (6 in.) from any idler or pulley.

9.4.4 Belt conveyor installations shall use a support structure without a deck between the upper and lower belt flights.

9.4.5 Belts that carry the load of the belt on a low-friction metal deck without rollers shall be permitted to be used.

9.4.6 Automatic Fire Suppression Systems at the Belt Drive.

9.4.6.1 Deluge water spray systems, foam systems, closed-head sprinkler systems, or dry chemical systems automatically actuated by rise in temperature shall be installed at main and secondary belt conveyor drives.

9.4.6.1.1 If sprinkler or water systems are installed, they shall comply with 4.3.3.3 and 9.4.6.3 of this standard.

9.4.6.1.2 If dry chemical systems are installed, they shall be installed and maintained in accordance with *NFPA 17* and the manufacturer's instructions.

9.4.6.2 Fire suppression systems shall extend to the drive areas of belt conveyors, including drive motor(s), reducer, head pulley, and belt storage unit (takeup), including any hydraulic power unit; its electrical controls; and the top and bottom of the first 15.2 m (50 ft) of belt from the drive on the downwind side.

9.4.6.2.1 Where a pre-engineered dry chemical fire suppression system is to be used, protection shall also be provided for the top surface of both the top and bottom belts, and the bottom surface of the top belt of the first 15.2 m (50 ft) of fire-resistant belt or 45.7 m (150 ft) of non-fire-resistant belt from the drive on the downward side.

9.4.6.3 Water-Based Fire Suppression Systems.

9.4.6.3.1 Water Supply.

9.4.6.3.1.1 The water supply shall be free of excessive sediment and corrosives. An approved strainer with a flush-out connection and manual shutoff valve shall be provided.

9.4.6.3.1.2 The water supply shall provide the required flow for not less than 60 minutes.

9.4.6.3.1.3* Approved or listed flexible connections shall be permitted from the water main to the pressure reducing device or shutoff valve to the sprinkler system.

(A) The flexible connection shall be rated at a pressure that exceeds the maximum water pressure expected on the system.

(B) If a non-metallic connection is used, it shall not be within 3.0 m (10 ft) of the belt drive motors or primary roller drive.

9.4.6.3.1.4 If a pressure regulator is used, it shall be set below the maximum pressure allowed by the pressure rating of the piping and fittings.

9.4.6.3.1.5 If a pressure regulator is used, it shall be inspected and tested on a weekly basis to ensure that it is functioning properly and the sprinkler system has the right amount of pressure.

Δ 9.4.6.3.2 General Sprinkler Requirements. Sprinkler systems shall meet the following requirements:

- (1) The sprinklers shall be installed in accordance with NFPA 13 as much as practical, and shall have components that have been listed.
- (2) The sprinkler activation temperature shall not be less than 65.6°C (150°F) or greater than 148.9°C (300°F).
- (3) Sprinklers shall be kept free of excessive rock dust, muck, conveyor string, or any other material that can block the discharge or insulate the fusible link.
- (4) The application rate shall not be less than 10.2 L/min/m² (0.25 gpm/ft²) over the top surface of the upper belt, and the discharge shall be directed at both the top and bottom surfaces of the upper belt and to the top surface of the lower belt.
- (5) With a water flow and pressure that is present under normal mine operating conditions, the residual pressure measured downstream of the opened sprinklers or the eight-head inspector's test connection of 70 kPa (10 psi) or greater for belt drive systems shall be maintained at all times.
- (6) Maximum distance between nozzles on a branch line shall not exceed 2.4 m (8 ft).
- (7) Piping for the deluge, foam, or closed-head sprinkler system shall be metal and listed for sprinkler applications.
- (8)* Sprinkler piping shall be supported by UL-listed pipe hangers or other substantial metal supports such as angle iron, U bolts, or heavy chain.
- (9) The system shall be interlocked to shut down the conveyor and shall provide an audible and visual alarm.
- (10) The components of the system shall be located so as to minimize the possibility of damage by roof collapse or by the moving belt and its load.
- (11) Wet pipe sprinklers shall be spaced a minimum of 1.8 m (6 ft) apart.

9.4.6.3.3 Deluge Water Systems. Deluge water spray systems shall meet the requirements of 9.4.6.3.3.1 through 9.4.6.3.3.4.

9.4.6.3.3.1 The system shall be activated by heat detectors or no less effective means.

(A) Detectors shall be located at the belt drive, hydraulic takeup unit (unless fire-resistive fluid is used), discharge roller, and the roof above the conveyor.

(B) Detectors at the roof line should be spaced 2.4 m to 3.0 m (8 ft to 10 ft) apart along the entire length of the protected area of the belt.

9.4.6.3.3.2 The water spray nozzles shall be full cone, corrosion resistant [if less than 0.95 cm ($\frac{3}{8}$ in.) inside diameter or K-factor 4.2 or lower], and provided with blow-off dust covers.

9.4.6.3.3.3 If water spray sprinklers or open-head sprinklers are used, blow-off dust covers are not required to keep them clean as long as they are flow tested in accordance with 4.3.3.5.5.3.

Δ 9.4.6.3.3.4 A closed-head sprinkler shall be used over the electrical controls.

9.4.6.3.4 Foam Systems.

9.4.6.3.4.1 Foam systems shall meet the requirements of 9.4.6.3.4.2 through 9.4.6.3.4.5.

9.4.6.3.4.2 The system shall be activated by heat detectors or no less effective means.

(A) Detectors shall be located at the belt drive, hydraulic takeup unit (unless fire-resistive fluid is used), discharge roller, and the roof above the conveyor.

(B) Detectors at the roof line should be spaced 2.4 m to 3.0 m (8 ft to 10 ft) apart along the entire length of the protected area of the belt.

9.4.6.3.4.3 The nozzles shall be full cone, corrosion resistant [if less than 0.95 cm ($\frac{3}{8}$ in.) inside diameter or K-factor 4.2 or lower], and provided with blow-off dust covers.

9.4.6.3.4.4 The system shall have a capacity to last 25 minutes.

9.4.6.3.4.5 A closed-head sprinkler shall be used over the electrical controls.

9.4.6.3.5 Maintenance and Testing. Fire suppression systems shall be maintained and tested in accordance with 4.3.3.5.

9.4.7 Manual Extinguishing.

9.4.7.1 Water lines shall be installed parallel to the entire length of belt conveyors and shall be equipped with fire taps with valves at 91.4 m (300 ft) intervals.

9.4.7.2 The threads on the hose taps shall be protected against dirt and rock grit that can prevent a quick connection.

9.4.7.3 The hose tap at the belt drive area shall be at least 15.2 m (50 ft) upwind of the belt drive.

9.4.7.4* At least 152.4 m (500 ft) of fire hose with fittings shall be stored at strategic locations along the conveyor belt, that is, at transfer points, drive areas, and tailpieces.

9.4.7.5 For each conveyor belt exceeding 610 m (2000 ft) in length, an additional cache of materials as specified in 9.4.7.4 shall be provided.

9.4.7.6 For mines using a track haulage system, the same criteria as those in Section 9.2 through 9.2.3 shall be met.

9.4.7.7 The following materials shall be stored within 91.4 m (300 ft) or 5 minutes of a belt drive:

- (1) 152.4 m (500 ft) of fire hose or a high-expansion foam device and 61 m (200 ft) of hose
- (2) Tools to open a stopping between the belt entry and the adjacent intake entry
- (3) 109 kg (240 lb) of rock dust

9.4.7.8 Foam.

9.4.7.8.1 The foam generator shall produce foam sufficient to fill 30.5 m (100 ft) of belt haulageway in not more than 5 minutes.

9.4.7.8.2 A 1-hour supply of foam shall be kept on hand.

9.4.7.9 The entry containing the main water line and crosscuts containing water outlets shall be accessible.

9.4.7.10 Suitable communication lines to the surface shall be provided in the belt haulageway or adjacent entry.

9.4.7.11 A crew consisting of at least five members for each shift shall be trained in fire-fighting operations. Fire drills shall be held at intervals not exceeding 6 months.

9.4.7.12 Two 9.1 kg (20 lb) dry chemical extinguishers shall be located at the drive areas.

9.4.8* A dust suppression water spray system actuated by a “conflow” switch or similar device shall be provided at the belt feeder.

9.4.9 Electrical equipment shall be permissible where required by the authority having jurisdiction.

9.5* Coal Storage — General. Coal bins, bunkers, and silos shall meet the following requirements:

- (1) Storage durations shall be limited to prevent spontaneous combustion.
- (2) Equipment shall be of noncombustible construction designed to minimize coal hang-up.
- (3) Means shall be provided to remove burning, wet, or smoldering coal so it can be disposed of without producing an explosion or a fire.

9.5.1 Storage Bins.

9.5.1.1 All interior bins handling dusty material shall be vented in accordance with 6.2.2.

9.5.1.2 Storage bins for coal shall be located so that sources of heat not intended specifically to control the temperature of coal do not raise the temperature of the coal in the bin, causing spontaneous combustion materially.

9.5.2 Coal Silos.

9.5.2.1 Coal shall not be stored in silos and bunkers for long periods. If coal must be stored for a long period, air entrainment shall be prevented using the following methods:

- (1) Covering the top of the stored coal with a binder material
- (2) Inerting the stored coal with recommended inert gas

9.5.2.2 Areas in the storage (hideouts) that can allow pockets of coal to form, dry, and combust spontaneously shall be removed.

9.5.2.3 Storage silos shall be constructed of noncombustible material.

9.5.2.4 Electrical equipment shall be installed to meet the requirements of *NFPA 70* in effect at the time of installation.

9.5.2.5 If a dust collector is provided, it shall be equipped with explosion relief panels in accordance with *NFPA 68*. The dust collector shall be grounded and have antistatic, fire-resistant bags.

9.5.2.6 Wash-down hoses shall be provided at the bottom of the silo.

9.5.2.7 Dual high-level cutoff switches shall be provided for the silo. The feed conveyor shall be interlocked to shut down on the low-high indication.

9.5.2.8 The silo shall be maintained on a regular cleaning schedule to minimize the buildup of coal beneath the hopper and other areas inside the silo.

9.5.2.9 Deluge water spray systems, foam systems, closed-head sprinkler systems, wet chemical systems, or dry chemical systems automatically actuated by rise in temperature shall be installed over the belt drive areas on top of a silo.

9.5.3 Stacker Tubes and Coal Storage Piles.

9.5.3.1 Coal piles shall be designed to minimize the entrainment of air.

9.5.3.1.1 Minimization shall be permitted by development of a compacted edge around the pile.

9.5.3.1.2 The edge described in 9.5.3.1.1 shall be sealed with binder to aid in sealing.

9.5.3.2 Hot spots or areas of spontaneous combustion shall be removed by digging.

9.5.3.3 The use of water for extinguishment shall be used at a minimum.

9.5.3.4 Active storage piles shall be worked to prevent dead pockets of coal, a potential source of spontaneous heating.

9.5.3.5 Coal piles shall not be located above heat sources, such as steam lines, or sources of air, such as manholes.

9.5.3.6 Coal placed in long-term storage shall be piled in layers, appropriately spread, and compacted prior to the addition of subsequent layers to reduce air movement and to minimize water infiltration into the pile.

9.5.3.7 Where possible, storage piles shall be arranged to allow access to the pile with earth-moving equipment in the event of developing hot spots or fire.

Chapter 10 Truck, Rail, and Barge Loadouts**10.1 Construction.**

10.1.1 The loadout shall be constructed of noncombustible material.

10.1.2 Conveyor systems shall be in accordance with Section 9.1.

10.2 Fire Prevention.

10.2.1 No smoking shall be allowed in the loadout control room.

10.2.2* Loadout control rooms shall be designed, constructed, and maintained to reduce the chances of coal dust entering the room.

10.2.3 Combustible storage shall be maintained at least 0.9 m (3 ft) from all electrical panels, gas-fired heaters, and electric resistance heaters.

10.2.4 Trash and other unnecessary combustibles shall not be allowed to accumulate in the loadout control room.

10.2.5 Motor control centers shall be thermographically scanned on an annual basis to identify hot spots and loose electrical connections.

10.2.6 Hydraulic equipment shall have the following alarms interlocked to shut down the equipment:

- (1) Low oil pressure
- (2) High oil temperature
- (3) Low oil level

10.3 Life Safety.

10.3.1 Two means of egress shall be provided from the loadout control room if the room is more than two levels high.

10.3.2 For multistory buildings, emergency lighting shall be provided in accordance with NFPA 101.

10.3.3 For multistory buildings, emergency exit signs shall be provided along the means of egress.

10.4 Fire Detection and Protection.

10.4.1 A smoke detector system shall be installed in the loadout control room in accordance with NFPA 72.

10.4.1.1 The smoke detector system shall actuate an audible and visual alarm system.

10.4.1.2 For infrequently occupied or remote locations, the system shall send an alarm to a constantly attended location.

10.4.2* A gaseous fire suppression system shall be installed in loadout control rooms that are not regularly occupied and located in remote areas.

10.4.3 An automatic fire suppression system shall be installed to protect hydraulic pumps that have a capacity over 189.3 L (50 gal) and are located on an upper floor.

10.4.3.1 The system shall be actuated by a heat detector system.

10.4.3.2 The system shall be interlocked to shut off the power to the unit.

10.4.3.3 A listed fire-resistive fluid shall be an acceptable alternative to an automatic fire suppression system.

10.5 Manual Fire Fighting.

10.5.1* Fire extinguishers shall be provided in accordance with NFPA 10.

10.5.2 For multistory buildings, an emergency response plan shall be developed with the input of the local fire department.

10.5.3 For areas subject to flood, an emergency response plan shall be developed to include fire-fighting procedures during a flood.

Chapter 11 Emergency Response, Manual Fire Fighting, and Training

11.1* Emergency Procedures.

11.1.1 Emergency procedures shall be provided to instruct all miners in the location and use of fire-fighting equipment, location of escapeways and exits, and evacuation procedures.

11.1.2 The emergency procedures shall include a specific fire-fighting and evacuation plan with procedures for evacuation of all miners not required for fire-fighting activities, rapid assembly and transportation of personnel and equipment to the fire scene, and operation of the fire suppression equipment available at the mine.

11.1.3 Instruction in emergency procedures shall be provided to all miners on an annual basis.

11.1.4 Instruction in the location of fire-fighting equipment, location of escapeways and exits, and evacuation procedures shall be provided to all miners prior to entering an active mining area for the first time.

11.1.5 All employees shall receive annual instruction on emergency evacuation procedures.

11.1.6 All employees shall receive annual instruction on the procedures for discharging portable fire extinguishers and the proper method of fire attack.

11.1.7 For underground mines, the following additional criteria shall be met:

- (1) Fire drills shall be held on a 90-day basis. A record of the drill shall be kept and include the date, the number of persons participating, the area of the mine involved, the procedures followed, and the equipment used.
- (2) At least two miners in each working section on each production shift shall be proficient in the use of all fire suppression equipment in that section and know the location of the equipment.
- (3) Visitors shall be trained on the hazards they might encounter and in the appropriate emergency procedures.

11.1.8 The local fire department shall be requested or invited to make an annual tour of the surface area of the mine buildings. The tour shall include all surface buildings, major equipment, the location of flammable and combustible liquid storage, a discussion of the water supply availability, and the location of electrical shutoffs.

11.2 Underground Operations.

11.2.1 General.

11.2.1.1 An emergency response team shall be available and trained in basic fire-fighting techniques that would include, but not be limited to, fire hose, foam generators, fire extinguishers, and smoke control.

11.2.1.2 Each operator of attended equipment and each miner assigned to job duties normally in sight of the equipment shall be proficient in the use of the fire suppression devices on that equipment.

11.2.1.3 On a maintenance shift, the foreman and at least one miner for every five shall be proficient in the use of fire suppression equipment available in the mine and know the location of the equipment.

11.2.2 Fire-Fighting Team. Mines shall have a fire-fighting team trained in basic fire-fighting techniques, for example, hose streams and foam generation.

11.2.2.1 The fire-fighting team shall have at least 16 hours of refresher training per year.

11.2.2.2 The team shall consist of at least five members on each shift.

11.2.2.3 Self-contained breathing apparatus (SCBA) and fire-retardant coats, boots, and gloves shall be provided for the fire-fighting team.

11.2.3 Emergency Vehicle.

11.2.3.1 All mines shall be provided with an emergency vehicle outfitted with fire hose, appropriate fittings, a “Y” or a “siamese” connection, two adjustable fire department-quality fog nozzles, various tools, and pressure regulators (where necessary).

11.2.3.2 If an underground water car is provided, it shall be at least 3785 L (1000 gal) capacity and shall have at least 91.4 m (300 ft) of fire hose with nozzles.

11.2.3.2.1 A water car shall be capable of providing flow through a hose of 190 L/min (50 gpm) at a nozzle pressure of 345 kPa (50 psi).

11.2.3.2.2 A portable wet or dry chemical car shall be permitted to be provided as long as it carries the extinguishing capacity equivalent to a water car.

11.2.3.2.3 The wet or dry chemical car described in 11.2.3.2.2 shall be no farther than 3.2 km (2 mi) from each working section.

11.2.4 Foam Generator. A high-expansion foam generator shall be available within 60 minutes of fire notification and have enough foam to supply the fire-fighting operation for 35 minutes.

11.2.5 Fire Hose and Hydrants.

11.2.5.1* Water lines installed parallel to haulage tracks using mechanized equipment in the track or adjacent entry shall be equipped with outlet valves at intervals of not more than 152.4 m (500 ft), and with 152.4 m (500 ft) of fire hose with fittings suitable for connection shall be provided at strategic locations.

11.2.5.2 Hydrants shall be provided along belt conveyors at intervals not to exceed 91.4 m (300 ft).

11.2.5.3 At least 152.4 m (500 ft) of fire hose shall be provided for each belt flight and strategically positioned within that belt flight.

11.2.5.4 The threads on the hose and hydrants shall be protected against dirt and rock grit.

11.2.5.5* Multiple hydrant assemblies, with the tools needed for their installation, shall be provided as part of each cache of emergency materials.

11.2.5.6 Fire hose shall be lined with a material having flame-resistant qualities meeting requirements for hose in the U.S. Bureau of Mines³ Schedule 2G.

11.2.5.6.1 The covers of the fire hose shall be polyester or other material with flame-spread qualities and mildew resistance equal or superior to polyester.

11.2.5.6.2 The bursting pressure shall be at least four times the water pressure at the valve to the hose inlet with the valve closed.

11.2.5.6.3 The maximum water pressure in the hose nozzle shall not exceed a gauge pressure of 689.5 kPa (100 psi).

11.2.6 Emergency Materials. In addition to specific area equipment, the following equipment shall be readily available at locations not exceeding 3.2 km (2 mi) from each working section:

- (1) 304.8 m (1000 ft) of brattice boards
- (2) Two rolls of brattice cloth
- (3) Two hand saws
- (4) 11.3 kg (25 lb) of 8d nails
- (5) 11.3 kg (25 lb) of 10d nails
- (6) 11.3 kg (25 lb) of 16d nails
- (7) Three claw hammers
- (8) 25 bags of wood fiber plaster or 10 bags of cement (or equivalent material)
- (9) 4536 kg (5 tons) of rock dust

11.3 Surface Operations.

11.3.1* Surface mines shall meet the same requirements for fire-fighting teams listed in 11.2.2 unless public fire fighters are available within 30 minutes with the capability to fight the most difficult fire at the mine site.

11.3.2 Fire extinguishers shall be provided in accordance with NFPA 10.

11.3.3 If fire hydrants are provided, they shall be installed in accordance with NFPA 24.

11.3.4 If fire hydrants are not provided, water trucks shall be the fire-fighting water source.

11.3.4.1 Water trucks shall be equipped with a pump, fire hose, nozzles, and appropriate fittings.

11.3.4.2 The water truck shall be equipped with a water cannon (turret).

11.3.4.3 The water truck shall be equipped with a connection to enable the fire department to take suction from the tank.

11.3.5 Fire hose and couplings shall be listed or approved. Cotton- or cotton-polyester-jacketed hose shall be treated in accordance with the U.S. Department of Agriculture Forest Service Specification 5100-186(d) for mildew resistance.

11.3.6 Water lines shall be capable of delivering at least 378.5 L/min (100 gpm) at a hose nozzle pressure of 689.5 kPa (100 psi).

11.3.7 The water pressure at the hose nozzle shall not be excessively high so as to present a hazard to the hose operator.

11.3.8 The hose connections shall have threads compatible with the local fire department's hoses, or a supply of adapters shall be available to adapt the hose connections to the fire department hoses. The local fire department shall be consulted to ensure thread compatibility for hose connections.

Annex A Explanatory Material

Annex A is not a part of the requirements of this NFPA document but is included for informational purposes only. This annex contains explanatory material, numbered to correspond with the applicable text paragraphs.

A.1.1.1 In the development of this document, the data in NIOSH Information Circular 9470, “Analysis of Mine Fires for All Underground and Surface Coal Mining Categories: 1990–1999,” were examined. Table A.1.1.1(a) shows the number of

fires for underground coal mines; surface fires at underground coal mines, at surface coal mines, and at coal preparation plants; as well as the number of fire injuries and coal production for the time period from 1990 to 1999. Table A.1.1.1(b) provides the number of coal mines and preparation plant fires, injuries due to fire, and coal production from 2001 to 2016.

Analysis of the data shows a general decrease in the number of fires over the 10-year period, particularly from 1996 to 1999, while coal production increased slightly. The largest number of fires over the 10-year period, as well as for each 2-year time period, occurred at surface coal mines. There were 164 injuries due to fire during the 10-year period, with the number decreasing significantly over the last 4 years. There were two fatalities in 1991.

A.1.3 Because of the uniqueness of coal mining, provisions in this standard can differ from commonly accepted fire protection standards and guides for other types of occupancies.

A.3.2.1 Approved. The National Fire Protection Association does not approve, inspect, or certify any installations, procedures, equipment, or materials; nor does it approve or evaluate testing laboratories. In determining the acceptability of installations, procedures, equipment, or materials, the authority

having jurisdiction may base acceptance on compliance with NFPA or other appropriate standards. In the absence of such standards, said authority may require evidence of proper installation, procedure, or use. The authority having jurisdiction may also refer to the listings or labeling practices of an organization that is concerned with product evaluations and is thus in a position to determine compliance with appropriate standards for the current production of listed items.

A.3.2.2 Authority Having Jurisdiction (AHJ). The phrase “authority having jurisdiction,” or its acronym AHJ, is used in NFPA documents in a broad manner, since jurisdictions and approval agencies vary, as do their responsibilities. Where public safety is primary, the authority having jurisdiction may be a federal, state, local, or other regional department or individual such as a fire chief; fire marshal; chief of a fire prevention bureau, labor department, or health department; building official; electrical inspector; or others having statutory authority. For insurance purposes, an insurance inspection department, rating bureau, or other insurance company representative may be the authority having jurisdiction. In many circumstances, the property owner or his or her designated agent assumes the role of the authority having jurisdiction; at government installations, the commanding officer or departmental official may be the authority having jurisdiction.

Table A.1.1.1(a) Number of Coal Mine and Preparation Plant Fires, Injuries Due to Fire, and Coal Production from 1990 to 1999

| Years | Number of Fires* | | | | | Coal Production [†] (10 ⁶ short tons) |
|-----------|------------------------|-----------------------------------|--------------------|-------------------------|--------------------------|--------------------------------------------------------------|
| | Underground Coal Mines | Surface at Underground Coal Mines | Surface Coal Mines | Coal Preparation Plants | Number of Fire Injuries* | |
| 1990–1991 | 25 | 17 | 67 | 23 | 59 | 2,004 |
| 1992–1993 | 18 | 14 | 37 | 22 | 29 | 1,928 |
| 1994–1995 | 23 | 16 | 47 | 18 | 39 | 2,059 |
| 1996–1997 | 6 | 7 | 40 | 8 | 19 | 2,155 |
| 1998–1999 | 15 | 11 | 24 | 20 | 18 | 2,218 |
| 1990–1999 | 87 | 65 | 215 | 91 | 164 | 10,364 |
| Total | | | | | | |

*Derived from MSHA “Fire Accident Abstract” and “Fire Accident Report” publications.

[†]Derived from MSHA “Injury Experience in Coal Mining” publications.

N Table A.1.1.1(b) Number of Coal Mine and Preparation Plant Fires, Injuries Due to Fire, and Coal Production from 2001 to 2016

| Years | Number of Fires* | | | | | Coal Production [†] (10 ⁶ short tons) |
|--------------|------------------------|-----------------------------------|--------------------|-------------------------|--------------------------|--------------------------------------------------------------|
| | Underground Coal Mines | Surface at Underground Coal Mines | Surface Coal Mines | Coal Preparation Plants | Number of Fire Injuries* | |
| 2001–2002 | 9 | 7 | 22 | 10 | 48 | 2,221 |
| 2003–2004 | 12 | 6 | 17 | 15 | 24 | 2,184 |
| 2005–2006 | 11 | 6 | 41 | 13 | 25 | 2,294 |
| 2007–2008 | 14 | 9 | 31 | 14 | 24 | 2,318 |
| 2009–2010 | 11 | 9 | 31 | 18 | 15 | 2,159 |
| 2011–2012 | 5 | 3 | 40 | 7 | 20 | 2,112 |
| 2013–2014 | 7 | 13 | 42 | 7 | 15 | 1,985 |
| 2015–2016 | 3 | 4 | 26 | 13 | 15 | 1,625 |
| Total | 72 | 57 | 250 | 97 | 186 | 16,898 |

*Derived from MSHA Datasets.

[†]Derived from the U.S. Energy Information Administration, *Annual Coal Report*, 2017.

A.3.2.4 Listed. The means for identifying listed equipment may vary for each organization concerned with product evaluation; some organizations do not recognize equipment as listed unless it is also labeled. The authority having jurisdiction should utilize the system employed by the listing organization to identify a listed product.

A.3.3.33 Mobile Equipment. Mobile equipment includes, but is not limited to, wheeled, skid-mounted, track-mounted, or rail-mounted equipment capable of moving or being moved.

N A.3.3.34 Noncombustible Material. Materials that are reported as passing ASTM E136, *Standard Test Method for Behavior of Materials in a Vertical Tube Furnace at 750°C*, should be considered noncombustible materials.

A.4.2 Potential sources of ignition include, but are not limited to, the following:

- (1) Smoking
- (2) Open flames
- (3) Cutting and welding
- (4) Hot surfaces
- (5) Frictional heat
- (6) Static, electrical, and mechanical sparks
- (7) Spontaneous ignition, including heat-producing chemical reactions
- (8) Radiant heat

A.4.2.5.1 Automatic-closing doors provide a higher level of fire protection and are therefore recommended.

A.4.2.6 Belt fires originating away from the drive area usually have been caused by idlers with defective or stuck bearings. Tests have shown that such idlers can become moderately hot [93.3°C to 149°C (200°F to 300°F)]. The coal task group has been unable to find reliable evidence that idlers can become hot enough to ignite fire-retardant belting directly.

It appears that a warm or hot idler can cause fine coal dust accumulated around the idler to ignite. Then, when the belt has been stopped, coal burning beneath the belt ignites the belting.

The key to avoiding belt fires is to prevent the accumulation of fine coal dust around idlers. If a metal deck is provided between the carrying strand and the return strand of the belt, coal dust accumulates around the troughing idlers. Where possible, return idlers should be supported at a substantial height above the bottom so that coal dust is not likely to build up around return idlers. With proper clearance beneath these idlers, accumulations of coal dust can be cleaned up more easily.

Slat-type, self-cleaning tail pulleys are recommended. Coal dust discharged by such pulleys should be cleaned up frequently. Both good maintenance and good fire prevention necessitate that noisy bearings, which might indicate probable failure, be changed promptly before they become hot.

Conveyor belt fires have been caused by belts that lose proper alignment, with the edge of the moving belt then contacting combustible material. Loss of alignment can result from a number of factors, including displacement of idlers or pulleys and movement of supporting structure, spillage of conveyed material, and failure of a bearing (typically on a pulley). Where alignment is affected significantly, the edge of the belt can rub abrasively on the structure and objects near the edge of the belt. If the object on which the belt rubs is

metal, the metal can become worn and heated. The edge of the belt can be damaged extensively, but the belt probably will not ignite because a point on the edge of the moving belt is in contact with the metal for only a very short period and will cool before it returns to the point of contact. The metal can become quite warm, but because it is a good conductor of heat, it will not become hot enough to ignite the belt if the belt stops. Nevertheless, if the material contacted is wood or another combustible, the combustible material could be heated by the friction of the edge of the moving belt until it ignites. Keeping combustible material away from the edge of the belt and use of alignment switches should prevent such fires.

A.4.2.11 Spontaneous combustion potential of coal depends on a number of factors, including mining practices, mining conditions, geology, and reactivity of the coal. The contributions of these factors can be determined by using a number of methods, including a NIOSH computer program named SPONCOM, which is available from the NIOSH web page.

A.4.2.11.2 Means to reduce the risk of spontaneous combustion include but are not limited to monitoring and trending of combustible gases, sealing, inerting, and using ventilation controls.

N A.4.2.12.1 Transformers with mineral oil or other combustible coolants create an unnecessary risk in underground coal mines. Air-cooled transformers, nitrogen-cooled transformers, and transformers with approved less-flammable coolants are acceptable alternatives to mineral oil-filled transformers. If less-flammable oil transformers are used, they should be FM approved.

N A.4.2.13 ASTM E1934, *Standard Guide for Examining Electrical and Mechanical Equipment with Infrared Thermography*, can be used as a guideline when performing thermographic scanning.

A.4.3 For further information see NIOSH Information Circular 9452, "An Underground Coal Mine Fire Preparedness and Response Checklist: The Instrument."

A.4.3.1.1.1 Routing of water lines has caused severe problems in fighting fires at some large mines. These mines had multiple intake shafts spaced apart at considerable distances. Such ventilation can create a neutral point between the shafts, with fresh air moving from each shaft toward the neutral point. At the original opening of one mine, a water source was established and the water line was extended as the mining developed farther away from the original opening. With the water line extended to each new intake shaft and passing through each neutral point, a condition of opposite direction of flow of air and water existed beyond each neutral point.

If a fire occurs in an area of opposite flow, the fire has to be approached in the same direction as the airflow, but the water flow is moving through the fire area. Usually water lines in a fire area are damaged or broken by falling sections of burning roof. When a water line breaks in such a situation, the fire fighters are without water, and direct fire fighting is no longer possible. The fire then can be controlled only by sealing. At least one large coal mining company now provides an additional water source at each new intake shaft to ensure the ability to fight such fires.

The likelihood of this problem appears to be increasing as more mines are ventilating belt entries with air moving outby, while the water flow is inby. In some cases, mine management has recognized the problem and has developed procedures to

change the direction of airflow in the event of a fire. Reversing the airflow should be done at a point close to and outby the fire to avoid pushing smoke-laden air back onto the fire. After the belt entry outby the fire has been cleared of smoke, the airflow can be reversed for the full length of the entry if desired.

Mines that obtain their water supply from an underground source also can have this problem of opposite directions of air flow and water flow. Usually there is no sure solution except to provide an alternative source of water or a large storage of water on the surface. If the power for the pumps is fed from the high-voltage system that feeds the mine and the fire damages the high-voltage cable anywhere on the system, the power can trip the entire system and shut down the pumps. Coordination of the electrical protective equipment or even a separate power supply might be needed to ensure that the pumps continue to supply water for fire fighting.

Even in situations where air and water are flowing in the same direction, management must recognize that water lines or hydrants in a burning entry are likely to be broken by the falling sections of burning roof. In such situations, a planned shut-down of the water line should be undertaken as soon as possible so a multiple hydrant can be installed in the water line at a convenient location close to the fire. With the multiple hydrant in place, at least three fire hose can be served effectively from the water line.

Because of the many factors that should guide the choice of location of water lines and hydrants, management should be properly qualified to select these locations, but management also should be able to justify its choice. Reliability of the water supply and ability of fire hose streams to reach a fire at any location or entry served by the water line should be the criteria by which the location is chosen.

A.4.3.1.1.9 Shutoff valve intervals of 305 m (1000 ft) are recommended. Indicator-type shutoff valves with labels specifying the normal operating position are recommended.

A.4.3.1.2.1 Water distribution lines generally cannot meet the capacity requirements of 4.3.1.2.1 unless 127 mm (5 in.) or 152.4 mm (6 in.) pipe is used for main water lines and 101.6 mm (4 in.) pipe is used for branch lines to producing areas. Higher nozzle pressures are recommended.

A.4.3.1.2.2 The required hose stream water demand equals a minimum supply of 817,650 L (216,000 gal).

A.4.3.1.3.1 Hydrants in a coal mine normally are only a valve screwed onto a tee that is installed on the water line. For the female coupling of a fire hose to be connected to a male thread, a pipe nipple usually is screwed into the discharge side of the valve. Because the threads of steel pipe nipples generally corrode if left exposed, brass nipples often are used instead of steel nipples. Many mines have begun to use Schedule 80 plastic nipples instead of steel. Regardless of the nipple material, the threads of the nipple should be protected against physical damage.

A properly designed system of hydrants and fire hose should make a good connection of fire hose lines to the hydrants without the need for tools.

The choice of locations for hydrants should be made to ensure that fire hose lines can be laid quickly from hydrants located on the water line through crosscuts to a fire located in

any parallel entry or crosscut, rather than to provide convenience for use in the entry where the water line is located.

A.4.3.1.3.2 Hydrants should preferably be located in crosscuts, and stoppings in such crosscuts should be fitted with a man door.

A.4.3.2 Automatic detection systems and automatic sprinkler systems in mining facilities need to be specifically addressed for the following reasons:

- (1) The contents of a mine occupancy are continually changing. Most items are not fixed and are designed to be moved with the mining operation. A mine operates as a heavy-duty excavation construction site and, thus, has the same transitory nature as a construction site.
- (2) Unlike aboveground industrial occupancies, great distances are not unusual within an underground mine. Mines covering 64.75 km² (25 mi²) or more are common.
- (3) Mines have extremely harsh and unusual environments compared to aboveground industrial occupancies. Heavy concentrations of combustible dusts, the presence of explosive gases, temperature extremes, saturated humidity conditions, standing water, unstable strata, roof-to-floor heights that vary from 710 mm to 6.1 m (28 in. to 20 ft), and complex ventilation systems are all commonplace. The possibility of abuse from heavy machinery is a common hazard.
- (4) Mining occupancies exhibit unique physical characteristics not found in any other type of occupancy. One example is the extreme pressures that can occur in a water line.
- (5) Mines employ specialized facilities, equipment, and production processes not utilized in other industries. Fire protection efforts that fail to consider the unusual operating characteristics and fire protection requirements of underground coal mining systems could result in nonoptimal protection or the inadvertent introduction of hazards.

30 CFR 75.1103-4 provides requirements for installing fire detection systems in underground coal mines in the United States.

A.4.3.2.1.1 An automatic fire detector is a device designed to detect the presence of fire and initiate action. For the purpose of this standard, automatic fire detectors are classified as follows:

- (1) *Heat detector*: a device that detects an abnormally high temperature or rate of temperature rise
- (2) *Smoke detector*: a device that detects the visible or invisible particles of combustion
- (3) *Flame detector*: a device that detects the infrared, ultraviolet, or visible radiation produced by a fire
- (4) *Fire-gas detector*: a device that detects gases produced by a fire
- (5) *Other fire detectors*: devices that detect a phenomenon other than heat, smoke, flame, or gases produced by a fire

Fire detectors should be installed as follows:

- (1) *Vertical Placement*. Because the hot gases from a fire will rise owing to buoyancy forces, combustion products initially will be stratified near the roof of an entry. As the stratified gas layer moves away from the fire, the resultant cooling and dilution eventually will produce a well-mixed flow of combustion products. Data from full-scale fires

indicate that some degree of stratification can exist at distances of hundreds of feet from the source of the fire. Because of this effect, fire detectors should be located at a vertical distance from the entry roof that does not exceed 25 percent of the average entry height. For example, in an entry with a height of 1.8 m (6 ft), the maximum distance from the roof at which a sensor should be located is 0.5 m (1½ ft). The maximum distance refers to the location of the actual sampling intake of the detector used.

- (2) **Lateral Placement.** In general, the point of origin of a fire is unpredictable. It can occur along the floor, ribs, or roof of the entry. To provide optimum protection, it is recommended that the fire detectors be located within 0.6 m (2 ft) of the approximate midpoint of the entry. For entries in which the point of origin of the fire can be better estimated (such as a belt entry), the detectors should be located in such a manner that they provide for the estimated best coverage of that entry.

A.4.3.2.1.3 Batteries charged by the mine power system should indicate the condition of the batteries upon either manual or automatic activation of a battery check circuit.

For further information see *NFPA 72*.

A.4.3.2.1.4 Electrical equipment classified as “permissible” or “intrinsically safe” is certified as meeting the requirements of Chapter I of 30 CFR 18.

A.4.3.2.2.1 Based on U.S. Bureau of Mines Report of Investigation 9570, “Hazards of Conveyor Belt Fires,” CO and smoke detectors provide a significant improvement over point type heat detectors in warning of a potential fire on conveyor belts.

A.4.3.2.2.2 U.S. Bureau of Mines Report of Investigation 9380, “Fire Detection for Conveyor Belt Entries,” provides information on smoke and CO sensor alarm levels and sensor spacing as a function of belt entry cross-sectional area and belt entry air velocity.

N A.4.3.2.2.10 A motor control center (MCC) is one example of the type of building described in 4.3.2.2.10.

A.4.3.3.1.1(3) Depending on the size of the equipment, additional manual actuators could be needed to provide quick access for activation of the system.

A.4.3.3.1.1(4) For further information on flame resistance, see 30 CFR 18.65.

A.4.3.3.1.1(6) Open-head deluge and water spray systems can be kept free of blockage by regular flow of water through the system. For example, fire suppression on continuous miners can be flowed once per shift to keep the nozzles clean. Deluge water spray systems at belt drives can be flowed weekly to keep the nozzles clean.

A.4.3.3.1.4 For criteria of equivalent protection, see 30 CFR 75.1107-13.

A.4.3.3.2.1 Wet-pipe automatic sprinkler systems have been found to be the preferred fire suppression systems for underground coal mines for the following reasons:

- (1) They are the simplest systems available.
- (2) They are the most reliable systems available.
- (3) They provide selective operation, because only sprinklers close to the fire operate.
- (4) They have the best performance record, especially on fires of Class A materials and of Class IIIB combustible liquids.
- (5) They need minimal maintenance.
- (6) They are nonelectrical.
- (7) They use a limited quantity of water.
- (8) The initial investment is low.

The major problem associated with automatic sprinkler systems in underground coal mines is the possibility of exposure to freezing conditions during cold weather. Another problem that can exist in very deep mines is that some of the listed components for automatic sprinkler systems might be unable to withstand the very high water pressure encountered (see U.S. Bureau of Mines Report of Investigation 9451, “Effect of Pressure on Leakage of Automatic Sprinklers”). It is not uncommon to encounter pressures above a gauge pressure of 3448 kPa (500 psi). The committee recommends testing sprinkler system components under anticipated maximum pressures. If sprinkler components are found to be unable to withstand the maximum pressure of the water line, the use of pressure regulators might be necessary. Experience has shown that pressure regulators can require considerable maintenance. Also, if the pressure regulating valve should leak, it might be necessary to provide a small relief valve on the discharge side of the regulating valve to prevent overpressure.

A.4.3.3.2.1.1(1) Under Report No. H0122086, “Suppression of Fires on Underground Coal Mine Conveyor Belts,” the Department of the Interior, U.S. Bureau of Mines (USBM), conducted a series of full-scale fire tests.

The tests demonstrated that standard, 12.7 mm (½ in.) orifice, nominal 100°C (212°F) automatic sprinklers, located over the belt on 3 m (10 ft) centers, effectively controlled every test fire while opening only two sprinklers, with residual pressure held to a constant a gauge pressure of 69 kPa (10 psi).

From the time that the USBM tests were conducted, underground belts have tended to become wider to carry increased tonnage; therefore, belt fire suppression systems should be designed to supply more sprinklers than indicated by these tests. Because many conveyor belts stretch a long distance in a straight line, a fire scenario would involve only a portion of the belt, regardless of the overall length of the belt. Because the actual incidence of belt fires is low in underground coal mines, and most of those are in the area of the belt drive and the belt takeup, protection of only the area from the discharge pulley to the end of the takeup is needed. If the belt structure contains a deck between upper and lower strands of the belt, automatic sprinklers should be located beneath the deck, virtually doubling the size of the sprinkler system.

If the sprinkler system is extended to cover a distance greater than 30.5 m (100 ft) in one direction from the point where the pipe holding the automatic sprinklers along the roof is fed, then a hydraulic calculation of the system is recommended. Long runs of pipe should be flow tested as required by 4.3.3.5.5.1, with the eight open sprinklers installed at the distant end of the pipe run. Branch piping intended to protect limited areas should be piped with adequately sized pipe to carry the required water flow. Table A.4.3.3.2.1.1(1) should be used to determine the minimum size of pipe.

Larger systems should be separately flow tested as required by 4.3.3.5.5.1.

Table A.4.3.3.2.1.1(1) Minimum Pipe Sizes per Number of Sprinklers

| Pipe Size | Maximum Number of Sprinklers on Pipe |
|-----------|--------------------------------------|
| 1 in. | 2 |
| 1¼ in. | 3 |
| 1½ in. | 5 |
| 2 in. | 10 |
| 2½ in. | 20 |
| 3 in. | 40 |
| 3½ in. | 65 |
| 4 in. | 100 |

For SI units, 1 in. = 25.4 mm.

A.4.3.3.2.2 Because many air compressors are moved frequently, the fire suppression system needs to be equally portable. Some compressors that have a deck or lid over the compressor have been fitted with piping and sprinklers attached to the underside of the deck. Other compressors without a deck have suitable piping with at least two sprinklers 3 m (10 ft) apart. The piping is made to be attached to roof bolts or otherwise suitably supported over the centerline of the compressor. The piping needs to be equipped with a pressure switch that prevents the operation of the compressor unless the piping is under pressure and with a flow switch that shuts the compressor down if water flows. If a fire hose is used to connect the piping to a water line, the connection point of the hose to the sprinkler piping should be located so that a fire on the compressor will not damage the fire hose.

A.4.3.3.3.1 NFPA 13 requires a minimum 140 kPa (20 psi) residual pressure for ordinary hazard pipe schedule sprinkler systems.

A.4.3.3.3.2.1 Pipe and fittings that permit limited motion of the pipe are recommended, as they allow the pipe to be held closer to the roof. If threaded fittings are used, steel pipe with extra-strength threaded fittings is recommended. Copper, aluminum, or other approved materials could be permitted if they are adequate for the pressure.

A number of mines use aluminum pipe or tubing with groove-type couplings and fittings. Where water pressure does not exceed 3448 kPa (500 psi), grooved couplings that have a 12.7 mm (½ in.) female national pipe thread (FNPT) outlet are used to provide connections for sprinklers. Piping put together in this manner can be located closer to an undulating roof, especially if the pipe lengths are short enough to put the couplings (and the automatic sprinklers) on 3 m (10 ft) centers. Mines that use groove-type couplings can have most of the piping pre-cut and grooved in the shop, which simplifies installation underground. Rolled grooves are recommended because they do not reduce the strength of the pipe as much as the cut grooves do. If cut grooves are used, Schedule 40 or heavier pipe should be used.

A.4.3.3.3.2.5 Some automatic sprinklers might not withstand the water pressure that can be encountered in deep mines. Information on the effect of high water pressure on automatic sprinklers can be found in U.S. Bureau of Mines Report of

Investigation 9451, “Effect of Pressure on Leakage of Automatic Sprinklers.”

Under U.S. Bureau of Mines Report of Investigation 9538, “Performance of Automatic Sprinkler Systems for Extinguishing Incipient and Propagating Conveyor Belt Fires Under Ventilated Conditions,” NIOSH conducted a series of full-scale fire tests under ventilated conditions of 1.1 and 4.0 m/s (225 and 800 ft/min) for fires up to 10.8 MW. The tests demonstrated that pendent and horizontal sidewall types were both able to extinguish incipient belt fires. Directional sprinklers showed a slightly improved performance in terms of maximum heat release rate at the lower airflow. Both pendent and horizontal sidewall sprinkler types were able to extinguish propagating fires. Horizontal sidewall sprinklers showed an increased effectiveness compared to the pendent sprinklers because of the increased upstream coverage area of the water discharge in terms of maximum heat release rate.

A.4.3.3.3.2.6 The restrictions on sprinkler spacing apply to sprinklers on the same line and those located between sprinklers on adjacent lines.

A.4.3.3.3.2.7 Where sprinkler positioning is such that full coverage can be impaired, such as where a single line of sprinklers protects a belt conveyor with little clearance, a flow test should be conducted to determine if adequate wetting of surface areas is achieved. Additional sprinklers should be provided in the event that adequate coverage is not achieved, or alternative arrangements such as rotated lines or sidewall sprinklers should be considered. Consideration also should be given to the need for noncombustible baffles to protect sprinklers from the discharge of adjacent sprinklers located within 1.8 m (6 ft).

A.4.3.3.3.5 Dry-pipe automatic sprinkler systems are more complex and more difficult to design and install than wet-pipe systems. The committee recommends that all systems be designed and installed by skilled and experienced personnel.

A pressure relief valve, set to relieve at a pressure below the maximum pressure rating of the dry-pipe valve, should be installed between the pressure regulating valve and the dry-pipe valve. The reclosing pressure of the relief valve should be higher than the set pressure of the regulating valve.

A.4.3.3.3.6.1 Underground shaft mines that use diesel-powered equipment generally employ underground diesel fuel storage areas to facilitate equipment refueling. Adit-type mines in the western United States might initially locate diesel fuel storage and refueling facilities on the surface; however, as the active mine workings progress farther from the adit portal(s), these facilities will likely be moved underground.

A common means of fire protection in many underground diesel fuel storage areas is the use of fixed water sprinkler systems. However, this situation represents a significant safety hazard. According to NFPA’s *Fire Protection Handbook*, water sprinklers can be permitted to be used on diesel fuel for control but not for extinguishment.

In “The Health and Safety Implications of the Use of Diesel-Powered Equipment in Underground Mines,” a report by an interagency task group prepared for MSHA in 1985, the simple conclusion was that “water spray or fog usually will not extinguish diesel fuel fires.”

In an underground coal mine, fire control is not sufficient; fire extinguishment is essential for the following reasons:

- (1) Unlike an underground metal or nonmetal mine, the mineral in a coal mine is combustible. All fire prevention and protection provisions in an underground coal mine are aimed at preventing the ignition of the coal. In a metal or nonmetal mine, if fire control efforts are unsuccessful in extinguishing a fire on a piece of diesel equipment or a diesel fuel fire, personnel can be evacuated and the fire can be allowed to consume all available fuel materials, thereby self-extinguishing. In an underground coal mine, this practice would almost certainly result in the ignition of the coal and the consequent loss of part or all of the mine.
- (2) Even if a fire does not grow in intensity or spread to the coal, toxic smoke and fire gases are produced as long as it burns, which can endanger persons within the mine.
- (3) According to NFPA's *Fire Protection Handbook*, overpressure failure of containers exposed to fire is considered the principal hazard of closed-container flammable and combustible liquid storage.
- (4) Even a "controlled" fire can cause such container failure, producing a fire so intense that the sprinkler system is unable to control it, much less extinguish it.
- (5) Water sprays are not effective in extinguishing pressure fires, running fuel fires, and obstructed spill fires, all of which could occur in a diesel refueling area.
- (6) Water supplies are limited in many underground mines. Fire "control" should be considered temporary, because when the water supply is depleted, the fire will grow immediately to the maximum intensity.
- (7) The vapor pressure of diesel fuel increases with elevation, due to reduced barometric pressure. As a result, even fuels without flash point-reducing additives can become flammable, depending on the altitude at which they are used. This reduction in flash point can result in reclassification of the diesel fuel to a Class IC flammable liquid. There is no clear consensus in the literature and industry practice as to the effectiveness of fixed water sprays in controlling and extinguishing fires involving Class IC flammable liquids. Although industry practice strongly favors fixed water sprays for such applications, the literature and available research results clearly indicate the ineffectiveness of fixed sprays on Class IC liquids, especially in the case of pressure fires, running fuel fires, and obstructed spill fires.

Therefore, water sprinkler systems installed for the protection of diesel fuel storage areas are considered inadequate; foam-water systems should be utilized. See the applicable sections of NFPA 16.

A.4.3.3.3.6.2 The alarm system that serves sprinklers protecting the drive area of a belt conveyor also should be permitted to serve as the fire detection system installed over that portion of the belt conveyor.

A.4.3.3.4.3.3 The clapper of a differential-type dry-pipe valve should be held off its seat during any test in excess of 345 kPa (50 psi), to prevent damaging the valve.

A.4.3.3.5.4 The special suppression system manufacturer is a good source for training regarding their equipment. Other acceptable training resources can be available.

A.4.3.3.5.5.2 The system could have several end-of-line drains if parts of the system dead end.

A.4.3.3.5.5.3 Deluge sprinklers might need to be flowed more frequently than monthly to keep the sprinkler systems clean. If caps are not used on water spray systems, they also might need to be flowed more frequently than monthly to keep the nozzles clean.

A.4.3.3.6.1 The actuation of a fire suppression system on self-propelled equipment should cause shutdown of the protected equipment.

A.4.3.3.6.1(11) Because exposure to some agents or their decomposition products could be hazardous to personnel, it is recommended that the appropriate NFPA standard for the agent under consideration be consulted to determine the agent's use and limitations, recognizing that the mine environment can make prompt evacuation difficult.

A.4.3.3.6.1(12) Wet and dry chemical systems should be inspected every 6 months in accordance with applicable NFPA standards.

A.4.3.3.6.2 Pipe or hose supplying open spray nozzles should be sized to avoid excessive pressure loss. Open nozzles provide a good spray pattern with 6.9 kPa to 137.9 kPa (10 psi to 20 psi) of water pressure at the nozzles. If nozzle pressure exceeds 172.4 kPa (25 psi), additional or larger orifice nozzles can be permitted to be used to increase the water flow. If nozzle pressure is less than 137.9 Pa (20 psi), smaller orifice nozzles should be used to increase the pressure. The objective is to obtain the maximum flow of water at a pressure high enough to provide a reasonable spray pattern.

The water spray should be directed upward to wet the roof over the machine. This prevents the fire from spreading to the coal, which should be the primary objective of the fire protection system. Also, water will fall back down onto the machine, cooling and possibly extinguishing the flames. Alternatively, the nozzles can be directed at the fire hazard areas of the machine. The risk of this method is that the fire could be in an area not covered by the sprays and could spread to the coal.

A.4.3.4.1.1.1 Larger capacity extinguishers that provide more agent and longer discharge time are recommended.

A.4.3.4.1.2.3 It is not the intent of 4.3.4.1.2.3 to allow two lower rated fire extinguishers to be used to achieve a higher overall rating.

A.4.3.4.1.3.2 Visual inspections require documentation only at 6-month intervals.

A.4.3.4.2.1.1 Hydrants should be located to ensure that fire hose can be laid quickly from hydrants, which are located on the water line in any of the entries, through crosscuts to a fire located in parallel entries or crosscuts, rather than being located for convenient use in the entry where the water line is located.

A.4.3.4.2.1.4 Fire hose should be purchased as an entire unit that consists of the hose and couplings. The pressure rating should include both the hose and the couplings.

A.4.3.4.2.1.6 These threads are also referred to as National Pipe Straight Hose (NPSH). National Hose (NH) is also known as National Standard Thread (NST) and National Standard (NS).

Threads of 38 mm (1½ in.) or 50 mm (2 in.) hose couplings should be straight, iron pipe thread, now labeled NPSH. While it is always preferable to use fire hose adapters, NPSH couplings can be attached to standard male pipe threads. This is especially important because of the large number of hydrants needed on water lines.

Where the gasket of a fire hose coupling is in good condition, the coupling should be tightened with bare-hand pressure only. It usually will not leak. Hose wrenches are needed to uncouple hose only. Overtightening couplings with hose wrenches harms the gaskets.

Rocker lug couplings are preferred to pin-type couplings.

Most mines use NPSH threads because the couplings will attach to male pipe threads of the same size.

A.4.3.4.2.1.9 In many fires, fire hose has to be carried to the fire. If manual transport is necessary, the hose should be coiled into “bundles” or “doughnuts,” with the male coupling at the center. In this manner, the hose is in proper orientation for use, and the exposed threads of the male coupling are protected. Hose lengths should be limited to 30.5 m (100 ft) or less, because greater lengths make the hose bundle too large and heavy.

It is sometimes preferable to coil bundles or doughnuts of fire hose starting with the approximate center point of the hose at the center of the bundle. A coil made in this manner positions the hose couplings on the outside so the hose can be laid starting at the hydrant moving toward the nozzle or from the nozzle back to the hydrant with equal efficiency.

Where high pressures are a concern, pressure relief devices can be used. The devices can be stored with the hose cache.

A.4.3.4.2.1.11 Consideration should be given to providing caches at intervals of less than 1524 m (5000 ft) where conditions warrant. A single hose cache might satisfy more than one of the required locations.

A.4.3.4.2.2 Fire hose requires special consideration at coal mines. Cotton- or linen-jacketed hose should not be used, as it is subject to mildew attack. Even mildew-treated hose does not endure. Rubber-lined and rubber-jacketed hose resists mildew attack, but this type of hose is heavy, stiff, and expensive. Neoprene-lined, polyester hose with rocker lug couplings is probably the best hose for mine use. The use of pin-type couplings should be avoided because the pins are easily broken or knocked off.

In low coal and where the water supply can deliver about 3.2 L/sec (50 gpm) at proper pressure, 38 mm (1½ in.) hose should be used. Where the water supply is able to provide 378 L/min to 460 L/min (100 gpm to 120 gpm) at proper pressure, 50 mm (2 in.) hose is preferable. Hose of 64 mm (2½ in.) has no advantage over 50 mm (2 in.) hose, and the extra weight and cost of 64 mm (2½ in.) hose is considerable.

Many mines have standardized on 38 mm (1½ in.) fire hose, even though their water lines can supply substantially more water than is required to get proper discharge from a 38 mm (1½ in.) hose nozzle. Some of these mines provide at least two valved connections (hydrants) in operating areas so that more than a single 38 mm (1½ in.) hose line can be used if needed. In some cases, short lengths of pipe with two or more hydrants are available for use at other points along the water lines.

These multiple hydrants can be put in the line at joints where the water line is joined with grooved couplings.

While the total water flow of two 38 mm (1½ in.) hose lines is about the same as one 50 mm (2 in.) hose line, in the opinion of many experienced mine fire fighters, two 38 mm (1½ in.) hose lines provide greater flexibility during a fire-fighting operation.

A.4.3.4.6 While regulatory agencies have legal powers and responsibilities in a mine fire situation, the mine operator should have a preplanned organization capable of managing an effective fire-fighting effort. This organization has to be prepared, resolute, and capable. As part of periodic training, the organization should conduct fire drills that involve all levels of mine management. The regulatory agencies also should be invited to participate in fire drills. Training develops management capability and promotes cooperation between concerned agencies and mine management.

A.5.2 Fires adversely affect all types of self-propelled and mobile surface mining equipment, including, but not limited to, trucks, front-end loaders, crawlers, drills, shovels, and drag-lines. Most fires occur on or near engine exhaust systems, high-speed drive lines, malfunctioning high-pressure-high-temperature hydraulic systems, or faulty electrical components.

Total elimination of fire hazards is impossible, because sources of ignition and fuel for fires are inherent in the basic equipment design. The problem is further complicated by the collection of environmental debris. Therefore, efforts to reduce fire losses must be aimed at fire prevention and fire suppression.

To improve fire protection and prevention on surface mining equipment, some manufacturers of mining equipment emphasize the reduction of the fire potential of specific items in the original design of their equipment. Such items include turbochargers, exhaust manifolds and exhaust pipe shielding and insulation, location of combustible and flammable liquid reservoirs, and hydraulic and fuel-line routing.

Most surface mining equipment is required to have at least one hand-portable extinguisher mounted in a readily accessible location. Extinguishers are most effective when used by trained operators. However, considering the size and configuration of machines found at a mine, fires can be difficult or impossible to fight with a hand-held extinguisher. For this reason, fire suppression systems have been developed to aid in suppressing those fires that are hard to access and thereby to reduce “off-road” equipment fire losses.

The key to operator protection is early detection of fires to provide a warning to the operator, fuel shutoff to minimize fuel for the fire, and fire suppression during its earliest stages. Specialized systems to perform these functions can be required to protect the operator and the machines. To be totally effective, however, system operation must be fully understood by owners and operators, and provisions must be made for periodic inspection and maintenance.

Fire suppression systems, including hand-portable extinguishers, offer the mining industry a cost-effective tool by which personnel and investments in mining equipment can be protected.

N A.5.3.2 According to NFPA 17A, wet chemical fire-extinguishing systems discharge wet chemical from fixed nozzles and piping by means of expellant gas.

A.5.3.4.1 This paragraph is not intended to include the boom of a dragline or shovel.

A.5.3.4.8(8) The same record tag or label can also indicate if recharging was performed.

• **A.5.3.5.2.2** Smoke detectors are not recommended because of the harsh environment.

A.5.3.5.3.1 Automatic systems are not necessary if the area is easily accessible for manual fire fighting.

A.5.3.5.4.2 Carbon dioxide would not be the best choice for fighting this type of fire due to the potential for the gas to be dispersed before the oxygen concentration is reduced enough to affect the fire.

For transformers over 5000 kVA, a fixed fire suppression system is recommended.

A.5.3.5.5.4 Based on the condition of the equipment, a higher frequency than annual scanning might be needed.

A.5.3.6.6 Equipment in this category is generally a vehicle weight of 90,720 kg (200,000 lb) or more and the size of a Hitachi 1800, Caterpillar 5230, Komatsu PC1000-6, Liebherr R984, DeMag H95, and Hitachi 1100.

A.5.3.8.1.1 Depending on the size of the vehicle and size of the fire, a 9.1 kg (20 lb) fire extinguisher could be more effective.

A.5.3.8.2.5 NFPA and manufacturers require 6-month inspections.

A.5.3.8.3.2 The following are examples of large equipment:

- (1) Track dozer of 300 horsepower or more or 31,752 kg (70,000 lb) weight or more (e.g., Caterpillar D8R)
- (2) Front-end loader of 400 horsepower or more and vehicle weight of 45,360 kg (100,000 lb) (e.g., Caterpillar 988)
- (3) Wheel dozer of 300 horsepower or more and vehicle weight of 27,216 kg (60,000 lb) or more (e.g., Caterpillar 824G)
- (4) Grader of 275 horsepower or more and vehicle weight of 24,948 kg (55,000 lb) or more (e.g., Caterpillar 16H)
- (5) Pull-type scraper of 450 horsepower or more and vehicle weight of 44,453 kg (98,000 lb) or more (e.g., Caterpillar 631E)
- (6) Scraper with push/pull twin engine of 450 horsepower and 490 horsepower or more and vehicle weight of 51,257 kg (113,000 lb) or more (e.g., Caterpillar 637E)
- (7) Blast hole drill of 360 horsepower or more and weight of 30,845 kg (68,000 lb) or more (e.g., Ingersol-Rand DM-30)

A.5.3.8.3.4(4) Depending on the size of the equipment, additional ground-level manual actuators could be needed to provide quick access for manual activation of the system.

A.5.3.8.3.8 Six months is required by NFPA standards and manufacturers. The fire suppression system manufacturer is a good source for proper training regarding their equipment. Other acceptable training resources might be available.

A.6.1.2.2 Pneumatic coal-cleaning systems employ low-pressure air, usually pulsed, to effect a separation between rela-

tively dry coal and mechanically associated impurities. The coal is usually 19 mm ($\frac{3}{4}$ in.) and smaller, with up to 4 percent surface moisture. The pickup of fines from the feed coal in the process air stream creates a potentially explosive mixture. However, approximately 2 m/sec (400 ft/min) air velocity dissipates methane from the coal and, in practice, reduces explosion and fire hazards to very low proportions inside the equipment. Nonetheless, in the area surrounding the equipment, a potential fire hazard exists from unintentionally vented fine coal, and the potential for all hazards increases where the cleaners are preceded by thermal dryers.

A.6.2.1.4 Electrical components of ventilation equipment installed in the open and separated from the ventilation air being pulled from the hazardous area can be permitted to be considered nonhazardous.

A.6.2.1.4.1 Electrical equipment classified as “permissible” is certified as meeting the requirements of Chapter 1 of 30 CFR 18.

A.6.2.1.6 Approved, intrinsically safe electrical equipment can be permitted to be used in any areas classified as “hazardous.”

A.6.2.1.7 The intent of this requirement is the avoidance of arcing ignition sources resulting from differing electrical potentials between metal structural elements or between any such element and ground. The metal building elements might include the building frame (beams, columns, etc.), roof panels, building or control room panels, building utilities such as piping, ducts, or conduit, or other items. The objective of connecting metal parts to a ground is recognized as the best means of avoiding arcing between building elements or between those elements and ground or other grounded items. Any arrangement that provides both a good ground and a system of metal continuity from the ground to all metal elements achieves the intent. Where construction provides solid, secure metal-to-metal contact, the necessary continuity normally is provided. In cases where grounding is in question, resistance measurements should be made between the most remote elements or the most suspected elements or both and ground. If tests show less than 0.1 ohm resistance to ground, the arrangement can be permitted to be considered satisfactory. Testing should be done during dry weather when ground moisture is at a minimum. If lightning protection is provided, additional bonding of major building members to lightning system conductors might be required. Such bonding, however, can be permitted to serve the grounding needs covered by this requirement.

A.6.2.2.3.1 For further information, see NFPA 68.

A.6.2.2.5 Round ducts should be used wherever possible. All ducts should limit the number of bends and irregularities that could interfere with free airflow. Rectangular ducts should be used only where clearance prevents the use of round ducts. Rectangular ducts should be made as nearly square as possible to minimize the deposit of combustible materials.

A.6.2.3.1 Provision of 0.1 m² (1 ft²) of building vent for each 2.3 m³ (80 ft³) of volume or space in which an explosion might occur generally is considered adequate for coal preparation plants, although the amount of venting needed to minimize structural damage that might be caused by a dust explosion varies according to the strength of the building, extent of the hazard, location and distribution of vents, properties of the

coal dust, and other factors. Reference should be made to NFPA 68 in the sizing of explosion vents.

A.6.2.4 Bulk storage of Class II combustible liquids should be located outside the preparation plant and should be appropriate for the nature of the liquids and the quantities being stored. Tanks within the preparation plant should be of limited size, holding no more than the quantities needed for one and one-half shifts of operation. Each tank should be fitted with an overflow pipe of ample size to return the full volume of the transfer pump to the bulk storage tank. Tanks within the preparation plant should be isolated from the rest of the plant. The isolated area containing the tanks should be protected with an automatic sprinkler system that can provide a density of 6.1 L/min/m² (0.15 gpm/ft²) over the entire area with all sprinklers flowing. The floors beneath these tanks should have curbs, adequate slope, and floor drains able to handle the liquid from the tanks as well as the discharge from all automatic sprinklers.

A.6.3 A typical coal preparation plant process begins with raw coal entering a breaker where coal and undesirables, such as rocks, are separated. From the breaker, the coal is crushed and screened and then transferred, usually by belt conveyor, to the washing process. During the washing process, the dirty coal is separated from clay and rock by water washing or by chemical flotation. From the washing process, the clean, wet coal is conveyed to a drying process whereby surface moisture is reduced. A variety of dryers can be used, such as centrifugal, fluidized bed, or thermal disk processors. From the drying process, the clean, dry coal is conveyed to storage facilities, such as bins, silos, and coal barns, and then loaded out for transport or shipment by rail, surface, or conveyor for downstream use. (See Figure A.6.3.)

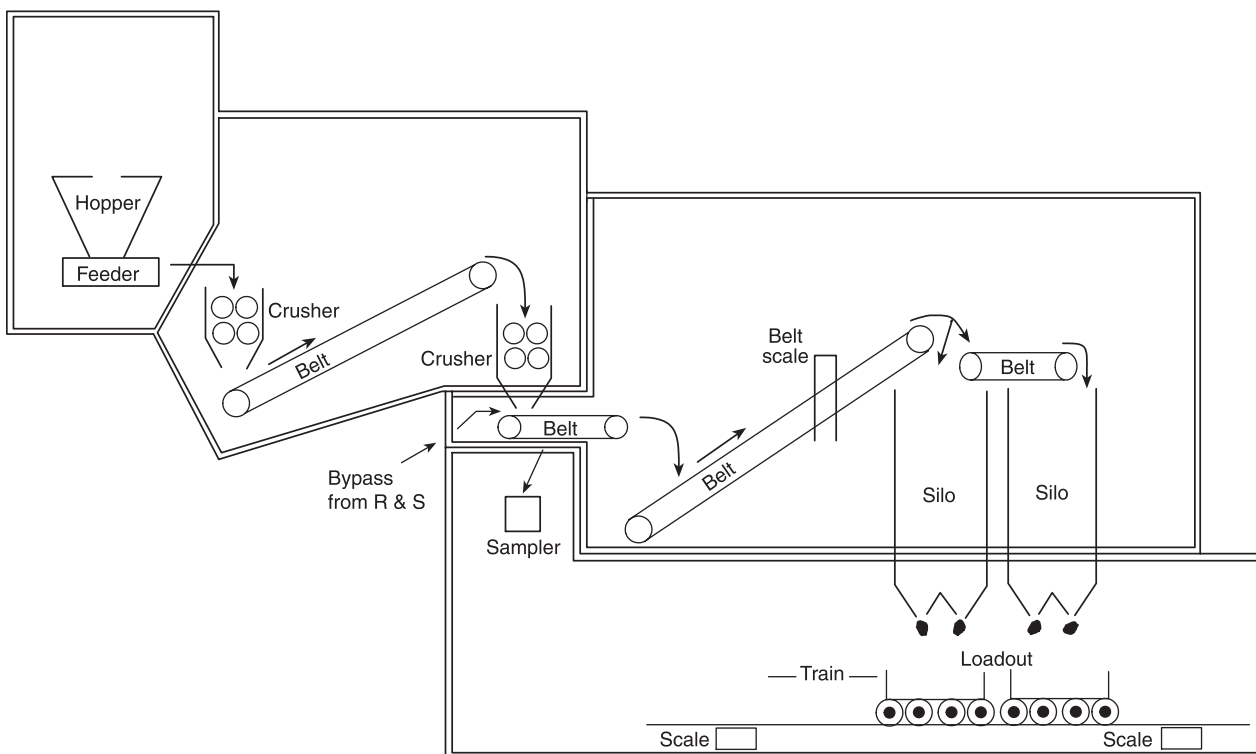


FIGURE A.6.3 Typical Coal Preparation Plant.

A.6.3.1.10 Phosphorescent exit signs can be used to identify building exits.

A.6.3.1.12.1 Refer to NFPA 850 for guidance on spacing transformers from buildings.

A.6.3.1.12.2 *NFPA 70* requires a 3-hour fire-rated room for transformers with combustible oil. This can be decreased to a 1-hour rated room if automatic fire suppression is provided.

A.6.3.1.12.3 In existing facilities, a combustible oil-filled transformer located on the roof of the preparation plant should be provided with a fire barrier and spill containment to limit fire damage to the building. Refer to NFPA 850 for guidance on fire barriers and spill containment for transformers.

A.6.3.2.2.1 Examples of where fixed protection might be needed in coal preparation include conveyor belts, galleries, tunnels, beneath bins, transfer houses, silo head houses, dust collectors, rotary compressors, and other areas such as switch gear rooms, control rooms, change houses, and combustible and flammable liquids storage or process areas. These areas should be considered ordinary hazards. Areas with noncombustible construction or noncombustible contents are areas where fixed protection might not be needed.

A.6.3.2.3.1 Standpipes should be located in exterior stairways. Where exterior stairways are not provided, standpipes should be located as close to stairways as practicable. This arrangement will provide fire fighters with ready access to fire-fighting water. Ideally, plants should have exterior stairways with standpipes on opposite ends of the plant. These stairways will provide fire fighters with two angles of attack.

When applying water, fire fighters should exercise care to avoid the use of solid hose streams in locations where the streams could create explosions by disturbing dust deposits.

Fire hose should not be used for washdown purposes.

In plants where the vibration anticipated is sufficient to cause movement of the fire protection system resulting in the wear of water piping at the hangers, it might be necessary to install vibration absorbers.

A.6.3.2.4.1 A readily available supply can include a dedicated fire protection water supply, a pond or other large body of water, an industrial process water system, or large water trucks (tankers). If water trucks (tankers) are used, they should be of a capacity and quantity to deliver a continuous source of water for the duration of the fire-fighting effort. Personnel should be trained in emergency vehicle operation and mobile water supply shuttle procedures. If an impounded body of water is provided, it should be close and accessible enough to the protected property to allow fire fighters a quick response.

A.6.3.2.4.4 Chapter 8 and Annex G of NFPA 1142 outline suggested methods for determining the estimated water supply (fire flow) that can be necessary for fire-fighting purposes.

A.6.3.2.6.3 A gaseous fire suppression system can also be considered for important motor control center (MCC) rooms or for rooms that contain input/output (I/O) cabinets. A gaseous fire suppression system or smoke detector system can also be considered for the preparation plant control room.

A.6.4.1 Thermal coal dryers can be of any type that conforms to the requirements of Section 6.4, including rotary dryers, continuous carrier dryers, vertical tray and cascade dryers, multilouver dryers, suspension or flash dryers, and fluidized bed dryers. These direct-fired convection-type dryers constitute the majority of currently operational units. Almost all these units utilize special direct-fired air heater-type furnaces, usually coal fired by stokers or by pulverized fuel systems.

A.6.4.2.5 For further information, see NFPA 68.

A.6.4.2.7 Thermal oil systems are used in coal preparation plants to indirectly dry coal in thermal disk processors. Severe losses have occurred due to lack of inadequate sprinkler protection, poor siting and confinement of expansion and storage tanks and heaters, improper piping arrangement, and inadequate interlocks and controls. Even though the wood-working industry has unique equipment that needs hot oil applications, the hot oil heating and distribution systems are similar, and the concepts provided in NFPA 664 can be utilized for the coal preparation industry.

Chapter 8 of NFPA 664 is the primary reference in NFPA standards for thermal oil systems used in industrial processes. While NFPA 664 addresses loss prevention in a specified occupancy (wood products), other standards might be applicable to any industrial process featuring thermal oil systems.

A.6.4.5 Guidance for design of vent ducts is provided in NFPA 68.

N A.6.7.1 Combustible loading in coal preparation plants has increased gradually as plastic equipment has replaced equipment that historically was constructed of steel. This equipment includes piping, spirals, cyclones, and screens. Combustible spirals normally are installed above ground in either open air or enclosed process buildings. Spirals typically are constructed

of fiberglass, polyurethane, or other unexpanded Group A plastic as defined by NFPA 13. Although normal operations wet the spirals on one side as well as create a high-humidity atmosphere, spiral plants are susceptible to very large fires, particularly when hot work is conducted during outages and water to the spirals might be locked out. Water-based fire suppression systems should be considered for spiral installations, where necessary for protection of important assets with large business interruption potential as determined by a fire risk assessment.

A.7.1 Gas and electric welding or cutting procedures should be in accordance with NFPA 51B.

A.7.1.2.1 For additional information, see NFPA 326 and AWS F4.1, *Recommended Safe Practices for the Preparation for Welding and Cutting Containers and Piping That Have Held Hazardous Substances*.

A.7.1.2.5 If the coal is susceptible to spontaneous combustion, water should not be used to wet down the area. Rock dust should be used.

A.7.1.4.1 For information on labeling of compressed and liquefied gas cylinders, see CGA C-7, *Guide to the Preparation of Precautionary Labeling and Marking of Compressed Gas Containers*.

A.7.1.5.9 For information on labeling of compressed and liquefied gas cylinders, see CGA C-7, *Guide to the Preparation of Precautionary Labeling and Marking of Compressed Gas Containers*.

A.7.3.1 Buried tanks do not create a fire hazard but preferably should be at least 1.5 m (5 ft) from all buildings.

Δ A.7.3.1.2 Information on the design and construction of atmospheric tanks can be found in API STD 650, *Standard for Welded Steel Tanks for Oil Storage*; UL 142, *Standard for Steel Above-ground Tanks for Flammable and Combustible Liquids*; or UL 80, *Standard for Steel Tanks for Oil-Burner Fuels and Other Combustible Liquids*.

Low pressure tanks and pressure vessels can be permitted to be used as atmospheric tanks.

Δ A.7.3.2 This can be accomplished by diking or drainage with remote impounding. (See Section 22.11 of NFPA 30 for additional details.)

A.7.3.3.4 For additional information see Annex B of NFPA 30.

A.7.3.3.6 For additional information see Section 27.8 of NFPA 30.

A.7.4.5 Combustible liquid storage in drums or totes preferably should be stored outside.

A.7.5.1.1 Electrical equipment classified as “permissible” is certified as meeting the requirements of Chapter 1 of 30 CFR 18.

A.7.6.2.2 Containers and portable tanks for combustible liquids authorized by the U.S. Department of Transportation should be acceptable as storage containers.

Δ A.7.6.2.10 Information on the design and construction of pressure vessels can be found in the ASME *Boiler and Pressure Vessel Code*.

A.7.6.2.13 Information on venting can be found in API STD 2000, *Standard for Venting Atmospheric and Low-Pressure Storage Tanks*.

A.7.6.3 The terms *transfer* and *transport* are used synonymously to mean movement of combustible liquid in closed containers, tanks, safety cans, or pipelines between underground locations.

A.7.6.3.10 The greatest risk of fire involving substantial quantities of combustible liquids exists when rail supply cars are being moved, especially on a trolley wire-powered rail system. In contrast, cars parked where trolley and feed wire are absent or de-energized represent a distinctly lower risk. Limiting the storage of lubricants in operating areas to a 3-day rather than a 1-day supply reduces the frequency of transport and, as a result, the overall risk of fire.

A.7.6.3.12 Where pressurized pipeline systems are used for combustible liquid transfer, consideration should be given to providing a pressure-sensing interlock downstream of the transfer pump discharge. This interlock should be suitable for Class I, Division 2 locations and should be arranged to shut down the pump immediately upon loss of line pressure.

A.7.6.5 The principal Class II combustible liquid used in a coal mine is diesel fuel.

A.7.6.5.2.7 There are no listed doors for storage areas in underground mines.

Δ A.7.6.5.2.10 Information on tank foundations can be found in Appendix E of API STD 650, *Standard for Welded Steel Tanks for Oil Storage*, and Appendix B of API STD 620, *Standard for the Design and Construction of Large, Welded, Low-Pressure Storage Tanks*.

A.7.6.8 No requirements for bonding or grounding to dissipate static electricity are included in NFPA 30, which does not require bonding or grounding for combustible liquids handled at temperatures below their flash points.

It is recognized, however, that certain conditions can exist that could necessitate bonding or grounding, such as those of temperature and altitude, which can reduce the flash point of diesel fuel.

For additional information on static electricity, see NFPA 77.

A.8.5 A manifold system should be considered for all new installations in shop buildings.

A.8.6.2 Automatic sprinkler protection provides the most affordable fire protection. Where water supplies are adequate, sprinkler protection should be strongly considered for office and warehouse occupancies.

A.8.6.3 If an adequate water supply is available, a fire hydrant should be installed within 15.2 m (50 ft) of the warehouse, shop, and office building.

A.8.6.6 For office buildings, a minimum of one 4.6 kg (10 lb) extinguisher should be provided for every 279 m² (3000 ft²) of building area. Travel distance from any point to the nearest extinguisher should not exceed 22.9 m (75 ft). For shop and warehouse areas, a minimum 9.1 kg (20 lb) extinguisher should be provided for every 22.9 m (75 ft) travel distance within the building.

Large-wheeled, wet or dry chemical or foam extinguishers should be considered for shop and warehouse areas. The type of fires that can occur in these areas can be too large to be handled by a handheld extinguisher.

A.9.1 Unless the conveyor is very long, burning coal on a moving belt is not likely to ignite the belt. Also, if the belt should ignite, the burning of the belt is likely to be extinguished after the burning coal has been discharged and the belt continues to run. No reports of running conveyor belts in and around preparation plants that have caught fire and burned have been located. Every reported case of belts catching fire and burning has occurred after the belts have been stopped.

Some preparation plants use the froth flotation process to separate impurities from fine coal. The agents typically used in froth flotation are Class II combustible liquids. The coal recovered from the froth cells is coated minimally with these agents. It has been found that frothed coal carried on conveyor belts will coat the belting with the agents, causing the coated belting to ignite easily and the flame spread to become significantly more rapid than usual. It is recommended that belts that carry frothed coal be protected with automatic sprinklers. While the froth flotation process operates as a water slurry and presents no risk of fire, the reagents normally used are No. 2 fuel oil and methyl isobutyl carbinol (MIBC), which are Class II combustible liquids.

Fortunately, evidence of heating is easy to detect. During the early stage of heating, the odor is unmistakable. When heating is more advanced, smoke and steam also might be apparent. If the hot coal is in an exposed storage pile, the hot material can be dug out and wetted. If the hot material has to be loaded onto a conveyor belt, the loading areas should be hosed down, and water should be applied to the hot material before or as it is loaded onto the belt.

Tunnels under silos or storage piles should be ventilated adequately and should be protected with a system of automatic sprinklers. Separate hose for fire fighting should be provided. The main tunnel should have exit routes at opposite ends of the tunnel.

A.9.1.1 The U.S. Mine Safety and Health Administration standards found in 30 CFR for fire-retardant conveyor belt materials should be used as a guide. Fire-retardant belt materials will burn and, therefore, might require additional fire protection.

Stockpile conveyors, reclaim conveyors, and conveyors going to loadout silos or bins should be fire-resistant belt.

Rip detection also can be considered for long runs or critical belt systems. Critical factors to be considered should be the impact on production if the belt is lost, the cost of the belt itself, availability of spare belting, length of time to repair the belt, and alternatives to bypass the belt if it is lost.

A.9.1.2 A steel deck, which often is placed between the top and bottom strands of a belt conveyor, should not be used. It is recommended that existing decks be removed.

Belt galleries that use supporting trusses with substantial length of span should be set entirely beneath the belt so that, in the event of a fire, the loaded structural members of the truss are not seriously exposed to the heat of the burning belt. The supports for the troughing and return idlers should not be structural parts of the truss. The covering for the belt should be partially open on the walkway side, allowing access to the belt and to the belt idlers for maintenance and fire fighting.

Belts that are located entirely within relatively long-span supporting trusses should be protected by a fixed fire protection system.

Provision for removing burning coal to a safe area utilizing conveyors should be considered. These conveyors might require manual water spray to cool smoldering coal. Flanged openings can be used for removing burning coal if adequate planning and equipment have been provided.

A.9.4.3 To minimize potential frictional ignition, alignment switches can be permitted to be provided at intervals sufficient to prevent the belt from contacting such materials.

A.9.4.6.3.1.3 The flexible hose should be attached at a point where it is least exposed to a fire ignition source, such as the drive rollers.

A.9.4.6.3.2(8) Pipe hangers should be designed to support five times the weight of the water-filled pipe plus 114 kg (250 lb) at each point of piping support. Hanger rods should be at least 9.5 mm ($\frac{3}{8}$ in.) thick for pipe up to 102 mm (4 in.). U hooks should be at least 8 mm ($\frac{5}{16}$ in.) thick for pipes up to 50.8 mm (2 in.). Eye rods should be at least 9.5 mm ($\frac{3}{8}$ in.) thick for pipe up to 102 mm (4 in.). This information is taken from Section 9.1 of NFPA 13.

A.9.4.7.4 Adjustable fog nozzles should be provided for all hoses.

A.9.4.8 Transfer points can also require dust suppression.

A.9.5 The key concept in coal storage is to prevent spontaneous combustion. Preventing spontaneous combustion requires all of the following:

- (1) Eliminating air entrainment in the coal
- (2) Eliminating heat sources near the storage
- (3) Preventing moisture in the coal

A.10.2.2 This process can be accomplished by pressurization, sealing the room, or air filtration. Housekeeping and coal-wetting agents also can be used to reduce the coal dust in the room. Coal dust should not be allowed to accumulate inside electrical cabinets.

A.10.4.2 CO₂ systems are not recommended for occupied areas. If a CO₂ system is used, it should have a maintenance lockout.

A.10.5.1 If the building has a standpipe system, a fire hose can be used as a substitute for a fire extinguisher as detailed in NFPA 10.

A.11.1 For mines where the response time of the public fire department is in excess of 30 minutes, an emergency organization that is trained in basic fire-fighting techniques should be developed. Training should consist of the use of large extinguishers and small hose streams 38 mm (1½ in.) to provide immediate fire-fighting efforts until the local fire department arrives. This training would also include procedures for using fire hose off a water truck or any other nearby sources of water. A crew consisting of at least five members for each shift should be trained in fire-fighting operations. Detailed fire-fighting procedures should be developed for each type of potential fire, for example, dragline, shovel, mobile equipment, warehouse, and office. Training should be conducted based on those scenarios.

A.11.2.5.1 Two portable water cars, readily available, can be used in place of the water lines prescribed in 11.2.5.1.

A.11.2.5.5 A multiple hydrant is a short length of 76.2 mm (3 in.) or 102 mm (4 in.) pipe, usually with three valved outlets (hydrants) to which fire hose lines can be connected. If the mine is equipped with a foam generator for fighting fires, there should be an additional outlet to feed the generator. An alternative is to assemble the hydrants from grooved pipe fittings that also have threaded tee connections to which the valved outlets are connected. The multiple hydrants should have adapters that allow them to be connected to any of the pipe sizes in use at the mine.

A.11.3.1 Surface fire-fighting teams should be trained and equipped in accordance with 11.2.2.

Annex B Informational References

B.1 Referenced Publications. The documents or portions thereof listed in this annex are referenced within the informational sections of this standard and are not part of the requirements of this document unless also listed in Chapter 2 for other reasons.

▲ B.1.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

NFPA 10, *Standard for Portable Fire Extinguishers*, 2018 edition.

NFPA 13, *Standard for the Installation of Sprinkler Systems*, 2019 edition.

NFPA 16, *Standard for the Installation of Foam-Water Sprinkler and Foam-Water Spray Systems*, 2019 edition.

NFPA 17A, *Standard for Wet Chemical Extinguishing Systems*, 2017 edition.

NFPA 30, *Flammable and Combustible Liquids Code*, 2018 edition.

NFPA 51B, *Standard for Fire Prevention During Welding, Cutting, and Other Hot Work*, 2019 edition.

NFPA 68, *Standard on Explosion Protection by Deflagration Venting*, 2018 edition.

NFPA 70®, *National Electrical Code*®, 2020 edition.

NFPA 72®, *National Fire Alarm and Signaling Code*®, 2019 edition.

NFPA 77, *Recommended Practice on Static Electricity*, 2019 edition.

NFPA 326, *Standard for the Safeguarding of Tanks and Containers for Entry, Cleaning, or Repair*, 2020 edition.

NFPA 664, *Standard for the Prevention of Fires and Explosions in Wood Processing and Woodworking Facilities*, 2020 edition.

NFPA 850, *Recommended Practice for Fire Protection for Electric Generating Plants and High Voltage Direct Current Converter Stations*, 2020 edition.

NFPA 1142, *Standard on Water Supplies for Suburban and Rural Fire Fighting*, 2017 edition.

NFPA *Fire Protection Handbook*, 20th edition, 2008.

B.1.2 Other Publications.

B.1.2.1 API Publications. American Petroleum Institute, 200 Massachusetts Avenue NW, Suite 1100, Washington, DC 20001.

API STD 620, *Standard Rules for the Design and Construction of Large, Welded, Low-Pressure Storage Tanks*, 2013.

API STD 650, *Standard for Welded Steel Tanks for Oil Storage*, 2013.

API STD 2000, *Standard for Venting Atmospheric and Low-Pressure Storage Tanks*, 2014.

B.1.2.2 ASME Publications. American Society of Mechanical Engineers, Two Park Avenue, New York, NY 10016-5990.

Boiler and Pressure Vessel Code, 2017.

B.1.2.3 ASTM Publications. ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM E136, *Standard Test Method for Assessing Combustibility of Materials in a Vertical Tube Furnace at 750°C*, 2019.

ASTM E1934, *Standard Guide for Examining Electrical and Mechanical Equipment with Infrared Thermography*, 1999a, reapproved 2018.

B.1.2.4 AWS Publications. American Welding Society, 8669 NW 36th Street, No. 130, Miami, FL 33166.

AWS F4.1, *Recommended Safe Practices for the Preparation for Welding and Cutting Containers and Piping That Have Held Hazardous Substances*, 2007.

B.1.2.5 CGA Publications. Compressed Gas Association, 14501 George Carter Way, Suite 103, Chantilly, VA 20151-2923.

CGA C-7, *Guide to the Preparation of Precautionary Labeling and Marking of Compressed Gas Containers*, 2014.

B.1.2.6 MSHA Publications. Mine Safety and Health Administration, National Mine Health and Safety Academy, 1301 Airport Road, Beaver, WV 25813-9426.

“Fire Accident Abstract.”

“Fire Accident Report.”

MSHA Datasets

“The Health and Safety Implications of the Use of Diesel-Powered Equipment in Underground Mines,” report prepared by an interagency task group for MSHA, 1985.

“Injury Experience in Coal Mining.”

B.1.2.7 NIOSH Publications. National Institute for Occupational Safety and Health, 1600 Clifton Road, Atlanta, GA 30333.

NIOSH IC 9452, “An Underground Coal Mine Fire Preparedness and Response Checklist: The Instrument,” 2000.

NIOSH IC 9470, “Analysis of Mine Fires for All Underground and Surface Coal Mining Categories: 1990–1999,” 2004.

B.1.2.8 UL Publications. UL LLC, 333 Pfingsten Road, Northbrook, IL 60062-2096.

UL 80, *Standard for Steel Tanks for Oil-Burner Fuels and Other Combustible Liquids*, 2007, revised 2014.

UL 142, *Standard for Steel Aboveground Tanks for Flammable and Combustible Liquids*, 2006, revised 2014.

Δ B.1.2.9 U.S. Bureau of Mines Publications. National Technical Information Service (NTIS), 5301 Shawnee Road, Alexandria, VA 22312.

Report No. H0122086, “Suppression of Fires on Underground Coal Mine Conveyor Belts,” 1974.

RI 9380, “Fire Detection for Conveyor Belt Entries,” 1991.

RI 9451, “Effect of Pressure on Leakage of Automatic Sprinklers,” 1993.

RI 9538, “Performance of Automatic Sprinkler Systems for Extinguishing Incipient and Propagating Conveyor Belt Fires Under Ventilated Conditions,” 1995.

RI 9570, “Hazards of Conveyor Belt Fires,” 1995.

N B.1.2.10 U.S. EIA Publications. U.S. Energy Information Administration, 1000 Independence Avenue, SW, Washington, DC 20585.

Annual Coal Report, 2017.

B.1.2.11 U.S. Government Publications. U.S. Government Publishing Office, 732 North Capitol Street, NW, Washington, DC 20401-0001.

Title 30, Code of Federal Regulations, Part 18, Chapter 1, “Mine Safety and Health Administration, Department of Labor.”

Title 30, Code of Federal Regulations, Part 18.65, “Flame Test of Hose.”

Title 30, Code of Federal Regulations, Part 75.1103-4, “Automatic Fire Sensor and Warning Device Systems; Installation; Minimum Requirements.”

Title 30, Code of Federal Regulations, Part 75.1107-13, “Approval of Other Fire Suppression Devices.”

B.2 Informational References. The following documents or portions thereof are listed here as informational resources only. They are not a part of the requirements of this document.

B.2.1 NFPA Publications. National Fire Protection Association, 1 Batterymarch Park, Quincy, MA 02169-7471.

Fire Protection Guide to Hazardous Materials, 2010.

NFPA 12, *Standard on Carbon Dioxide Extinguishing Systems*, 2018 edition.

NFPA 12A, *Standard on Halon 1301 Fire Extinguishing Systems*, 2018 edition.

NFPA 15, *Standard for Water Spray Fixed Systems for Fire Protection*, 2017 edition.

NFPA 20, *Standard for the Installation of Stationary Pumps for Fire Protection*, 2019 edition.

NFPA 22, *Standard for Water Tanks for Private Fire Protection*, 2018 edition.

NFPA 69, *Standard on Explosion Prevention Systems*, 2019 edition.

NFPA 385, *Standard for Tank Vehicles for Flammable and Combustible Liquids*, 2017 edition.

NFPA 505, *Fire Safety Standard for Powered Industrial Trucks Including Type Designations, Areas of Use, Conversions, Maintenance, and Operations*, 2018 edition.

NFPA 1963, *Standard for Fire Hose Connections*, 2019 edition.

B.2.2 Other Publications.

B.2.2.1 ACGIH Publications. American Conference of Governmental Industrial Hygienists, 1330 Kemper Meadow Drive, #600, Cincinnati, OH 45240-1634.

Industrial Ventilation: A Manual of Recommended Practice for Design, 30th edition, 2019.

▲ **B.2.2.2 ANSI Publications.** American National Standards Institute, Inc., 25 West 43rd Street, 4th Floor, New York, NY 10036.

ANSI/SAIA A92.2, *Vehicle-Mounted Elevating and Rotating Aerial Devices*, 2015.

ANSI/SAIA A92.3, *Elevating Work Platforms, Manually Propelled*, 2006 (Reaffirmed 2014).

■ **B.2.2.3 ASME Publications.** American Society of Mechanical Engineers, Two Park Avenue, New York, NY 10016-5990.

ASME B30.5, *Mobile and Locomotive Cranes*, 2018.

▲ **B.2.2.4 ASTM Publications.** ASTM International, 100 Barr Harbor Drive, P.O. Box C700, West Conshohocken, PA 19428-2959.

ASTM D56, *Standard Test Method for Flash Point by Tag Closed Cup Tester*, 2016a.

ASTM D86, *Standard Test Method for Distillation of Petroleum Products and Liquid Fuels at Atmospheric Pressure*, 2018.

ASTM D93, *Standard Test Methods for Flash Point by Pensky-Martens Closed Cup Tester*, 2018.

ASTM D3278, *Standard Test Methods for Flash Point of Liquids by Small Scale Closed-Cup Apparatus*, 1996, reapproved 2011.

B.2.2.5 IEEE Publications. IEEE, 3 Park Avenue, 17th Floor, New York, NY 10016-5997.

IEEE Standard 446, *Recommended Practice for Emergency and Standby Power Systems for Industrial and Commercial Applications*, 1995.

▲ **B.2.2.6 SAE Publications.** SAE International, Society of Automotive Engineers, 400 Commonwealth Drive, Warrendale, PA 15096.

SAE Standard J53, *Minimum Performance Criteria for Emergency Steering of Wheeled Earthmoving Construction Machines*, 1993.

SAE Standard J185, *Access Systems for Off-Road Machines*, 2016.

SAE Standard J925, *Minimum Service Access Dimensions for Off-Road Machines*, 1993.

deLime, T. L., “Improved Fire Protection for Off-Highway Equipment,” Society of Automotive Engineers Off-Highway Vehicle Meeting, Milwaukee, Sept. 1979, SAE 790882.

Jewett, J., “Fire Suppression Systems,” Society of Automotive Engineers Off-Highway Vehicle Meeting, Milwaukee, Sept. 1979, SAE 790779.

Johnson, G. A., “Improved Fire Protection Systems for Surface Coal Equipment,” Society of Automotive Engineers Off-Highway Vehicle Meeting, Sept. 1977, SAE 770744.

Pomroy, W. H., “Improved Automatic Fire Protection Systems for Off-Highway Mine Vehicles,” Society of Automotive Engineers Off-Highway Vehicle Meeting, Milwaukee, Sept. 1979, SAE 790880.

▲ **B.2.2.7 U.S. Bureau of Mines Publications.** The following former Bureau of Mines reports and articles are available for Open File (OFR) inspection at the following locations: National Institute for Occupational Safety & Health (NIOSH), 1600 Clifton Road Atlanta, GA 30329-4027; U.S. Geological Survey, 12201 Sunrise Valley Drive, Reston, VA 20192; and the National Mine Health and Safety Academy, 1301 Airport Road, Beaver, WV 25813-9426. They also may be obtained directly from the National Technical Information Service (NTIS), 5301 Shawnee Road, Alexandria, VA 22312.

Note: Publications marked with an asterisk provide information on fire risk assessment.

Report No. H0122086, “Suppression of Fires on Underground Coal Mine Conveyor Belts.”

Report No. J0275008, “Annotated Bibliography of Coal Mine Fire Reports.”

Baker, R. M., “An Annotated Bibliography of Metal and Nonmetal Mine Fire Reports,” 1980. U.S. BuMines OFR 68 (1)-(3)-81. NTIS PB 81-223711.

Johnson, G. A., “Automatic Fire Protection Systems for Large Haulage Vehicles; Prototype Development and In-Mine Testing,” 1978. U.S. BuMines IC 8683.

*Kasten, A. E., “Develop and Test an Automatic Fire Control System for Surface Mining Machinery, Volume I, Systems Development,” 1977. U.S. BuMines OFR 119-78. NTIS PB 293 983.

Lease, W., “Development and Testing of a Fire Protection System for Coal Augers,” 1975. U.S. BuMines OFR 25-76. NTIS PB 249-865.

Lease, W., “Development, Installation, and Testing Services for an Automatic, Point-Type Thermal Sensor Fire Protection System on a Mining Dozer,” 1976. U.S. BuMines OFR 71-77. NTIS PB 266075/AS.

*Lease, W. D., “Development of an Automatic Fire Protection System for Surface Vehicles,” 1981. U.S. BuMines OFR 73-82. NTIS PB 82-215765.

*McDonald, L. A., “Development and Test of an Automatic Fire Control System for Surface Mining Machinery, Volume II, Reliability Testing,” 1981.

*McDonald, L. A., “Improved Fire Protection System for AN-FO Haulers and Loaders,” 1982. U.S. BuMines OFR 46-83.

*Pomroy, W. H., “Automatic Fire Protection Systems for Surface Mining Equipment,” 1980. U.S. BuMines IC 8832.

Pomroy, W. H., “A Statistical Analysis of Coal Mine Fire Incidents in the United States from 1950 to 1977,” 1980. U.S. BuMines IC 8830.

*Pomroy, W. H., “Economic Analysis of Surface Mining Mobile Equipment Fire Protection Systems,” 1982. U.S. BuMines RI 8698.

*Stevens, R. B., "Improved Sensors and Fire Control System for Mining Equipment," 1972. U.S. BuMines OFR 25 (1)-(2)-74. NTIS PB 232405 and NTIS PB 232406.

Stevens, R. B., "Automatic Fire Sensing and Suppression System for Mobile Mining Equipment," 1978. U.S. BuMines OFR 34-79. NTIS PB 294 731.

U.S. BuMines Mining Research Staff, "Metal Mine Fire Protection Research," 1977. BuMines IC 8752.

U.S. BuMines Technology News, No. 27, "Automatic Fire Protection for Surface Coal Augers," 1976.

U.S. BuMines Technology News, No. 50, "Bulldozer Fire Protection," 1978.

U.S. BuMines Technology News, No. 70, "Fire Protection for Blasthole Drill," 1979.

U.S. BuMines Technology News, No. 74, "Fire Protection for Front-End Loaders," 1979.

U.S. BuMines Technology News, No. 77, "Loading Shovel Fire Protection," 1980.

U.S. BuMines Technology News, No. 78, "Fire Protection for Hydraulic Excavators," 1980.

U.S. BuMines Technology News, No. 79, "Automatic Fire Protection for Mining Trucks," 1980.

U.S. BuMines Technology News, No. 106, "Dragline Fire Protection," 1981.

U.S. BuMines Technology News, No. 107, "An-Fo Hauler Fire Protection," 1981.

B.2.2.8 U.S. Government Publications. U.S. Government Publishing Office, 732 North Capitol Street, NW, Washington, DC 20401-0001.

Title 30, Code of Federal Regulations, Part 75.1101-14, "Installation of Dry Powder Chemical Systems."

Δ B.2.2.9 Other Publications.

Accident Prevention Manual for Industrial Operations, National Safety Council, 425 North Michigan Avenue, Chicago, IL 60611.

Jenson, R., ed., *Fire Protection for the Design Professional*, 1975. Cahners Books, Boston, MA.

B.3 References for Extracts in Informational Sections. (Reserved)

Index

Copyright © 2019 National Fire Protection Association. All Rights Reserved.

The copyright in this index is separate and distinct from the copyright in the document that it indexes. The licensing provisions set forth for the document are not applicable to this index. This index may not be reproduced in whole or in part by any means without the express written permission of NFPA.

- A-
- Adequate Ventilation**
 - Definition, 3.3.1
- Administration**, Chap. 1
 - Application, 1.3, A.1.3
 - Equivalency, 1.5
 - Purpose, 1.2
 - Retroactivity, 1.4
 - Scope, 1.1
- Approved**
 - Definition, 3.2.1, A.3.2.1
- Atmospheric Tank**
 - Definition, 3.3.2
- Authority Having Jurisdiction (AHJ)**
 - Definition, 3.2.2, A.3.2.2
- B-
- Boiling Point**
 - Definition, 3.3.3
- C-
- Closed Container**
 - Definition, 3.3.4
- Coal Conveyance and Storage**, Chap. 9
 - Below-Grade Reclaim Conveyors, 9.3
 - Coal Storage — General, 9.5, A.9.5
 - Coal Silos, 9.5.2
 - Stacker Tubes and Coal Storage Piles, 9.5.3
 - Storage Bins, 9.5.1
 - Conveyors — General, 9.1, A.9.1
 - Overland Conveyors, 9.2
 - Underground Conveyors, 9.4
 - Automatic Fire Suppression Systems at the Belt Drive, 9.4.6
 - Water-Based Fire Suppression Systems, 9.4.6.3
 - Deluge Water Systems, 9.4.6.3.3
 - Foam Systems, 9.4.6.3.4
 - General Sprinkler Requirements, 9.4.6.3.2
 - Maintenance and Testing, 9.4.6.3.5
 - Water Supply, 9.4.6.3.1
 - Manual Extinguishing, 9.4.7
 - Foam, 9.4.7.8
- Coal Preparation**
 - Definition, 3.3.5
- Coal Processing**, Chap. 6
 - Conveyors, 6.5
 - Dryers, 6.4
 - Explosion Venting, 6.4.5, A.6.4.5
 - Fire Protection for Drying Chambers, 6.4.4
 - General, 6.4.1, A.6.4.1
 - Instrumentation and Control, 6.4.3
 - Loss Prevention Design Features, 6.4.2
- Fire and Explosion Prevention, 6.2
 - Dust Collectors and Dust Removal Equipment, 6.2.2
 - Electrical Classification of Hazard, 6.2.1
 - Electrical Equipment Rooms, 6.2.1.9
 - Transformers, 6.2.1.11
 - Explosion Venting, 6.2.3
 - Flammable and Combustible Liquids and Liquefied Petroleum Gas, 6.2.4, A.6.2.4
 - Housekeeping, 6.2.6
 - Maintenance, 6.2.5
- General, 6.1
 - Coal Dust Control, 6.1.2
 - DeDusters, 6.1.2.1
 - Pneumatic Cleaners, 6.1.2.2, A.6.1.2.2
 - Coal Storage, 6.1.3
 - Materials and Construction, 6.1.1
- Mobile Equipment, 6.6
- Preparation Plants and Crusher Buildings, 6.3, A.6.3
 - Building Construction, 6.3.1
 - Electrical Equipment, 6.3.1.12
 - Fire Protection, 6.3.2
 - Fixed Fire Protection Systems, 6.3.2.2
 - Inspection and Maintenance of Fire Protection Equipment, 6.3.2.5
 - Portable Extinguishers, 6.3.2.1
 - Standpipe and Hose Systems, 6.3.2.3
 - Surveillance, 6.3.2.6
 - Water Supply, 6.3.2.4
 - Availability, 6.3.2.4.1, A.6.3.2.4.1
 - Capacity, 6.3.2.4.4, A.6.3.2.4.4
 - Fire Mains, 6.3.2.4.2
 - Other Water Supplies, 6.3.2.4.3
 - Spiral Concentrators, 6.7
- Combustible**
 - Definition, 3.3.6
- Combustible Liquid**
 - Definition, 3.3.7
- Combustible Liquid Storage Area — Fixed**
 - Definition, 3.3.8
- Combustible Liquid Storage Area — Mobile**
 - Definition, 3.3.9
- Combustible Liquid Storage Area — Portable**
 - Definition, 3.3.10
- Combustion**
 - Definition, 3.3.11
- Container**
 - Definition, 3.3.12

| | | | |
|--------------------------------------------------------------------------|------------|----------------------------------------------|------------|
| | -D- | | |
| Definitions , Chap. 3 | | Informational References , Annex B | |
| Diesel-Powered Equipment | | Intrinsically Safe | |
| Definition, 3.3.13 | | Definition, 3.3.29 | |
| Dry Pipe Sprinkler System | | | -L- |
| Definition, 3.3.14 | | Labeled | |
| | -E- | Definition, 3.2.3 | |
| Emergency Egress | | Liquid | |
| Definition, 3.3.15 | | Definition, 3.3.30 | |
| Emergency Response, Manual Fire Fighting, and Training , Chap. 11 | | Listed | |
| Emergency Procedures, 11.1, A.11.1 | | Definition, 3.2.4, A.3.2.4 | |
| Surface Operations, 11.3 | | Low Pressure Tank | |
| Underground Operations, 11.2 | | Definition, 3.3.31 | |
| Emergency Materials, 11.2.6 | | | -M- |
| Emergency Vehicle, 11.2.3 | | Mine Operator | |
| Fire Hose and Hydrants, 11.2.5 | | Definition, 3.3.32 | |
| Fire-Fighting Team, 11.2.2 | | Mine Surface Buildings , Chap. 8 | |
| Foam Generator, 11.2.4 | | Compressed Gas Storage and Usage, 8.5, A.8.5 | |
| General, 11.2.1 | | Construction, 8.1 | |
| Equipment Operator | | Fire Detection and Protection, 8.6 | |
| Definition, 3.3.16 | | Fire Prevention, 8.2 | |
| Explanatory Material , Annex A | | Flammable and Combustible Liquids, 8.4 | |
| | -F- | Life Safety, 8.3 | |
| Fire Detector | | Water Supplies, 8.7 | |
| Definition, 3.3.17 | | Mobile Equipment | |
| Fire Risk Assessment | | Definition, 3.3.33, A.3.3.33 | |
| Definition, 3.3.20 | | | -N- |
| Fire-Resistant Construction | | Noncombustible Material | |
| Definition, 3.3.18 | | Definition, 3.3.34, A.3.3.34 | |
| Fire-Resistant Enclosure | | Normal Operation | |
| Definition, 3.3.19 | | Definition, 3.3.35 | |
| Fixed Fire-Suppression System | | | -O- |
| Definition, 3.3.21 | | Operating Area | |
| Engineered Systems | | Definition, 3.3.36 | |
| Definition, 3.3.21.1 | | Outby | |
| Pre-Engineered Systems | | Definition, 3.3.37 | |
| Definition, 3.3.21.2 | | | -P- |
| Flammable Liquid | | Permissible Equipment | |
| Definition, 3.3.22 | | Definition, 3.3.38 | |
| Flammable Liquid Storage Area | | Pipeline System | |
| Definition, 3.3.23 | | Definition, 3.3.39 | |
| Flash Point | | Portable Extinguisher | |
| Definition, 3.3.24 | | Definition, 3.3.40 | |
| | -H- | Portable Tank | |
| Hand Hose Line System | | Definition, 3.3.41 | |
| Definition, 3.3.25 | | Pressure Vessel | |
| Hydrant | | Definition, 3.3.42 | |
| Definition, 3.3.26 | | | -R- |
| | -I- | Referenced Publications , Chap. 2 | |
| Important Structures | | Rock Dust | |
| Definition, 3.3.27 | | Definition, 3.3.43 | |
| Inby | | | |
| Definition, 3.3.28 | | | |

-S-**Safety Can**

Definition, 3.3.44

Self-Closing Doors

Definition, 3.3.45

Self-Propelled Equipment

Definition, 3.3.46

Shall

Definition, 3.2.5

Should

Definition, 3.2.6

Standard

Definition, 3.2.7

Storage and Use of Compressed Gases and Flammable and Combustible Liquids, Chap. 7

Combustible Liquids Stored and Used Underground, 7.6

Combustible Liquid Containers and Tanks, 7.6.2

Dispensing Combustible Liquids, 7.6.8, A.7.6.8

Fixed Areas for Class II Liquid Storage, 7.6.5, A.7.6.5

Fixed Storage Areas for Class III Combustible Liquids, 7.6.6

General, 7.6.1

Storage, Transport, and Dispensing of Combustible Liquids Using Mobile Equipment, 7.6.7

Temporary Areas for the Storage of Combustible Liquids in Portable Containers, 7.6.4

Transfer and Transport of Combustible Liquids, 7.6.3, A.7.6.3

Compressed Gas Storage and Usage — Cutting and Welding, 7.1, A.7.1

Fire Prevention and Control, 7.1.2

Inspection, 7.1.2.12

Procedures and Maintenance of Equipment, 7.1.1

Surface Storage, 7.1.5

Underground Storage, 7.1.4

Underground Transport, 7.1.3

Flammable and Combustible Liquid Storage on Surface Equipment and in Buildings, 7.4

Smoking and Open Flames, 7.4.7

Vehicle Refueling, 7.4.8

Flammable and Combustible Liquid Storage Tanks on the Surface, 7.3

Control of Ignition Sources, 7.3.7

Control of Spillage from Aboveground Tanks, 7.3.2, A.7.3.2

Design and Location of Storage Tanks, 7.3.1, A.7.3.1

Fire Extinguishers, 7.3.8

Fuel Lines, 7.3.4

Leakage and Overfill of Buried Tanks, 7.3.5

Normal and Emergency Venting, 7.3.3

Emergency Relief, 7.3.3.4, A.7.3.3.4

Vehicle Barriers, 7.3.6

Flammable Liquids Stored and Used Underground, 7.5

Dispensing Flammable Liquids, 7.5.4

Flammable Liquid Containers, 7.5.2

Flammable Liquid Storage Areas, 7.5.3

General, 7.5.1

Liquid Propane Storage and Use, 7.2

Suitable

Definition, 3.3.47

Surface Mining Operations, Chap. 5

Fire Prevention, 5.2, A.5.2

Compressed Gas Storage and Usage, 5.2.4

Flammable and Combustible Liquid Storage on Equipment and in Buildings, 5.2.3

Housekeeping, 5.2.1

Inspection and Maintenance of Equipment, 5.2.2

Fire Protection, 5.3

Draglines, Electric Shovels, Highwall Miners, and Hydraulic/Electric Excavators, 5.3.5

Center Pin/Collector Ring Area, 5.3.5.1

Electrical Room or Cabinet, 5.3.5.5

Hydraulics, 5.3.5.2

Lube Oil Pumping and Storage, 5.3.5.3

Manual Extinguishing Equipment, 5.3.5.6

Transformers, 5.3.5.4

Fire Extinguishers for Equipment, 5.3.4

Hydraulic/Diesel Excavators, 5.3.6

Mobile Equipment, 5.3.7

Fire Protection, 5.3.7.1

Self-Propelled Equipment, 5.3.8

Fire Detection, 5.3.8.2

Fixed Suppression Systems, 5.3.8.3

Portable Fire Extinguishers, 5.3.8.1

General, 5.1

-T-**Tank**

Definition, 3.3.48

Task Trained

Definition, 3.3.49

Truck, Rail, and Barge Loadouts, Chap. 10

Construction, 10.1

Fire Detection and Protection, 10.4

Fire Prevention, 10.2

Life Safety, 10.3

Manual Fire Fighting, 10.5

-U-**Unattended**

Definition, 3.3.50

Underground Mining Operations, Chap. 4

Fire Prevention, 4.2, A.4.2

Belt Conveyors, 4.2.6, A.4.2.6

Combustible Liquids Storage and Use, 4.2.9

Cutting and Welding, 4.2.3

Flammable Liquids Storage and Use, 4.2.8

Housekeeping, 4.2.4

Hydraulic Fluids, 4.2.7

Liquid-Filled Transformers, 4.2.12

Methane Control, 4.2.10

Rock Dusting, 4.2.2

Spontaneous Combustion, 4.2.11, A.4.2.11

Thermographic Scanning, 4.2.13, A.4.2.13

Underground Maintenance Shops, 4.2.5

Fire Protection, 4.3, A.4.3

Fire Protection Systems, 4.3.3

- Applications, 4.3.3.2
 - Air Compressors, 4.3.3.2.2, A.4.3.3.2.2
 - Equipment and Facilities, 4.3.3.2.1, A.4.3.3.2.1
- Automatic Sprinkler System Acceptance Testing, 4.3.3.4
 - Flow Testing of Sprinkler Systems, 4.3.3.4.2
 - Flushing of Water-Line Connections, 4.3.3.4.1
 - Tests of Dry-Pipe Sprinkler Systems, 4.3.3.4.3
- Fire Suppression for Self-Propelled Equipment, 4.3.3.6
- General Requirements, 4.3.3.1
- Inspection, Maintenance, and Testing, 4.3.3.5
 - Antifreeze Systems, 4.3.3.5.6
 - Sprinkler System Maintenance, 4.3.3.5.5
- Sprinkler System Requirements, 4.3.3.3
 - Antifreeze System, 4.3.3.3.4
 - Dry-Pipe System, 4.3.3.3.5, A.4.3.3.3.5
 - General Alarm Requirements for Sprinkler Systems, 4.3.3.3.3
 - General Installation Requirements, 4.3.3.3.2
 - Protection of Specific Hazards, 4.3.3.3.6
 - Water Supply, 4.3.3.3.1, A.4.3.3.3.1
- Manual Fire Fighting, 4.3.4
 - Emergency Materials, 4.3.4.5
 - Hand Hose Line Systems, 4.3.4.2
 - Maintenance, 4.3.4.2.2, A.4.3.4.2.2
 - Selection and Application, 4.3.4.2.1
- Portable Fire Extinguishers, 4.3.4.1
 - General Requirements, 4.3.4.1.1
 - Inspection and Maintenance, 4.3.4.1.3
 - Visual Inspection, 4.3.4.1.3.2, A.4.3.4.1.3.2
 - Selection and Application, 4.3.4.1.2
- Portable Foam-Generating Devices, 4.3.4.3
 - General Requirements, 4.3.4.3.1
 - High-Expansion Foam, 4.3.4.3.2
 - Maintenance, 4.3.4.3.3
- Rock Dust, 4.3.4.4
- Training, 4.3.4.6, A.4.3.4.6
- Protective Signaling Fire Detection Systems, 4.3.2, A.4.3.2
 - General Requirements, 4.3.2.1
 - Inspection, Maintenance, and Testing, 4.3.2.3
 - Selection and Application, 4.3.2.2
- Water Supply for Mine Fire Protection, 4.3.1
 - General Requirements, 4.3.1.1
 - Hydrants, 4.3.1.3
 - Maintenance, 4.3.1.4
 - Water Demand, 4.3.1.2
- General, 4.1

Sequence of Events for the Standards Development Process

Once the current edition is published, a Standard is opened for Public Input.

Step 1 – Input Stage

- Input accepted from the public or other committees for consideration to develop the First Draft
- Technical Committee holds First Draft Meeting to revise Standard (23 weeks); Technical Committee(s) with Correlating Committee (10 weeks)
- Technical Committee ballots on First Draft (12 weeks); Technical Committee(s) with Correlating Committee (11 weeks)
- Correlating Committee First Draft Meeting (9 weeks)
- Correlating Committee ballots on First Draft (5 weeks)
- First Draft Report posted on the document information page

Step 2 – Comment Stage

- Public Comments accepted on First Draft (10 weeks) following posting of First Draft Report
- If Standard does not receive Public Comments and the Technical Committee chooses not to hold a Second Draft meeting, the Standard becomes a Consent Standard and is sent directly to the Standards Council for issuance (see Step 4) or
- Technical Committee holds Second Draft Meeting (21 weeks); Technical Committee(s) with Correlating Committee (7 weeks)
- Technical Committee ballots on Second Draft (11 weeks); Technical Committee(s) with Correlating Committee (10 weeks)
- Correlating Committee Second Draft Meeting (9 weeks)
- Correlating Committee ballots on Second Draft (8 weeks)
- Second Draft Report posted on the document information page

Step 3 – NFPA Technical Meeting

- Notice of Intent to Make a Motion (NITMAM) accepted (5 weeks) following the posting of Second Draft Report
- NITMAMs are reviewed and valid motions are certified by the Motions Committee for presentation at the NFPA Technical Meeting
- NFPA membership meets each June at the NFPA Technical Meeting to act on Standards with “Certified Amending Motions” (certified NITMAMs)
- Committee(s) vote on any successful amendments to the Technical Committee Reports made by the NFPA membership at the NFPA Technical Meeting

Step 4 – Council Appeals and Issuance of Standard

- Notification of intent to file an appeal to the Standards Council on Technical Meeting action must be filed within 20 days of the NFPA Technical Meeting
- Standards Council decides, based on all evidence, whether to issue the standard or to take other action

Notes:

1. Time periods are approximate; refer to published schedules for actual dates.
2. Annual revision cycle documents with certified amending motions take approximately 101 weeks to complete.
3. Fall revision cycle documents receiving certified amending motions take approximately 141 weeks to complete.

Committee Membership Classifications^{1,2,3,4}

The following classifications apply to Committee members and represent their principal interest in the activity of the Committee.

1. M *Manufacturer*: A representative of a maker or marketer of a product, assembly, or system, or portion thereof, that is affected by the standard.
2. U *User*: A representative of an entity that is subject to the provisions of the standard or that voluntarily uses the standard.
3. IM *Installer/Maintainer*: A representative of an entity that is in the business of installing or maintaining a product, assembly, or system affected by the standard.
4. L *Labor*: A labor representative or employee concerned with safety in the workplace.
5. RT *Applied Research/Testing Laboratory*: A representative of an independent testing laboratory or independent applied research organization that promulgates and/or enforces standards.
6. E *Enforcing Authority*: A representative of an agency or an organization that promulgates and/or enforces standards.
7. I *Insurance*: A representative of an insurance company, broker, agent, bureau, or inspection agency.
8. C *Consumer*: A person who is or represents the ultimate purchaser of a product, system, or service affected by the standard, but who is not included in (2).
9. SE *Special Expert*: A person not representing (1) through (8) and who has special expertise in the scope of the standard or portion thereof.

NOTE 1: “Standard” connotes code, standard, recommended practice, or guide.

NOTE 2: A representative includes an employee.

NOTE 3: While these classifications will be used by the Standards Council to achieve a balance for Technical Committees, the Standards Council may determine that new classifications of member or unique interests need representation in order to foster the best possible Committee deliberations on any project. In this connection, the Standards Council may make such appointments as it deems appropriate in the public interest, such as the classification of “Utilities” in the National Electrical Code Committee.

NOTE 4: Representatives of subsidiaries of any group are generally considered to have the same classification as the parent organization.

Submitting Public Input / Public Comment Through the Online Submission System

Following publication of the current edition of an NFPA standard, the development of the next edition begins and the standard is open for Public Input.

Submit a Public Input

NFPA accepts Public Input on documents through our online submission system at www.nfpa.org. To use the online submission system:

- Choose a document from the List of NFPA codes & standards or filter by Development Stage for “codes accepting public input.”
- Once you are on the document page, select the “Next Edition” tab.
- Choose the link “The next edition of this standard is now open for Public Input.” You will be asked to sign in or create a free online account with NFPA before using this system.
- Follow the online instructions to submit your Public Input (see www.nfpa.org/publicinput for detailed instructions).
- Once a Public Input is saved or submitted in the system, it can be located on the “My Profile” page by selecting the “My Public Inputs/Comments/NITMAMs” section.

Submit a Public Comment

Once the First Draft Report becomes available there is a Public Comment period. Any objections or further related changes to the content of the First Draft must be submitted at the Comment Stage. To submit a Public Comment follow the same steps as previously explained for the submission of Public Input.


Other Resources Available on the Document Information Pages

Header: View document title and scope, access to our codes and standards or NFCSS subscription, and sign up to receive email alerts.



Current & Prior Editions

Research current and previous edition information.



Next Edition

Follow the committee’s progress in the processing of a standard in its next revision cycle.



Technical Committee

View current committee rosters or apply to a committee.



Ask a Technical Question

For members, officials, and AHJs to submit standards questions to NFPA staff. Our Technical Questions Service provides a convenient way to receive timely and consistent technical assistance when you need to know more about NFPA standards relevant to your work.



News

Provides links to available articles and research and statistical reports related to our standards.



Purchase Products & Training

Discover and purchase the latest products and training.



Related Products

View related publications, training, and other resources available for purchase.

Information on the NFPA Standards Development Process

I. Applicable Regulations. The primary rules governing the processing of NFPA standards (codes, standards, recommended practices, and guides) are the NFPA *Regulations Governing the Development of NFPA Standards (Regs)*. Other applicable rules include NFPA *Bylaws*, NFPA *Technical Meeting Convention Rules*, NFPA *Guide for the Conduct of Participants in the NFPA Standards Development Process*, and the NFPA *Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council*. Most of these rules and regulations are contained in the *NFPA Standards Directory*. For copies of the *Directory*, contact Codes and Standards Administration at NFPA headquarters; all these documents are also available on the NFPA website at “www.nfpa.org/regs.”

The following is general information on the NFPA process. All participants, however, should refer to the actual rules and regulations for a full understanding of this process and for the criteria that govern participation.

II. Technical Committee Report. The Technical Committee Report is defined as “the Report of the responsible Committee(s), in accordance with the Regulations, in preparation of a new or revised NFPA Standard.” The Technical Committee Report is in two parts and consists of the First Draft Report and the Second Draft Report. (See *Regs* at Section 1.4.)

III. Step 1: First Draft Report. The First Draft Report is defined as “Part one of the Technical Committee Report, which documents the Input Stage.” The First Draft Report consists of the First Draft, Public Input, Committee Input, Committee and Correlating Committee Statements, Correlating Notes, and Ballot Statements. (See *Regs* at 4.2.5.2 and Section 4.3.) Any objection to an action in the First Draft Report must be raised through the filing of an appropriate Comment for consideration in the Second Draft Report or the objection will be considered resolved. [See *Regs* at 4.3.1(b).]

IV. Step 2: Second Draft Report. The Second Draft Report is defined as “Part two of the Technical Committee Report, which documents the Comment Stage.” The Second Draft Report consists of the Second Draft, Public Comments with corresponding Committee Actions and Committee Statements, Correlating Notes and their respective Committee Statements, Committee Comments, Correlating Revisions, and Ballot Statements. (See *Regs* at 4.2.5.2 and Section 4.4.) The First Draft Report and the Second Draft Report together constitute the Technical Committee Report. Any outstanding objection following the Second Draft Report must be raised through an appropriate Amending Motion at the NFPA Technical Meeting or the objection will be considered resolved. [See *Regs* at 4.4.1(b).]

V. Step 3a: Action at NFPA Technical Meeting. Following the publication of the Second Draft Report, there is a period during which those wishing to make proper Amending Motions on the Technical Committee Reports must signal their intention by submitting a Notice of Intent to Make a Motion (NITMAM). (See *Regs* at 4.5.2.) Standards that receive notice of proper Amending Motions (Certified Amending Motions) will be presented for action at the annual June NFPA Technical Meeting. At the meeting, the NFPA membership can consider and act on these Certified Amending Motions as well as Follow-up Amending Motions, that is, motions that become necessary as a result of a previous successful Amending Motion. (See 4.5.3.2 through 4.5.3.6 and Table 1, Columns 1-3 of *Regs* for a summary of the available Amending Motions and who may make them.) Any outstanding objection following action at an NFPA Technical Meeting (and any further Technical Committee consideration following successful Amending Motions, see *Regs* at 4.5.3.7 through 4.6.5) must be raised through an appeal to the Standards Council or it will be considered to be resolved.

VI. Step 3b: Documents Forwarded Directly to the Council. Where no NITMAM is received and certified in accordance with the *Technical Meeting Convention Rules*, the standard is forwarded directly to the Standards Council for action on issuance. Objections are deemed to be resolved for these documents. (See *Regs* at 4.5.2.5.)

VII. Step 4a: Council Appeals. Anyone can appeal to the Standards Council concerning procedural or substantive matters related to the development, content, or issuance of any document of the NFPA or on matters within the purview of the authority of the Council, as established by the *Bylaws* and as determined by the Board of Directors. Such appeals must be in written form and filed with the Secretary of the Standards Council (see *Regs* at Section 1.6). Time constraints for filing an appeal must be in accordance with 1.6.2 of the *Regs*. Objections are deemed to be resolved if not pursued at this level.

VIII. Step 4b: Document Issuance. The Standards Council is the issuer of all documents (see Article 8 of *Bylaws*). The Council acts on the issuance of a document presented for action at an NFPA Technical Meeting within 75 days from the date of the recommendation from the NFPA Technical Meeting, unless this period is extended by the Council (see *Regs* at 4.7.2). For documents forwarded directly to the Standards Council, the Council acts on the issuance of the document at its next scheduled meeting, or at such other meeting as the Council may determine (see *Regs* at 4.5.2.5 and 4.7.4).

IX. Petitions to the Board of Directors. The Standards Council has been delegated the responsibility for the administration of the codes and standards development process and the issuance of documents. However, where extraordinary circumstances requiring the intervention of the Board of Directors exist, the Board of Directors may take any action necessary to fulfill its obligations to preserve the integrity of the codes and standards development process and to protect the interests of the NFPA. The rules for petitioning the Board of Directors can be found in the *Regulations Governing Petitions to the Board of Directors from Decisions of the Standards Council* and in Section 1.7 of the *Regs*.

X. For More Information. The program for the NFPA Technical Meeting (as well as the NFPA website as information becomes available) should be consulted for the date on which each report scheduled for consideration at the meeting will be presented. To view the First Draft Report and Second Draft Report as well as information on NFPA rules and for up-to-date information on schedules and deadlines for processing NFPA documents, check the NFPA website (www.nfpa.org/docinfo) or contact NFPA Codes & Standards Administration at (617) 984-7246.

Xchange

The Online Community of the
National Fire Protection Association®



CONNECT WITH YOUR PEERS FROM AROUND THE WORLD



NFPA® Xchange™ is an online forum for finding and sharing knowledge among an open community of professionals worldwide.

This educational tool and job aid allows you to explore content relevant to you, participate in discussions with peers and industry leaders, ask and answer questions, and receive expert advice.

Membership to NFPA Xchange is free and provides access to:

- An active community of more than **50,000 professionals collaborating** in a single place
- Insights and information on **trending topics, emerging issues, and new technologies**
- **Blogs and webinars for learning on-the-job skills, and forums** for submitting queries to be answered by peers and NFPA® technical staff
- **Job board for posting open positions and discovering employment opportunities** from NFPA and partner organizations
- **A robust collection of previously asked questions and subject matter** in a searchable database accessible anywhere, anytime, from any device

Have the resources you need by your side at all times. NFPA Xchange provides the knowledge and support to help you do your job better and help protect lives and property. **Join the conversation today!**

Join now for free at nfpa.org/xchange-community



IT'S A BIG WORLD.
LET'S PROTECT IT TOGETHER.®